

ADDENDUM NO. #1
September 24, 2025
FIRE STATION 15 AND FIRE STATION 16 RENOVATIONS
(25% MBE PARTICIPATION GOAL)

TO ALL BIDDERS:

This addendum, including all articles and corrections listed below, shall be taken into account in preparing the Bid.

ITEM NO. 1

The drawings for station 15 had the wrong HVAC and Electrical drawings in it. It had the HVAC and Electrical drawings for Station 16. The correct Station 15 drawings are attached.

CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, Ohio, 45420

ARCHITECT

App Architecture


615 Woodside Drive
Englewood, Ohio 45322
(937) 836-8898

MECHANICAL & ELECTRICAL ENGINEERS


Nauman & Zelinski, LLC

204 South Ludlow Street, Suite 400
Dayton, Ohio 45402
(937) 223-3821

USE GROUP PLAN

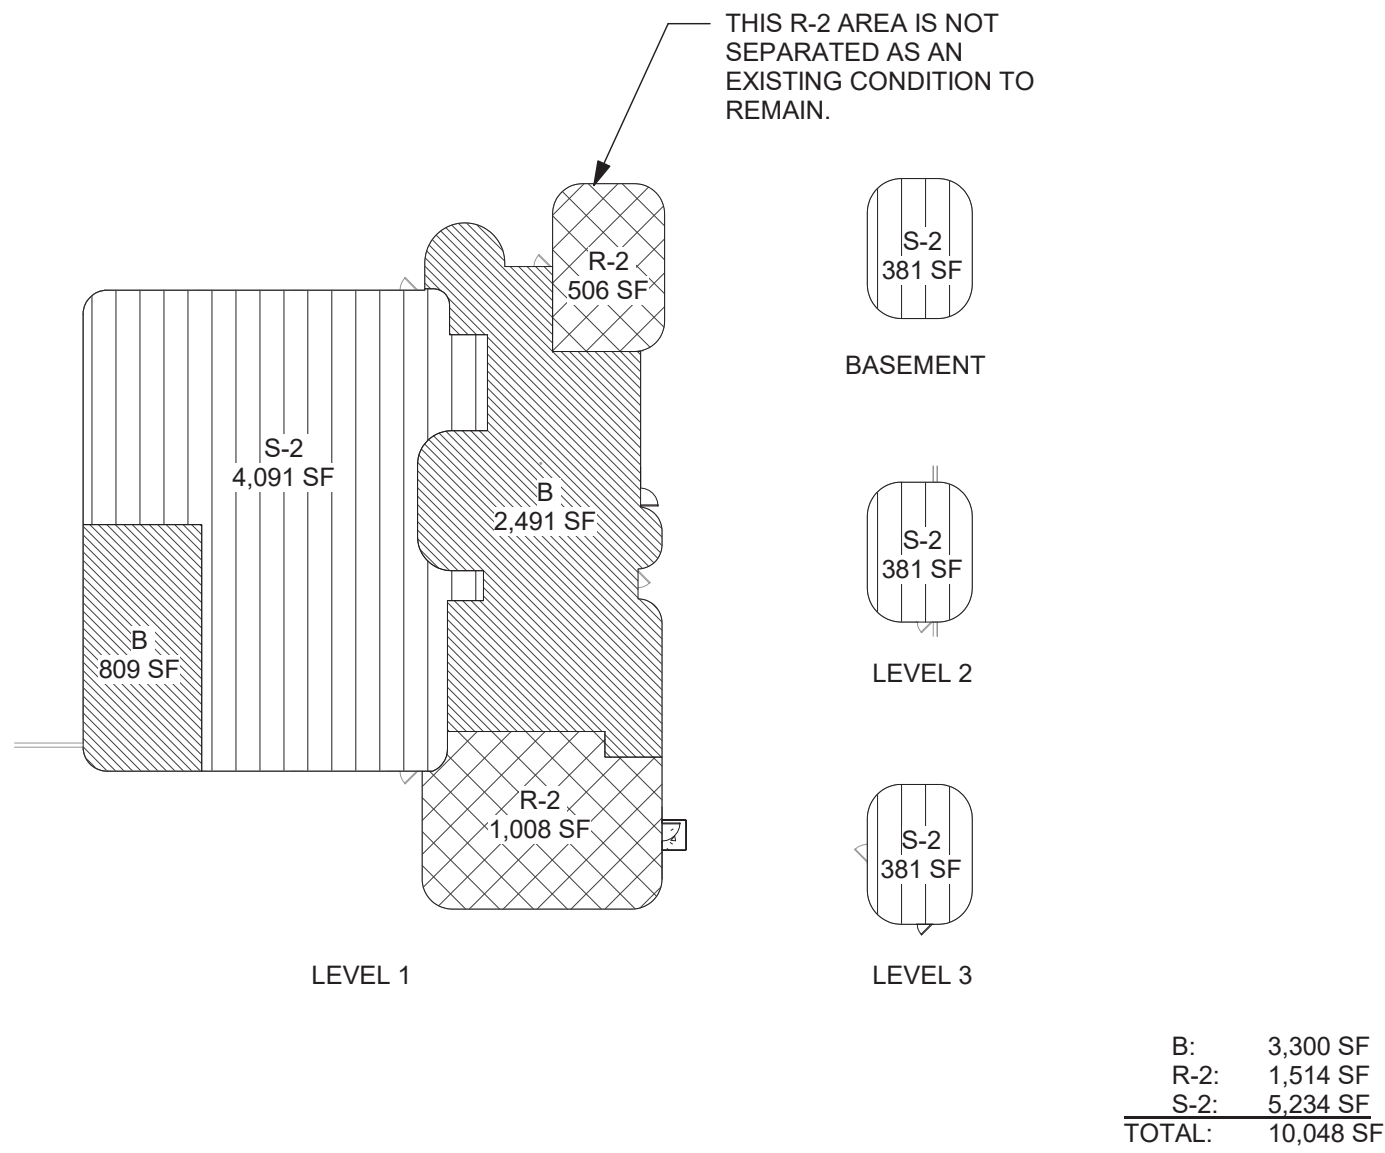

VICINITY MAP

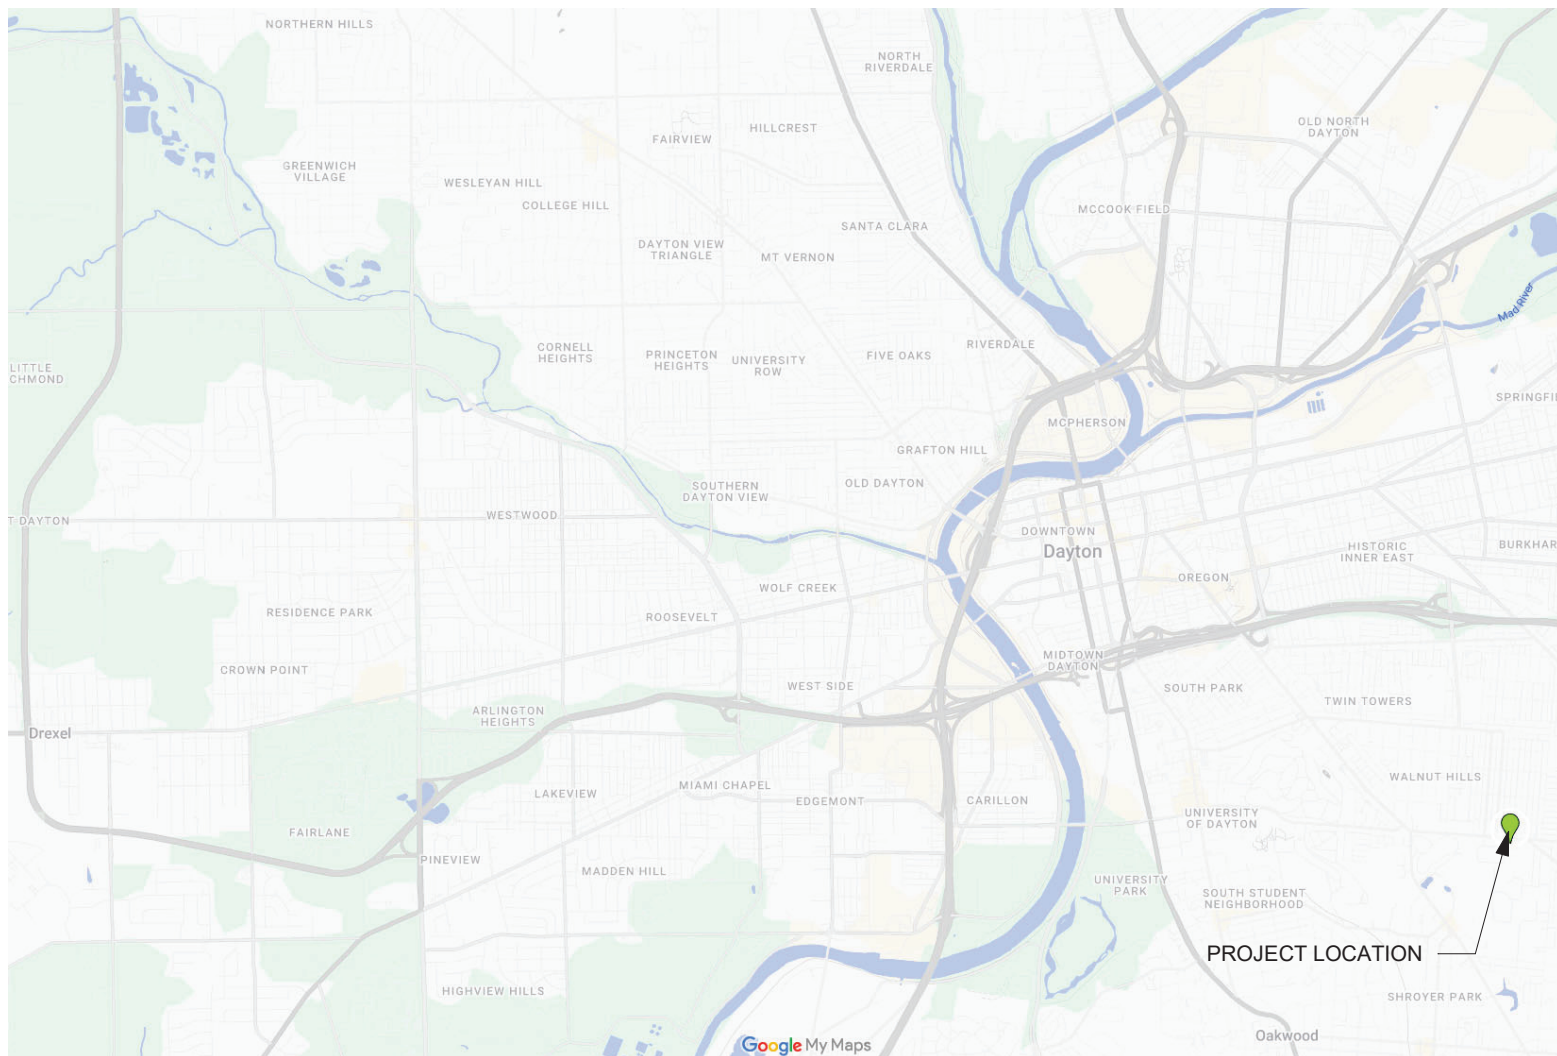

CODE INFORMATION

(OBC 2024, OEBC 2024)

PROJECT DESCRIPTION

PROJECT CONSISTS OF INTERIOR RENOVATION OF AN EXISTING FIRE STATION FOR THE CITY OF DAYTON.

USE GROUP CLASSIFICATION (REFER TO USE GROUP PLAN THIS SHEET)

OBC (302) USE GROUP: MIXED USE - UNSEPARATED
B: STATION OFFICES AND LIVING AREAS
R-2: CREW SLEEPING QUARTERS
S-2: APPARATUS BAYS AND STORAGE AREAS

OBC (508.3) MIXED OCCUPANCIES:
UNSEPARATED MIXED USE
EXCEPTION 2: R-2 DWELLING AND SLEEPING UNITS SHALL BE SEPARATED FROM OTHER OCCUPANCIES CONTIGUOUS TO THEM IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 420.

OBC (708.3) FIRE RESISTANCE RATING:
EXCEPTION 2: DWELLING UNIT AND SLEEPING UNIT SEPARATIONS IN BUILDINGS OF TYPE IIB, IIBB, AND VB CONSTRUCTION SHALL HAVE FIRE-RESISTANT RATINGS OF NOT LESS THAN 1/2-HOUR IN BUILDING EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM.

SLEEPING UNITS TO HAVE 20 MIN. RATED DOORS AND FRAMES IN ACCORDANCE WITH OBC TABLE 716.1.

CONSTRUCTION TYPE CLASSIFICATION

OBC (602) CONSTRUCTION TYPE = IIB

HEIGHT AND AREA LIMITATIONS

OBC (503) ALLOWABLE AREA = 16,000 SF (BASED ON R-2, MOST RESTRICTIVE)
ACTUAL AREA = 10,048 SF

OBC ALLOWABLE HEIGHT = 55' - 0" (3 STORIES)
ACTUAL HEIGHT = 32' - 8"

HEIGHT AND AREA REMAIN UNCHANGED.

OCCUPANT LOAD

OBC (1004) ALLOWABLE= SF / SF PER OCCUPANT

FIRE STATION:
B: 3,300 SF / 150 = 22
R-2: 1,514 SF / 200 = 7
S-2: 5,234 SF / 300 = 17
TOTAL = 46 OCCUPANTS

FIRE PROTECTION

BUILDING DESCRIPTION : LIMITED AREA FIRE SUPPRESSION FOR R-2 USES.

PLUMBING FIXTURES REQUIRED

USE GROUP	WC	LAVS	SHOWERS	D.F.	SERVICE SINK
B	1	1	0	1	1
R-2	1	1	1 (SHOWER/EYEWASH)	1	1
S-2	1	1	0	1	1
TOTAL	3	3	1	1	1

PLUMBING FIXTURES PROPOSED

USE GROUP	WC	LAVS	SHOWERS	D.F.	SERVICE SINK
TOTAL	5	8	4/1 (SHOWER/EYEWASH)	1	1

STORM SHELTER PROVISIONS

STORM SHELTER IS NOT REQUIRED FOR EXISTING EMERGENCY FACILITY PER OEBC 2024 SECTION 503.19.

DRAWING INDEX

GENERAL	
G0.1	COVER SHEET
ARCHITECTURAL	
A0.01	ABBREVIATIONS AND SYMBOLS
A0.02	FINISH SCHEDULES
A0.03	DOOR SCHEDULES
A0.04	WALL TYPES
A0.05	DOOR DETAILS
A0.06	INTERIOR DETAILS
A0.07	INTERIOR DETAILS- BAR GRATE INFILL
A1.11	DEMOLITION PLAN
A1.12	REFERENCE PLANS
A1.13	DIMENSION PLANS
A1.14	EQUIPMENT PLAN
A2.11	DEMOLITION REFLECTED CEILING PLAN
A2.12	REFLECTED CEILING PLAN
A5.01	EXTERIOR DETAILS
A7.11	INTERIOR ELEVATIONS
A7.12	INTERIOR ELEVATIONS
A7.13	INTERIOR ELEVATIONS
A8.01	CASEWORK DETAILS
A8.02	CASEWORK DETAILS
A8.03	CASEWORK DETAILS
A9.01	FINISHES FLOOR PLAN
FIRE PROTECTION	
F0.1	LEGENDS AND SCHEDULES
F2.1	FIRE SUPPRESSION PLANS
PLUMBING	
P0.1	LEGENDS AND SCHEDULES
P0.2	MATERIAL SCHEDULES
P1.1	BASEMENT AND FIRST FLOOR DEMOLITION PLANS
P1.2	SECOND AND THIRD FLOOR DEMOLITION PLANS
P2.1	BASEMENT AND UNDERFLOOR PLAN
P2.2	FIRST FLOOR PLAN
P2.3	SECOND FLOOR AND UPPER APPARATUS BAY PLAN
P3.1	DETAILS
P4.1	SOIL, WAST, AND VENT DIAGRAM
MECHANICAL	
H0.1	LEGENDS AND SCHEDULES
H0.2	MATERIAL SCHEDULES
H0.3	EQUIPMENT SCHEDULES
H1.1	DEMOLITION PLAN
H2.1	NEW WORK PLAN
H3.1	DETAILS
H3.2	DETAILS
H3.3	DETAILS
H3.4	DETAILS
H3.5	DETAILS
H4.1	CONTROLS
H4.2	CONTROLS
H5.1	VENTILATION
ELECTRICAL	
E0.1	LEGEND
E0.2	SCHEDULES
E0.3	PANEL SCHEDULES
E0.4	DETAILS
E1.1	DEMOLITION
E2.1	NEW LIGHTING PLAN
E3.1	NEW POWER AND SYSTEMS PLAN

App Architecture
creative focused design



CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION
08/01/25	FOR CONSTRUCTION	

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB
COPYRIGHT © 2025 - App Architecture, Inc.	
TITLE	COVER SHEET

SHEET NO.
G0.1

SYMBOL	
@	AT
&	ANGLE
Ø	DIAMETER
⊕	CENTER LINE
Ⓟ	PLATE
A	
ABV	ABOVE
A/C	AIR CONDITIONING
AFC	ABOVE FINISHED FLOOR
AHU	AIR HANDLER UNIT
AL	ALUMINUM
ALT	ALTERNATE
ANOD	ANODIZED
ANCH	ANCHOR
APPROX	APPROXIMATELY
ARCH	ARCHITECT OR ARCHITECTURAL
ATTEN	ATTENUATED
AUTO	AUTOMATIC
AVG	AVERAGE
B	
BLDG	BUILDING
BLK	BLOCK
BLKG	BLOCKING
BOT	BOTTOM
BRG	BEARING
BSMT	BASEMENT
C	
CAB	CABINET
CB	CATCH BASIN
C/C	CENTER TO CENTER
CF	CUBIC FOOT
CFCI	CONTRACTOR FURNISH, CONTRACTOR INSTALL
CFR	CONTRACTOR FURNISH, OWNER INSTALL
CJ	CORNER GUARD
CL	CONTROL JOINT
CLG	CEILING
CL	CLOSET
CLR	CLEAR
CM	CONCRETE MASONRY UNIT
CO	CLEAN OUT
COL	COLUMN
CONC	CONCRETE
CONST	CONSTRUCTION
CONT	CONTINUOUS OR CONTINUE
CP	CENTRAL PROCESSING UNIT (COMPUTER)
CY	CUBIC YARD
D	
DBL	DOUBLE
DEMO	DEMOLISH, DEMOLITION
DF	DRAINING FOUNTAIN
DIA	DIAMETER
DIM	DIMENSION
DSP	DISPENSER
DIV	DIVISION
DS	DOWNSPOUT
DWG	DRAWING
DTL	DETAIL
E	
EA	EACH
EC	ELECTRICAL CONTRACTOR
EI	EXTERIOR INSULATION AND FINISH SYSTEM
EJ	EXPANSION JOINT
ELEC	ELECTRIC OR ELECTRICAL
ELV	ELEVATION OR ELEVATOR
EMERG	EMERGENCY
EQ	EQUAL
EQUIP	EQUIPMENT
EW	ELECTRIC WATER COOLER
EXIST OR EX	EXISTING
EXP	EXPANSION
EXT	EXTERIOR
F	
FD	FLOOR DRAIN
FE	FIRE EXTINGUISHER
FEC	FIRE EXTINGUISHER CABINET
FF	FINISH FLOOR
FIN	FINISH OR FINISHED
FLR	FLOOR
FND	FOUNDATION
FT	FIRE RETARDANT TREATED WOOD
FTG	FOOT OR FEET OR FULLY TEMPERED
FTT	FOOTING
FRT	FIRE TREATING
FUR	FURRING
FLY	FIELD VERIFY
FW	FACE OF WALL

G	
GA	GAUGE
GALV	GALVANIZED
GC	GENERAL CONTRACTOR
GD	GRADE OR GRADING
GEN	GENERAL
GI	GLASS OR GLAZING
GND	GROUND
GYP	GYPSPUM
GWB	GYPSPUM BOARD
GWT	GLAZED WALL TILE
H	
HB	HOSE BIBB
HD	HARDWARE
HM	HOLLOW METAL
HORIZ	HORIZONTAL
HT	HEATING
HVAC	HEATING, VENTILATION & AIR CONDITIONING
HWD	HARDWARE
I	
ID	INSIDE DIAMETER
IN	INCH
INCL	INCLUDE (D) (ING)
INT	INTERIOR
INVT	INVERT
J	
JB	JUNCTION BOX
JC	JANITOR CLOSET
L	
L	LONG
LAV	LAVATORY
LBS	POUNDS
LH	LEFT HAND
LL	LIVE LOAD
LLH	LONG LEG HORIZONTAL
LLV	LONG LEG VERTICAL
LTL	UNTEL
LVR	LOUVER
M	
M	MEN OR METER
MAS	MASONRY
MAT	MATERIAL
MAX	MAXIMUM
MC	MECHANICAL CONTRACTOR
MECH	MECHANICAL
MFR	MANUFACTURER
MH	MOUNTING HEIGHT, MANHOLE
MIL	THOUSANDTHS OF AN INCH
MM	MILLIMETER
MN	MINIUM
MISC	MISCELLANEOUS
MO	MASONRY OPENING
MTO	MOUNTED
MTL	METAL
N	
N	NORTH OR NITROGEN
NC	NURSE CALL
NO	NOT IN CONTRACT
NO	NUMBER OR NITROUS OXIDE
NOM	NOMINAL
NRC	NOISE REDUCTION COEFFICIENT
NTS	NOT TO SCALE
O	
OD	OUTSIDE DIAMETER
OF	OWNER FURNISH, CONTRACTOR INSTALL
OFOI	OWNER FURNISH, OWNER INSTALL
OFVI	OWNER FURNISH, VENDOR INSTALL
OH	OVERHEAD
OP	OVERHEAD DOOR
OPNG	OPENING
OPP	OPPOSITE
O ₂	OXYGEN
P	
PAR	PARALLEL
PC	PLUMBING CONTRACTOR
PCF	POUNDS PER CUBIC FOOT
PL	PLATE OR PROPERTY LINE
PLUMB	PLUMBING
PLWD	PLYWOOD
PME	PLUMBING, MECHANICAL & ELECTRICAL
PHL	PHIL
PR	PAIR
PR	PAR
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PVC	POLYVINYL CHLORIDE

Q	
QTY	QUANTITY
R	
R	RADIUS
RA	RETURN AIR
RB	RUBBER BASE
RD	ROOF DRAIN
RECEPT	RECEPTACLE
REF	REFERENCE
REINF	REINFORCE
REQD	REQUIRED
RET	RETURN
REV	REVISION
RH	RIGHT HAND
RM	ROOM
ROUGH	ROUGH OPENING
ROW	RIGHT OF WAY
S	
S	SOUTH
SAN	SANITARY
SB	SINK BASE
SCHED	SCHEDULE
SEAL	SEALANT
SECT	SECTION
SF	SQUARE FEET
SG	SAFETY GLASS
SH	SPRINKLER HEAD OR SHOWER HEAD
SHT	SHEET
SHTG	SHEATHING
SIM	SIMILAR
SPEC	SPECIFICATION(S)
SPK	SPEAKER
SQ	SQUARE
ST	STREET
STC	SOUND TRANSMISSION CLASSIFICATION
STD	STANDARD
STL	STEEL
STR	STRUCTURAL
SUSP	SUSPENDED
SV	SHEET VINYL
SYS	SYSTEM
T	
T & G	TONGUE & GROOVE
TB	TOWEL BAR
T&B	TOP AND BOTTOM
TEL	TELEPHONE
TOC	TOP OF CONCRETE
TOS	TOP OF STEEL
TCM	TOP OF MASONRY
TOW	TOP OF WALL
TRANS	TRANSFORMER
TV	TELEVISION
TYP	TYPICAL
U	
UC	UNDER CABINET OR COUNTER
UH	UNIT HEATER
UL	UNDERWRITERS LABORATORY
UNO	UNLESS NOTED OTHERWISE
V	
V	VACUUM
VB	VAPOR BARRIER
VCT	VITRO COMPOSITION TILE
VERT	VERTICAL
VS	VACUUM SLIDE
W	
W	WIDE OR WEST OR WOMEN
WI	WITH
W/O	WITHOUT
WC	WATER CLOSET OR WALL CABINET
WD	WOOD
WIN	WINDOW
WP	WORK POINT
WPT	WELD PRESERVATIVE TREATMENT
WT	WEIGHT
WWF	WELDED WIRE FABRIC

DRAWING TITLE

A1 **FIRST FLOOR PLAN**

$1/4" = 1' - 0"$

DRAWING TITLE

SCALE OF DRAWING

DRAWING REFERENCE NUMBER

 DRAWING REFERENCE NUMBER
 DRAWING SHEET NUMBER

 DRAWING REFERENCE NUMBER
 DRAWING SHEET NUMBER

Diagram illustrating the components of a drawing reference number and sheet number:

- B1**: DRAWING REFERENCE NUMBER
- A1.1**: DRAWING SHEET NUMBER

 DRAWING REFERENCE NUMBER
 DRAWING SHEET NUMBER

	EARTH		LOOSE OR BATT INSULATION		BRICK
	GRANULAR FILL		RIGID INSULATION		SOLID SURFACE
	CONCRETE		STEEL		GYPSUM / PLASTER
	CMU BLOCK		PLYWOOD		WOOD, FINISHED
	BLOCKING / SHIM				WOOD, DIMENSIONAL

COLUMN CENTER LINES **REFLECTED CEILING SYMBOLS**

ROOM NAME ROOM NAME
 101 ROOM NUMBER

	CONSTRUCTION NOTES
	DEMOLITION NOTES
	ACCESSORIES (LETTERS)
	DOOR NUMBER SYMBOL
	WINDOW SYMBOL
	WALL TYPE
	REVISION / CHANGE
	CORNER GUARD
	END WALL PROTECTOR

	}	SURFACE MOUNTED LIGHT FIXTURES
	}	RECESSED LIGHT FIXTURES
		CALL LIGHT
		EXIT LIGHT
	}	SUPPLY DIFFUSER
		RETURN
		SMOKE DETECTOR
		SPEAKER
		SPRINKLER HEAD
		CURTAIN OR IV TRACK
		CEILING HEIGHT

	DUPLEX RECEPTACLE
	TELE/DATA OUTLET
	LIGHT SWITCH
	DUPLEX RECEPTACLE (EMERGENCY POWER)
	NURSE CALL BUTTON
	CODE BLUE BUTTON
	MEDICAL GAS OUTLET
	TEMPERED GLASS
	SPANDREL GLASS

 CHANGE IN ELEVATION
 ELEVATION

EXISTING CONSTRUCTION TO BE REMOVED

EXISTING CONSTRUCTION TO REMAIN

NEW CONSTRUCTION (NEW BUILDING OR ADDITION)

Legend for fire barrier and smoke resistant ratings:

- SMOKE RESISTIVE (Pink dashed line)
- 1 (Blue dashed line)
- 1S (Purple dashed line)
- 2 (Green dashed line)
- 2S (Red dashed line)
- 3 (Dark blue dashed line)

1 HR. FIRE BARRIER
1 HR. FIRE/SMOKE BARRIER
2 HR. FIRE BARRIER
2 HR. FIRE/SMOKE BARRIER
3 HR. FIRE BARRIER

(FOLLOW THESE UNLESS NOTED OTHERWISE)


SIGNAGE LEGEND

SIGN NOTES

- A. ALL SIGNS SHALL HAVE BRAILLE LETTERING BENEATH TEXT, TYPICAL.
- B. SIGNS MOUNTED ON GLASS AT DOOR NEED TO BE MOUNTED WITH ADHESIVE AND MATCHING BACKER PLATE FOR OTHER SIDE OF GLASS.
- C. TEXT AND GRAPHICS TO BE NON-GLARE COLOR IN HIGH CONTRAST WITH BACKGROUND. SELECTED BY ARCHITECT FROM MANUFACTURER'S STANDARD COLORS.
- D. BACKGROUND TO BE NON-GLARE COLOR IN HIGH CONTRAST WITH TEXT AND GRAPHICS. SELECTED BY ARCHITECT FROM MANUFACTURER'S STANDARD COLORS.
- E. 1/2" RADIUS CORNERS.
- F. ALL TEXT ON SIGNS LOCATED NEXT TO INTERIOR DOORS WILL BE 1/32" RAISED CHARACTERS, UPPERCASE, AND VIEWABLE AT LESS THAN 6 FEET.


UNISEX RESTROOM - TYPE 1

3" = 1'-0"

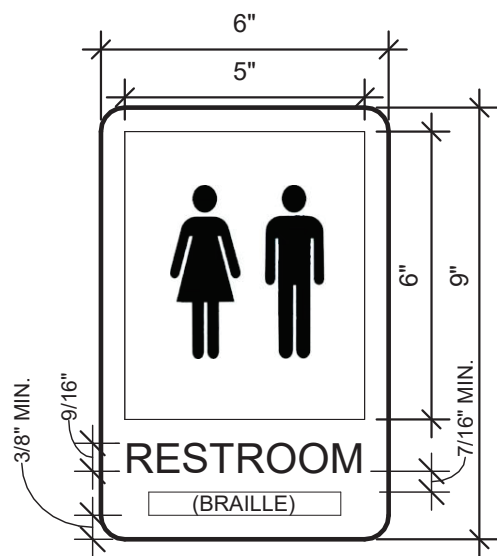


UNISEX RESTROOM - TYPE 2

3" = 1'-0"

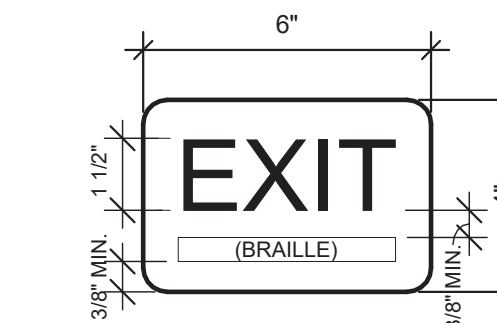

EXIT SIGN - TYPE 3

3" = 1'-0"

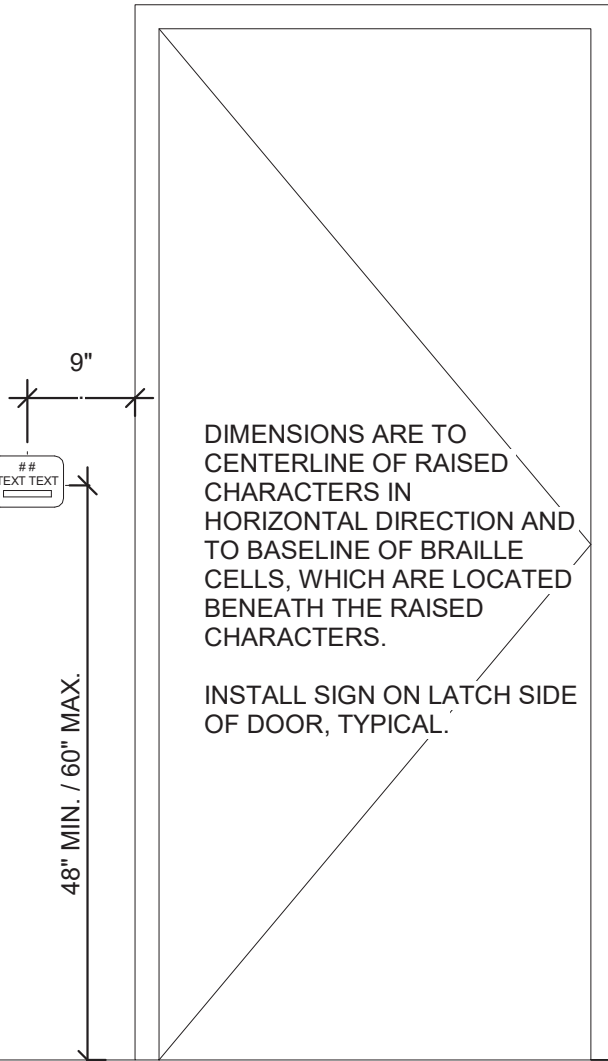

SIGNAGE LOCATION

3/4" = 1'-0"

DOOR AND FRAME SCHEDULE


DOOR No.	ROOM NAME	HDW. SET	DOOR							FRAME							FIRE RTG.	REMARKS
			SIZE			MAT.	TYPE	FIN.	U/C	MAT.	TYPE	FIN.	DETAILS					
			W	H	T								HEAD	JAMB	SILL			
101A	REPORT	1	3'-0"	7'-0"	2"	WD	EXIST	STAIN		HM	EXIST	EP-4	-	-	-	-	1	
101B	REPORT	2	2'-8"	7'-0"	1 3/4"	HM	EXIST	EP-4		HM	EXIST	EP-4	-	-	-	-	2	
102A	LOBBY	-	3'-0"	7'-10"	1 3/4"	ALUM	EXIST	-		ALUM	EXIST	-	-	-	-	-	3, 7	
102B	LOBBY	1	3'-0"	7'-0"	1 3/4"	HM	EXIST	EP-4		HM	EXIST	EP-4	-	-	-	-	2	
103	LT. DORM	4	3'-0"	7'-0"	1 3/4"	WD	EXIST	STAIN		HM	EXIST	EP-4	-	-	-	-	1	
104A	TLT/ SHR	3	2'-8"	7'-0"	1 3/4"	WD	EXIST	STAIN		HM	EXIST	EP-4	-	-	-	-	1, 6	
104B	TLT/ SHR	3	2'-8"	7'-0"	1 3/4"	WD	EXIST	STAIN		HM	EXIST	EP-4	-	-	-	-	1, 6	
105	LT OFFICE	3	3'-0"	7'-0"	1 3/4"	WD	EXIST	STAIN		HM	EXIST	EP-4	-	-	-	-	1	
106	SUPPLY	-	2'-8"	7'-0"	1 3/4"	HM	EXIST	-		HM	EXIST	-	-	-	-	-	3	
107	SUPPLY	-	3'-0"	7'-0"	1 3/4"	HM	EXIST	-		HM	EXIST	-	-	-	-	-	3	
108	TLT	3	3'-0"	7'-0"	1 3/4"	WD	EXIST	STAIN		HM	EXIST	EP-4	-	-	-	-	3	
109A	APPARATUS BAY 1	6	3'-0"	7'-0"	1 3/4"	HM	EXIST	EP-4		HM	EXIST	EP-4	-	-	-	-	1, 6	
109B	DAYROOM	11	3'-0"	7'-0"	1 3/4"	ALUM	AL1	BRONZE		ALUM	-	BRONZE	F1/A0.05	F8/A0.05	F3/A0.05	-	2	
110.1C	APPARATUS BAY 1	-	3'-0"	7'-0"	1 3/4"	HM	EXIST	-		HM	EXIST	-	-	-	-	-	3	
110.1D	APPARATUS BAY 1	-	3'-0"	7'-0"	1 3/4"	WD	EXIST	-		HM	EXIST	-	-	-	-	-	3	
111	MECH.	-	3'-0"	7'-0"	1 3/4"	HM	EXIST	-		HM	EXIST	-	-	-	-	-	3	
112	HOSE DRYING TOWER	-	3'-0"	7'-0"	1 3/4"	HM	EXIST	-		HM	EXIST	-	-	-	-	-	3	
113A	HALL	6A	3'-0"	7'-0"	1 3/4"	WD	NL1	STAIN		HM	2	EP-4	E1/A0.05	E3/A0.05	-	20 MIN.		
113B	HALL	6B	3'-0"	7'-0"	1 3/4"	HM	NL1	EP-4		HM	2	EP-4	C1/A0.05	C3/A0.05	-	20 MIN.		
113C	HALL	10	3'-0"	7'-0"	1 3/4"	HM	F1	EP-4		HM	2	EP-4	B6/A5.01	D5/A5.01	-		7	
114	KITCHEN	6	3'-0"	7'-0"	1 3/4"	HM	EXIST	EP-4		HM	EXIST	EP-4	-	-	-	-	2	
115	LKR ROOM	7	3'-0"	7'-0"	1 3/4"	WD	F1	EP-4		HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	20 MIN.		
116	LAUNDRY	5	3'-0"	6'-8"	1 3/4"	WD	F1	STAIN		-	-	EP-4	B1/A0.06	B3/A0.06	-	20 MIN.	8	
117	TLT/ SHR	3	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN	3/4"	HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	-	6	
118	TLT/ SHR	3	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN	3/4"	HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	-	5	
119	TLT/ SHR	3	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN	3/4"	HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	-	5	
120	ADA DORM	9	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN		HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	20 MIN.		
120A	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
120B	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
120C	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
121	ADA DORM	9	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN		HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	20 MIN.		
121A	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
121B	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
121C	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
122	ADA DORM	9	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN		HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	20 MIN.		
122A	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
122B	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
122C	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
123	DORM	9	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN		HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	20 MIN.		
123A	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
123B	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
123C	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
124	DORM	9	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN		HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	20 MIN.		
124A	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
124B	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
124C	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
125	DORM	9	3'-0"	7'-0"	1 3/4"	WD	F1	STAIN		HM	1	EP-4	B1/A0.05	B3/A0.05	B4/A0.05	20 MIN.		
125A	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
125B	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
125C	HALL	12	1'-8"	6'-0"	1 3/4"	WD	F1	STAIN		HM	3	EP-4	D4 / D6/A8.02	B3/A0.05 SIM	D4 / D6/A8.02	20 MIN.		
126	DECON	8	3'-6"	7'-0"	1 3/4"	HM	NL1	EP-4		HM	2	EP-4	B6/A0.05	D6/A0.05	-			
127	FITNESS	8	3'-0"	7'-0"	1 3/4"	HM	HG1	EP-4		HM	2	EP-4	B6/A0.05	D6/A0.05	-			
128A	VEST.	-	3'-0"	7'-10"	1 3/4"	ALUM	EXIST	-		ALUM	-	-	-	-	-	-	3, 6	
128B	VEST.	-	3'-0"	7'-10"	1 3/4"	ALUM	EXIST	-		ALUM	-	-	-	-	-	-	3	
201	TOG/STORAGE	-	2'-6"	7'-0"	1 3/4"	HM	EXIST	EP-4		HM	EXIST	EP-4	-	-	-	-	4	
301	MECH.	-	3'-0"	7'-0"	1 3/4"	HM	EXIST	EP-4		HM	EXIST	EP-4	-	-	-	-	4	
302	MECH.	-	3'-0"	7'-0"	1 3/4"	HM	EXIST	EP-4		HM	EXIST	EP-4	-	-	-	-	4	

DOOR REMARKS


No.	REMARK
1	EXISTING WOOD DOOR. REMOVE DOOR, REFINISH TO MATCH NEW DOORS, REHANG DOOR WITH NEW HARDWARE.
2	EXISTING HM DOOR. REMOVE DOOR, PREP FOR PAINT, PAINT DOOR, AND REHANG WITH NEW HARDWARE.
3	NO NEW WORK THIS DOOR.
4	PAINT INTERIOR OF DOOR AND FRAME ONLY. NOT OTHER NEW WORK THIS DOOR.
5	SIGN TYPE 1 THIS DOOR.
6	SIGN TYPE 2 THIS DOOR.
7	SIGN TYPE 3 THIS DOOR.
8	DOOR BASIS OF DESIGN: AD SYSTEMS, FIRESLIDE SLIDING DOOR SYSTEM. HARDWARE BY DOOR MANUFACTURER.

STOREFRONT SCHEDULE

TYPE	ROUGH OPENING		JAMB	HEAD	SILL	HEAD HEIGHT	COMMENTS
	WIDTH	HEIGHT					
SF-1	6' - 7 3/4"	8' - 0"	F6/A0.05	F1/A0.05	F3/A0.05	8' - 0"	

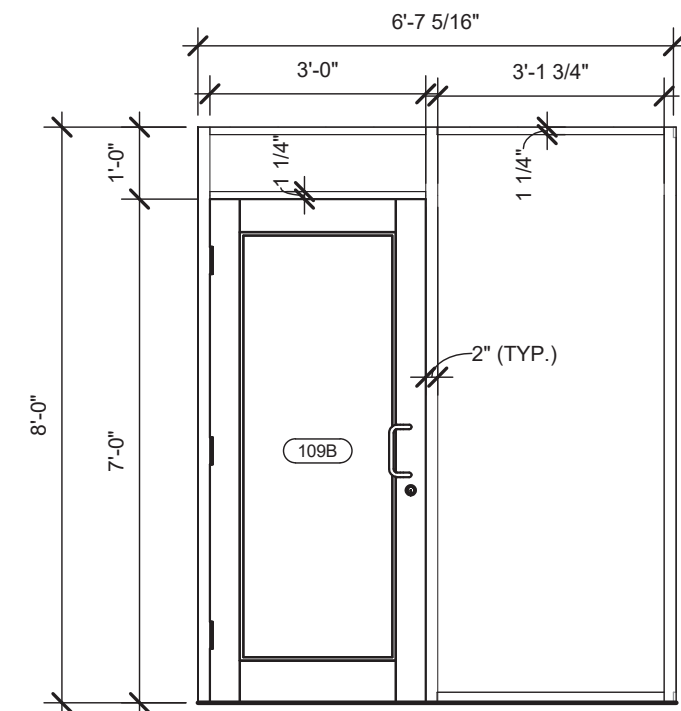

F3 SF-1
3/8" = 1'-0"

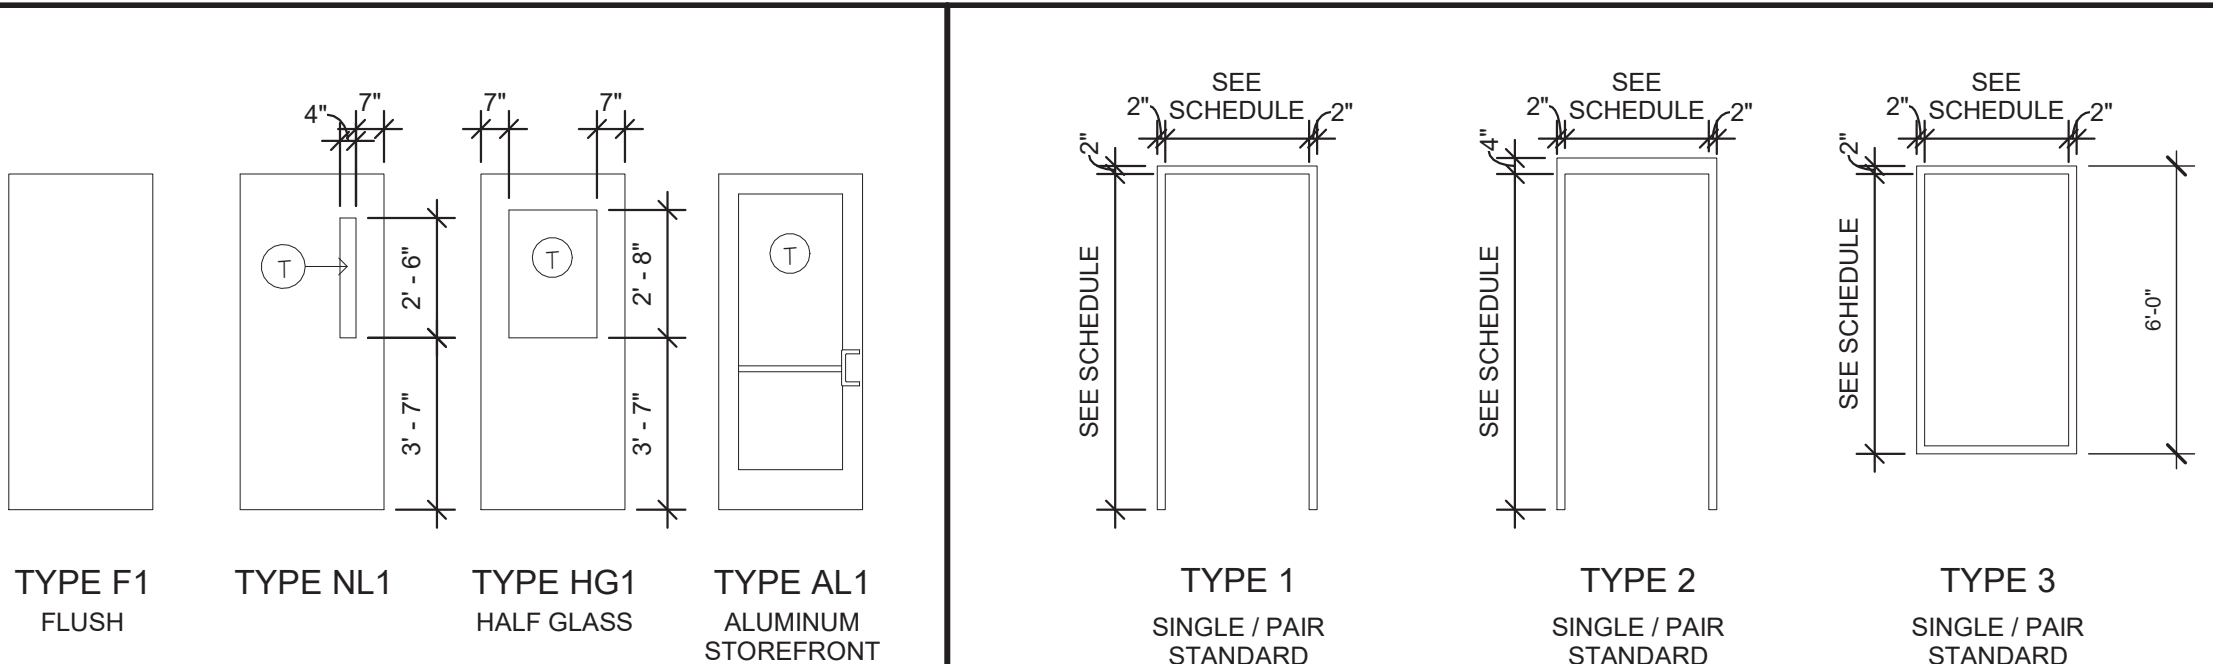

DOOR ELEVATIONS

FRAME ELEVATIONS

8/1/2025 1:22:12 PM

A

B


C

D

E

F

INTERIOR WALL TYPES SCHEDULE



TYPE	BASE WALL WIDTH	FIRE RATING TESTING AGENCY, ASSEMBLY NO.	DETAILS & NOTES	TYPE	BASE WALL WIDTH	FIRE RATING TESTING AGENCY, ASSEMBLY NO.	DETAILS & NOTES	TYPE	BASE WALL WIDTH	FIRE RATING TESTING AGENCY, ASSEMBLY NO.	DETAILS & NOTES
A1	3 5/8"	- -	DEFLECTION TRACK AT HEAD 5/8" TYPE "X" GYPSUM BOARD 3 5/8" STEEL STUDS @ 16" O.C. 3 1/2" SOUND ATTENUATION 5/8" TYPE "X" GYPSUM BOARD NOTES: 5/8" CEMENTITIOUS BACKER UNITS TO FULL HEIGHT OF WALL TILE.	F1	3 5/8"	1 HR. UL. NO U407	FIRESTOP DEFLECTION TRACK AT HEAD 5/8" TYPE "X" GYPSUM BOARD 3 5/8" STEEL STUDS @ 16" O.C. 3 1/2" SOUND ATTENUATION 5/8" TYPE "X" GYPSUM BOARD NOTES: FIRE CAULK PERIMETER AND PENETRATIONS.	C1	--	1 HR. OBC 2017 PRESCRIPTIVE METHOD TABLE 721.1(3) ITEM NUMBER 22-1.1	BOTTOM OF ROOF TRUSS (2) LAYERS OF 5/8" TYPE "X" GYPSUM WALLBOARD NOTES: • CEILING ASSEMBLY TO BE CONSTRUCTED IN ACCORDANCE WITH THE PRESCRIBED METHOD IN THE OBC 2017 TABLE 721.1(3). • MINIMUM FIRE RESISTANCE RATING REQUIRED IS 30 MINUTES TO THIS APPLICATION.
B1	6 5/8"		EXISTING WALL 6" STEEL STUDS @ 16" O.C. 6" SOUND ATTENUATION 5/8" TYPE "X" GYPSUM BOARD	M1	7 5/8"		DEFLECTION TRACK AT HEAD 5/8" TYPE "X" GYPSUM BOARD 6" STEEL STUDS @ 16" O.C. 6" SOUND ATTENUATION 5/8" TYPE "X" GYPSUM BOARD 7 1/4" EQ. EQ. 8" NOMINAL CMU 10'-0"	GENERAL NOTES A. MOISTURE/MOLD RESISTANT GYPSUM BOARD SHALL BE USED BEHIND ALL SINKS, SERVICE SINKS AND SHOWER AREAS. EXTEND MINIMUM 24" BEYOND PLUMBING FIXTURES. B. PROVIDE & INSTALL DEFLECTION TRACK AT ALL INTERIOR WALLS THAT EXTEND TO DECK. C. UL TEST NUMBERS FOR INTERIOR PARTITIONS WILL VARY DEPENDING ON THE MANUFACTURER OF COMPONENTS ACTUALLY USED. MAINTAIN RATING AND ADVISE IF WALL THICKNESS WILL CHANGE. D. DRYWALL CONTRACTOR TO PAINT WALL RATINGS LABELS AT MAXIMUM 12 FEET O.C. ON ALL FIRE RATED PARTITIONS. LABEL TO BE PAINTED ABOVE CEILING WITH A STENCIL MIN. OF 4 INCHES IN HEIGHT, BLACK COLOR. E. FIRE RATED WALLS AND SMOKE PARTITIONS ARE TO BE CONSTRUCTED TIGHT TO STRUCTURE, PIPING AND OTHER PENETRATIONS. ALL PENETRATIONS AND PERIMETER OF WALLS TO BE FIRE CAULKED. F. STEEL STUD PARTITIONS SHALL BE BRACED TO STRUCTURE ABOVE. G. REFER TO FLOOR PLANS FOR LOCATIONS OF INTERIOR PARTITION TYPES. H. REFER TO SHEET A0.06 FOR TYPICAL INTERIOR PARTITIONS DETAILS. I. ALL PARTITIONS SCHEDULED RECEIVE WALL TILE SHALL HAVE CEMENTITIOUS BACKER UNIT TO FULL HEIGHT OF WALL TILE. J. ALL PENETRATIONS IN FIRE RATED PARTITIONS SHALL BE FIRESTOPPED, WHETHER THEY ARE NEW OR EXISTING. INCLUDING THOSE CREATED BY THE REMOVAL OF AN EXISTING PENETRATING ITEM. FIRESTOPPING SYSTEMS SHALL BE FM OR U.L. LABORATORY APPROVED PRODUCTS. K. APPLY ACOUSTICAL SEALANT AT ENTIRE PERIMETER OF ALL GYPSUM BOARD PARTITIONS. L. EXISTING BUILDING FLOOR TO FLOOR HEIGHTS FOR AREAS OF WORK: - BASEMENT TO FIRST FLOOR: 10'-0" - FIRST FLOOR TO SECOND FLOOR: 12'-0" - SECOND FLOOR TO THIRD FLOOR: 10'-0" - THIRD FLOOR TO ROOF: 10'-8"			
B2	3 5/8"		EXISTING WALL 3 5/8" STEEL STUDS @ 16" O.C. 3 1/2" SOUND ATTENUATION 5/8" TYPE "X" GYPSUM BOARD	M2	7 5/8"		4" 8'-0" 8" NOMINAL CMU				
B3	2 1/2"		EXISTING WALL 2 1/2" STEEL STUDS @ 16" O.C. 2 1/2" SOUND ATTENUATION 5/8" TYPE "X" GYPSUM BOARD	M2	7 5/8"		4" 8'-0" 8" NOMINAL CMU				

App Architecture
creative focused design

645 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com

STATE OF OHIO
TIMOTHY J. BERMENT
17095
Professional Engineer
Expiration Date 12/31/2025

CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, Ohio, 45420


ISSUE	
NO.	DATE DESCRIPTION
08/01/25	FOR CONSTRUCTION

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB


COPYRIGHT © 2025 - App Architecture, Inc.

TITLE
WALL TYPES


SHEET NO.
A0.04

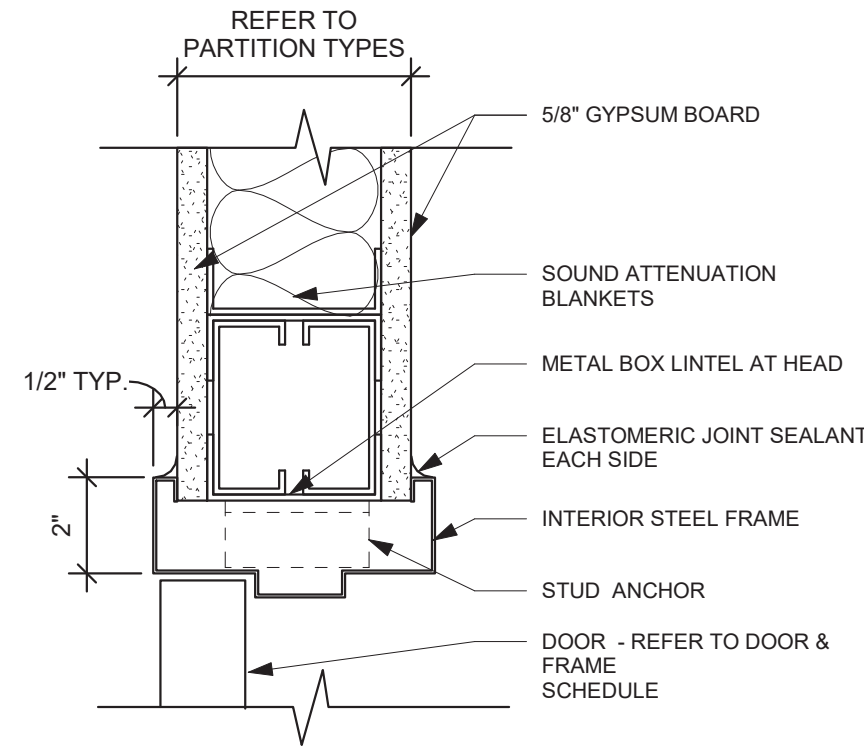


B1 TYP. INTERIOR DOOR HEAD DETAIL
3" = 1'-0"

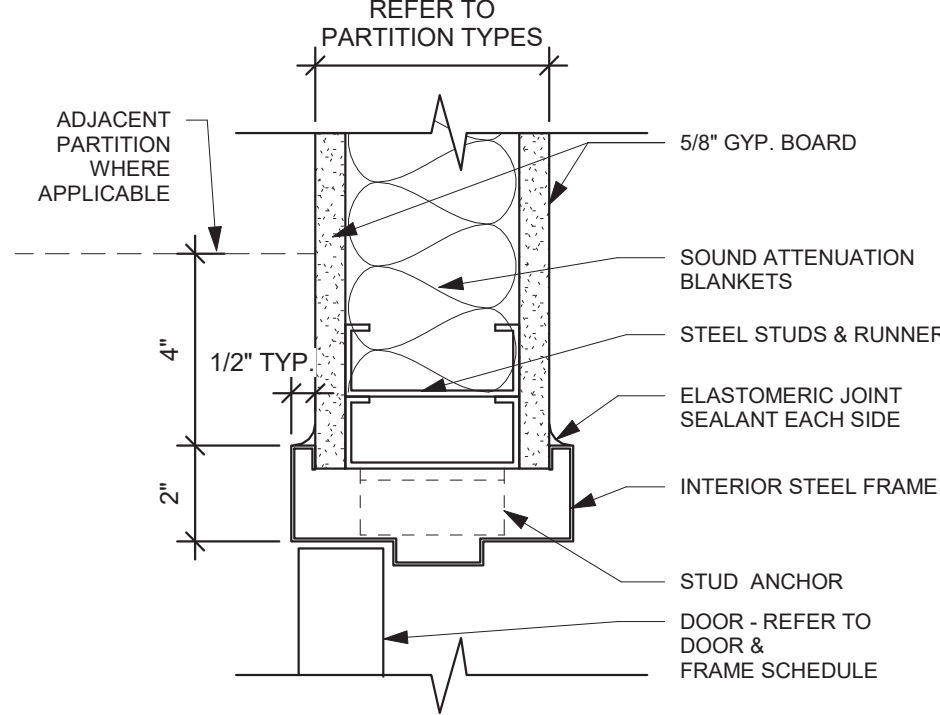


B3 TYP. INTERIOR DOOR JAMB DETAIL
3" = 1'-0"

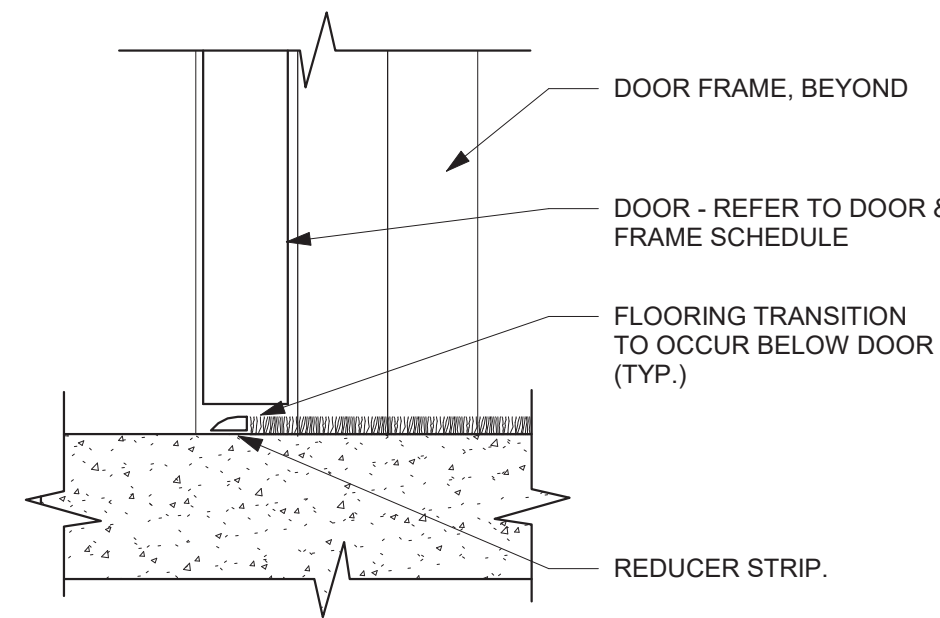


B4 TYP. INTERIOR DOOR SILL DETAIL
3" = 1'-0"

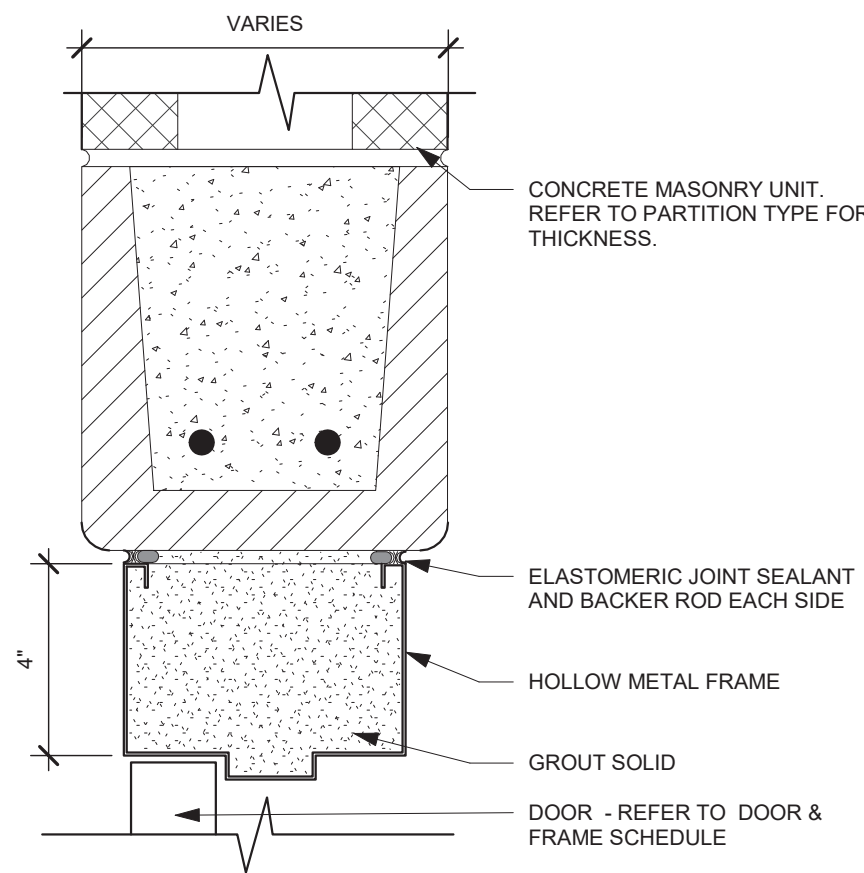


B6 HEAD DETAIL (CMU)
3" = 1'-0"

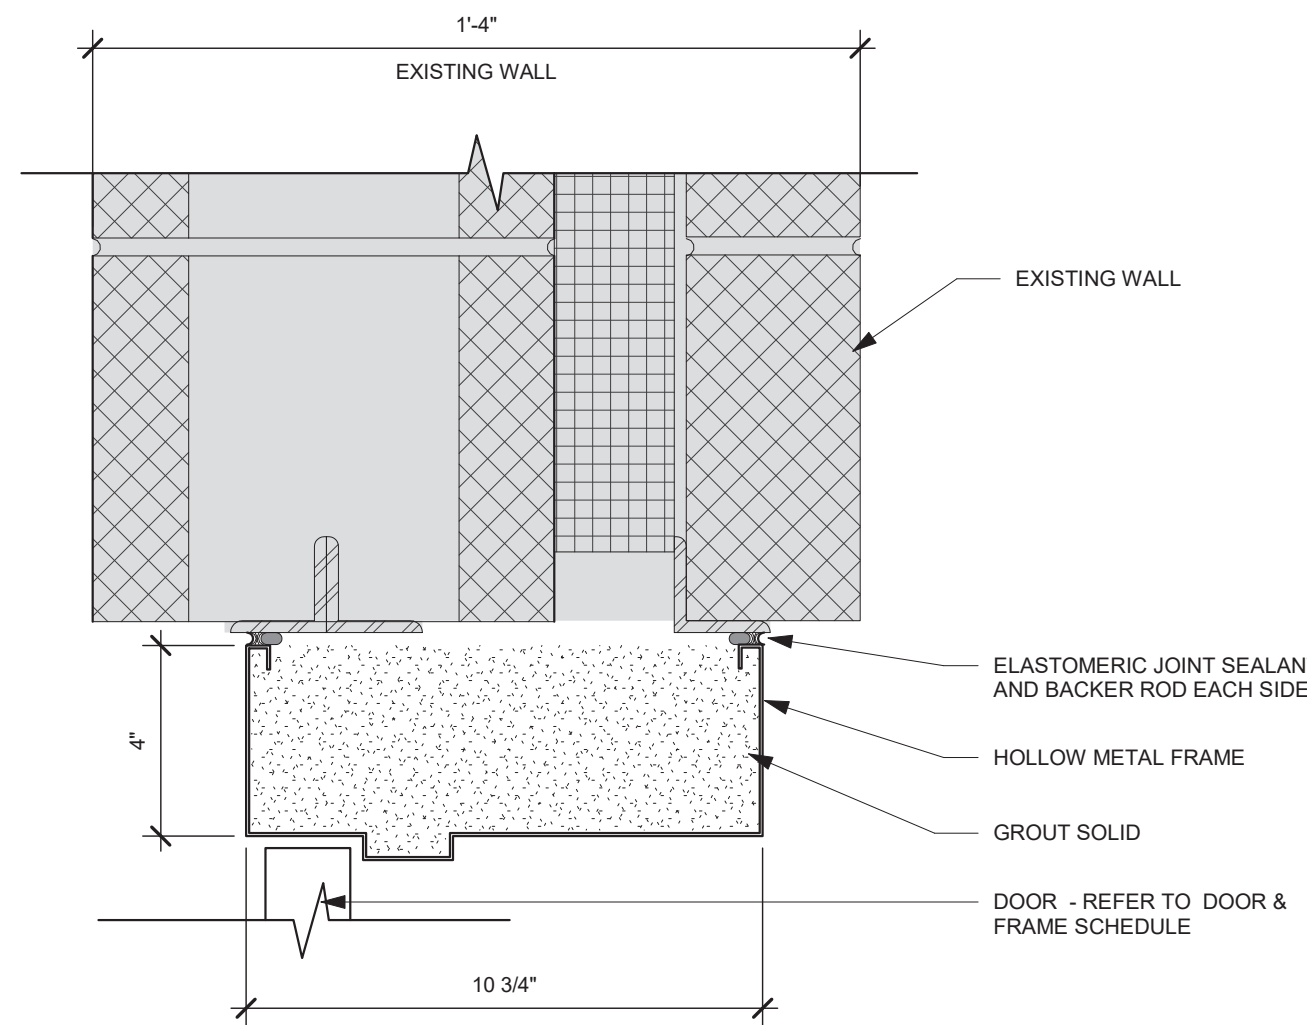


C1 HEAD DETAIL (EXISTING APP BAY CMU WALL)
3" = 1'-0"

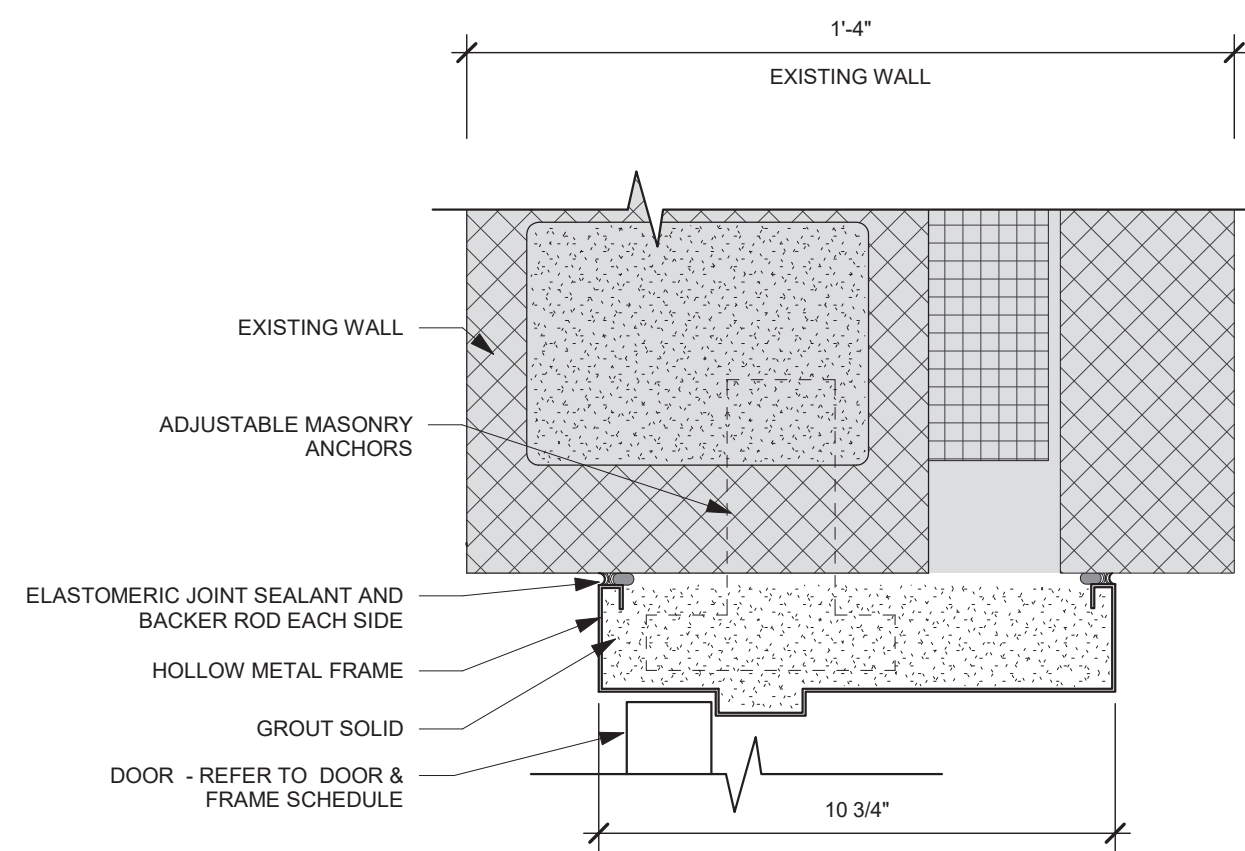


C3 JAMB DETAIL (EXISTING APP BAY CMU WALL)
3" = 1'-0"

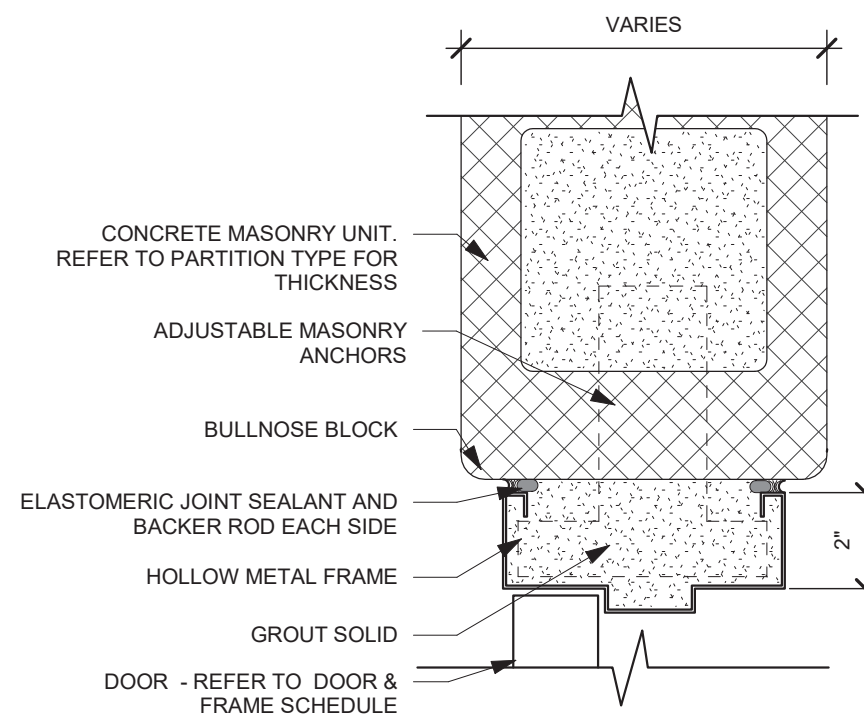


D6 DOOR JAMB DETAIL (CMU)
3" = 1'-0"

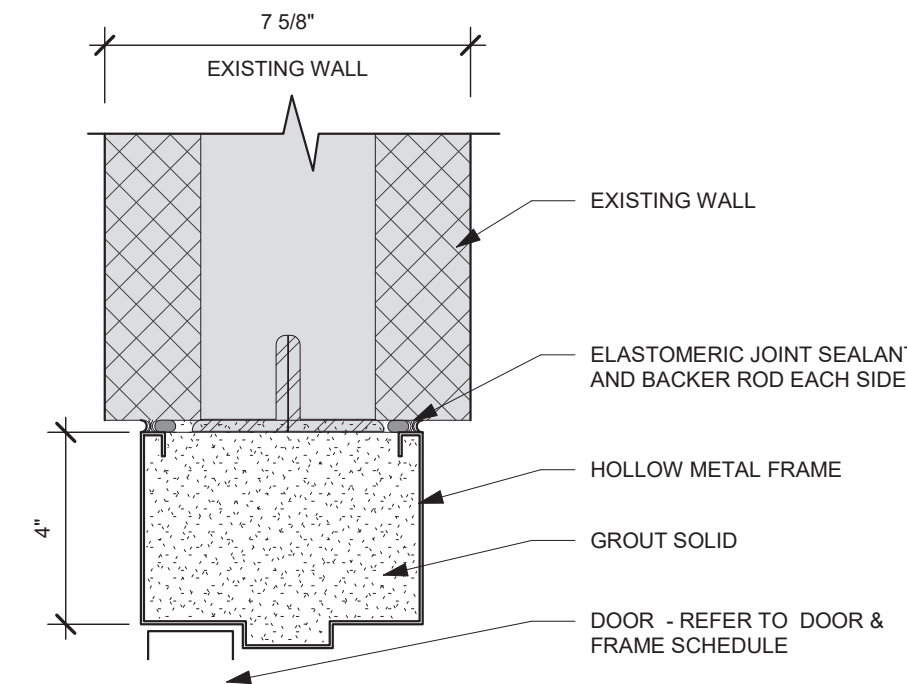


E1 HEAD DETAIL (EXISTING INTERIOR CMU WALL)
3" = 1'-0"

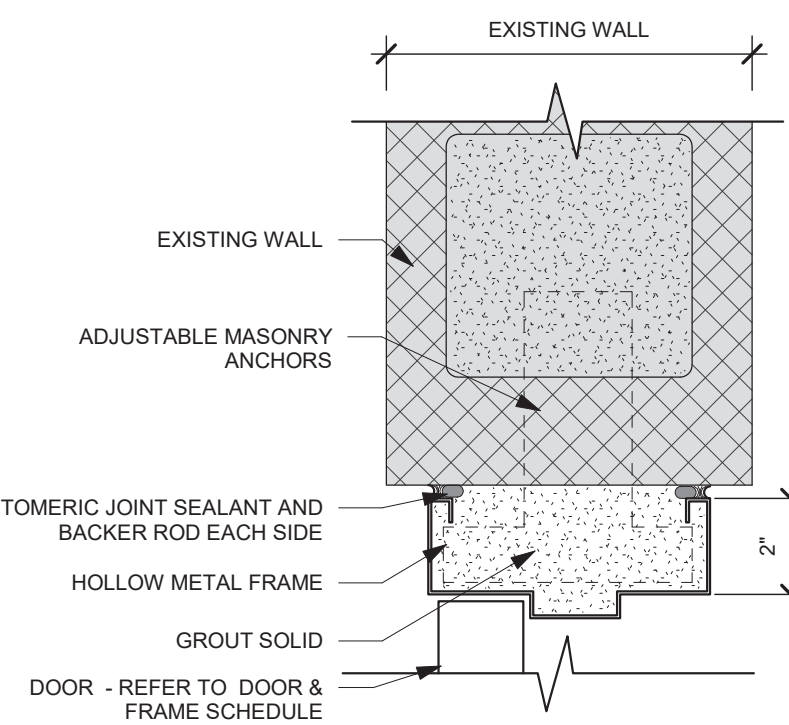


E3 JAMB DETAIL (EXISTING INTERIOR CMU WALL)
3" = 1'-0"

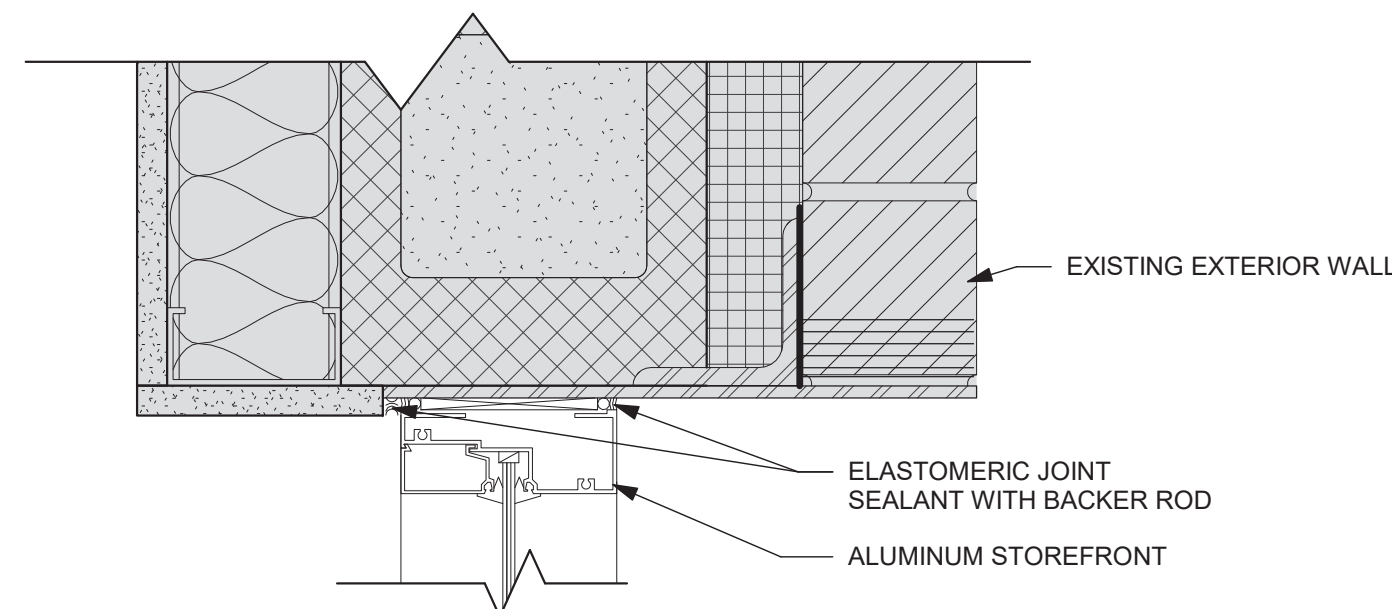


F1 HEAD DETAIL - CMU WALL W/ STUD WALL (STOREFRONT)
3" = 1'-0"

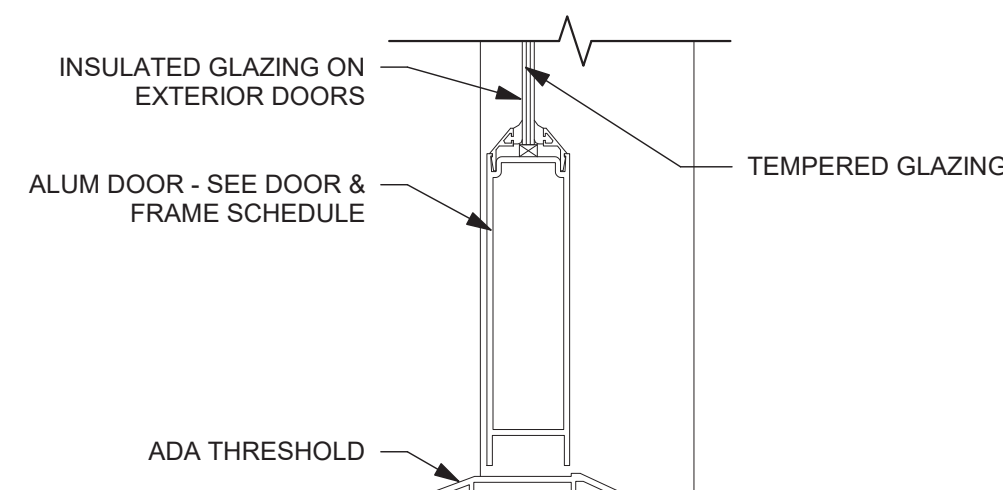


F3 SILL DETAIL - STOREFRONT DOOR
3" = 1'-0"

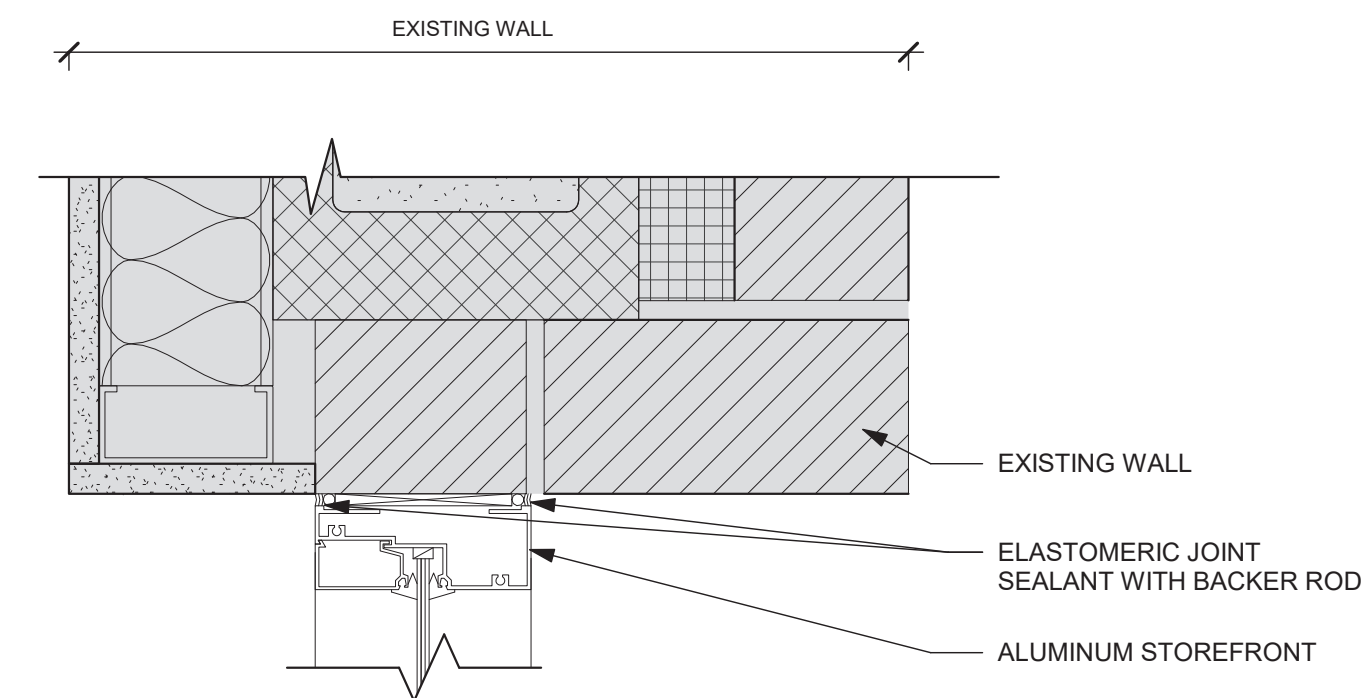


F6 JAMB DETAIL - CMU WALL W/ STUD WALL (STOREFRONT)
3" = 1'-0"

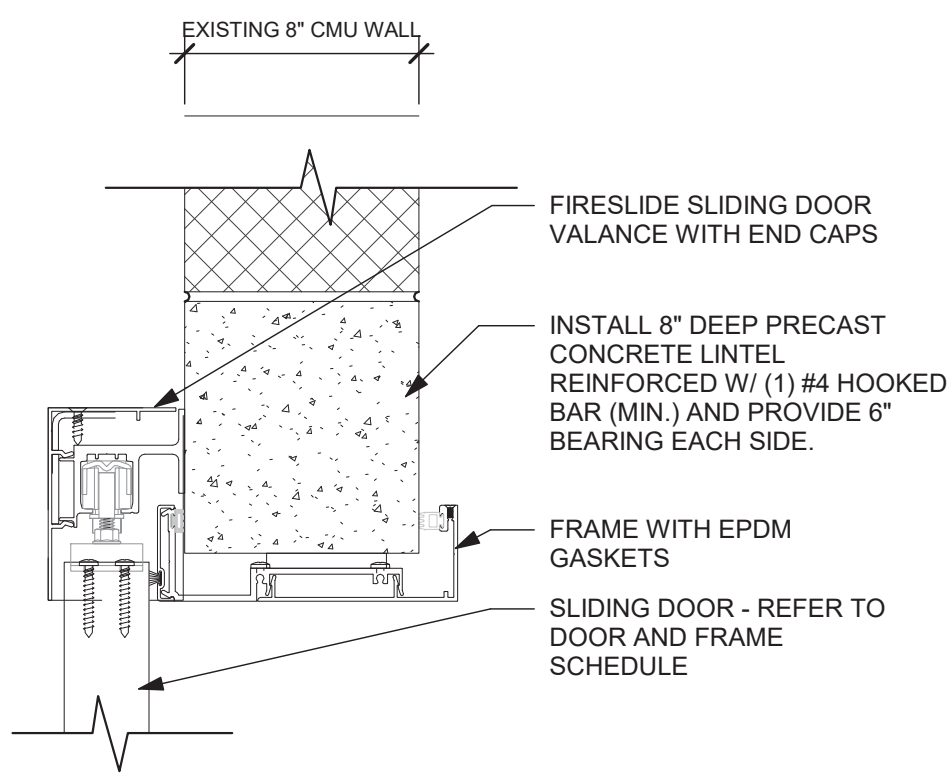


B1 SLIDING DOOR HEAD DETAIL
3" = 1'-0"

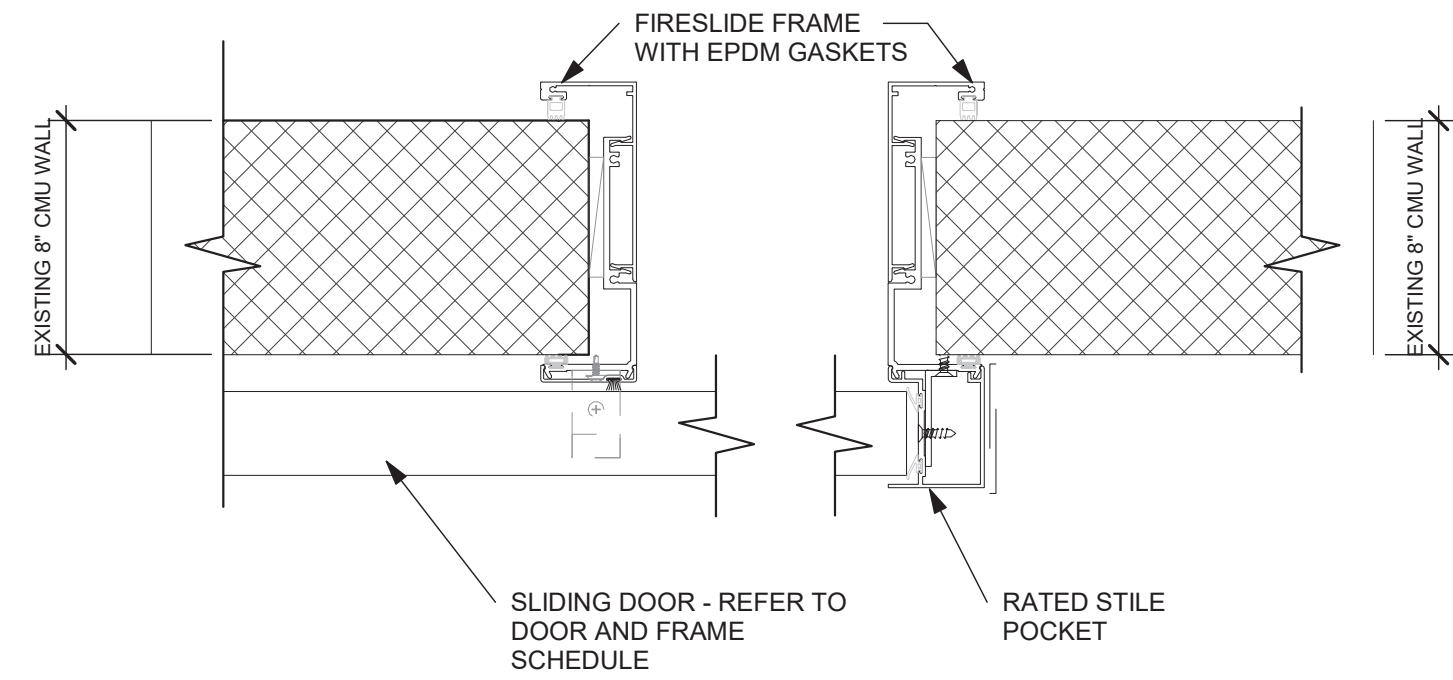


B3 SLIDING DOOR JAMB DETAIL
3" = 1'-0"

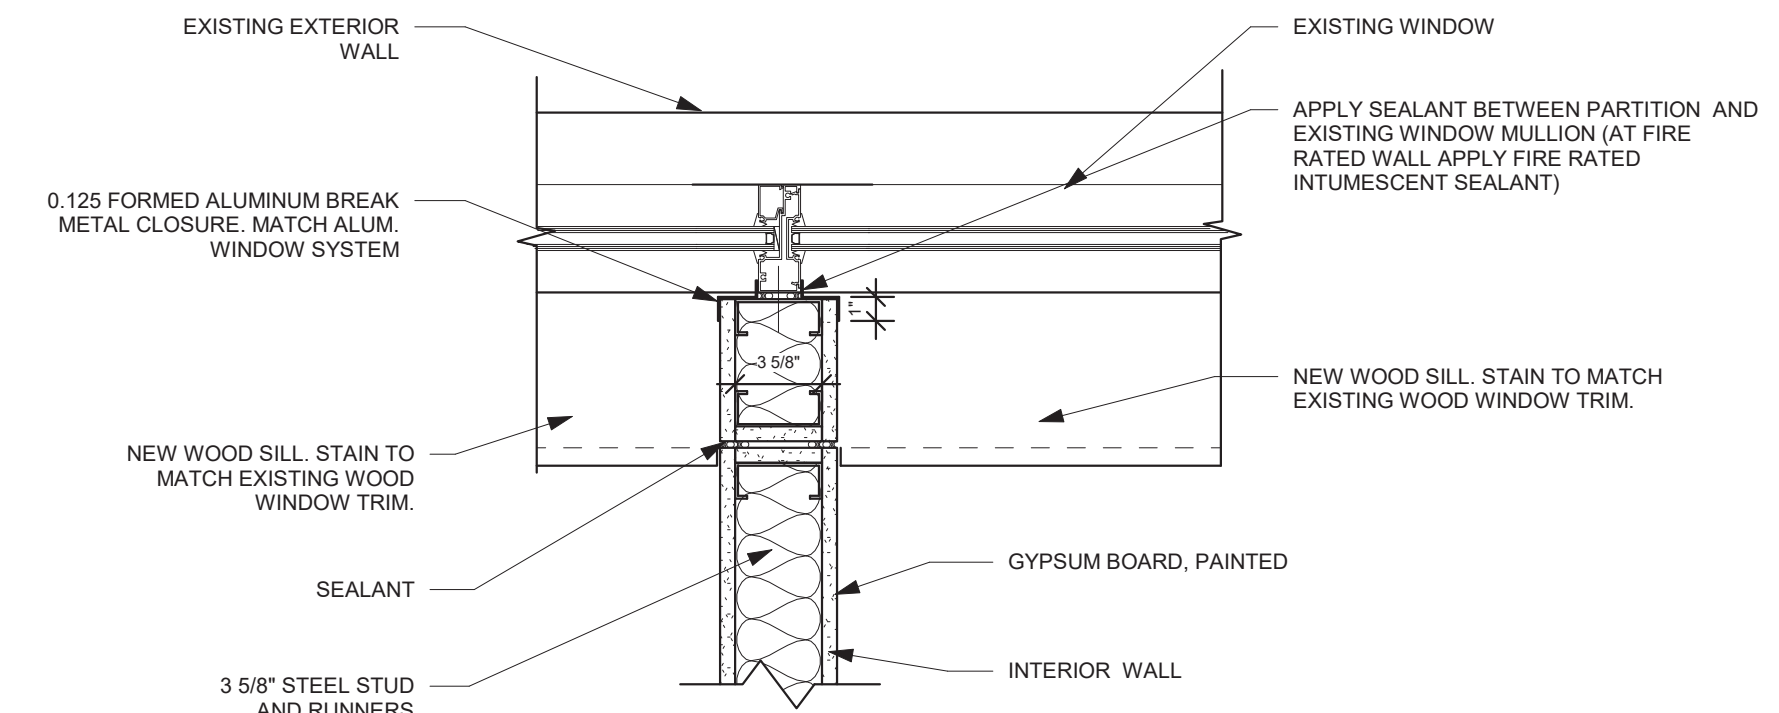


B6 WALL TO WINDOW DETAIL - FIRE RATED
1 1/2" = 1'-0"

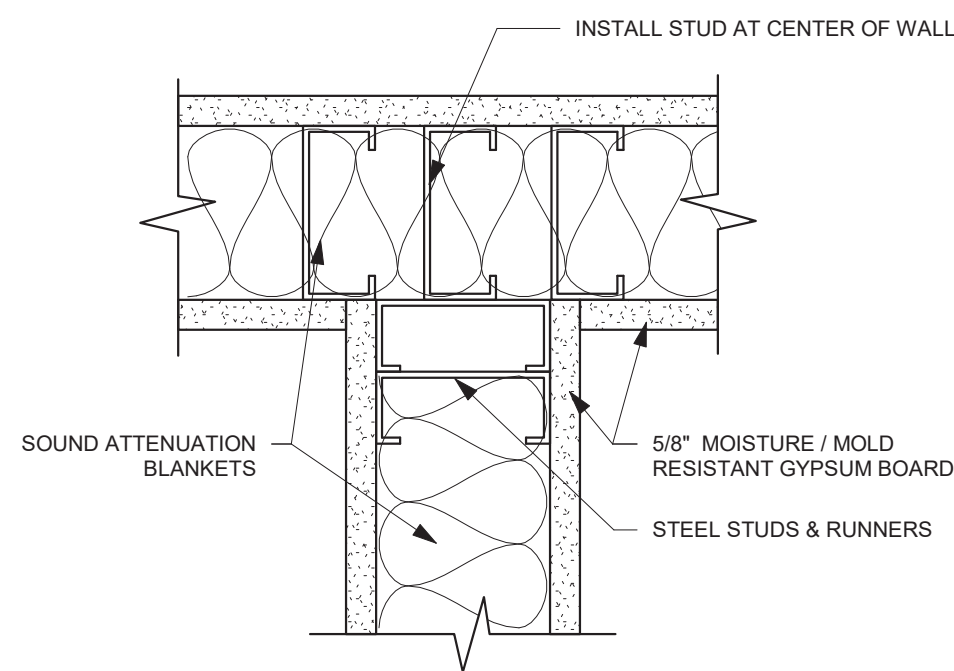


C1 TYP. GWB WALL INTERSECTION
3" = 1'-0"

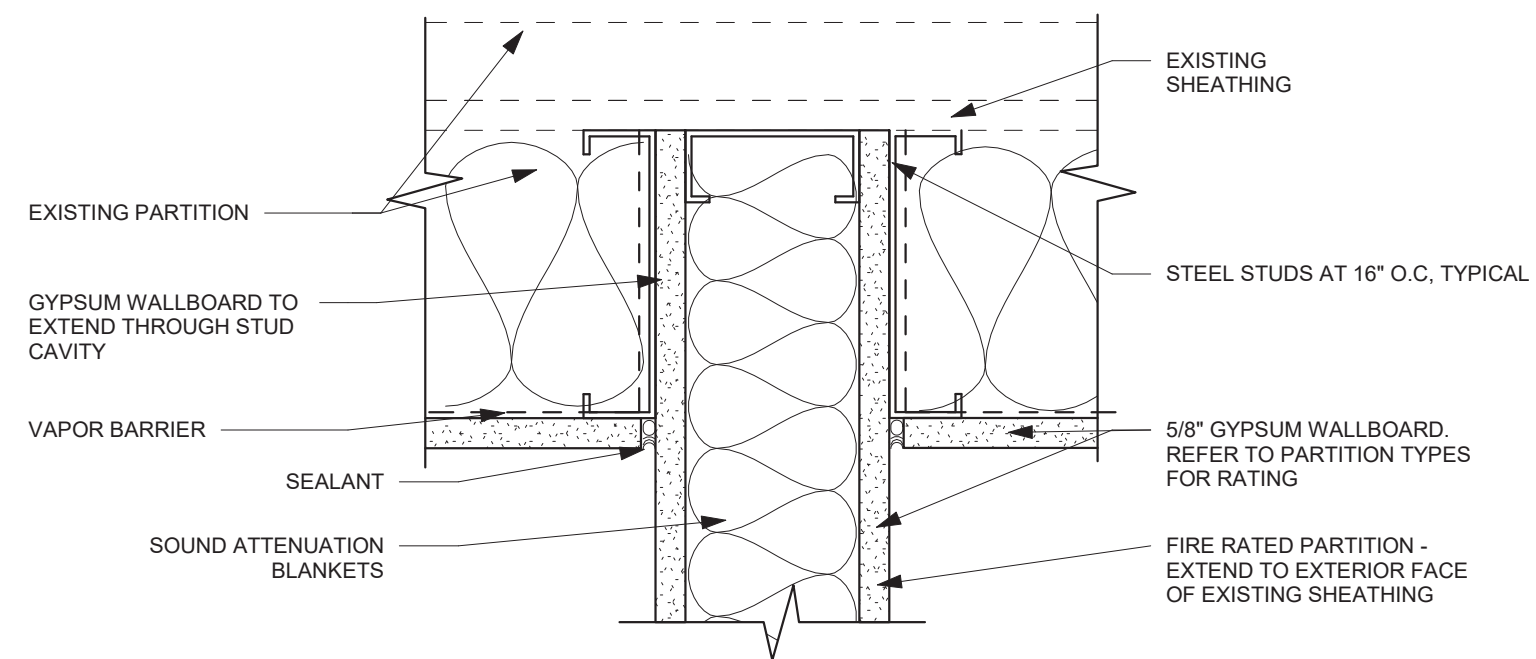


C2 TYP. INT. PARTITION INTERSECTION WITH EXT. WALL - FIRE RTD.
3" = 1'-0"

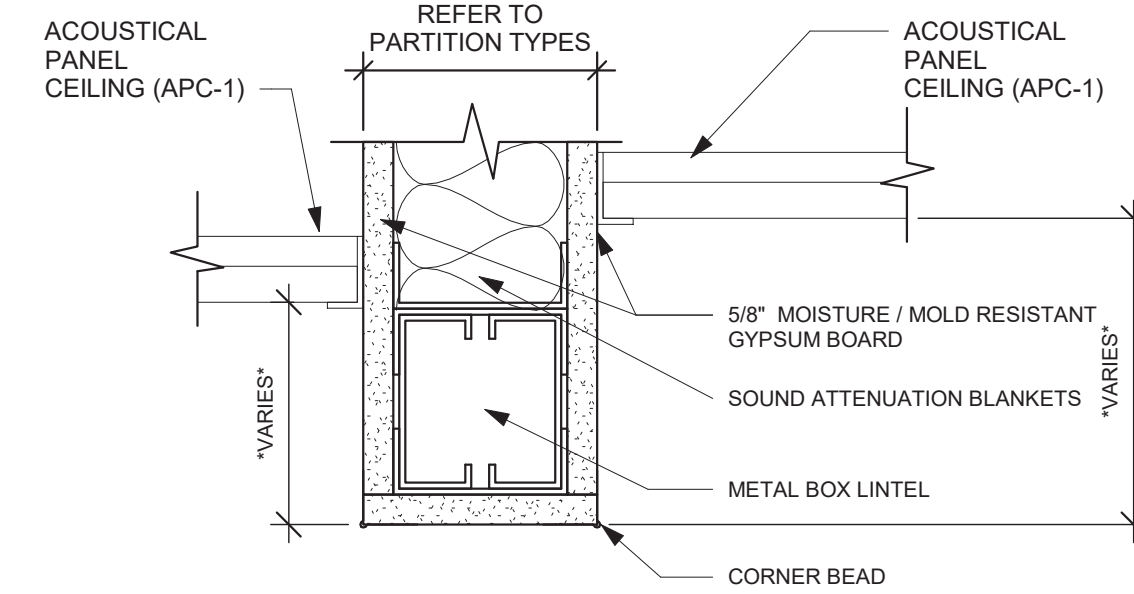


C5 TYP. BULKHEAD DETAIL
3" = 1'-0"

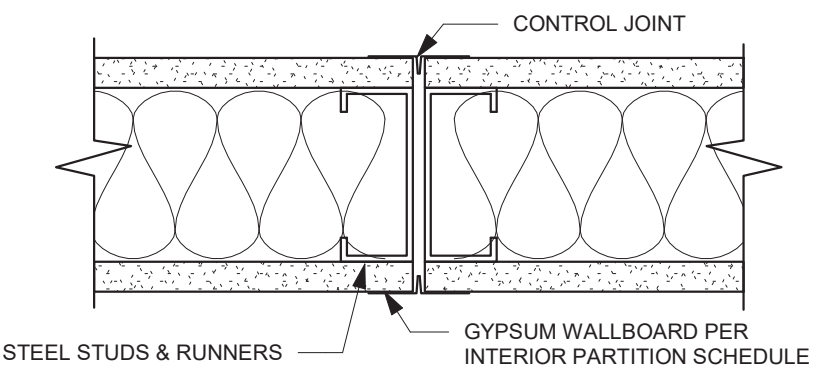


C6 TYP. GWB EXPANSION DETAIL
3" = 1'-0"

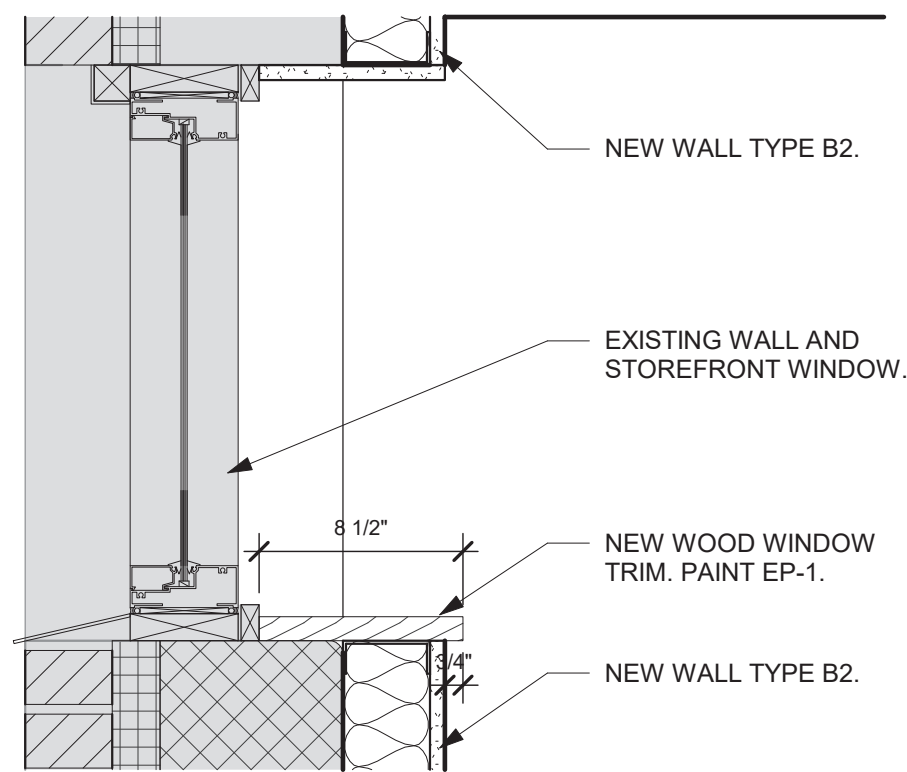


E3 WINDOW SILL DETAIL
1 1/2" = 1'-0"

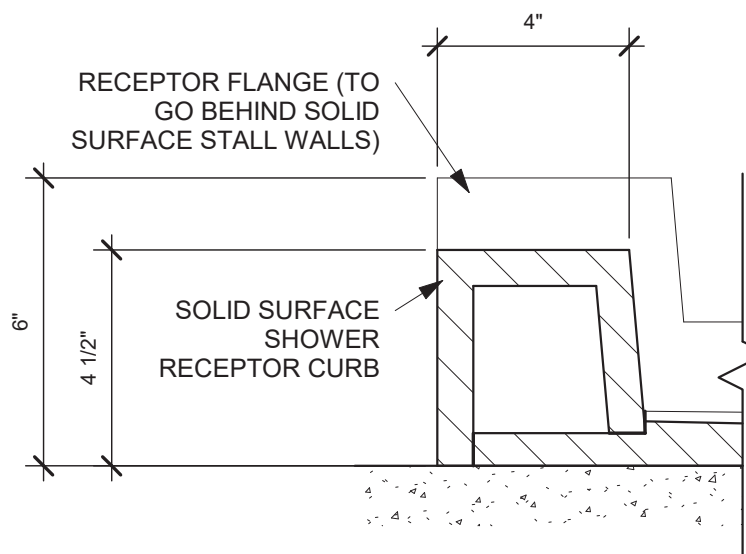


D4 CURB STYLE SHOWER CURB SECTION
3" = 1'-0"

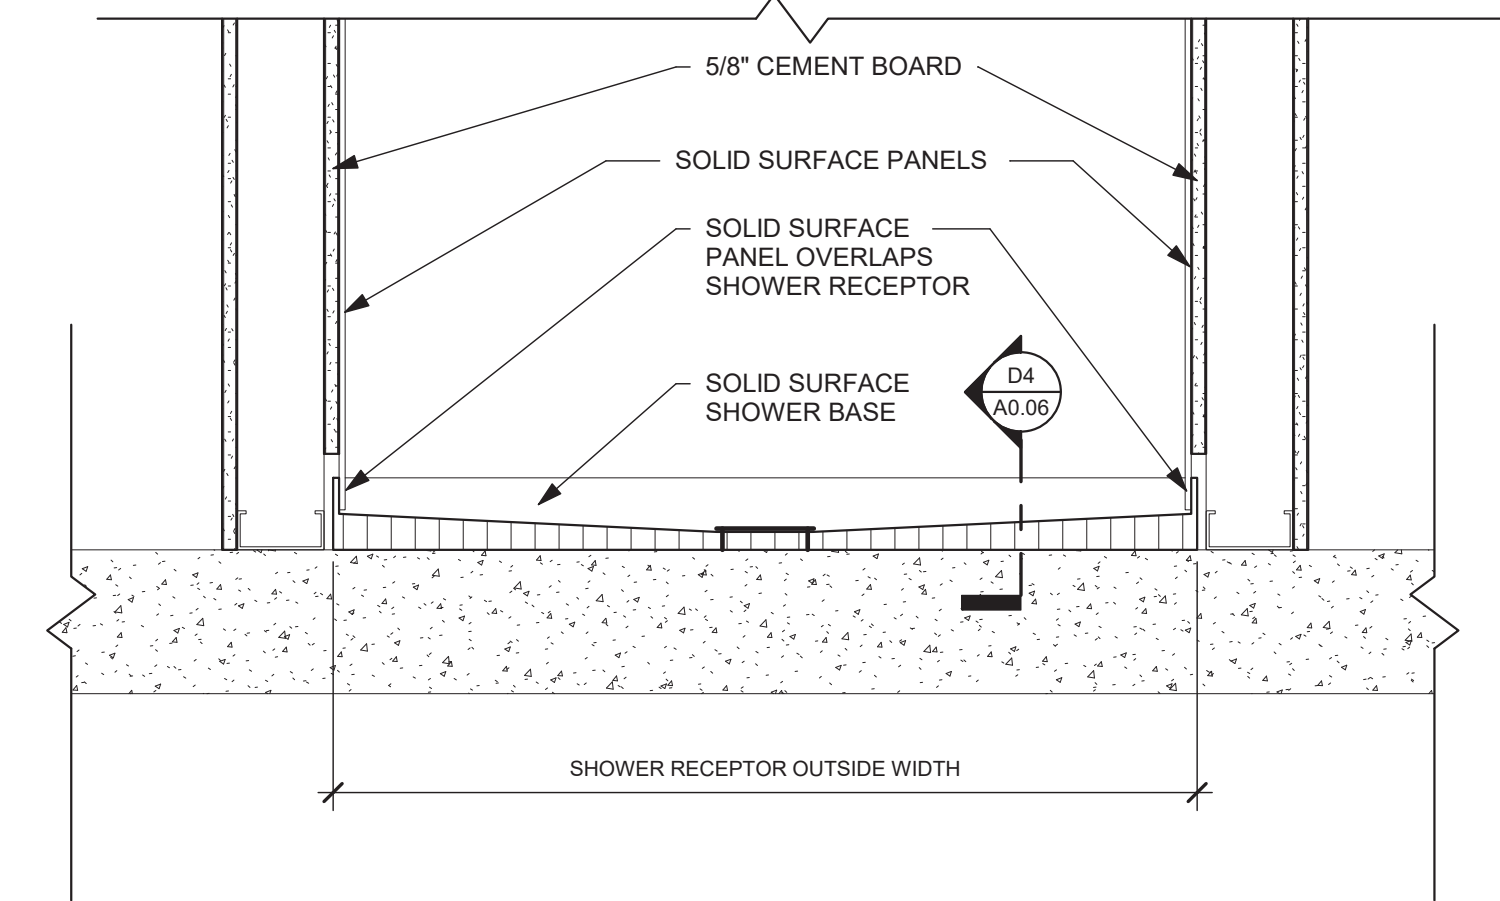


D6 CURB STYLE SHOWER RECEPTOR DETAIL
1 1/2" = 1'-0"

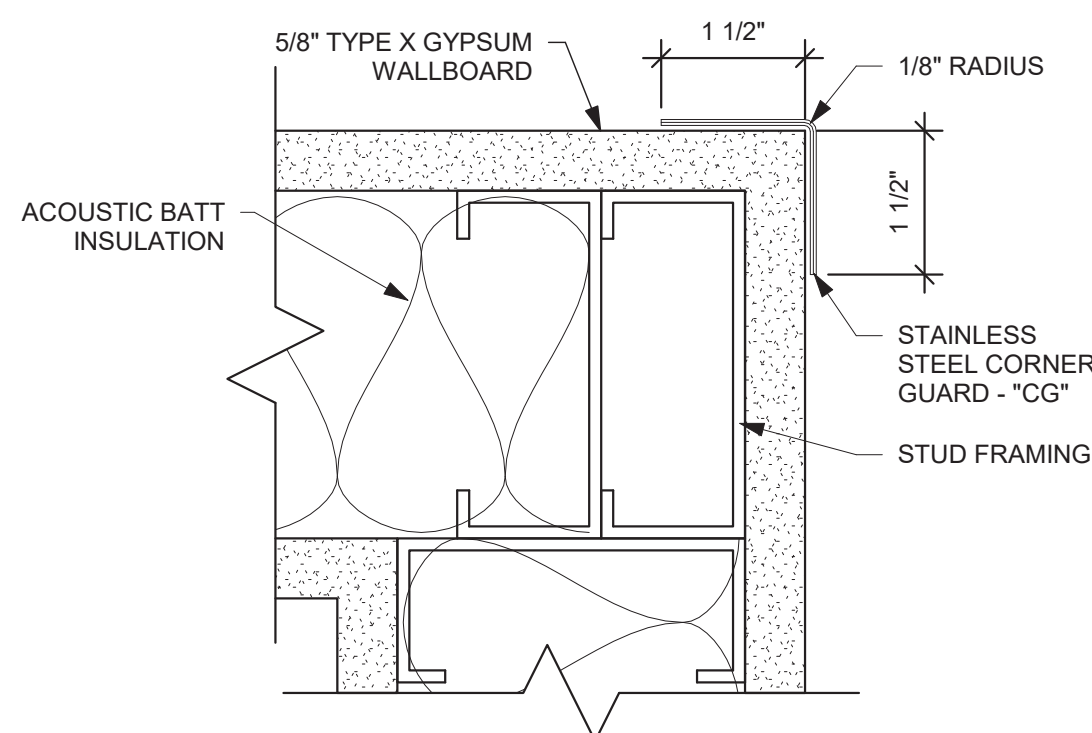

F2 CG-1 CORNER GUARD
6" = 1'-0"

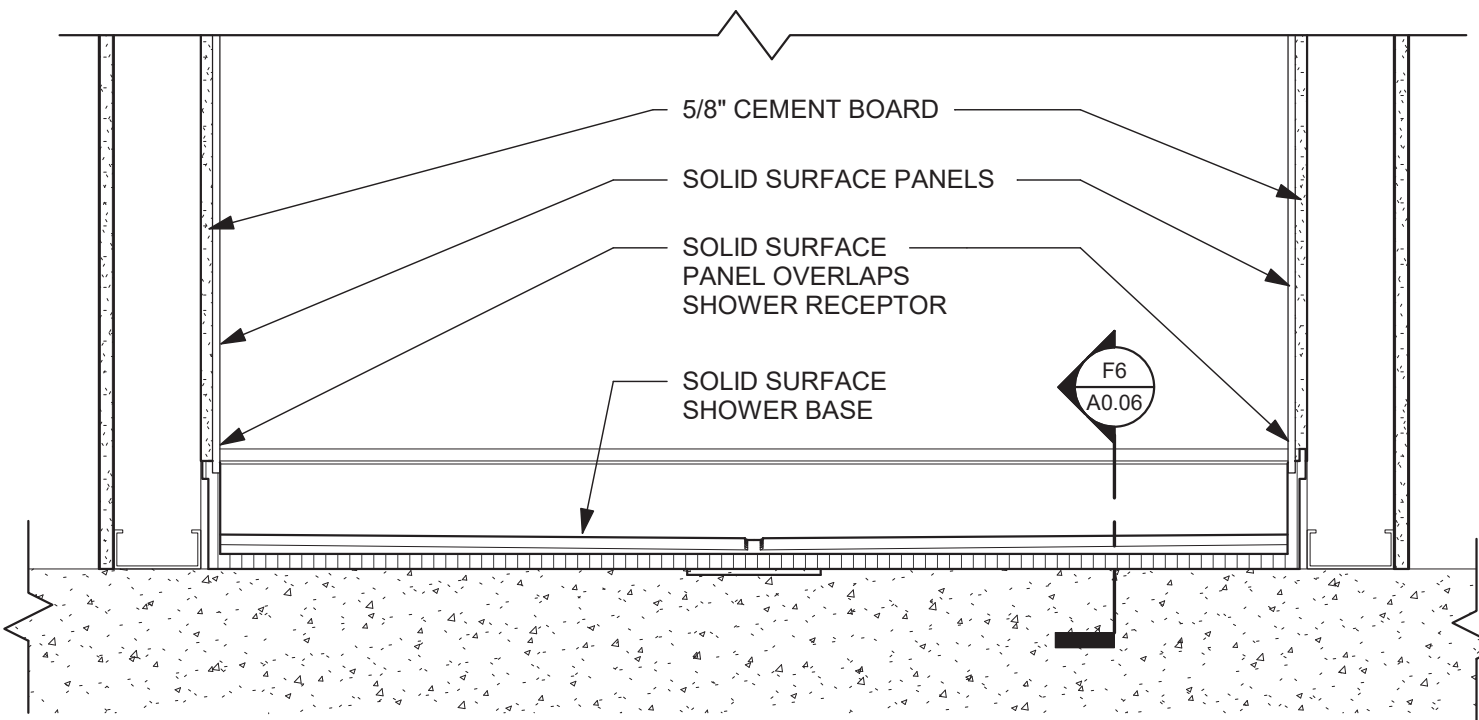

F4 ADA RECEPTOR DETAIL
1 1/2" = 1'-0"

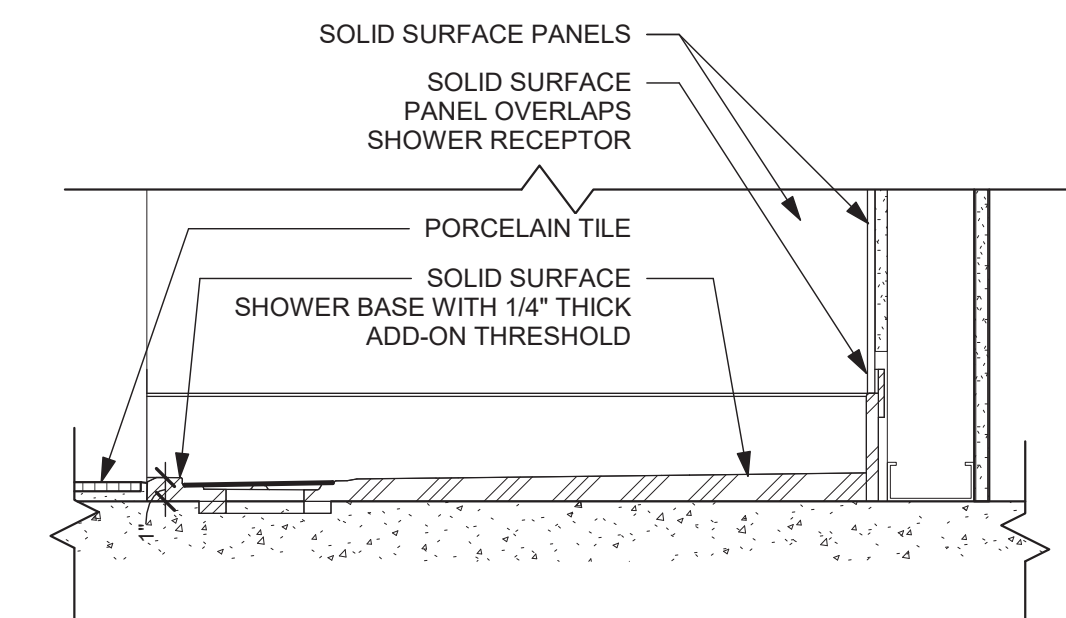

F6 ADA SHOWER RECEPTOR SECTION
1 1/2" = 1'-0"

A

B

C

D

E

F

1

2


3

4


5

6


7

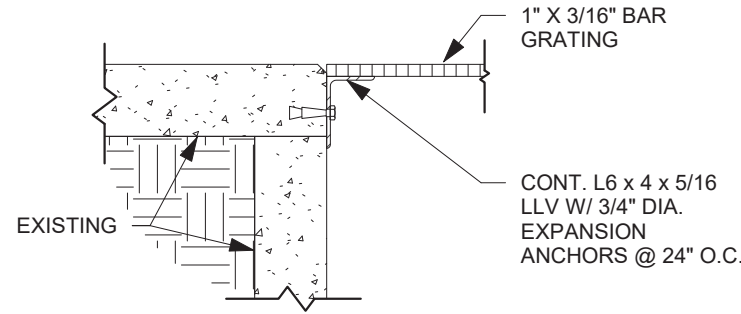


A5 BAR GRATE SECTION A
3/4" = 1'-0"

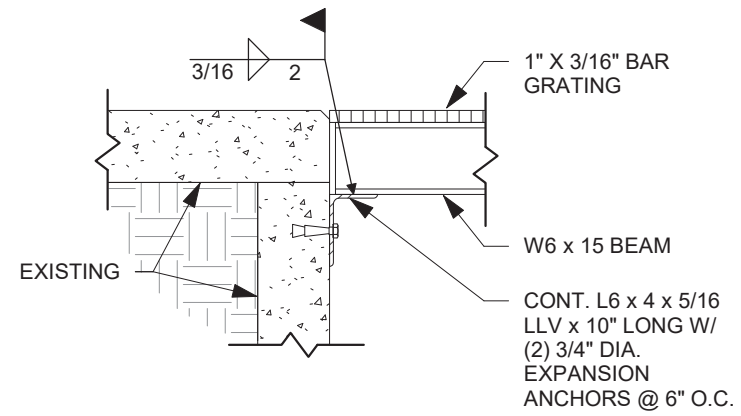


B5 BAR GRATE SECTION B
3/4" = 1'-0"

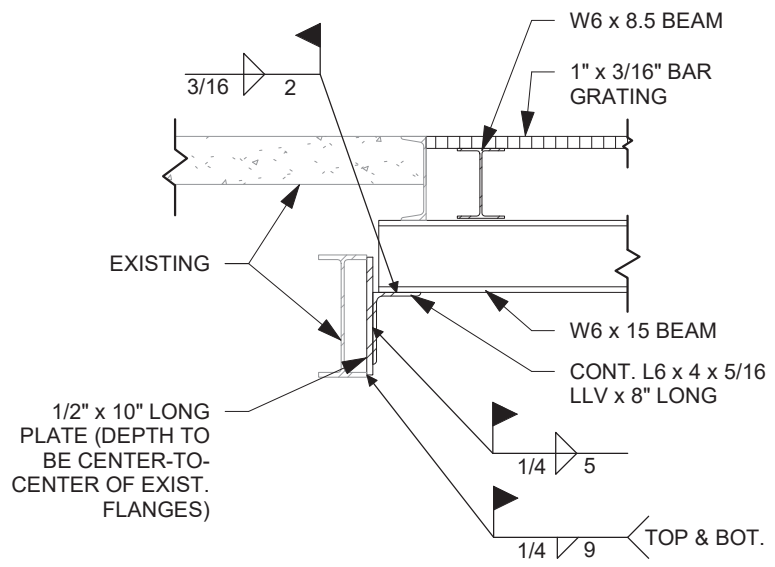

D5 BAR GRATE SECTION C
3/4" = 1'-0"

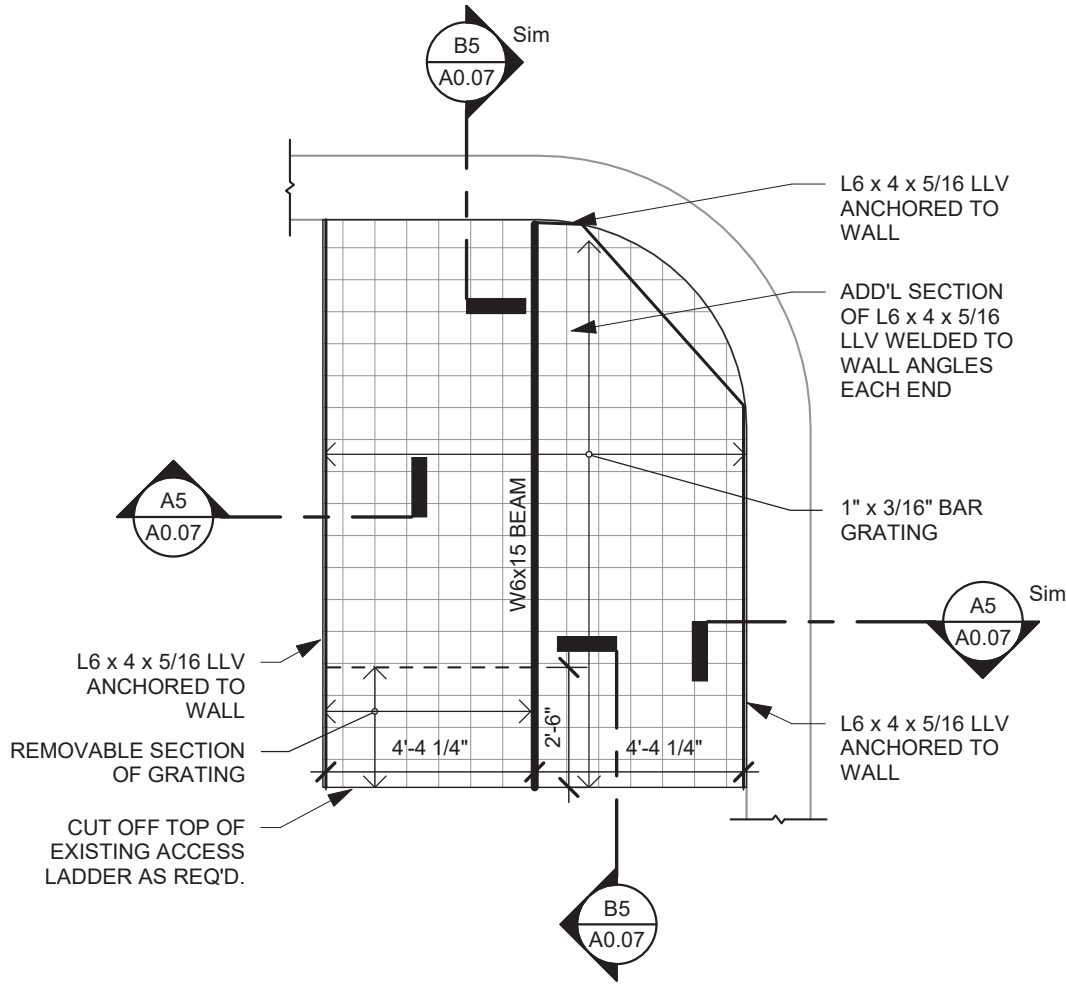

B6 PARTIAL ENLARGED BASEMENT PLAN
1/4" = 1'-0"

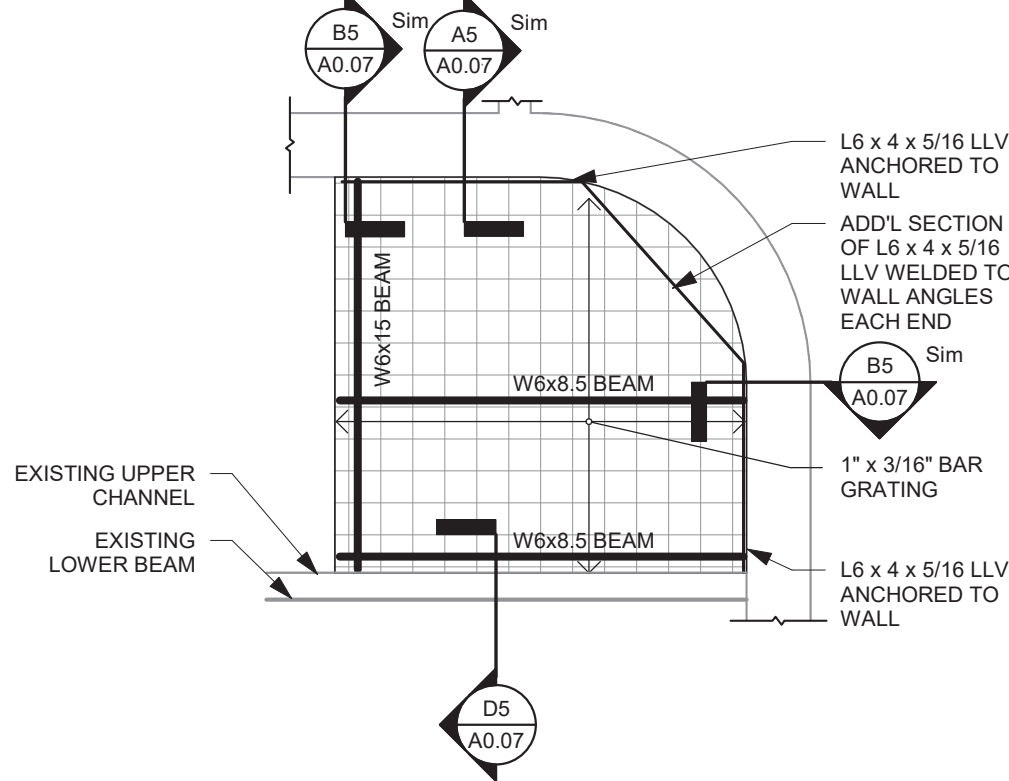

D6 PARTIAL ENLARGED LEVEL 1 PLAN
1/4" = 1'-0"

APP Architecture

creative focused design

615 Woodside Drive, Englewood, Ohio 45322

T 937.836.8898 F 937.832.3696

www.app-arch.com

STATE OF OHIO

TIMOTHY J. BEMENT

1205

Professional Engineer

Timothy J. Bement License #12305

Expiration Date 12/31/2025

CITY OF DAYTON

DAYTON FIRE DEPARTMENT

STATION 15

2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB

COPYRIGHT © 2025 - App Architecture, Inc.

TITLE
INTERIOR DETAILS-
BAR GRATE INFILL

SHEET NO.

A0.07

01/2025 1:25:17 PM

A

B

C

D

E

F

1

2


3

4


5

6


7

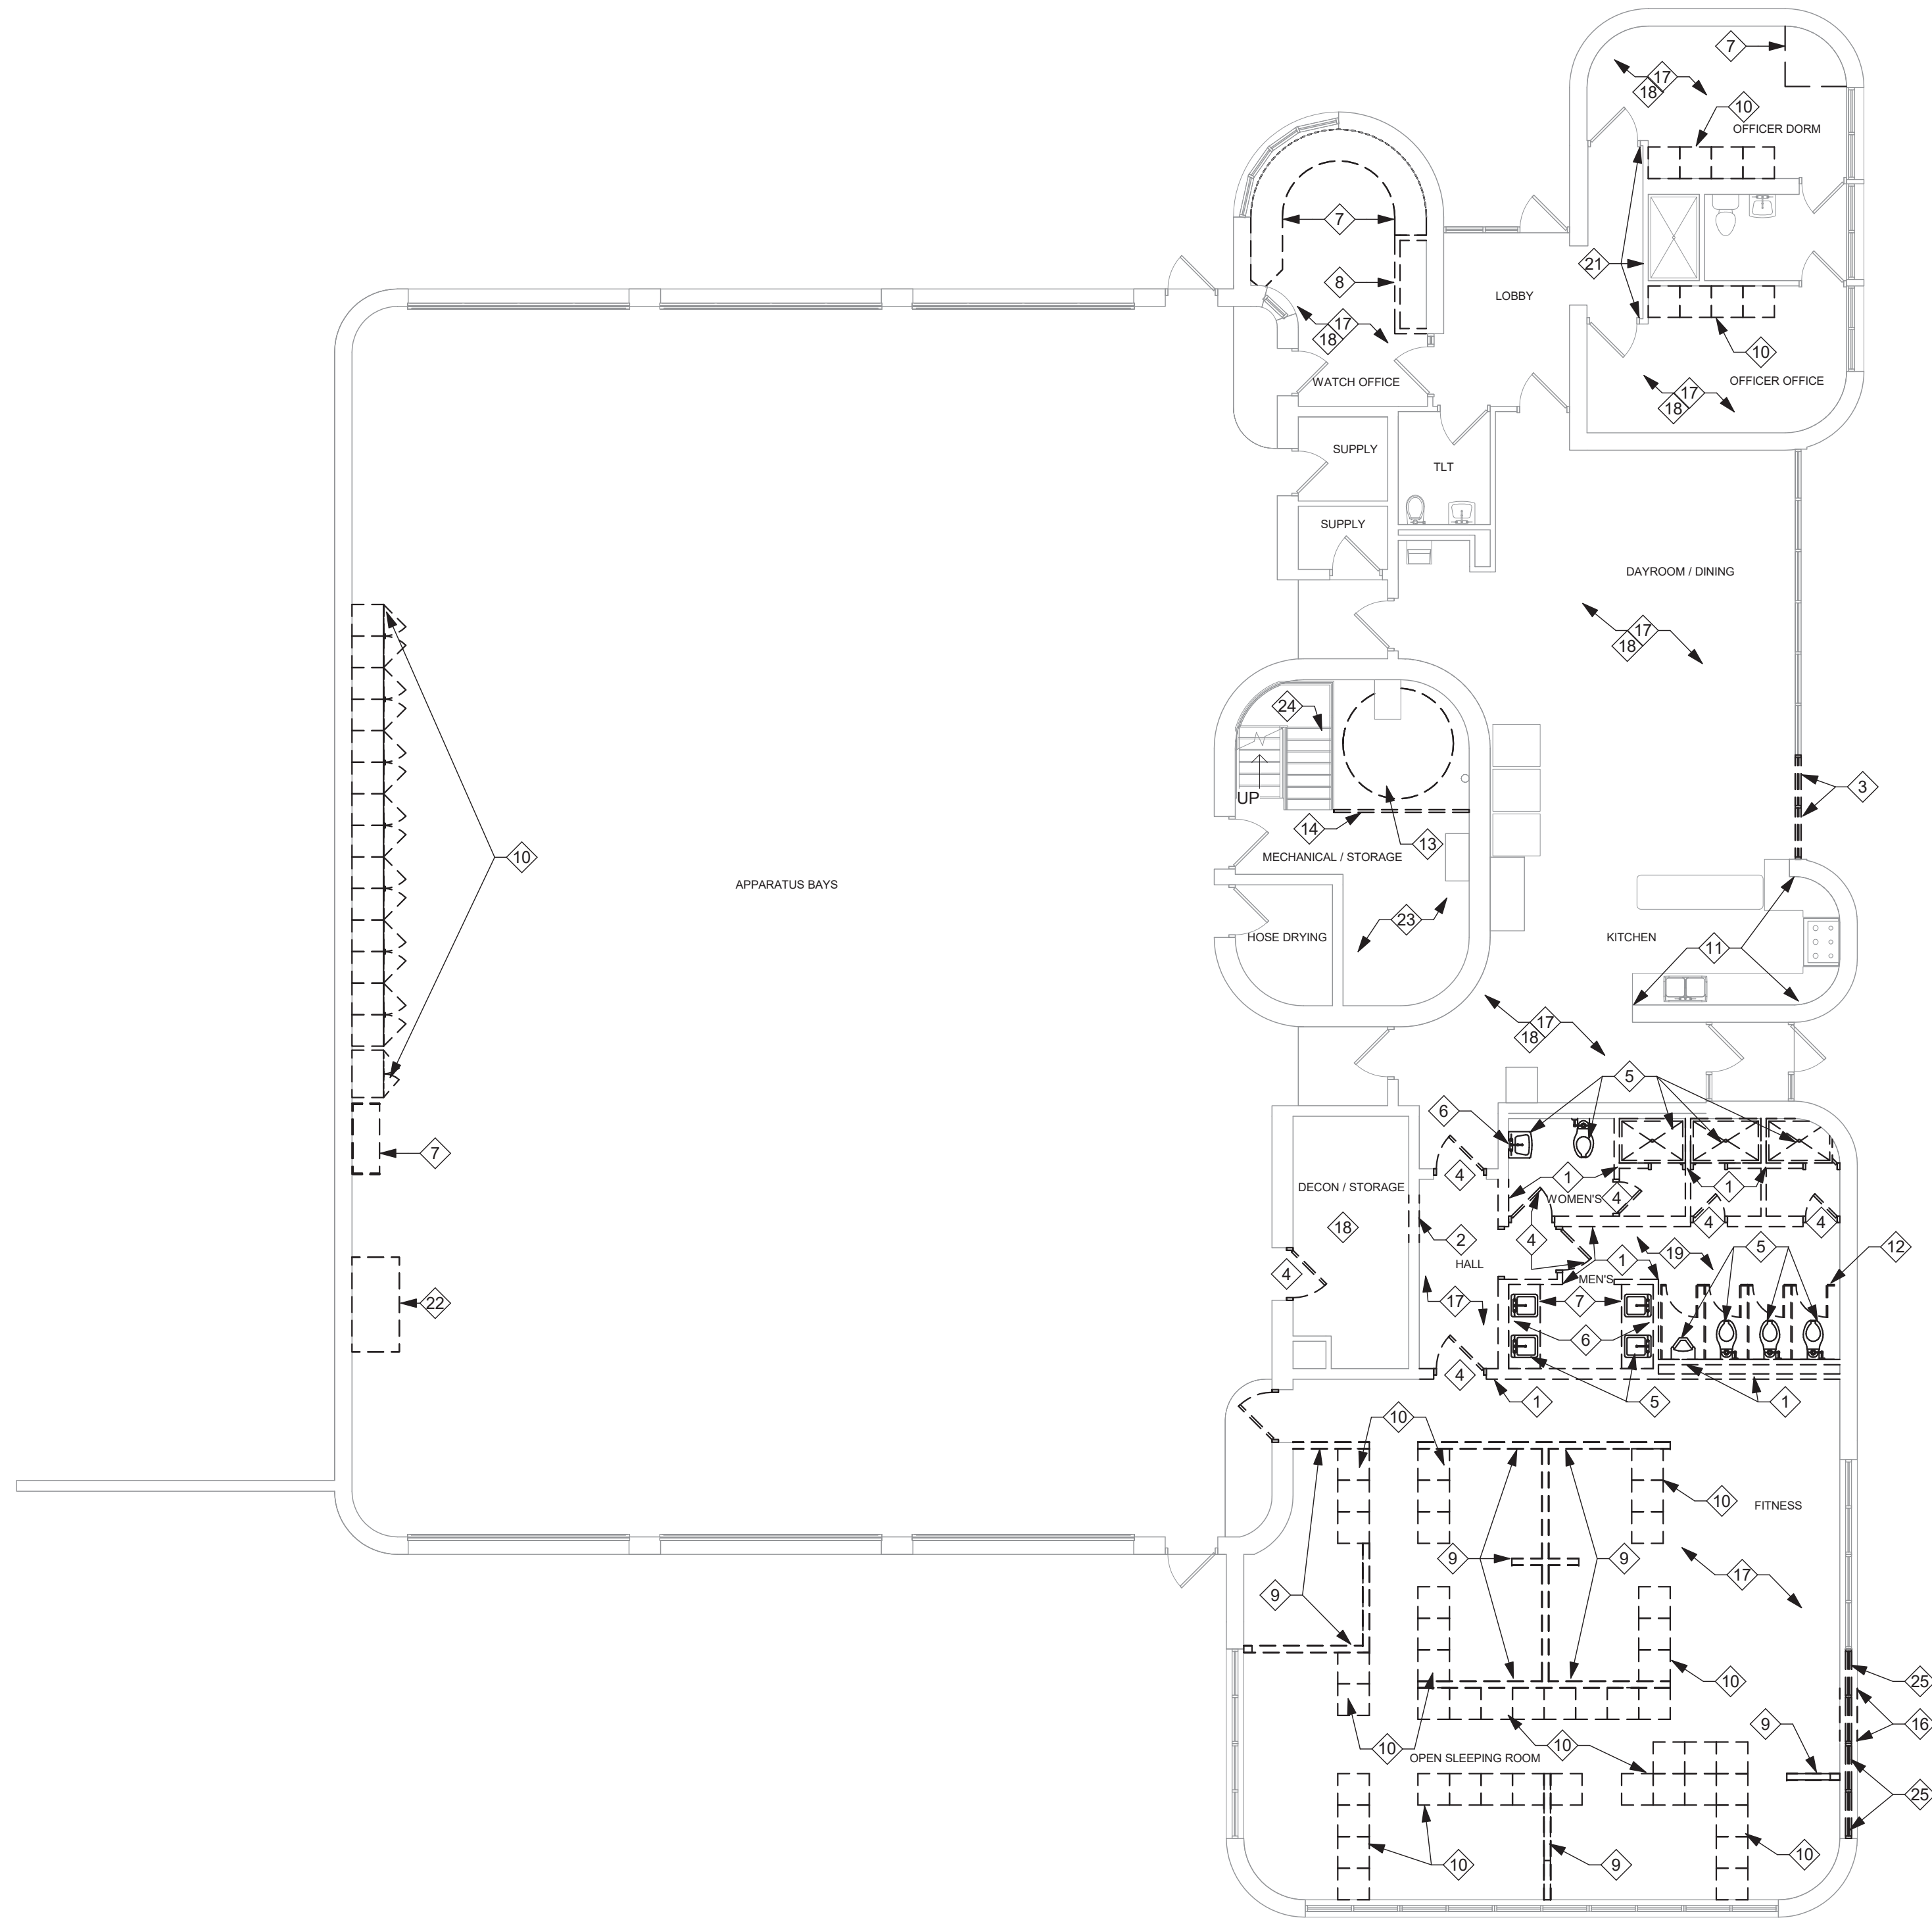


E1 DEMOLITION FLOOR PLAN - LEVEL 1
1/8" = 1'-0"

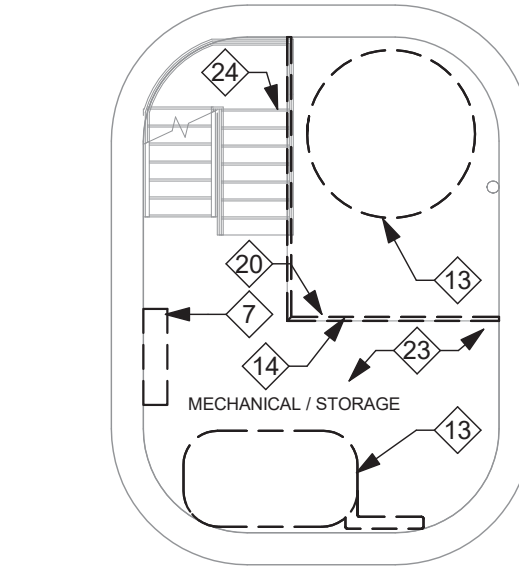

B5 DEMOLITION FLOOR PLAN - BASEMENT
1/8" = 1'-0"

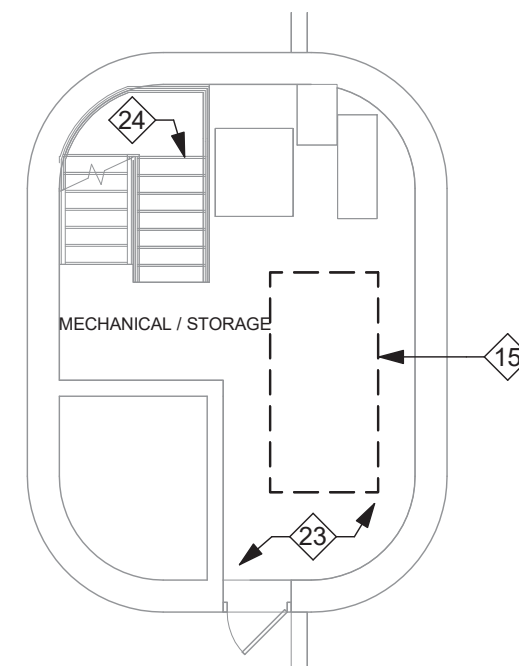

C5 DEMOLITION FLOOR PLAN - LEVEL 2
1/8" = 1'-0"

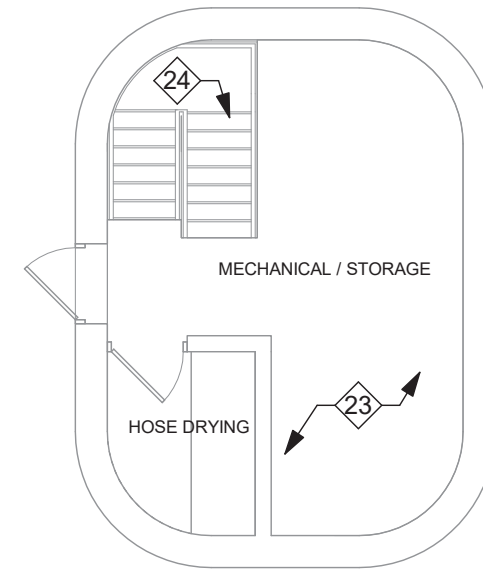

E5 DEMOLITION FLOOR PLAN - LEVEL 3
1/8" = 1'-0"

DEMOLITION NOTES

INDICATES DEMOLITION NOTE.

- REMOVE PORTION OF EXISTING CMU WALL IN PREPARATION FOR NEW CONSTRUCTION.
- REMOVE PORTION OF EXISTING WALL IN PREPARATION FOR NEW DOOR..
- REMOVE PORTION OF EXISTING STOREFRONT GLAZING SYSTEM IN PREPARATION FOR NEW DOOR.
- REMOVE EXISTING DOOR AND FRAME.
- REMOVE EXISTING PLUMBING FIXTURE. REFER TO PLUMBING DRAWINGS.
- REMOVE EXISTING TOILET ACCESSORIES.
- REMOVE EXISTING CASEWORK.
- REMOVE EXISTING MURPHY BED AND SURROUNDING CASEWORK.
- REMOVE EXISTING SLEEPING ROOM PARTITIONS.
- REMOVE EXISTING LOCKERS.
- REMOVE EXISTING TILE BACKSPASH.
- REMOVE EXISTING TOILET PARTITIONS.
- REMOVE EXISTING SOLAR HOT WATER TANK AND ASSOCIATED ABANDONED PLUMBING. REFER TO PLUMBING DRAWINGS.
- REMOVE EXISTING RAILING.
- REMOVE EXISTING AIR HANDLER. REFER TO HVAC DRAWINGS.
- REMOVE PORTION OF EXISTING WALL AND STOREFRONT WINDOW IN PREPARATION FOR NEW DOOR.
- REMOVE EXISTING LVIT/ VCT FLOORING. PREP. AND LEVEL CONCRETE SLAB FOR NEW FLOORING.
- PREP. EXISTING GYP. BD./ CMU WALLS FOR NEW FINISH.
- REMOVE EXISTING TILE FLOORING. PREP. AND LEVEL CONCRETE SLAB FOR NEW FLOORING.
- CUT LADDER OFF LEVEL WITH FLOOR.
- REMOVE WALL COVERING. PREP. GYP. BD. WALL FOR PAINT.
- EXISTING GENERATOR TO BE REMOVED. REFER TO ELECTRICAL DRAWINGS.
- PREPARE CMU WALLS FOR NEW PAINT.
- PREPARE METAL STAIRCASE AND RAILING FOR NEW PAINT.
- REMOVE PORTION OF EXISTING STOREFRONT WINDOW.

GENERAL NOTES

- DASHED LINES INDICATE BUILDING ELEMENTS, MATERIALS AND EQUIPMENT TO BE REMOVED.
- DURING DEMOLITION AND RECONSTRUCTION, ATTENTION MUST BE GIVEN TO MAINTAINING AND PRESERVING THE STRUCTURAL INTEGRITY OF THE BUILDING. IF ANY UNFORESEEN SITUATION DEVELOPS, NOTIFY THE OWNER AND ARCHITECT IMMEDIATELY.
- PRIOR TO CONSTRUCTION, FIELD INVESTIGATE EXISTING CONDITIONS AND NOTIFY THE OWNER AND ARCHITECT OF ANY DISCREPANCIES.
- RENOVATION WORK IS EXTENSIVE THROUGHOUT AREA OF WORK. ACCESSORIES IN MULTIPLE INSTANCES ARE TO BE REMOVED. CONTACT ARCHITECT IF ANY QUESTIONS.
- REPAIR, LEVEL, AND PREPARE EXISTING CONCRETE FLOOR SLABS TO RECEIVE NEW FLOOR FINISH INCLUDING AREAS WHERE OLD WALLS ARE REMOVED.
- REFER TO PLUMBING, HVAC & ELECTRICAL DRAWINGS FOR OTHER ITEMS THAT NEED TO BE REMOVED.

A

B

C

D

E

F

App Architecture
creative focused design



CITY OF DAYTON
**DAYTON FIRE DEPARTMENT
STATION 15**

2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/25	FOR CONSTRUCTION

DATE 08/01/25

JOB NO. 4284.00

DRAWN AEE

CHECKED CMS/TJB

COPYRIGHT © 2025 - App Architecture, Inc.


TITLE
DEMOLITION PLAN

SHEET NO.


A1.11

A
B
C
D
E
F


E1 LEVEL 1 FLOOR PLAN
1/8" = 1'-0"

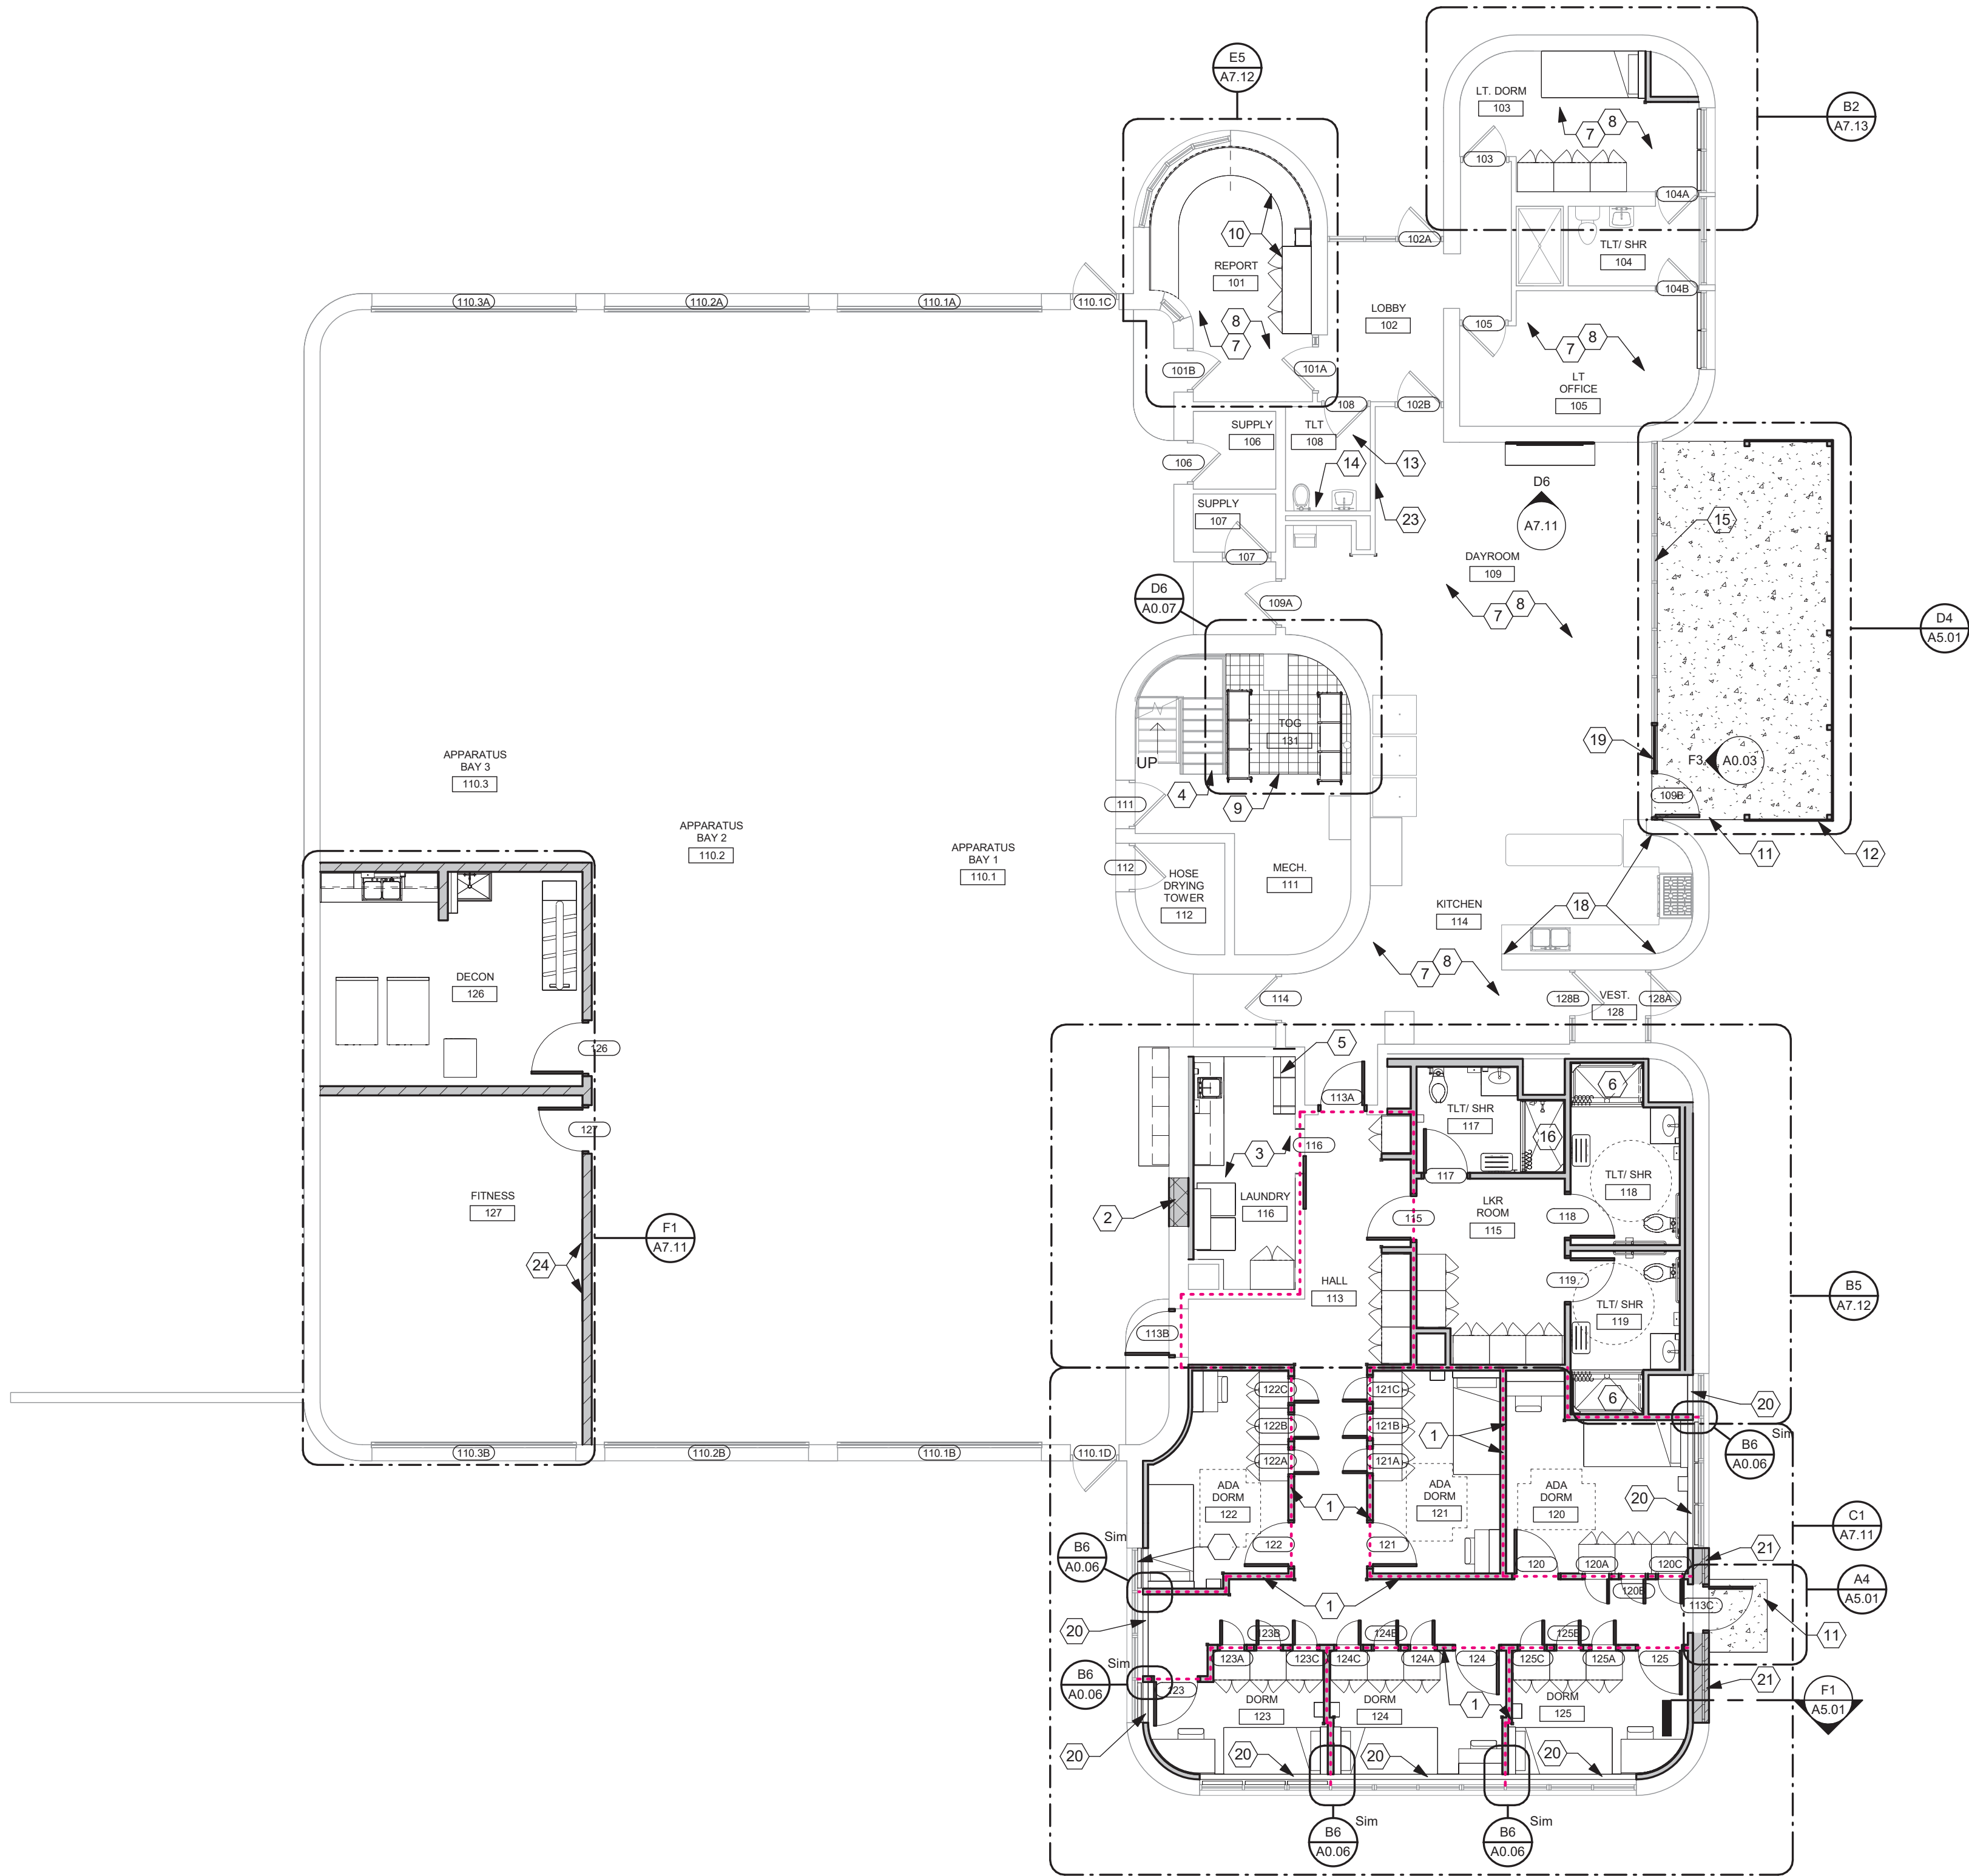


E5 LEVEL 3 FINISH FLOOR PLAN
1/8" = 1'-0"

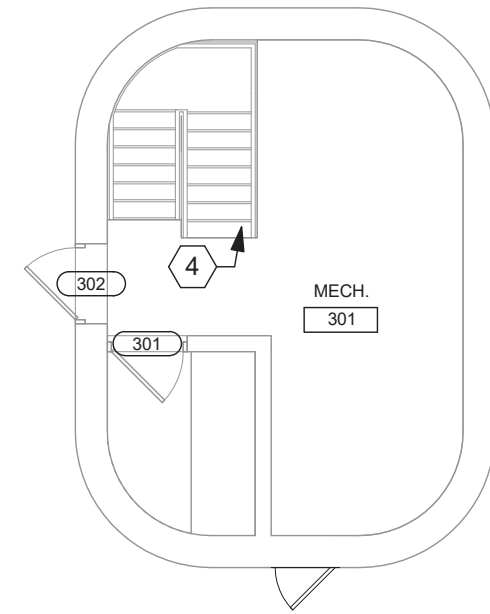

C5 LEVEL 2 FINISH FLOOR PLAN
1/8" = 1'-0"

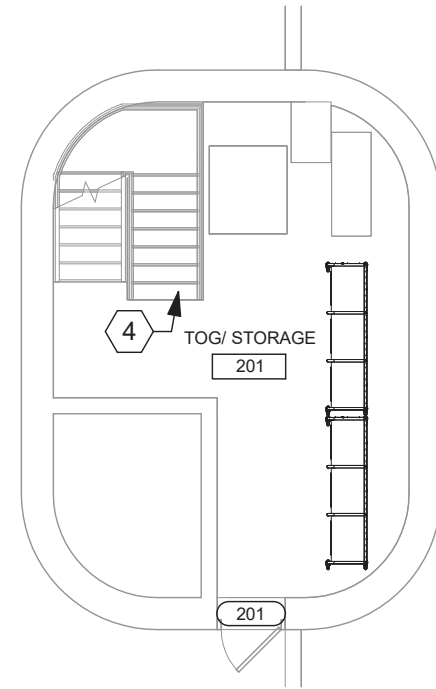

B5 BASEMENT FINISH FLOOR PLAN
1/8" = 1'-0"

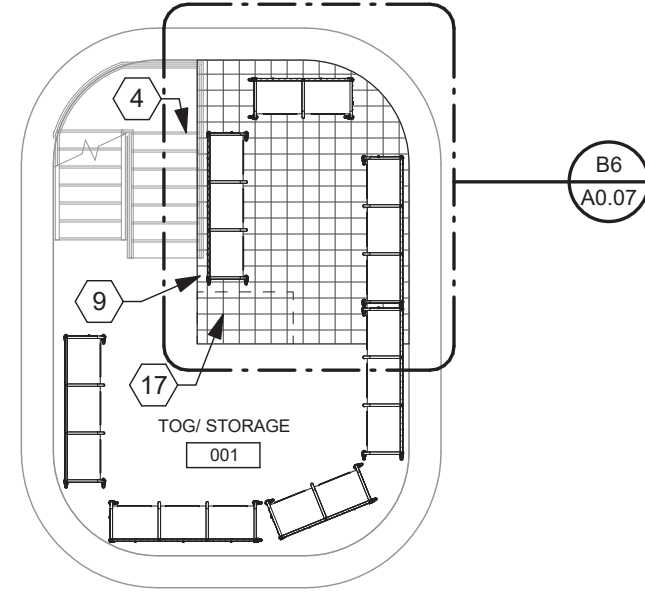

CONSTRUCTION NOTES

- (00) INDICATES CONSTRUCTION NOTE.
- 1/2 HOUR RATED PARTITION AROUND R-2 USE AS INDICATED. PROVIDE 1 HR. RATED CEILING ASSEMBLY (C1). REFER TO SHEET A0.04 FOR RATED ASSEMBLY DETAILS.
 - NEW WALL INFILL. MATCH ADJACENT EXISTING WALL. (12" AND 4" CMU INFILL).
 - INFILL FLOOR 6" WITH FRT WOOD STRINGERS AND PLYWOOD TO MATCH STATION FLOOR LEVEL.
 - PAINT METAL STAIRCASE AND RAILING EP-4.
 - ADJUSTABLE SHELVES. REFER TO CASEWORK DETAILS.
 - 36" X 60" ADA SHOWER BASE.
 - ROOM TO RECEIVE NEW FLOORING. REFER TO ROOM FINISH SCHEDULE.
 - ROOM TO RECEIVE NEW PAINT. REFER TO ROOM FINISH SCHEDULE.
 - INFILL FLOOR WITH STEEL GRATE FLOOR.
 - NEW PLASTIC LAMINATE COUNTER AND CASEWORK.
 - NEW CONCRETE SLAB ON GRADE. REFER TO SHEET A5.01 FOR DETAILS.
 - NEW WOOD PATIO WALL. REFER TO SHEET A5.01 FOR DETAILS.
 - CLEAN CLEAN GROUT AND TILES ON FLOOR AND WALLS.
 - REPAINT WOOD GRAIN LIGHT FIXTURE P-1
 - PROVIDE AND INSTALL PERFORATED WINDOW DECALS ON EXTERIOR OF STOREFRONT. ENTIRE GLAZED AREA TO BE COVERED. 8'-0" X 28'-0" DIVIDED INTO (8) SECTIONS. ART SELECTED BY OWNER. BASIS OF DESIGN: SIGNS.COM, PERFORATED WINDOW DECALS WITH PROTECTIVE LAMINATE.
 - 36" X 60" CURB STYLE SHOWER BASE.
 - ACCESS HATCH IN STEEL GRATE FLOOR AT LADDER.
 - REPLACE TILE BACKSPLASH WITH SSB-1.
 - NEW STOREFRONT AND DOOR TO MATCH EXISTING.
 - NEW WINDOW SILL. REFER TO DETAIL E3/A0.06.
 - INFILL EXTERIOR WALL WHERE STOREFRONT HAS BEEN REMOVED. REFER F1/A5.01 FOR DETAILS.
 - STATION CREST VINYL WALL GRAPHIC LOCATION. 48" X 48". ART TO BE SUPPLIED BY OWNER.
 - 42" X 84" FRAMELESS MIRROR. MOUNT TO WALL @ 6" A.F.F.

GENERAL NOTES

- ALL INTERIOR PARTITIONS ARE TYPE A1 U.N.O.
- ALL PARTITIONS TO BE CONSTRUCTED TO DECK ABOVE U.N.O.
- PROVIDE FIRE RETARDANT WOOD BLOCKING BEHIND ALL WALL HUNG ACCESSORIES, CABINETS, FURNISHINGS, HANDRAILS U.N.O.
- REFER TO EQUIPMENT PLAN AND ELEVATIONS FOR TOILET ROOM ACCESSORY CALLOUTS.
- FOR SIDEWALKS AND EXTERIOR PADS REFER TO CIVIL SITE PLAN AND LANDSCAPE PLAN.
- ALL EXPOSED STRUCTURAL STEEL TO BE EPOXY PAINTED.
- HINGE SIDE OF DOORS ARE 6" FROM ADJACENT WALL U.N.O.
- DIMENSIONS ARE FROM FINISHED FACE TO FINISHED FACE U.N.O.
- FURNITURE SHOWN FOR REFERENCE ONLY.
- REFER TO ENLARGED PLANS FOR ADDITIONAL DETAILS.

APP Architecture
creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com

**CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15**


2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE

NO.	DATE	DESCRIPTION
08/01/25	FOR CONSTRUCTION	

REFERENCE PLANS

TITLE	REFERENCE PLANS
SHEET NO.	A1.12

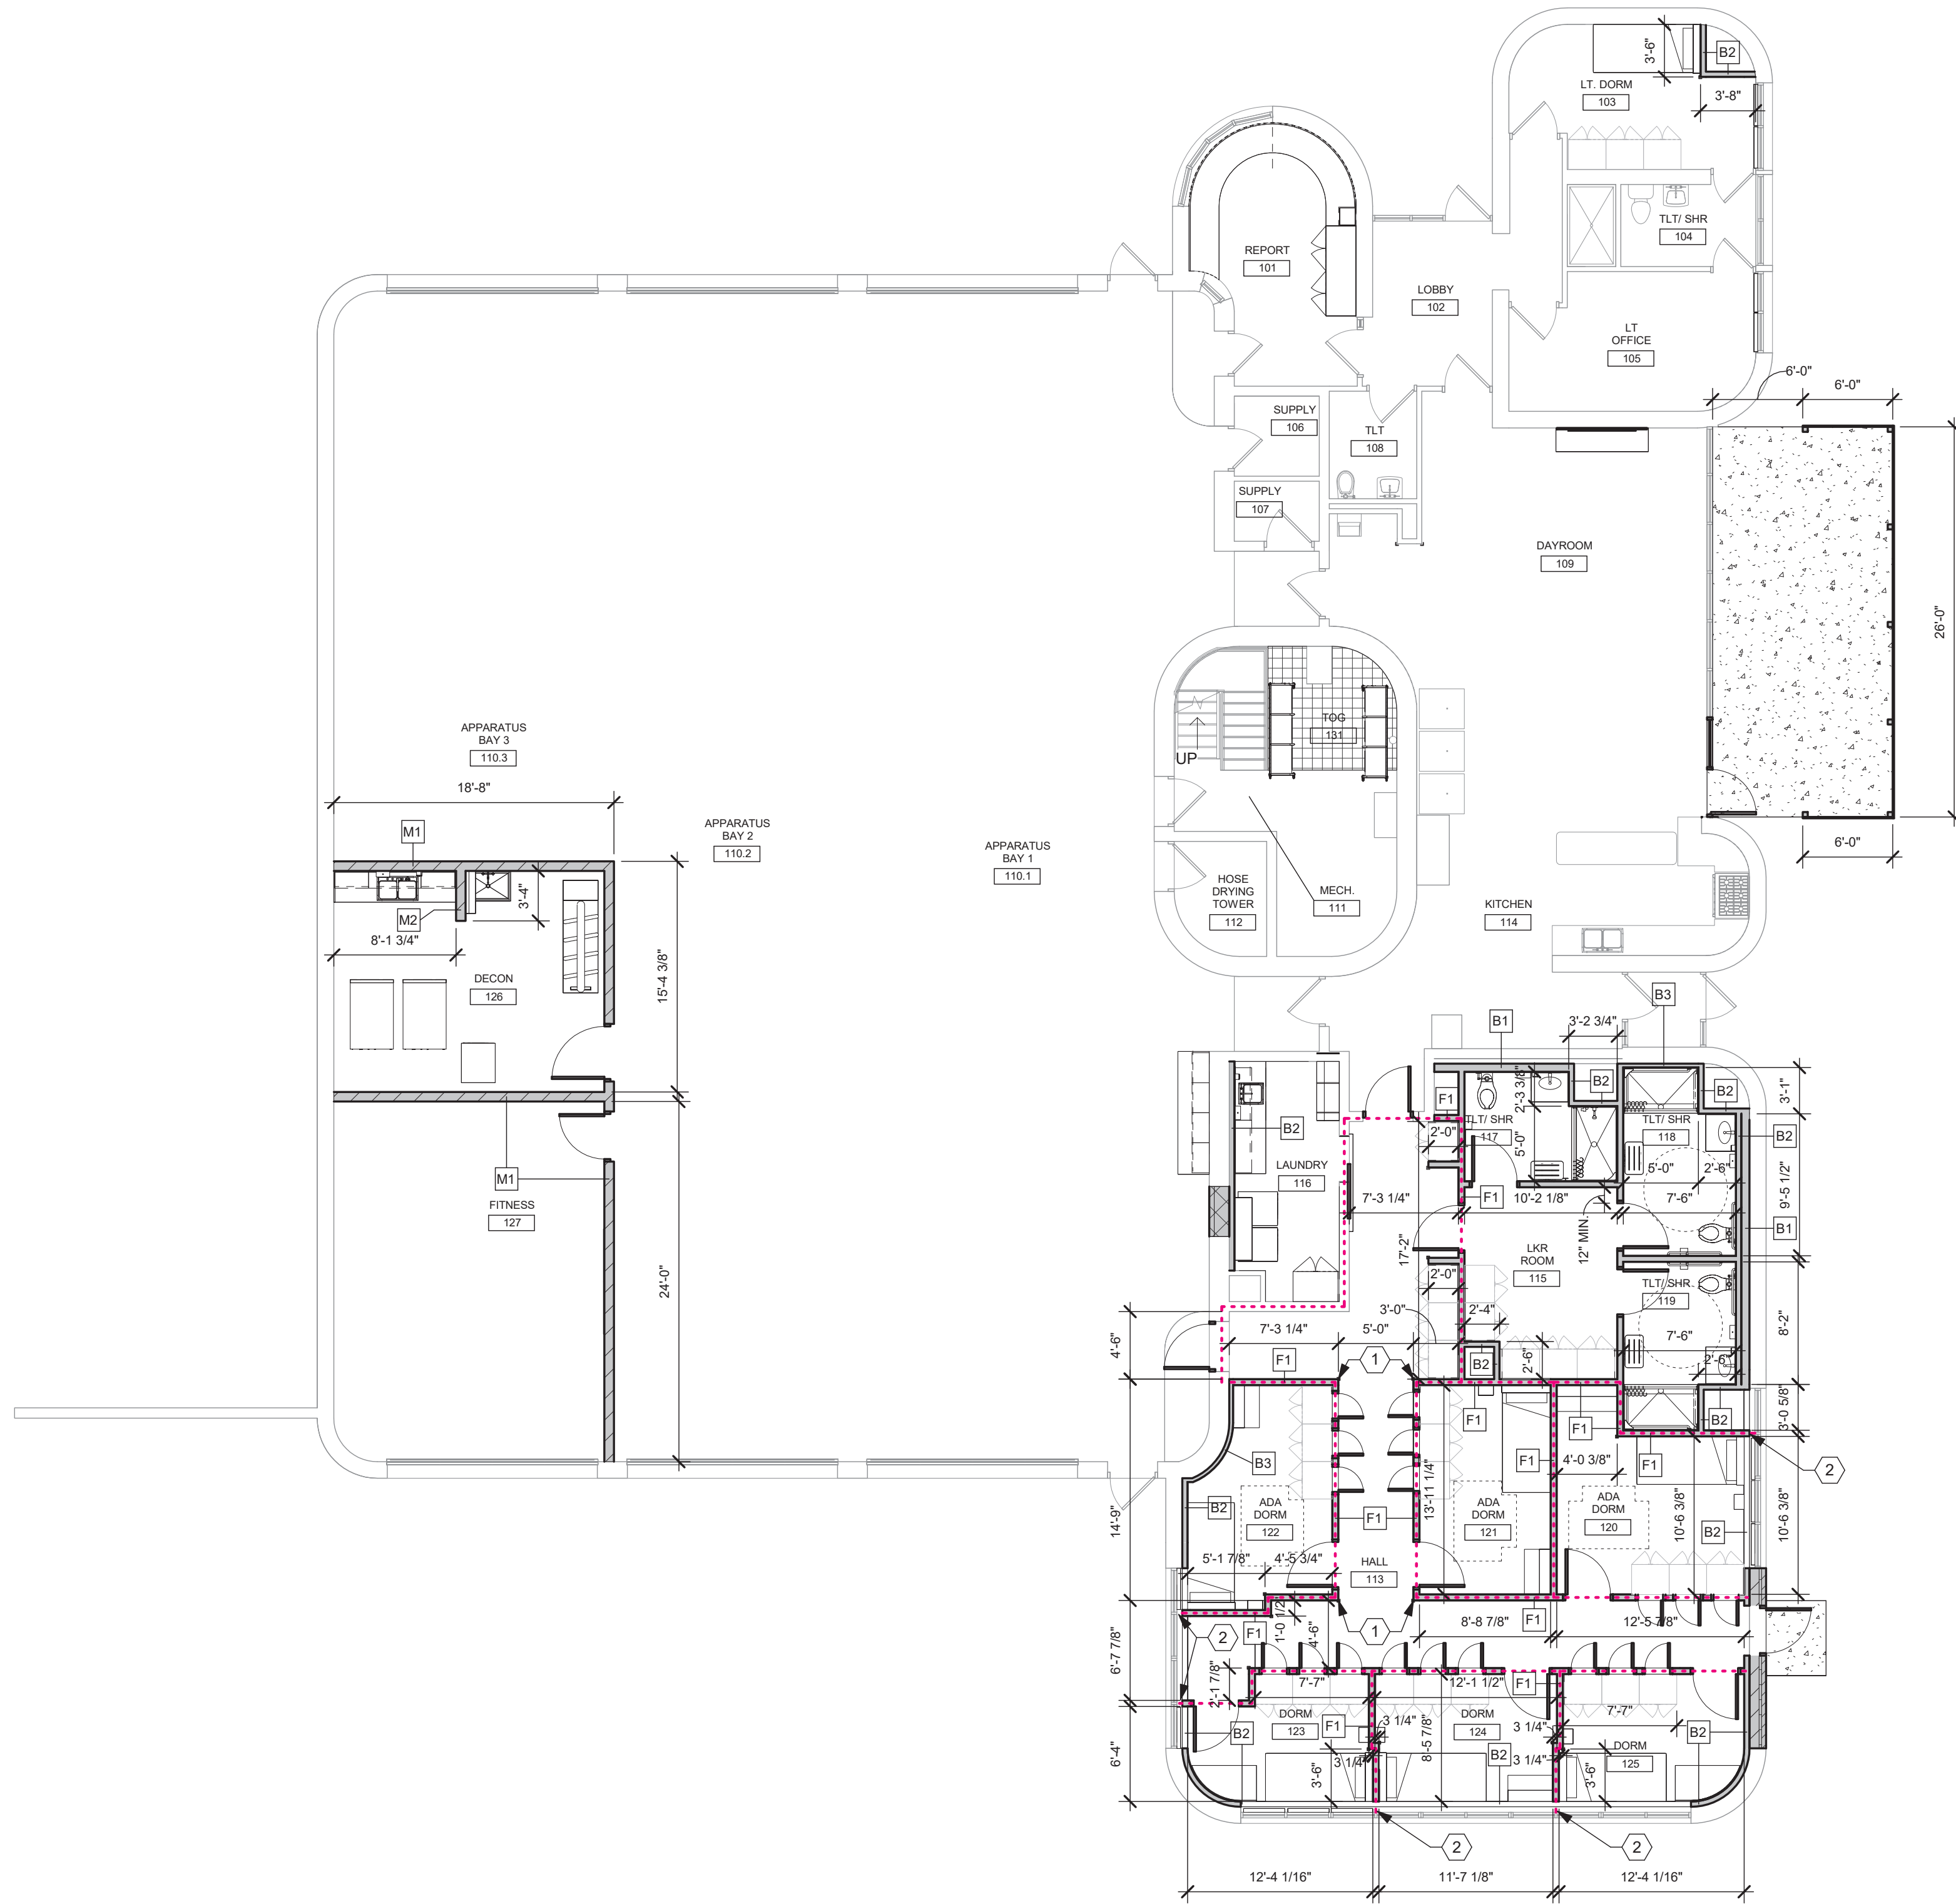

E1 LEVEL 1 FLOOR PLAN
1/8" = 1'-0"



E5 BASEMENT FLOOR PLAN
1/8" = 1'-0"

B5 LEVEL 3 FLOOR PLAN
1/8" = 1'-0"

C5 LEVEL 2 FLOOR PLAN
1/8" = 1'-0"

CONSTRUCTION NOTES

(00) INDICATES CONSTRUCTION NOTE.

- 1 ALIGN
- 2 INTENTION IS FOR NEW PARTITIONS TO INTERSECT WINDOW MULLIONS TO ACHIEVE 30 MINUTE FIRE RATING BETWEEN NEW DORM ROOMS. REVIEW ANY DISCREPANCIES WITH ARCHITECT DURING FRAMING LAYOUT.

GENERAL NOTES

- A. ALL INTERIOR PARTITIONS ARE TYPE A1 U.N.O.
- B. ALL PARTITIONS TO BE CONSTRUCTED TO DECK ABOVE U.N.O.
- C. PROVIDE FIRE RETARDANT WOOD BLOCKING BEHIND ALL WALL HUNG ACCESSORIES, CABINETS, FURNISHINGS, HANDRAILS U.N.O.
- D. REFER TO EQUIPMENT PLAN AND ELEVATIONS FOR TOILET ROOM ACCESSORY CALLOUTS.
- E. FOR SIDEWALKS AND EXTERIOR PADS REFER TO CIVIL SITE PLAN AND LANDSCAPE PLAN.
- F. ALL EXPOSED STRUCTURAL STEEL TO BE EPOXY PAINTED.
- G. HINGE SIDE OF DOORS ARE 6" FROM ADJACENT WALL U.N.O.
- H. DIMENSIONS ARE FROM FINISHED FACE TO FINISHED FACE U.N.O.
- I. FURNITURE SHOWN FOR REFERENCE ONLY.
- J. REFER TO ENLARGED PLANS FOR ADDITIONAL DETAILS.

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/25	FOR CONSTRUCTION

DATE		08/01/25
JOB NO.		4284.00
DRAWN		AEE
CHECKED		CMS/TJB
COPYRIGHT © 2025 - App Architecture, Inc.		
TITLE		DIMENSION PLANS

SHEET NO.

01/2025 1:22:29 PM

A

B

C

D

E

F

F1 LEVEL 1 FLOOR PLAN
1/8" = 1'-0"

F5 LEVEL 3 FLOOR PLAN
1/8" = 1'-0"

D5 LEVEL 2 FLOOR PLAN
1/8" = 1'-0"

B5 BASEMENT FLOOR PLAN
1/8" = 1'-0"

EQUIPMENT SCHEDULE CFCI		
TYPE	DESCRIPTION	COMMENTS
EQ-01	MOP HANGER WITH OVERSHELF	REFER TO SPECIFICATIONS
EQ-08	ROOM DARKENING ROLL SHADE	REFER TO SPECIFICATIONS
EQ-09	BLACKOUT ROLL SHADE	REFER TO SPECIFICATIONS
EQ-16	ROOM DARKENING ROLL SHADE	REFER TO SPECIFICATIONS
EQ-17	3' - 6" X 7' - 0" MIRROR	REFER TO SPECIFICATIONS
TS-03	MIRROR, WALL - 18" X 36"	REFER TO SPECIFICATIONS
TS-04	GRAB BAR, STAINLESS STEEL, (3) PIECE ASSEMBLY, 18" x 1.5" DIA. 42" x 1.5" DIA	REFER TO SPECIFICATIONS
TS-05	SOAP DISH, CORNER	<varies>
TS-06	GRAB BAR, STAINLESS STEEL 30" x 1.5" DIA.	REFER TO SPECIFICATIONS
TS-07	GRAB BAR, STAINLESS STEEL 48" x 1.5" DIA.	REFER TO SPECIFICATIONS
TS-08	TOILET TISSUE DISPENSER	REFER TO SPECIFICATIONS
TS-09	SEAT, FOLDING	REFER TO SPECIFICATIONS
TS-10	SHOWER ROD AND CURTAIN	REFER TO SPECIFICATIONS
TS-11	ROBE HOOK	MOUNT @ 4' - 6" A.F.F.

EQUIPMENT SCHEDULE OFCI		
TYPE	DESCRIPTION	COMMENTS
EQ-02	MOBILE TURN OUT GEAR LOCKERS 24" X 20", 2 PACK	
EQ-03	MOBILE TURN OUT GEAR LOCKERS 24" X 20", 3 PACK	
EQ-05	DECON GEAR WASHER	
EQ-06	RESIDENTIAL CLOTHES WASHER	
EQ-07	RESIDENTIAL CLOTHES DRYER	
EQ-10	60" SMART TV	
TS-01	PAPER TOWEL DISPENSER	
TS-02	SOAP DISPENSER	

EQUIPMENT SCHEDULE OFOI		
TYPE	DESCRIPTION	COMMENTS
EQ-04	DECON GEAR DRYER	

App Architecture
creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com

STATE OF OHIO
TIMOTHY J. BEMENT
12/05
Professional Engineer
Timothy J. Bement License #12305
Expiration Date 12/31/2025

CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15
2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE

NO.	DATE	DESCRIPTION
08/01/25	FOR CONSTRUCTION	

TITLE
EQUIPMENT PLAN

SHEET NO.
A1.14

01/2025 1:23:31 PM

A

B

C

D

E

F

1

2


3

4

5

6


7

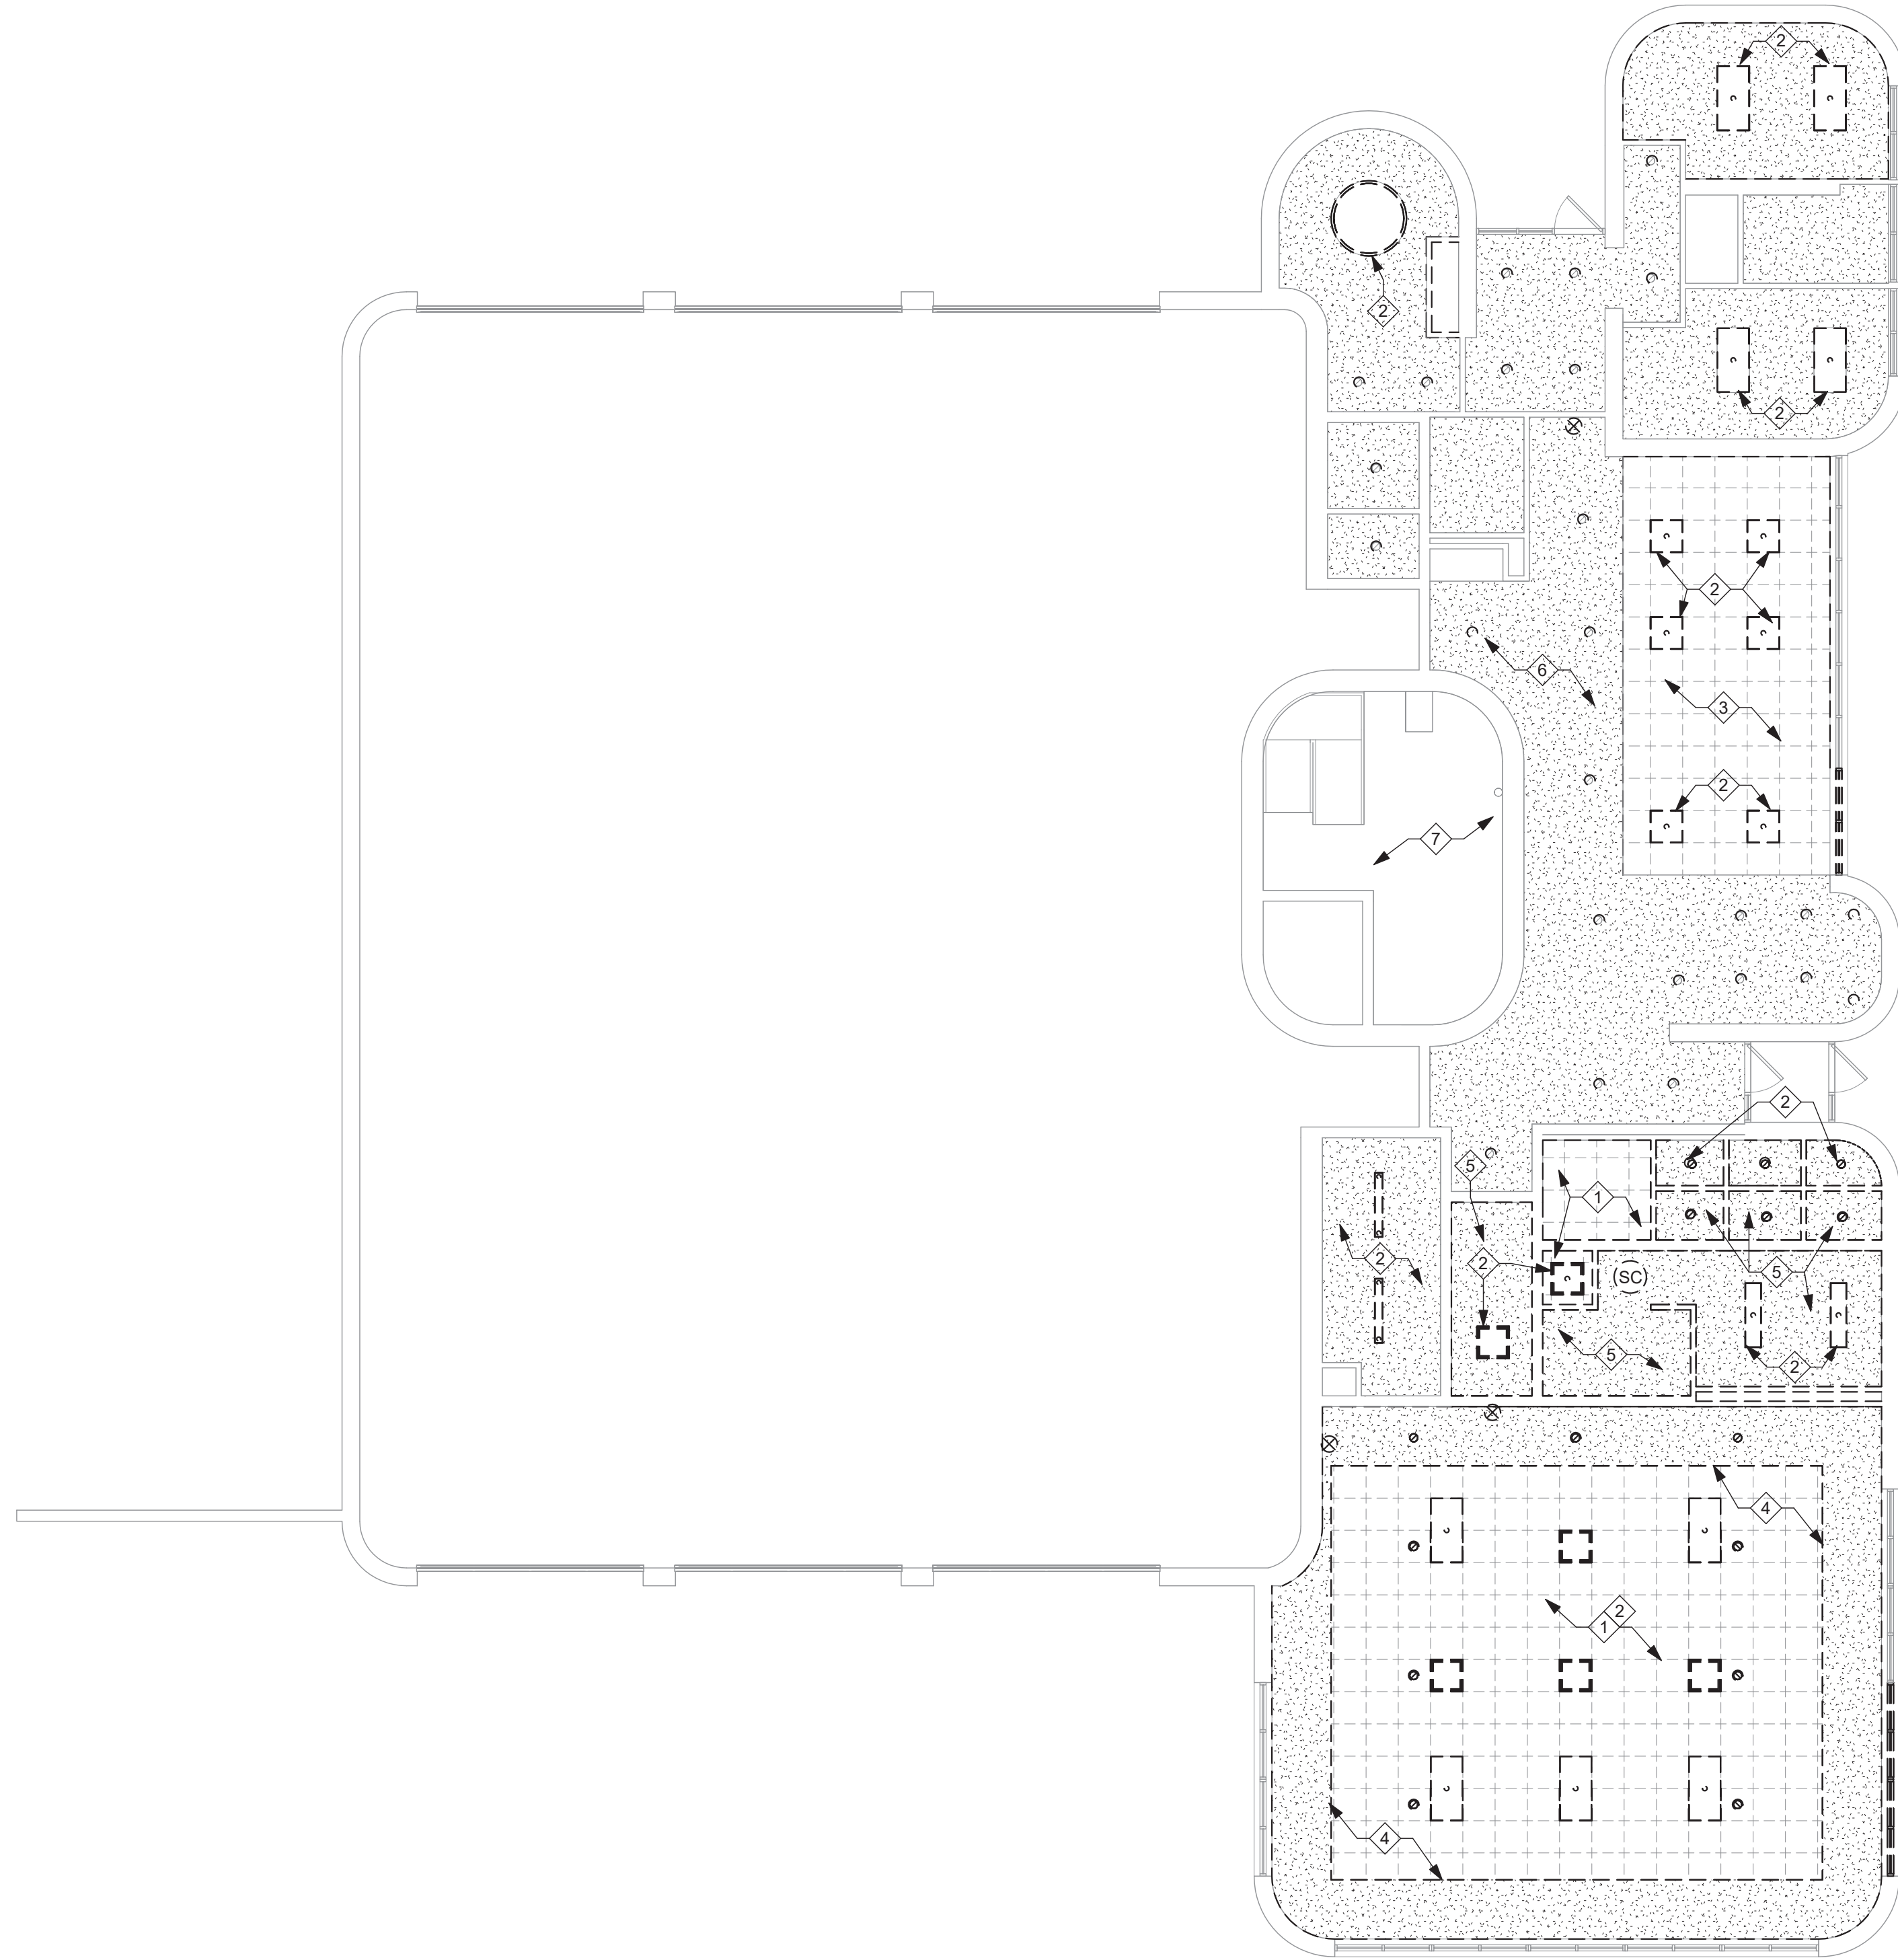


E1 DEMOLITION CEILING PLAN - LEVEL 1
1/8" = 1'-0"




E5 DEMOLITION CEILING PLAN - LEVEL 3
1/8" = 1'-0"

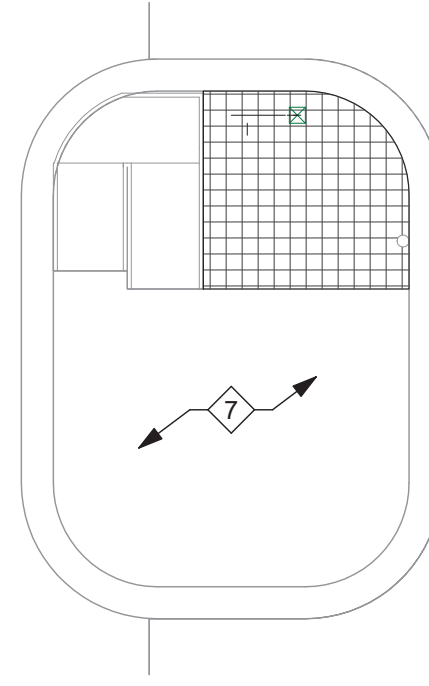

B5 DEMOLITION CEILING PLAN - BASEMENT
1/8" = 1'-0"

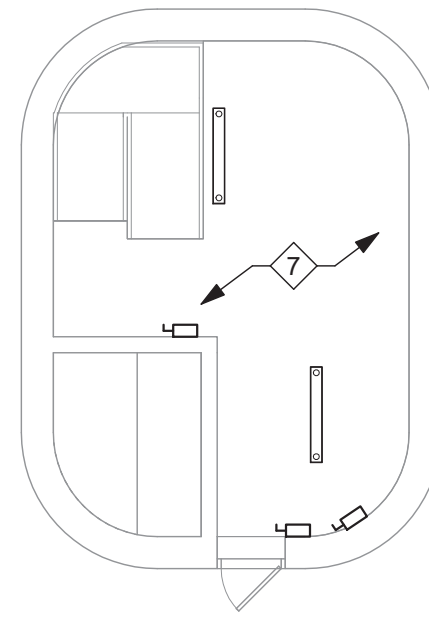

D5 DEMOLITION CEILING PLAN - LEVEL 2
1/8" = 1'-0"

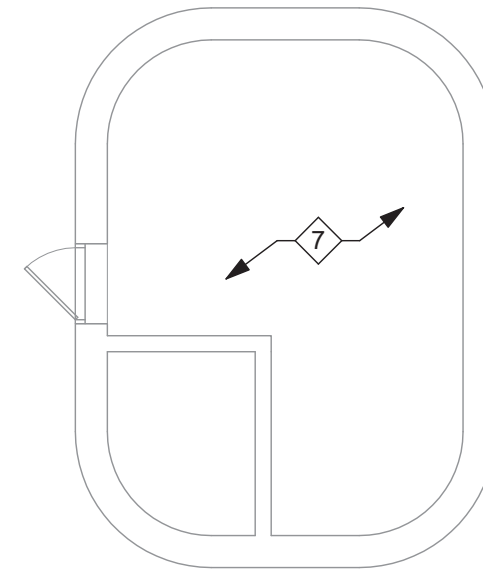

DEMOLITION NOTES

INDICATES DEMOLITION NOTE.

- REMOVE EXISTING ACOUSTIC paneled ceiling ASSEMBLY (PADS, GRID, AND WIRES)
- REMOVE EXISTING LIGHT FIXTURES, MECHANICAL DIFFUSERS, AND OTHER CEILING MOUNTED DEVICES. REFER TO P.M.E. DRAWINGS FOR MORE INFO. TYP. (NOT ALL DEVICES SHOWN).
- REMOVE EXISTING CEILING PADS.
- REMOVE EXISTING GYP. BOARD BULKHEADS AND SOFFITS.
- REMOVE EXISTING GYP. BOARD CEILING.
- REMOVE PORTIONS OF GYP. BOARD CEILING. FOR DEMO OF HVAC DEVICES. REFER TO MECH. DRAWINGS.
- PREPARE EXPOSED STRUCTURE FOR NEW PAINT.

GENERAL NOTES

- DASHED LINES INDICATE BUILDING ELEMENTS, MATERIALS AND EQUIPMENT TO BE REMOVED.
- DURING DEMOLITION AND RECONSTRUCTION, ATTENTION MUST BE GIVEN TO MAINTAINING AND PRESERVING THE STRUCTURAL INTEGRITY OF THE BUILDING. IF ANY UNFORESEEN SITUATION DEVELOPS, NOTIFY THE OWNER AND ARCHITECT IMMEDIATELY.
- PRIOR TO CONSTRUCTION, FIELD INVESTIGATE EXISTING CONDITIONS AND NOTIFY THE OWNER AND ARCHITECT OF ANY DISCREPANCIES.
- RENOVATION WORK IS EXTENSIVE THROUGHOUT AREA OF WORK. ACCESSORIES IN MULTIPLE INSTANCES ARE TO BE REMOVED. CONTACT ARCHITECT IF ANY QUESTIONS.
- REPAIR, LEVEL, AND PREPARE EXISTING CONCRETE FLOOR SLABS TO RECEIVE NEW FLOOR FINISH INCLUDING AREAS WHERE OLD WALLS ARE REMOVED.
- REFER TO PLUMBING, HVAC & ELECTRICAL DRAWINGS FOR OTHER ITEMS THAT NEED TO BE REMOVED.

A

B

C

D

E

F

APP Architecture
creative focused design



CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION
08/01/25		FOR CONSTRUCTION

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB

COPYRIGHT © 2025 - App Architecture, Inc.
TITLE
**DEMOLITION REFLECTED
CEILING PLAN**

SHEET NO.

A2.11



A


B

C


D

E


F

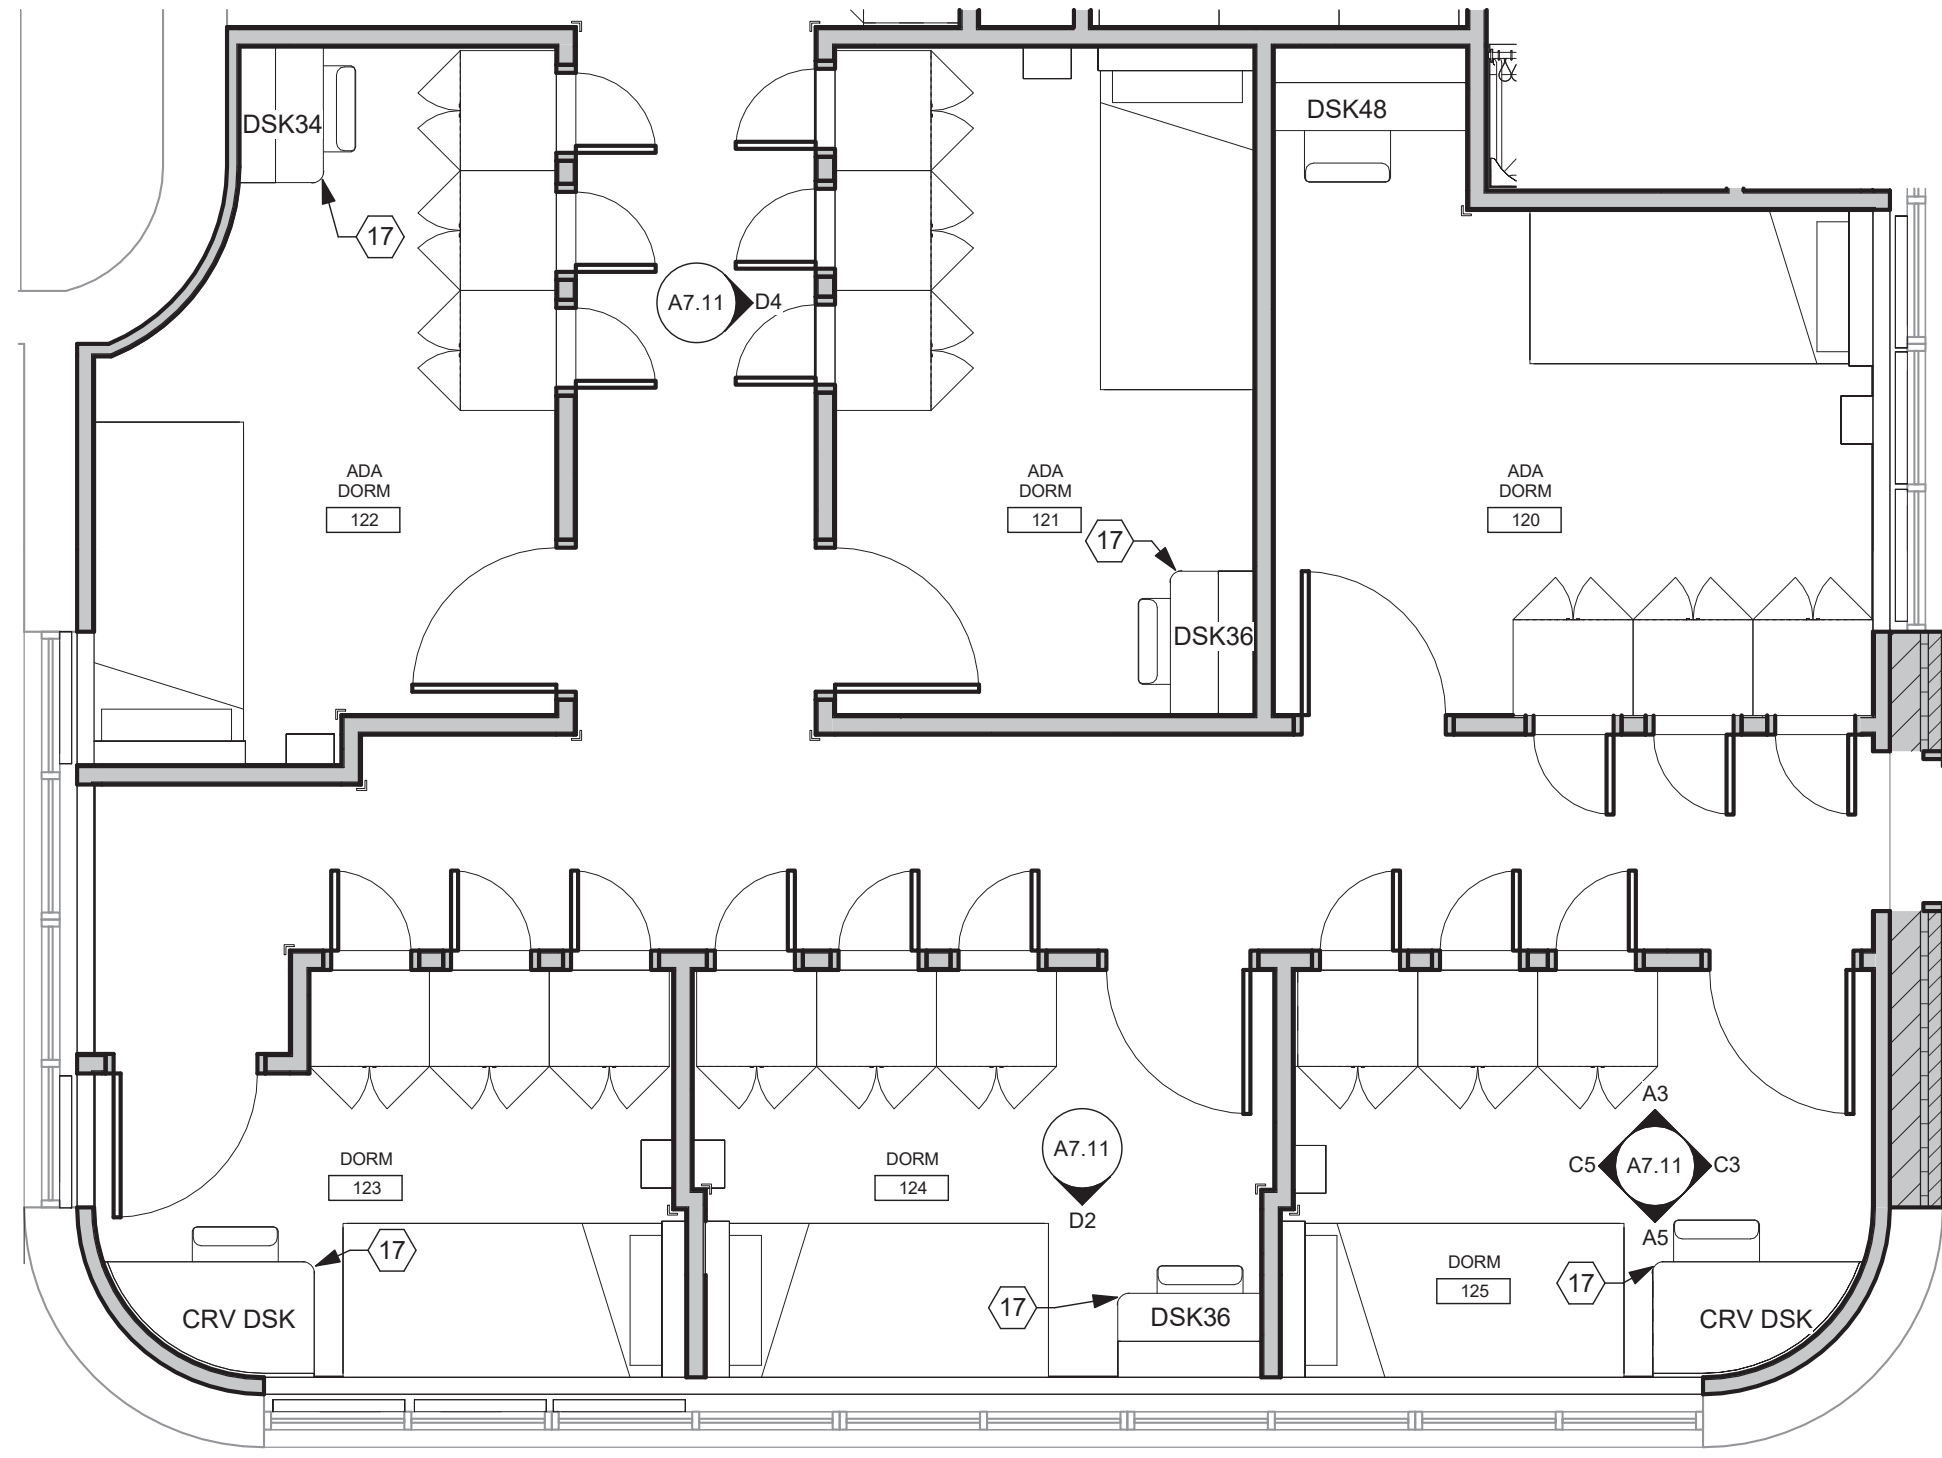


(C1) ENLARGED FLOOR PLAN A
1/4" = 1'-0"

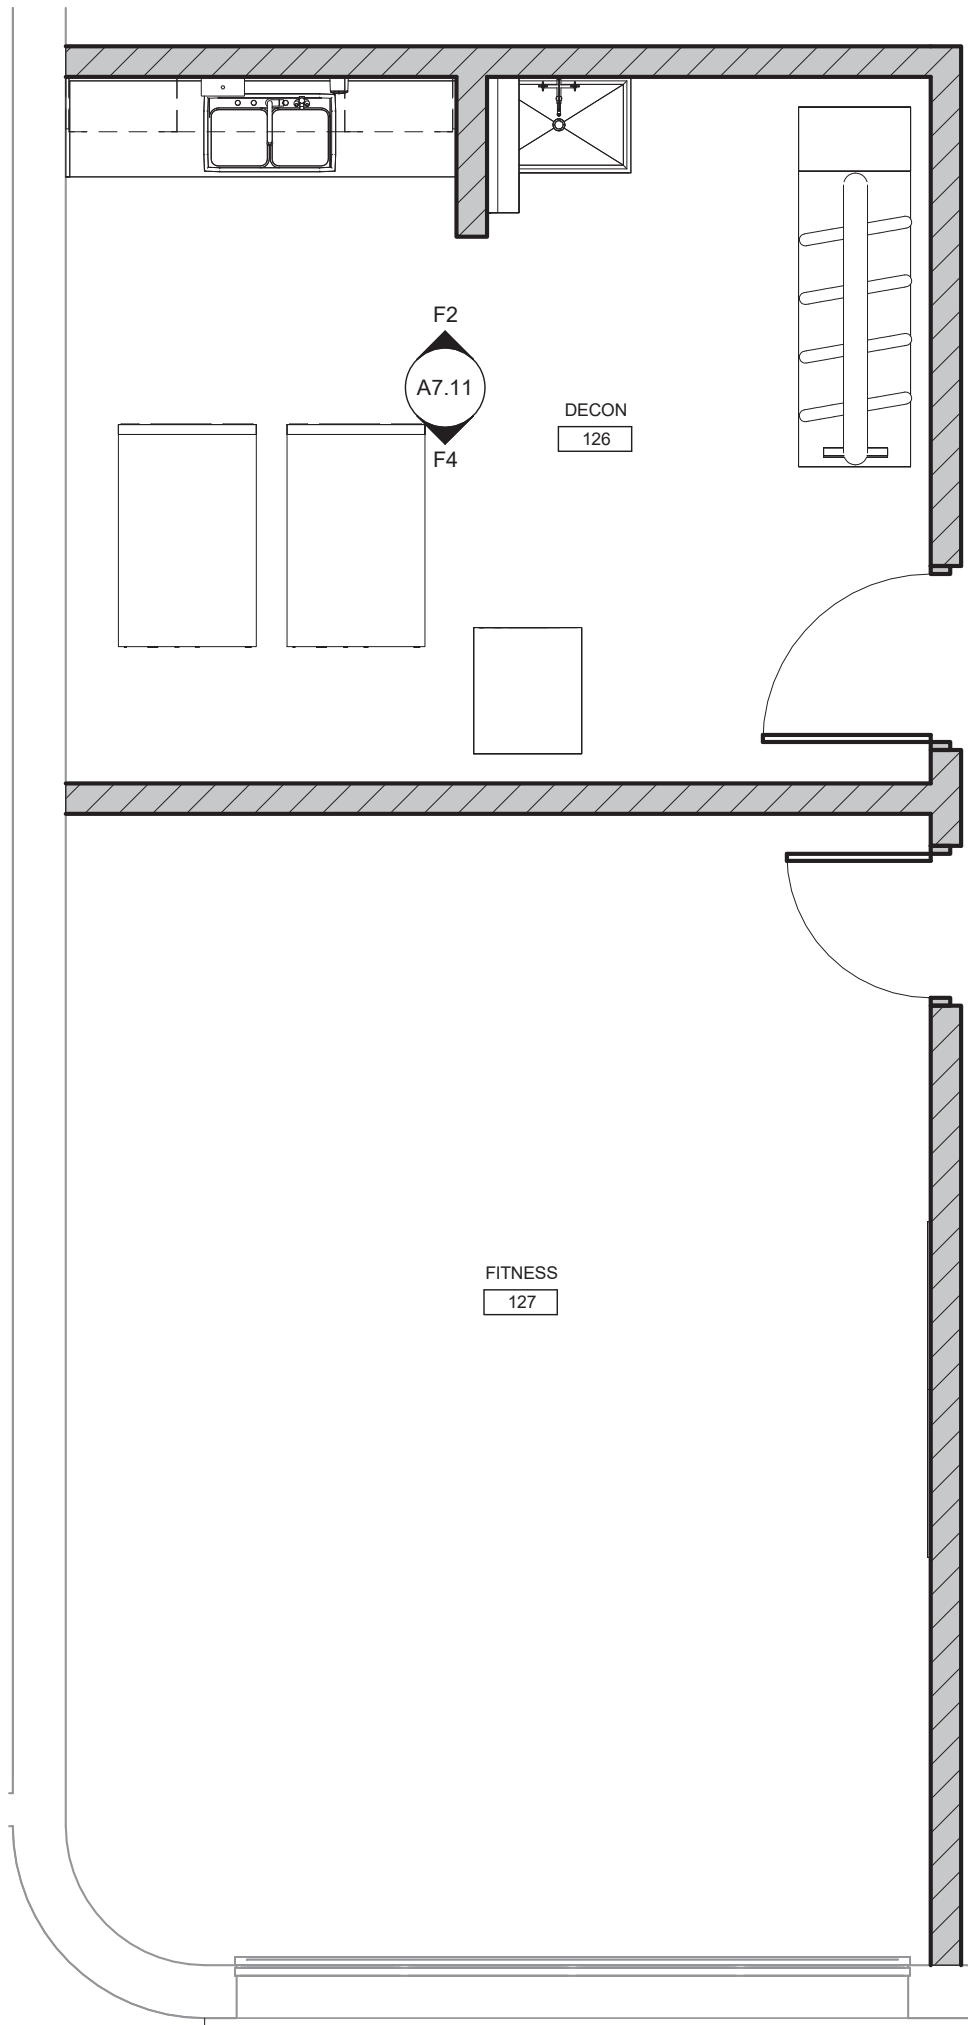


(F1) ENLARGED FLOOR PLAN B
1/4" = 1'-0"

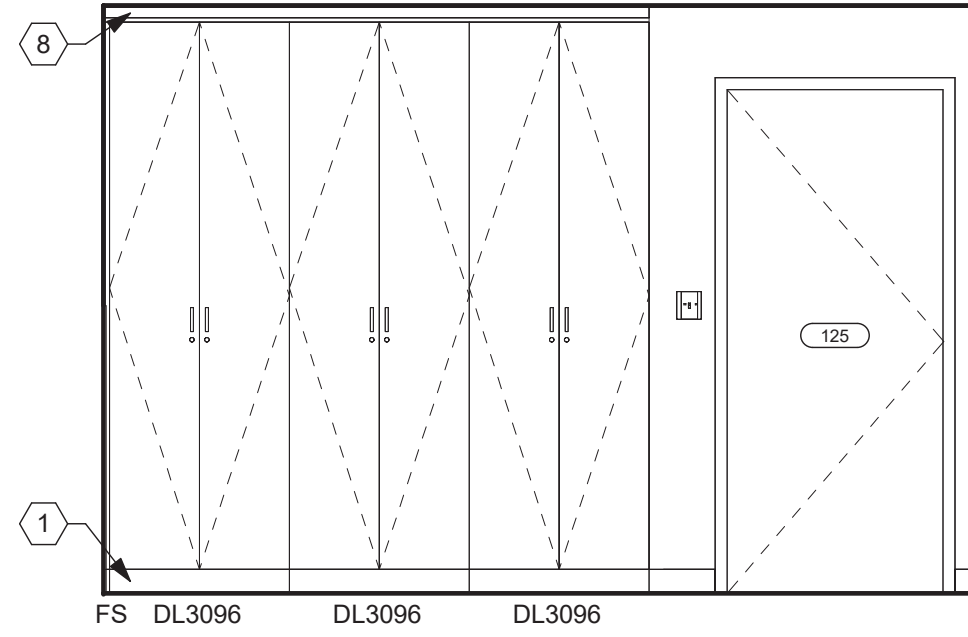


(A3) 125 DORM NORTH
3/8" = 1'-0"

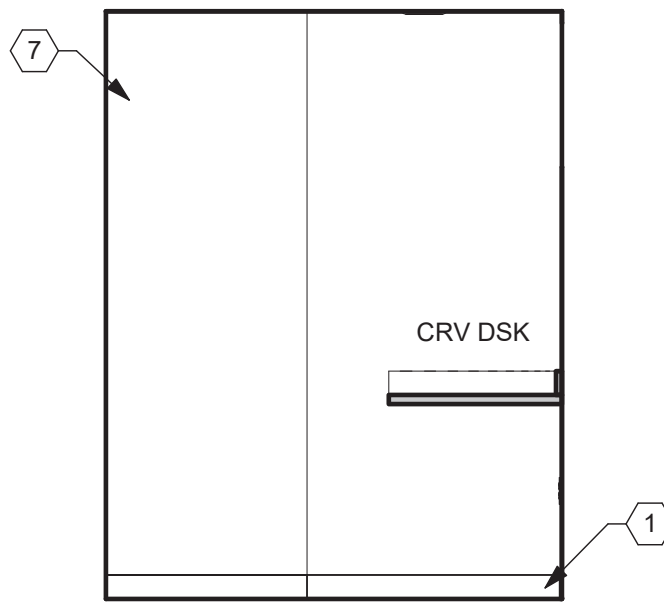


(C3) 125 DORM EAST
3/8" = 1'-0"

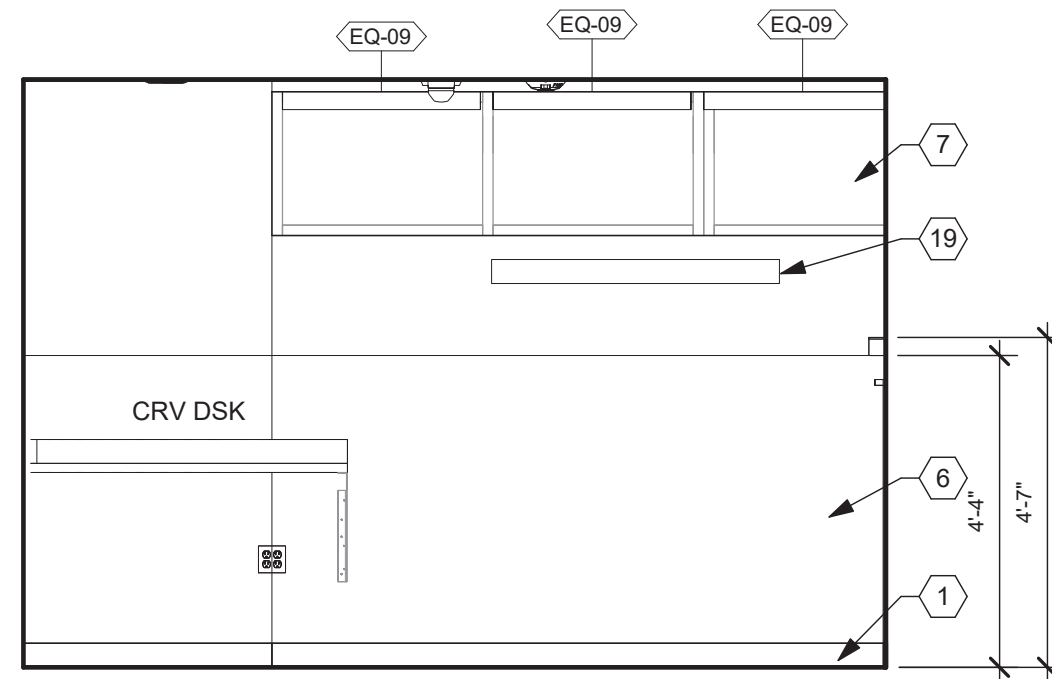


(A5) 125 DORM SOUTH
3/8" = 1'-0"

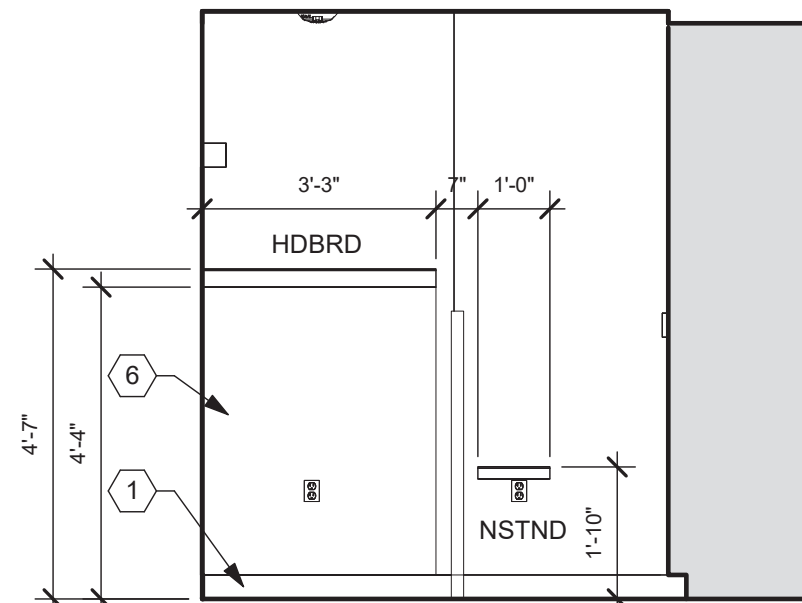


(C5) 125 DORM WEST
3/8" = 1'-0"

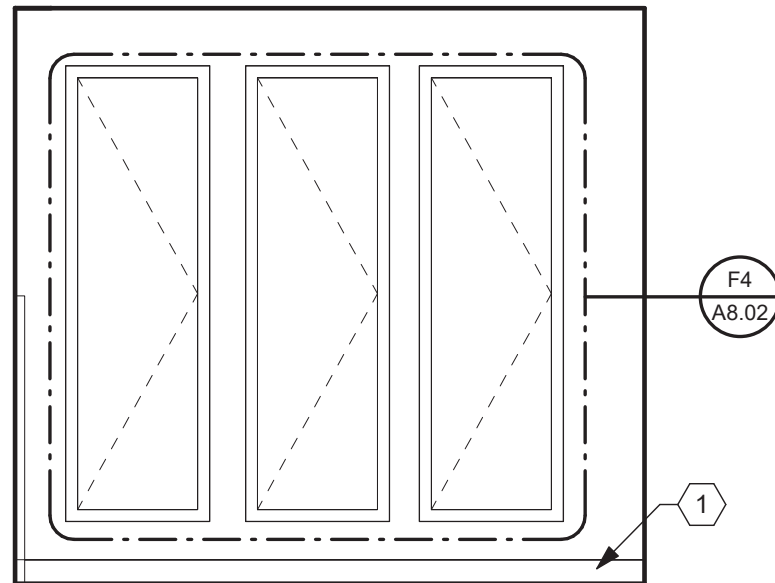


(D4) 113 HALL LOCKERS
3/8" = 1'-0"

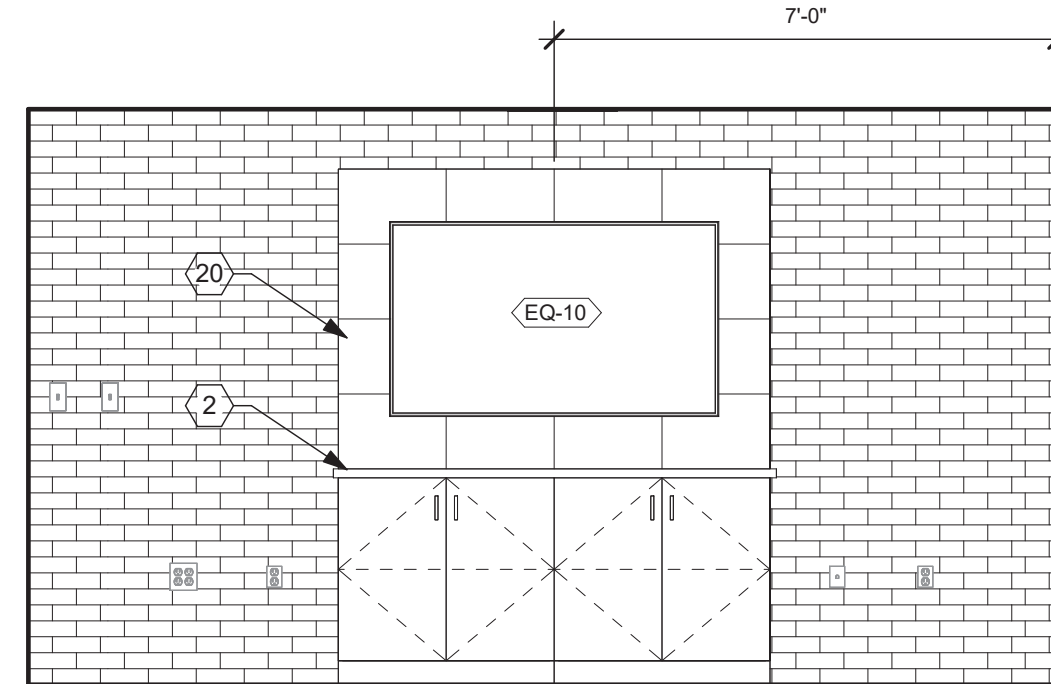


(D6) 109 DAYROOM NORTH
3/8" = 1'-0"

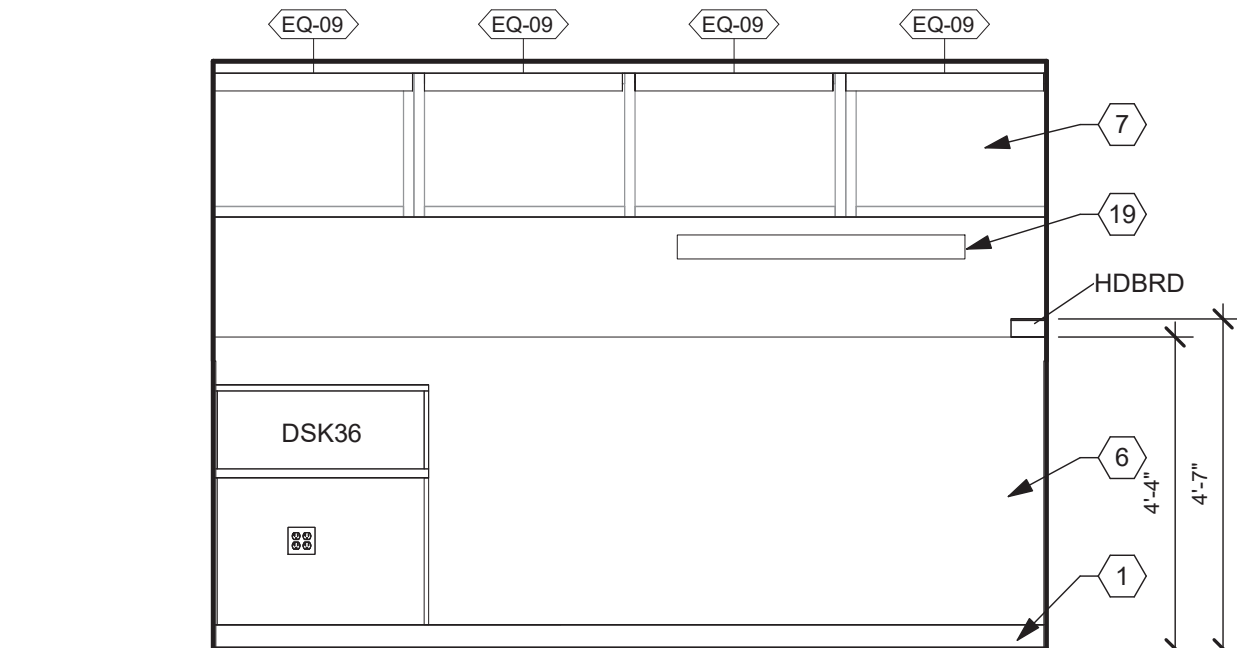

(D2) 124 DORM SOUTH
3/8" = 1'-0"

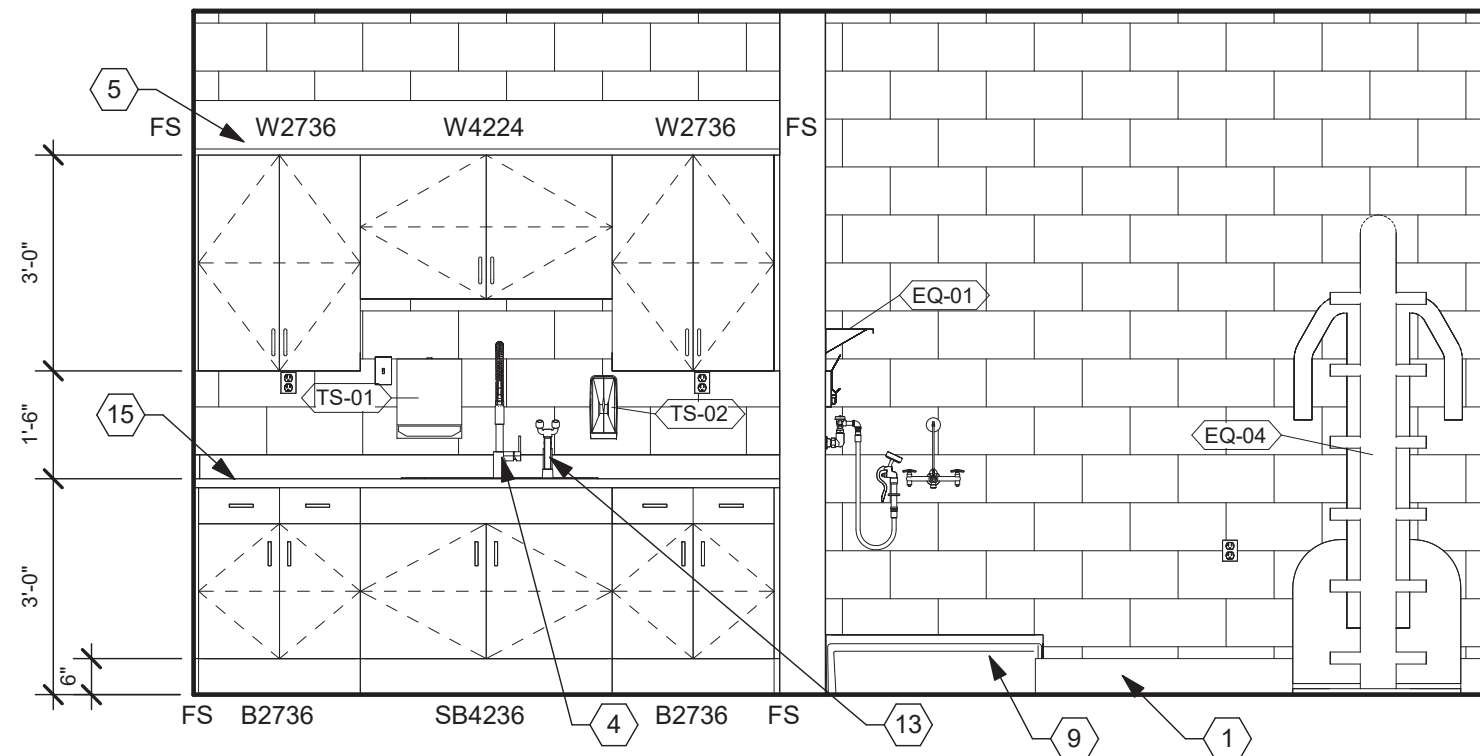

(F2) 126 DECON NORTH
3/8" = 1'-0"

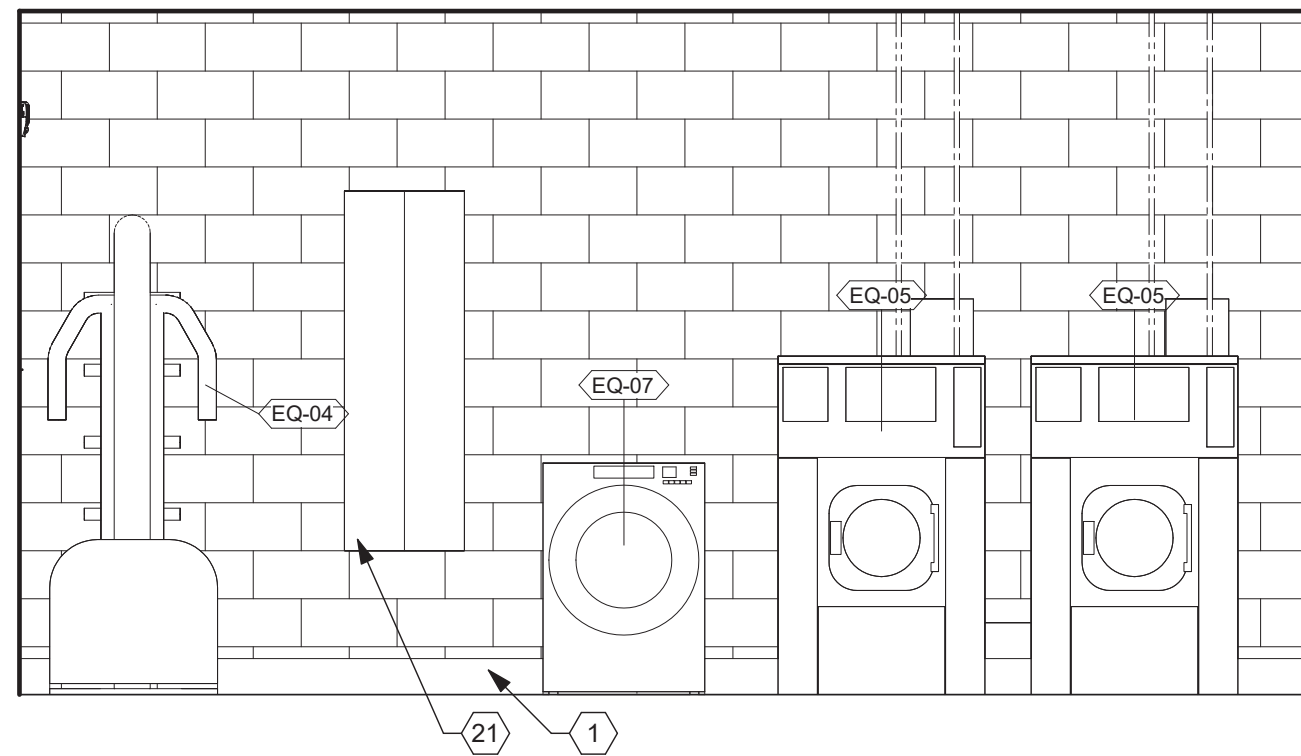

(F4) 126 DECON SOUTH
3/8" = 1'-0"

CONSTRUCTION NOTES

- (00) INDICATES CONSTRUCTION NOTE. NOT ALL NOTES USED THIS SHEET.
- WALL BASE. REFER TO FINISH SCHEDULE FOR TYPE.
 - PLASTIC LAMINATE COUNTERTOP. (PL-2)
 - BUTCHER BLOCK WORK SURFACE.
 - SINK. REFER TO PLUMBING DRAWINGS.
 - PLASTIC LAMINATE SLOPED TOP.
 - VINYL WALL PROTECTION. REFER TO FINISH SCHEDULE FOR HEIGHT AND TYPE.
 - BLACK OUT WINDOWS WITH WINDOW FILM.
 - GYP. BD. SOFFIT.
 - MOP SINK WITH MOP HANGER ABOVE. REFER TO PLUMBING DRAWINGS AND EQUIPMENT PLAN.
 - ADJUSTABLE SHELVING (ADJS). REFER TO A8.01 FOR DETAILS.
 - PORCELAIN TILE WALL BASE. (PTWB-1) ALIGN GROUT LINES WITH FLOOR TILE GROUT LINES.
 - EYE WASH STATION. REFER TO PLUMBING DRAWINGS.
 - TOILET. REFER TO PLUMBING DRAWINGS.
 - STAINLESS STEEL COUNTERTOP WITH BACK AND SIDE SPLASHES AND INTEGRAL SINK.
 - PORCELAIN WALL TILE. (PTW-1) ALIGN GROUT LINES WITH FLOOR TILE GROUT LINES.
 - 3" RADIUS DESK (DSK) CORNER.
 - PORCELAIN WALL TILE. (PTW-2)
 - LIGHT. REFER TO ELECTRICAL DRAWINGS.
 - WALL-HUNG TV CASEWORK. REFER TO SHEET A8.03 FOR DETAILS.
 - ELECTRICAL PANEL BOX. REFER TO ELECTRICAL DRAWINGS.
 - METAL SUPPORT BRACKETS @ 4' - 0" O.C. MAX.

GENERAL NOTES

EXAMPLE OF CASEWORK DIMENSIONS (2436) INDICATES 24" WIDTH X 36" HEIGHT. FOR DEPTH REFER TO TYPICAL CASEWORK DETAILS U.N.O.

ALL PLASTIC LAMINATE BASE, WALL & TALL CABINETS TO BE (PL-1) U.N.O.

ALL CASEWORK COUNTERTOPS TO BE SOLID SURFACE (PL-2) UNLESS NOTED OTHERWISE.

PROVIDE MIN. 3/4" PLASTIC LAMINATE SCRIBE AGAINST FINISHED WALLS AT BASE, WALL AND TALL CABINETS.

INSTALL SOLID WOOD (FIRE-TREATED) (CONTRACTOR OPTION SHEET STEEL) BLOCKING IN WALLS BEHIND WALLMOUNTED ITEMS INCLUDING CASEWORK, RAILINGS, TOILET ACCESSORIES, ETC.

REFER TO ELECTRICAL DRAWINGS FOR ELECTRICAL RECEPTACLE LOCATIONS. NOT ALL ELECTRICAL DEVICES ARE SHOWN ON ELEVATIONS.

SEE SHEETS A8.0 SERIES FOR TYPICAL CABINET SECTIONS AND DETAILS.

ALL OUTSIDE CORNERS OF SOLID SURFACE COUNTERTOPS SHALL PROJECT 1" PAST CABINET/SUPPORT AND SHALL HAVE 1 1/2" RADIUS CORNER EXCEPT AT REFRIGERATORS AND EQUIPMENT, WHERE SQUARE CORNERS AND 1/4" PROJECTION SHALL BE USED.

SEE SHEET A7.1 FOR ACCESSORY SCHEDULE. NOT EVERY ITEM SHOWN IS LABELED. LABEL IS "TYPICAL" OF OTHERS SHOWN. COORDINATE FINAL POSITION WITH OWNER.

DESIGNATION (XX-X) REFERS TO FINISHES. REFER TO SPECIFICATIONS DIVISION 09 AND SHEET A0.2 & A0.3 FOR FINISH DESCRIPTIONS AND ABBREVIATIONS.

ALL COUNTERTOPS 25" DEEP U.N.O.

ALL EXPOSED END PANELS IN CASEWORK TO RECEIVE SAME PLASTIC LAMINATE FINISH AS FRONT SURFACES.

ALL INTERIOR WALLS TO HAVE A WALL BASE. REFER TO FINISH SCHEDULE FOR TYPE.

REFER TO SHEET A0.1 FOR TYPICAL MOUNTING HEIGHT DIMENSIONS.

CASEWORK TYPES (PREFIX) ABBREVIATIONS:

SADA - "ADA" SINK BASE
B - BASE CABINET
4DB - 4 DOOR BASE CABINET
SB - SINK BASE
OB - OPEN SHELF BASE CABINET
W - WALL CABINET
WM - WALL MICROWAVE CABINET
OW - OPEN SHELF WALL CABINET
FC - FILE CABINET
LFC - LATERAL FILE CABINET
ET - ENTERTAINMENT CABINET
TC - TALL CABINET
TOC - TALL OPEN CABINET
DL - DORM LOCKER

A

B

C

D

E

F

A


B

C


D

E


F

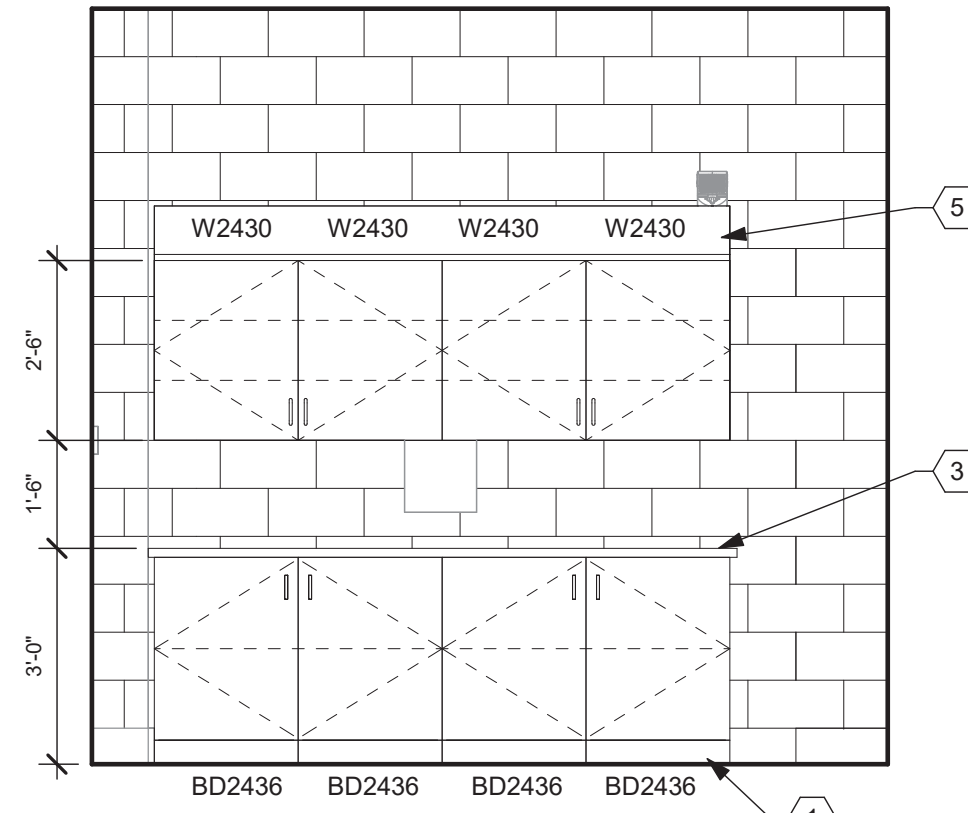


B1 110.1 BAY 1 WORKBENCH
3/8" = 1'-0"

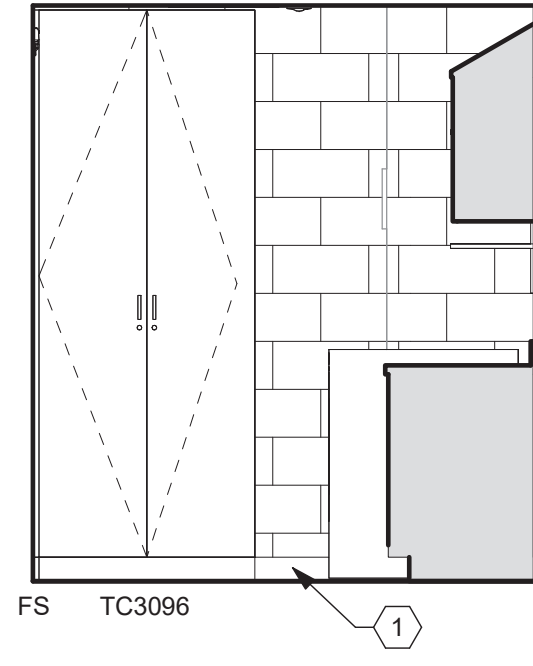


B2 116 LAUNDRY SOUTH
3/8" = 1'-0"

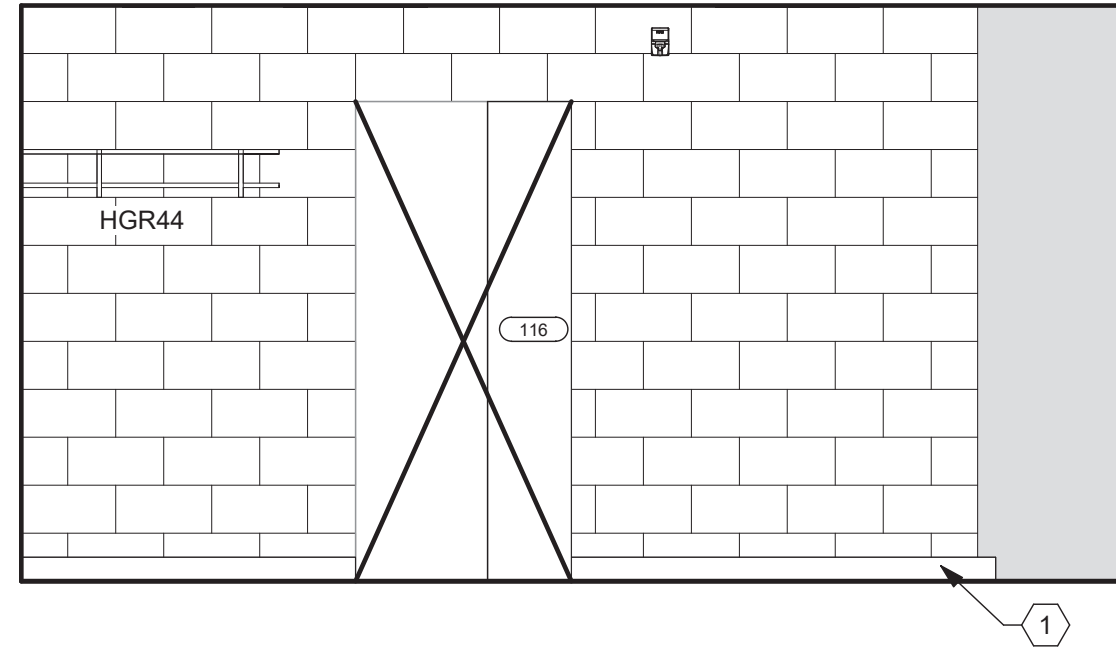


B3 116 LAUNDRY EAST
3/8" = 1'-0"

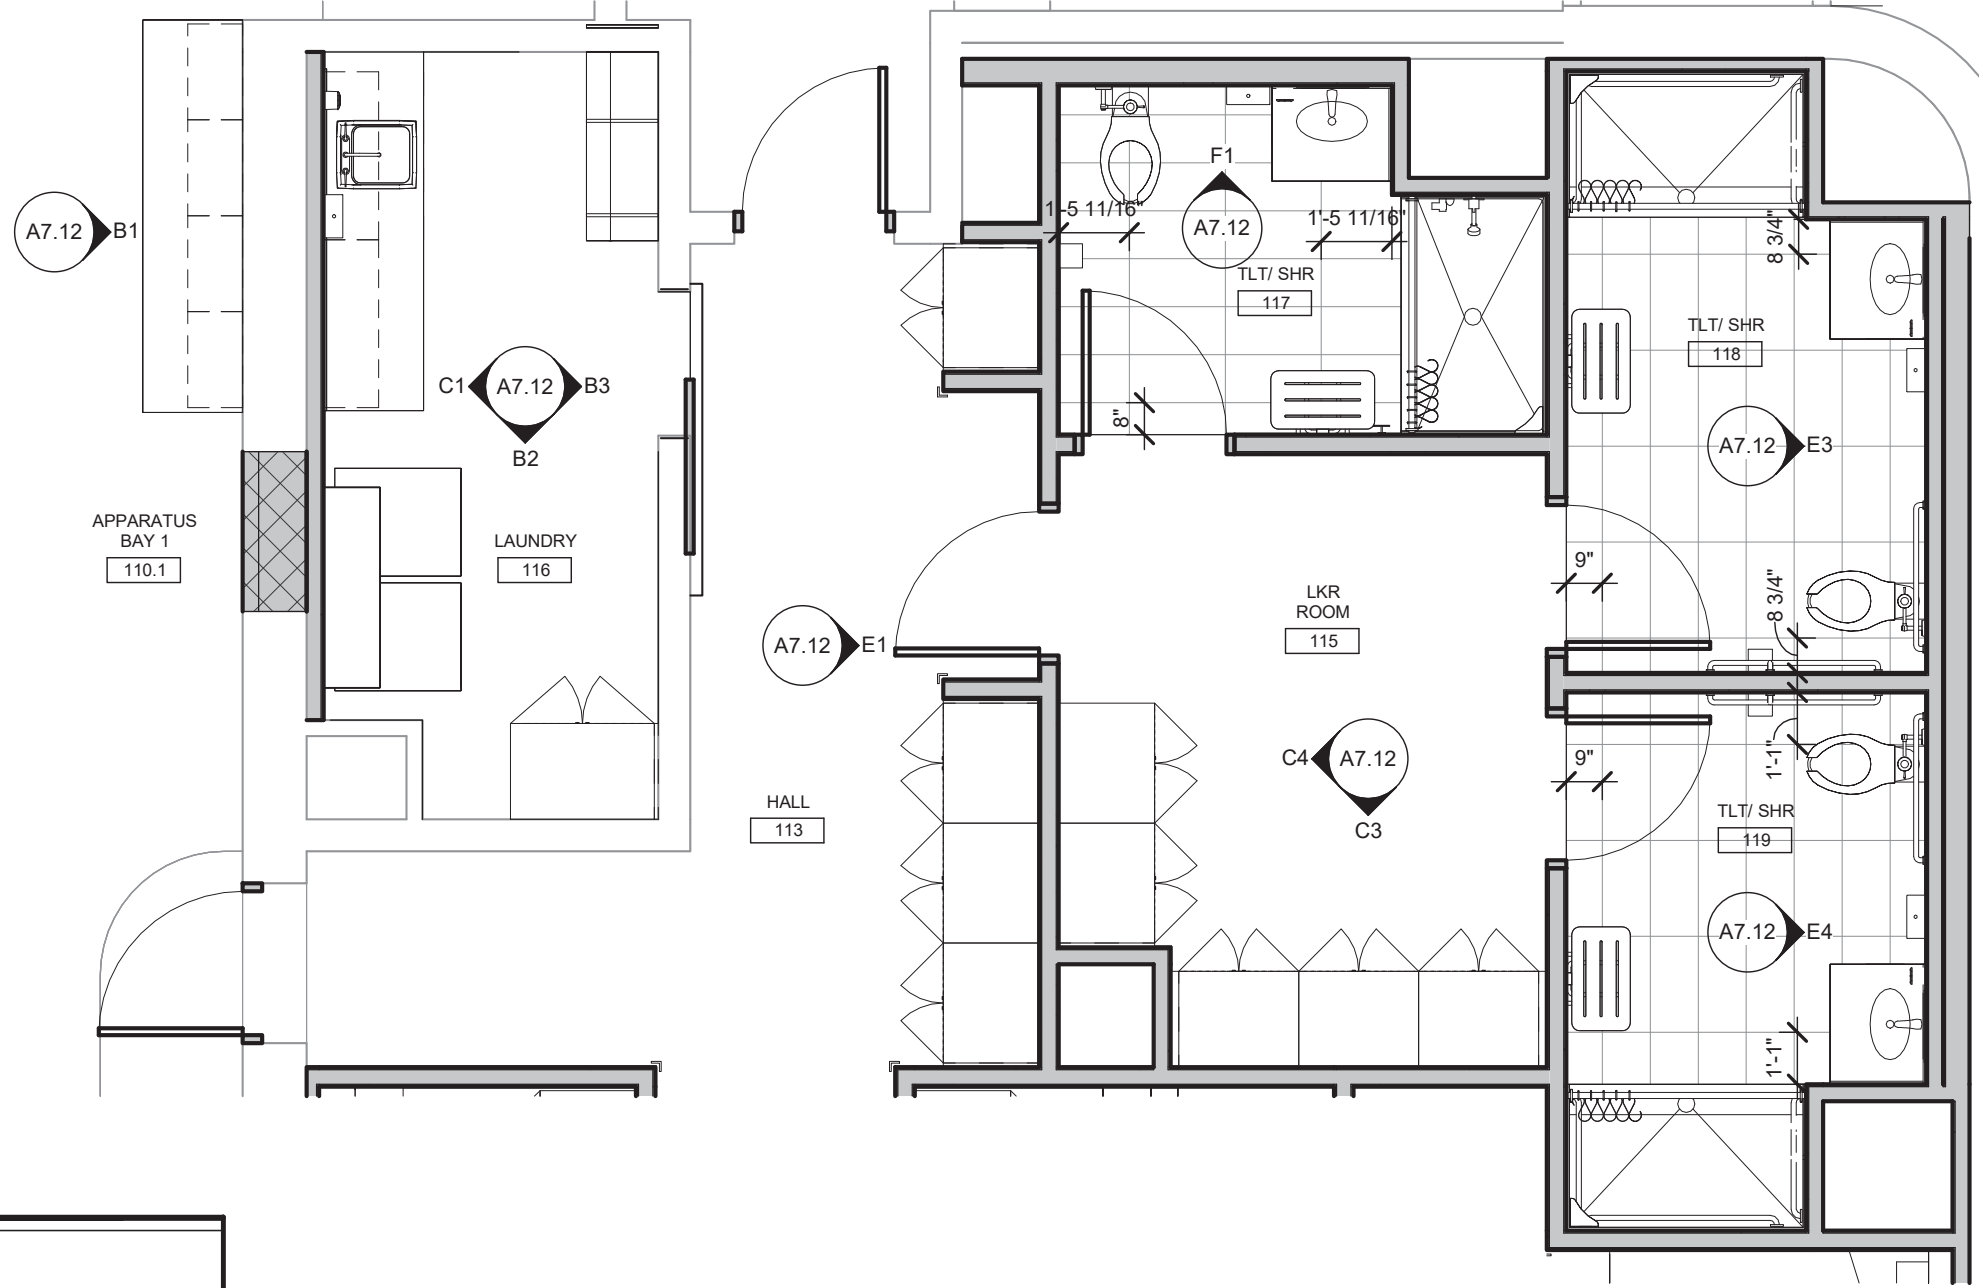


B5 ENLARGED FLOOR PLAN C
1/4" = 1'-0"

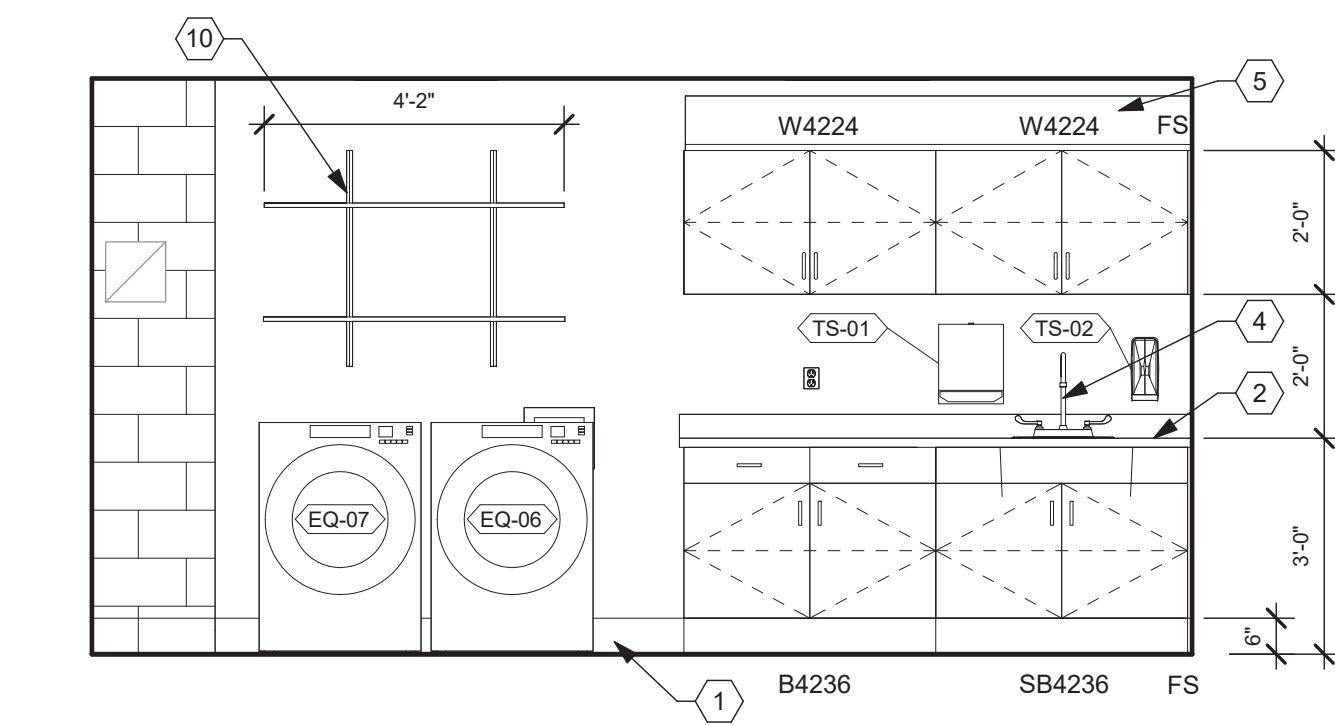


C1 116 LAUNDRY WEST
3/8" = 1'-0"

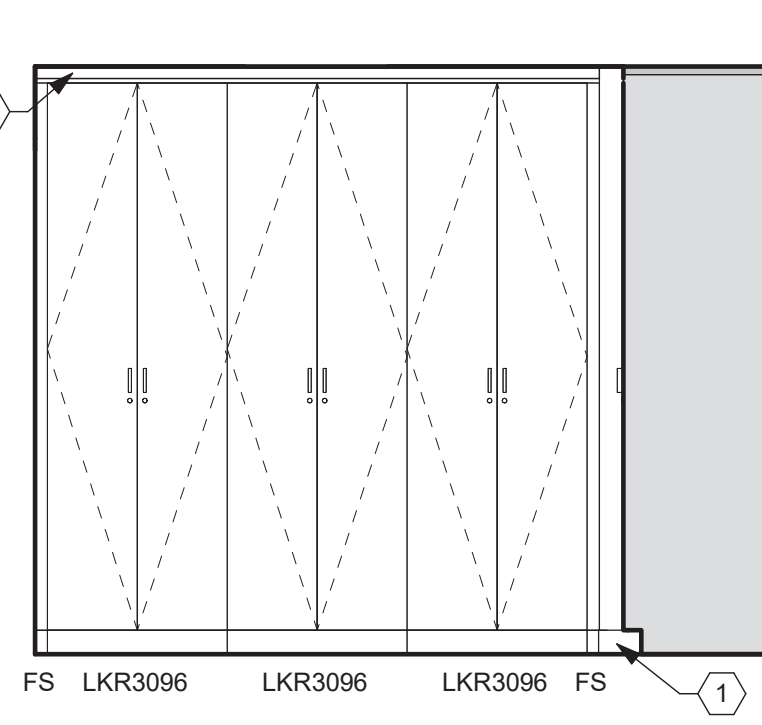


C3 115 LKR ROOM SOUTH
3/8" = 1'-0"

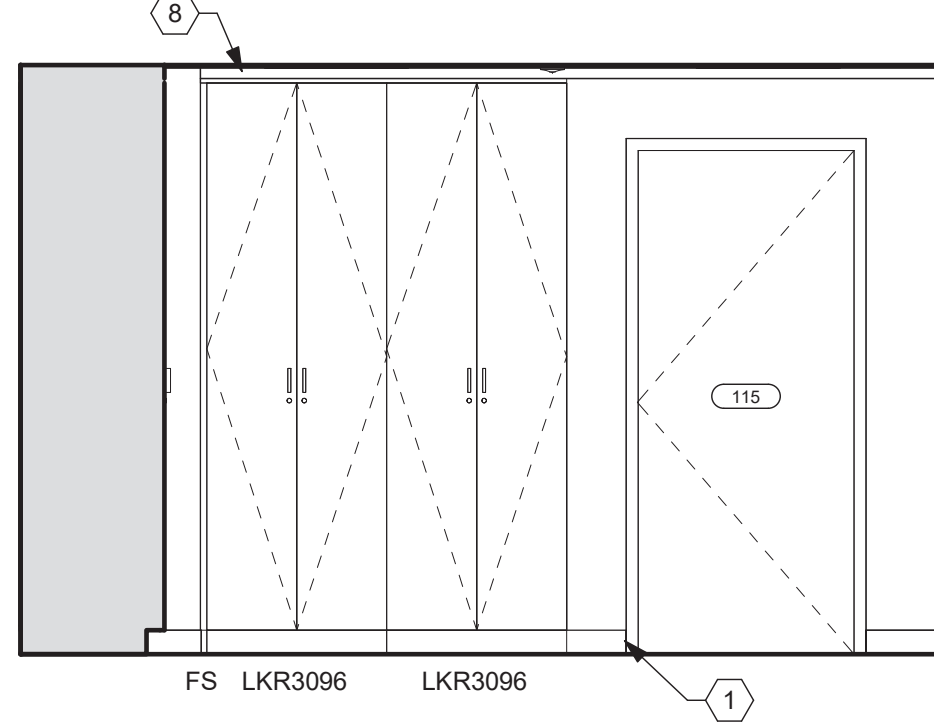


C4 115 LKR ROOM WEST
3/8" = 1'-0"

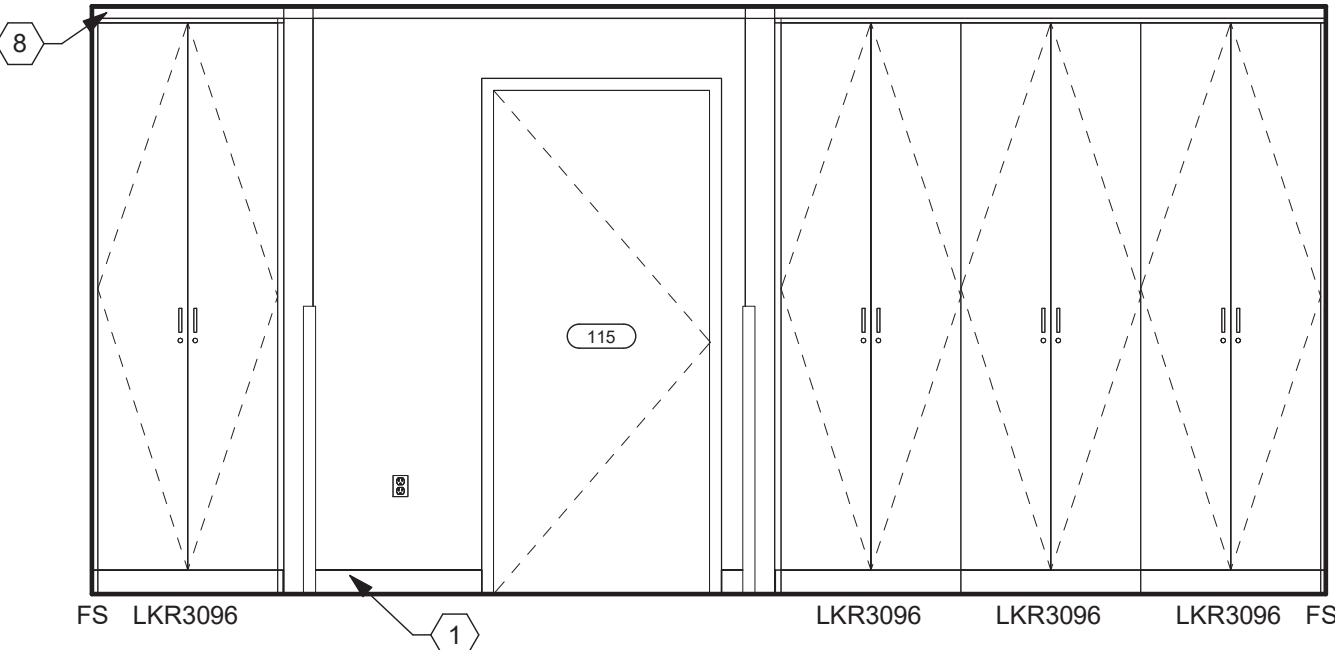


E1 113 HALL EAST
3/8" = 1'-0"

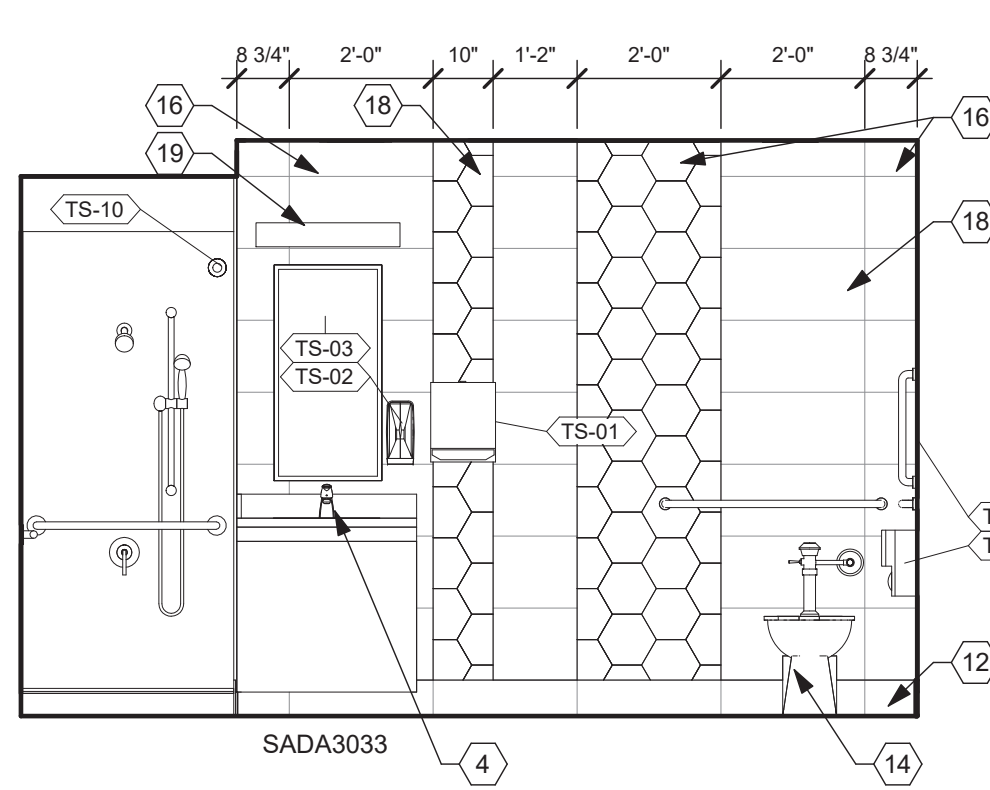


E3 118 TLT/ SHR EAST
3/8" = 1'-0"

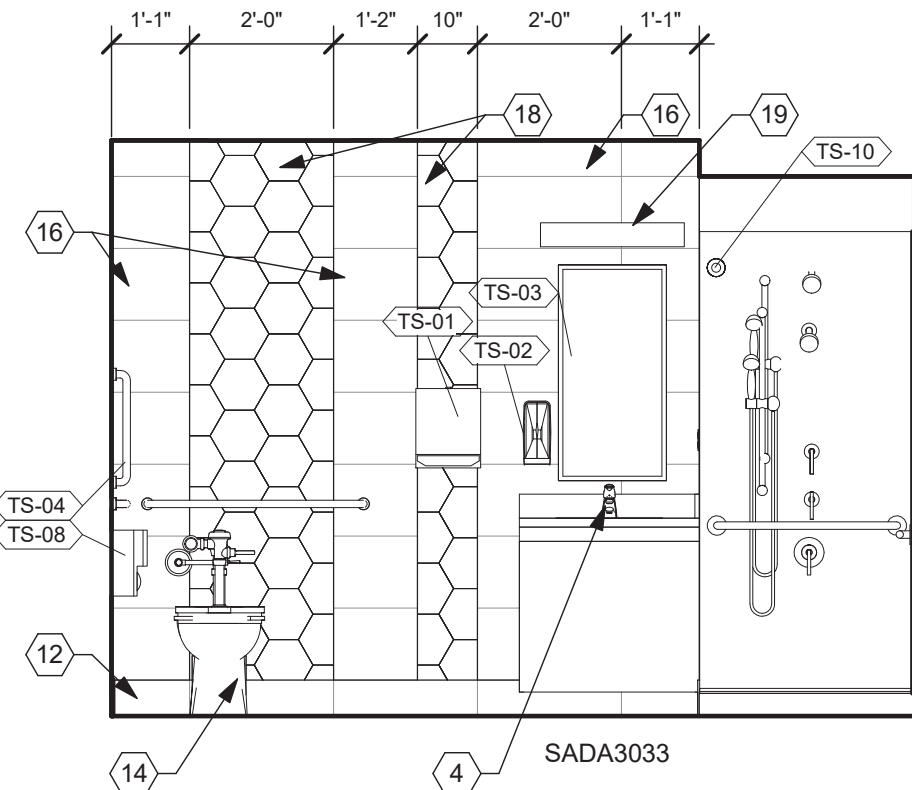


E4 119 TLT/ SHR EAST
3/8" = 1'-0"

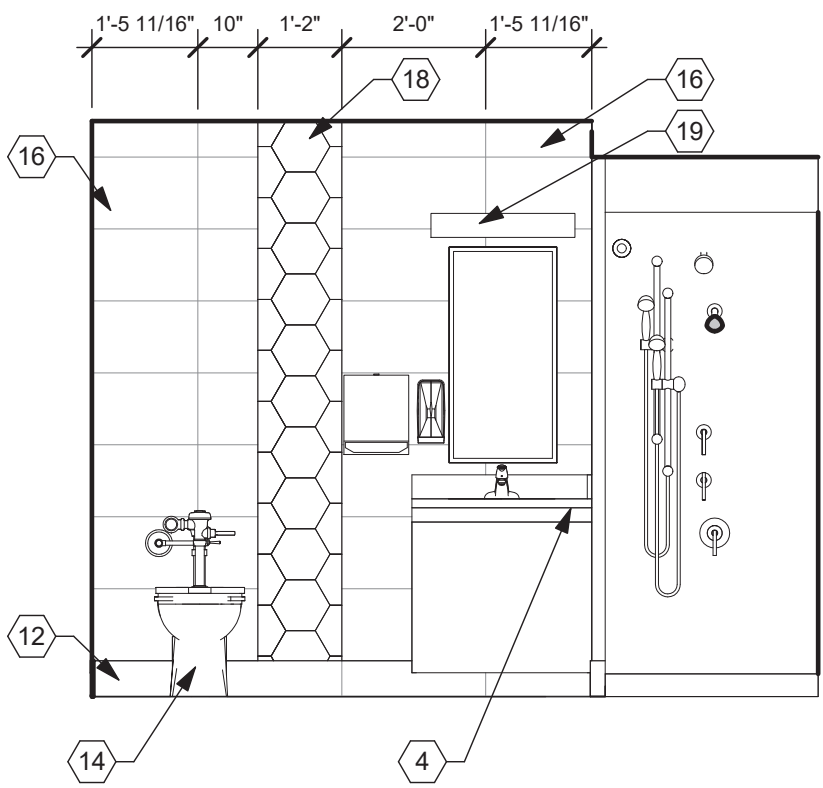


F1 117 TLT/ SHR NORTH
3/8" = 1'-0"

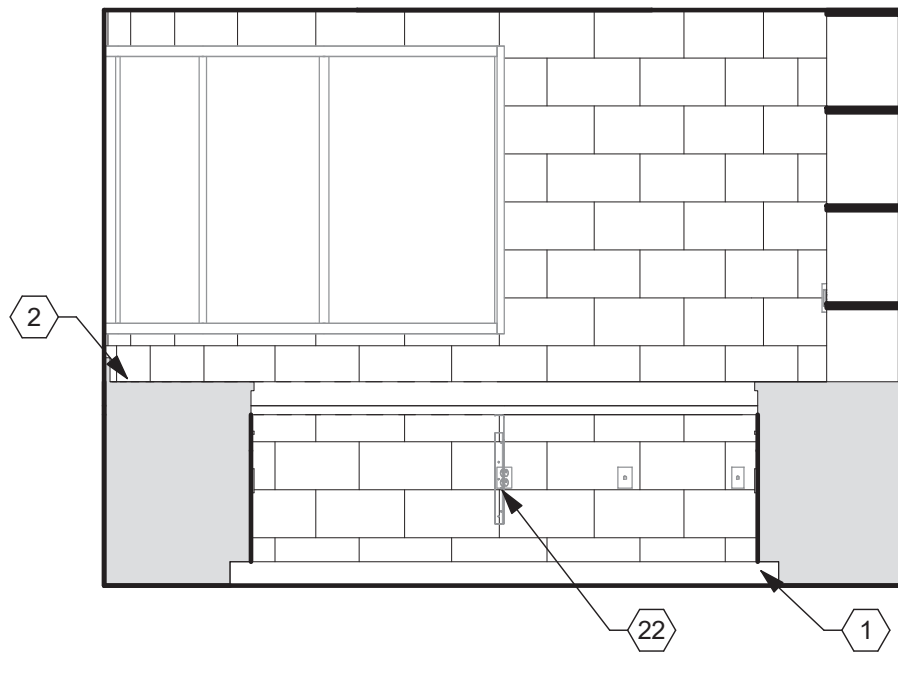


F2 101 REPORT NORTH
3/8" = 1'-0"

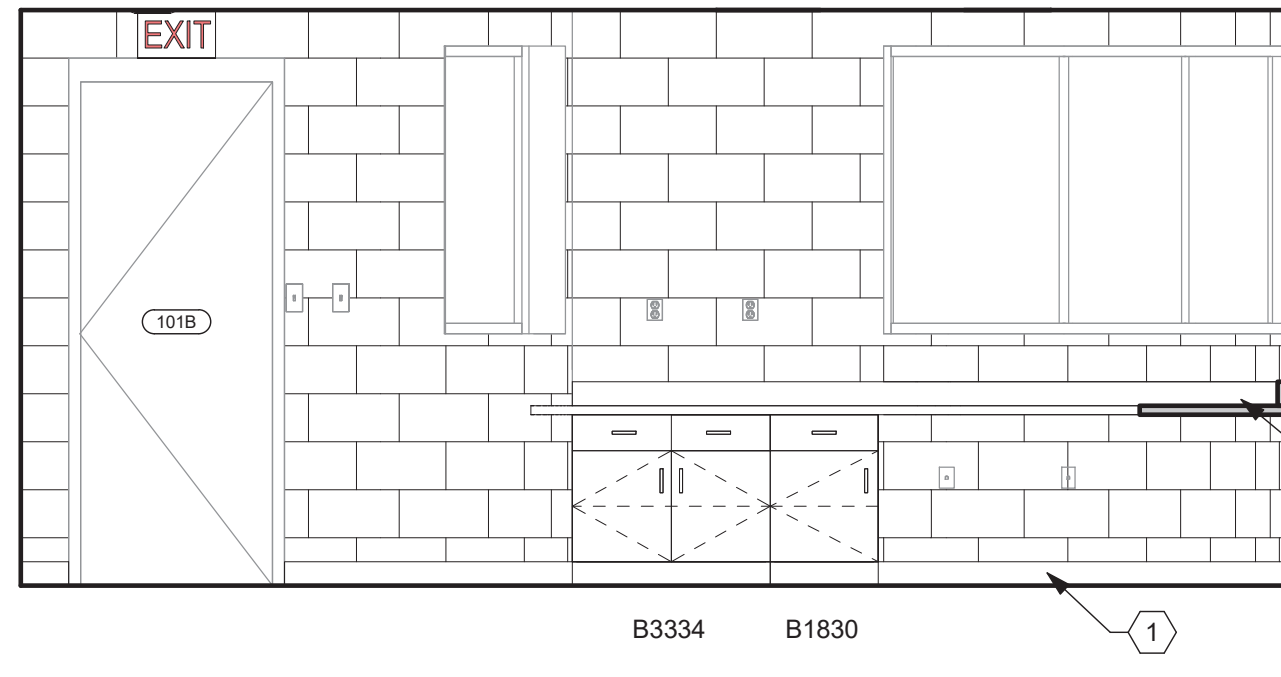

F3 101 REPORT WEST
3/8" = 1'-0"

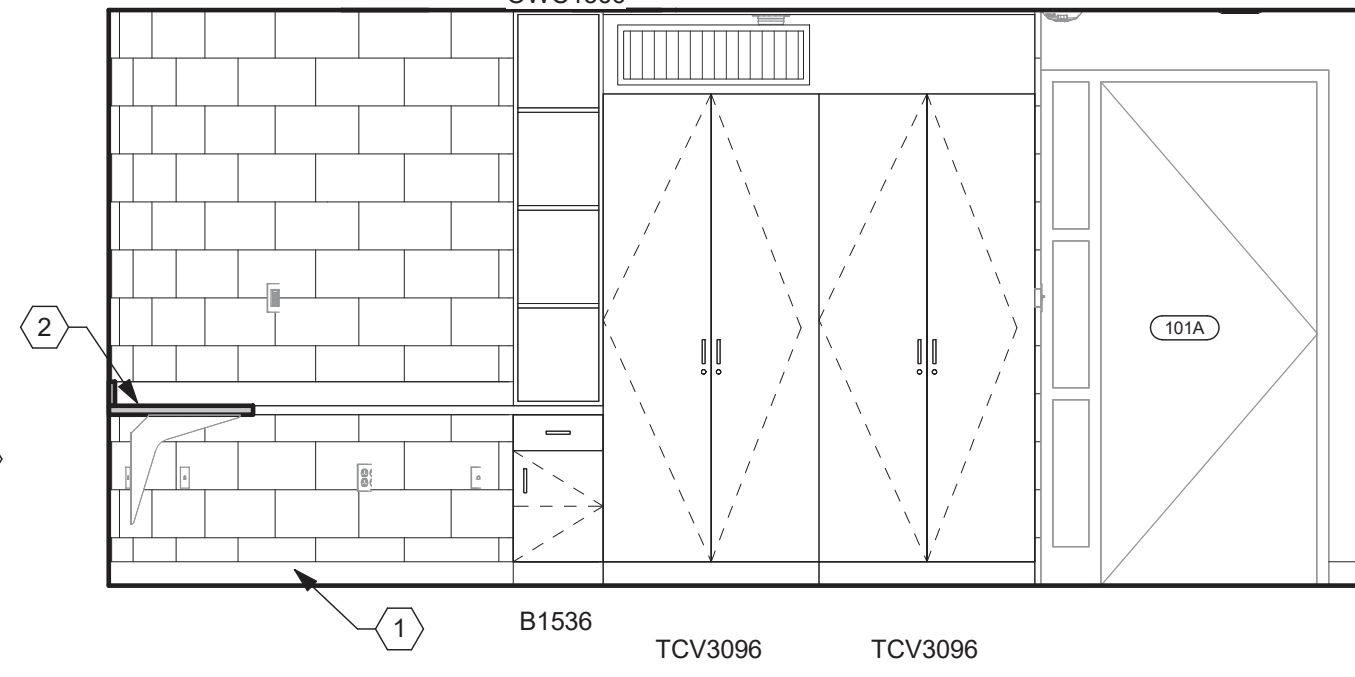

F5 101 REPORT EAST
3/8" = 1'-0"

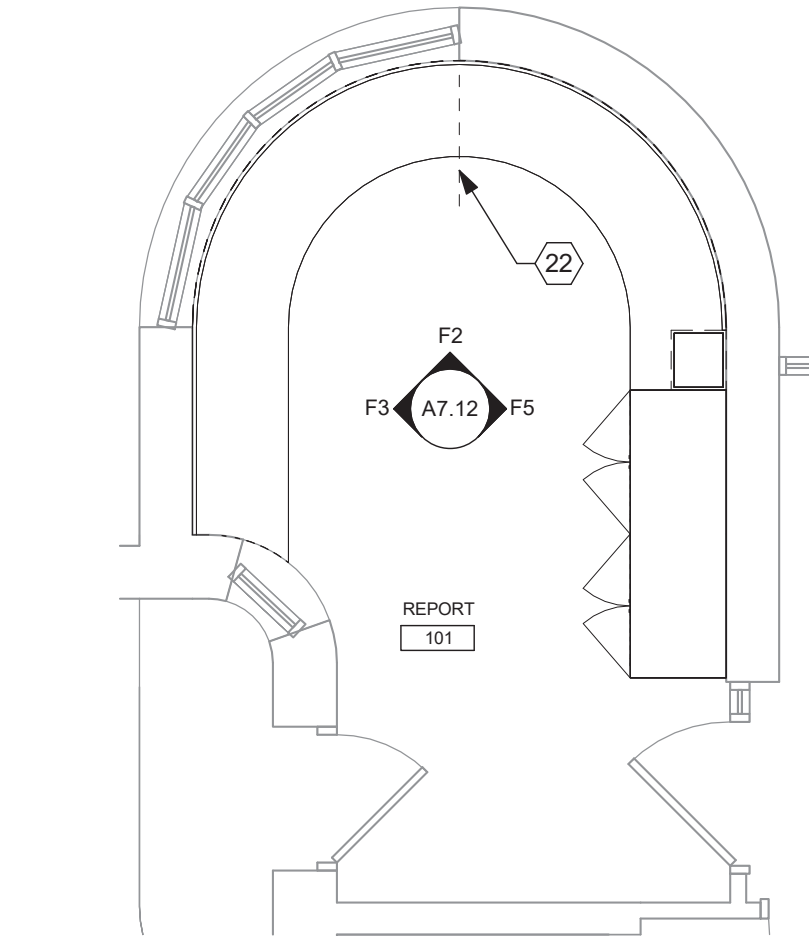

E5 ENLARGED FLOOR PLAN D
1/4" = 1'-0"

CONSTRUCTION NOTES

(00) INDICATES CONSTRUCTION NOTE.
NOT ALL NOTES USED THIS SHEET.

- WALL BASE. REFER TO FINISH SCHEDULE FOR TYPE.
- PLASTIC LAMINATE COUNTERTOP. (PL-2)
- BUTCHER BLOCK WORK SURFACE.
- SINK. REFER TO PLUMBING DRAWINGS.
- PLASTIC LAMINATE SLOPED TOP.
- VINYL WALL PROTECTION. REFER TO FINISH SCHEDULE FOR HEIGHT AND TYPE.
- BLACK OUT WINDOWS WITH WINDOW FILM.
- GYP. BD. SOFFIT.
- MOP SINK WITH MOP HANGER ABOVE. REFER TO PLUMBING DRAWINGS AND EQUIPMENT PLAN.
- ADJUSTABLE SHELVING (ADJS). REFER TO A8.01 FOR DETAILS.
- PORCELAIN TILE WALL BASE. (PTWB-1) ALIGN GROUT LINES WITH FLOOR TILE GROUT LINES.
- EYE WASH STATION. REFER TO PLUMBING DRAWINGS.
- TOILET. REFER TO PLUMBING DRAWINGS.
- STAINLESS STEEL COUNTERTOP WITH BACK AND SIDE SPLASHES AND INTEGRAL SINK.
- PORCELAIN WALL TILE. (PTW-1) ALIGN GROUT LINES WITH FLOOR TILE GROUT LINES.
- 3" RADIUS DESK (DSK) CORNER.
- PORCELAIN WALL TILE. (PTW-2)
- LIGHT. REFER TO ELECTRICAL DRAWINGS.
- WALL-HUNG TV CASEWORK. REFER TO SHEET A8.03 FOR DETAILS.
- ELECTRICAL PANEL BOX. REFER TO ELECTRICAL DRAWINGS.
- METAL SUPPORT BRACKETS @ 4' - 0" O.C. MAX.

GENERAL NOTES

EXAMPLE OF CASEWORK DIMENSIONS (2436) INDICATES 24" WIDTH X 36" HEIGHT. FOR DEPTH REFER TO TYPICAL CASEWORK DETAILS U.N.O.

ALL PLASTIC LAMINATE BASE, WALL & TALL CABINETS TO BE (PL-1) U.N.O.

ALL CASEWORK COUNTERTOPS TO BE SOLID SURFACE (PL-2) UNLESS NOTED OTHERWISE.

PROVIDE MIN. 3/4" PLASTIC LAMINATE SCRIBE AGAINST FINISHED WALLS AT BASE, WALL AND TALL CABINETS.

INSTALL SOLID WOOD (FIRE-TREATED) (CONTRACTOR OPTION SHEET STEEL) BLOCKING IN WALLS BEHIND WALLMOUNTED ITEMS INCLUDING CASEWORK, RAILINGS, TOILET ACCESSORIES, ETC.

REFER TO ELECTRICAL DRAWINGS FOR ELECTRICAL RECEPTACLE LOCATIONS. NOT ALL ELECTRICAL DEVICES ARE SHOWN ON ELEVATIONS.

SEE SHEETS A8.0 SERIES FOR TYPICAL CABINET SECTIONS AND DETAILS.

ALL OUTSIDE CORNERS OF SOLID SURFACE COUNTERTOPS SHALL PROJECT 1" PAST CABINET/SUPPORT AND SHALL HAVE 1 1/2" RADIUS CORNER EXCEPT AT REFRIGERATORS AND EQUIPMENT, WHERE SQUARE CORNERS AND 1/4" PROJECTION SHALL BE USED.

SEE SHEET A7.1 FOR ACCESSORY SCHEDULE. NOT EVERY ITEM SHOWN IS LABELED. LABEL IS "TYPICAL" OF OTHERS SHOWN. COORDINATE FINAL POSITION WITH OWNER.

DESIGNATION (XX-X) REFERS TO FINISHES. REFER TO SPECIFICATIONS DIVISION 09 AND SHEET A0.2 & A0.3 FOR FINISH DESCRIPTIONS AND ABBREVIATIONS.

ALL COUNTERTOPS 25" DEEP U.N.O.

ALL EXPOSED END PANELS IN CASEWORK TO RECEIVE SAME PLASTIC LAMINATE FINISH AS FRONT SURFACES.

ALL INTERIOR WALLS TO HAVE A WALL BASE. REFER TO FINISH SCHEDULE FOR TYPE.

REFER TO SHEET A0.1 FOR TYPICAL MOUNTING HEIGHT DIMENSIONS.

CASEWORK TYPES (PREFIX) ABBREVIATIONS:

SADA - "ADA" SINK BASE
B - BASE CABINET
4DB - 4 DOOR BASE CABINET
SB - SINK BASE
OB - OPEN SHELF BASE CABINET
W - WALL CABINET
WM - WALL MICROWAVE CABINET
OW - OPEN SHELF WALL CABINET
FC - FILE CABINET
LFC - LATERAL FILE CABINET
ET - ENTERTAINMENT CABINET
TC - TALL CABINET
TOC - TALL OPEN CABINET
DL - DORM LOCKER

A

B

C

D

E

F

8/1/2025 1:29:40 PM

A


B

C


D

E


F

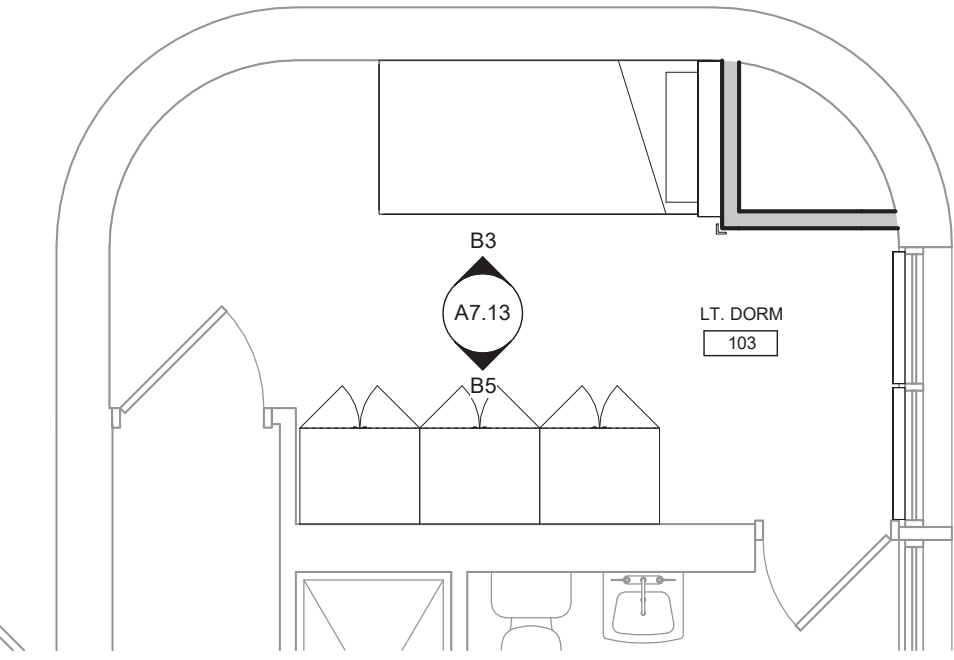

B2 ENLARGED FLOOR PLAN E
1/4" = 1'-0"

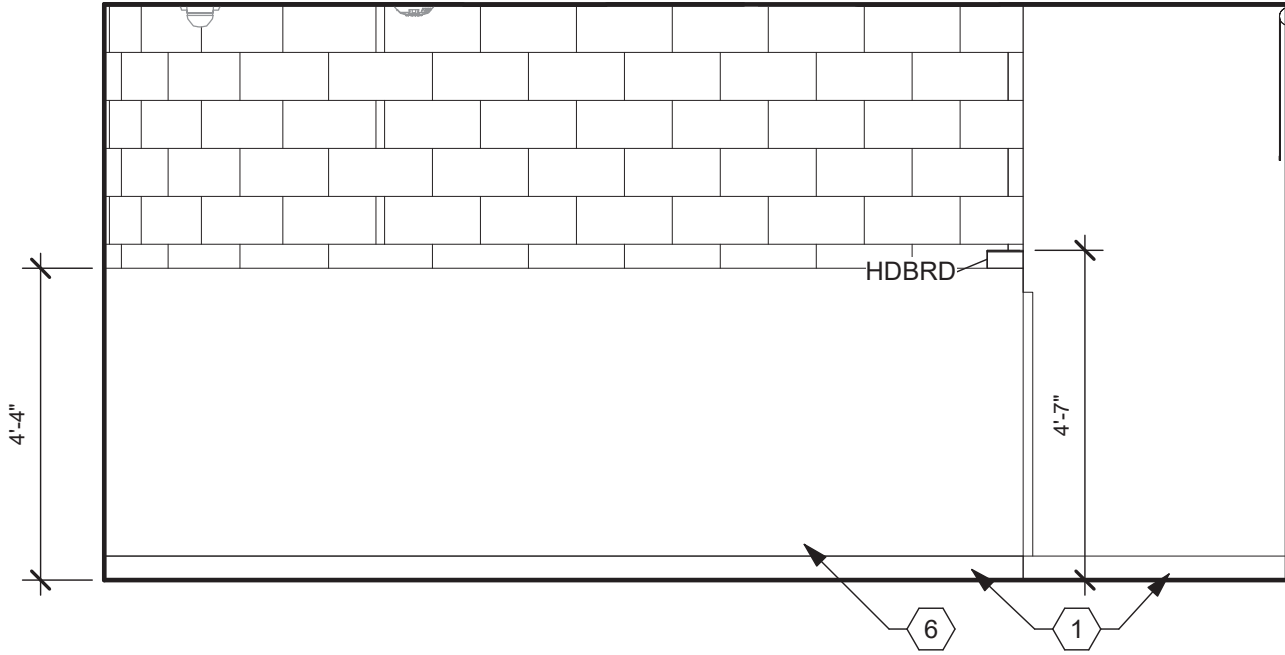

B3 103 LT. DORM NORTH
3/8" = 1'-0"

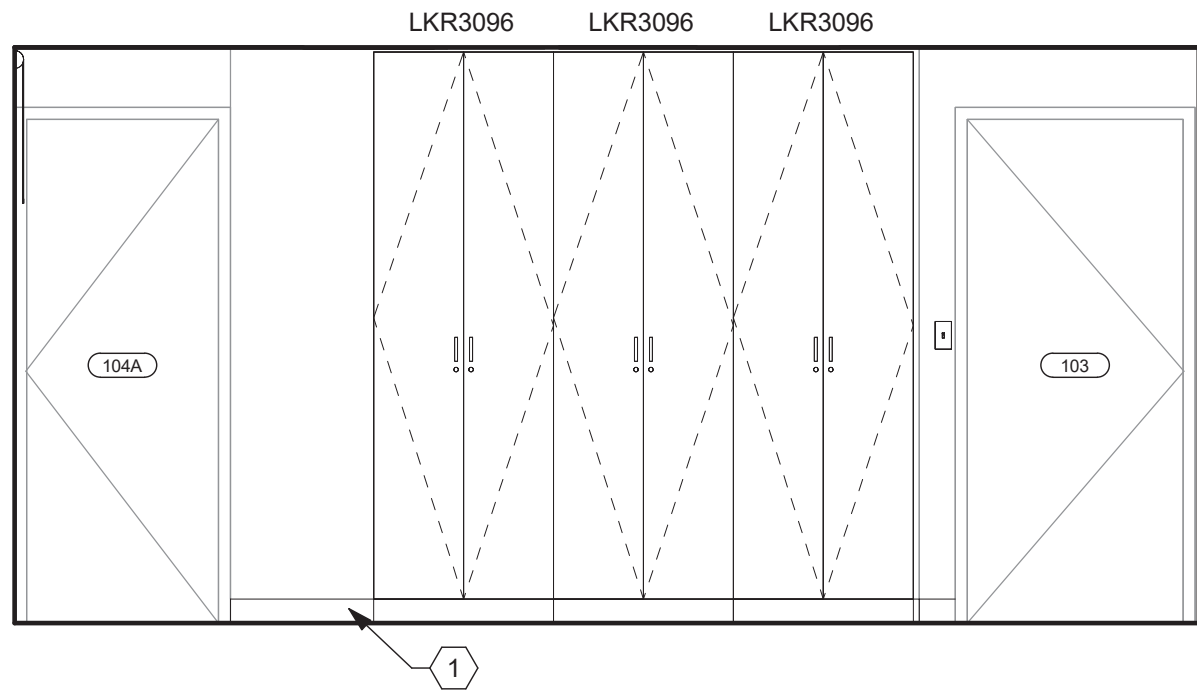

B5 103 LT. DORM SOUTH
3/8" = 1'-0"

CONSTRUCTION NOTES

(00) INDICATES CONSTRUCTION NOTE.
NOT ALL NOTES USED THIS SHEET.

- 1 WALL BASE. REFER TO FINISH SCHEDULE FOR TYPE.
- 2 PLASTIC LAMINATE COUNTERTOP. (PL-2)
- 3 BUTCHER BLOCK WORK SURFACE.
- 4 SINK. REFER TO PLUMBING DRAWINGS.
- 5 PLASTIC LAMINATE SLOPED TOP.
- 6 VINYL WALL PROTECTION. REFER TO FINISH SCHEDULE FOR HEIGHT AND TYPE.
- 7 BLACK OUT WINDOWS WITH WINDOW FILM.
- 8 GYP. BD. SOFFIT.
- 9 MOP SINK WITH MOP HANGER ABOVE. REFER TO PLUMBING DRAWINGS AND EQUIPMENT PLAN.
- 10 ADJUSTABLE SHELVING (ADJS). REFER TO A8.01 FOR DETAILS.
- 12 PORCELAIN TILE WALL BASE. (PTWB-1) ALIGN GROUT LINES WITH FLOOR TILE GROUT LINES.
- 13 EYE WASH STATION. REFER TO PLUMBING DRAWINGS.
- 14 TOILET. REFER TO PLUMBING DRAWINGS.
- 15 STAINLESS STEEL COUNTERTOP WITH BACK AND SIDE SPLASHES AND INTEGRAL SINK.
- 16 PORCELAIN WALL TILE. (PTW-1) ALIGN GROUT LINES WITH FLOOR TILE GROUT LINES.
- 17 3" RADIUS DESK (DSK) CORNER.
- 18 PORCELAIN WALL TILE. (PTW-2)
- 19 LIGHT. REFER TO ELECTRICAL DRAWINGS.
- 20 WALL-HUNG TV CASEWORK. REFER TO SHEET A8.03 FOR DETAILS.
- 21 ELECTRICAL PANEL BOX. REFER TO ELECTRICAL DRAWINGS.
- 22 METAL SUPPORT BRACKETS @ 4' - 0" O.C. MAX.

GENERAL NOTES

EXAMPLE OF CASEWORK DIMENSIONS (2436) INDICATES 24" WIDTH X 36" HEIGHT. FOR DEPTH REFER TO TYPICAL CASEWORK DETAILS U.N.O.

ALL PLASTIC LAMINATE BASE, WALL & TALL CABINETS TO BE (PL-1) U.N.O.

ALL CASEWORK COUNTERTOPS TO BE SOLID SURFACE (PL-2) UNLESS NOTED OTHERWISE.

PROVIDE MIN. 3/4" PLASTIC LAMINATE SCRIBE AGAINST FINISHED WALLS AT BASE, WALL AND TALL CABINETS.

INSTALL SOLID WOOD (FIRE-TREATED) (CONTRACTOR OPTION SHEET STEEL) BLOCKING IN WALLS BEHIND WALLMOUNTED ITEMS INCLUDING CASEWORK, RAILINGS, TOILET ACCESSORIES, ETC.

REFER TO ELECTRICAL DRAWINGS FOR ELECTRICAL RECEPTACLE LOCATIONS. NOT ALL ELECTRICAL DEVICES ARE SHOWN ON ELEVATIONS.

SEE SHEETS A8.0 SERIES FOR TYPICAL CABINET SECTIONS AND DETAILS.

ALL OUTSIDE CORNERS OF SOLID SURFACE COUNTERTOPS SHALL PROJECT 1" PAST CABINET/SUPPORT AND SHALL HAVE 1 1/2" RADIUS CORNER EXCEPT AT REFRIGERATORS AND EQUIPMENT, WHERE SQUARE CORNERS AND 1/4" PROJECTION SHALL BE USED.

SEE SHEET A7.1 FOR ACCESSORY SCHEDULE. NOT EVERY ITEM SHOWN IS LABELED. LABEL IS "TYPICAL" OF OTHERS SHOWN. COORDINATE FINAL POSITION WITH OWNER.

DESIGNATION (XX-X) REFERS TO FINISHES. REFER TO SPECIFICATIONS DIVISION 09 AND SHEET A0.2 & A0.3FOR FINISH DESCRIPTIONS AND ABBREVIATIONS.

ALL COUNTERTOPS 25" DEEP U.N.O.

ALL EXPOSED END PANELS IN CASEWORK TO RECEIVE SAME PLASTIC LAMINATE FINISH AS FRONT SURFACES.

ALL INTERIOR WALLS TO HAVE A WALL BASE. REFER TO FINISH SCHEDULE FOR TYPE.

REFER TO SHEET A0.1 FOR TYPICAL MOUNTING HEIGHT DIMENSIONS.

CASEWORK TYPES (PREFIX) ABBREVIATIONS:

SADA - "ADA" SINK BASE
B - BASE CABINET
4DB - 4 DOOR BASE CABINET
SB - SINK BASE
OB - OPEN SHELF BASE CABINET
W - WALL CABINET
WM - WALL MICROWAVE CABINET
OW - OPEN SHELF WALL CABINET
FC - FILE CABINET
LFC - LATERAL FILE CABINET
ET - ENTERTAINMENT CABINET
TC - TALL CABINET
TOC - TALL OPEN CABINET
DL - DORM LOCKER

A

B

C


D

E

F

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/25	FOR CONSTRUCTION

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB

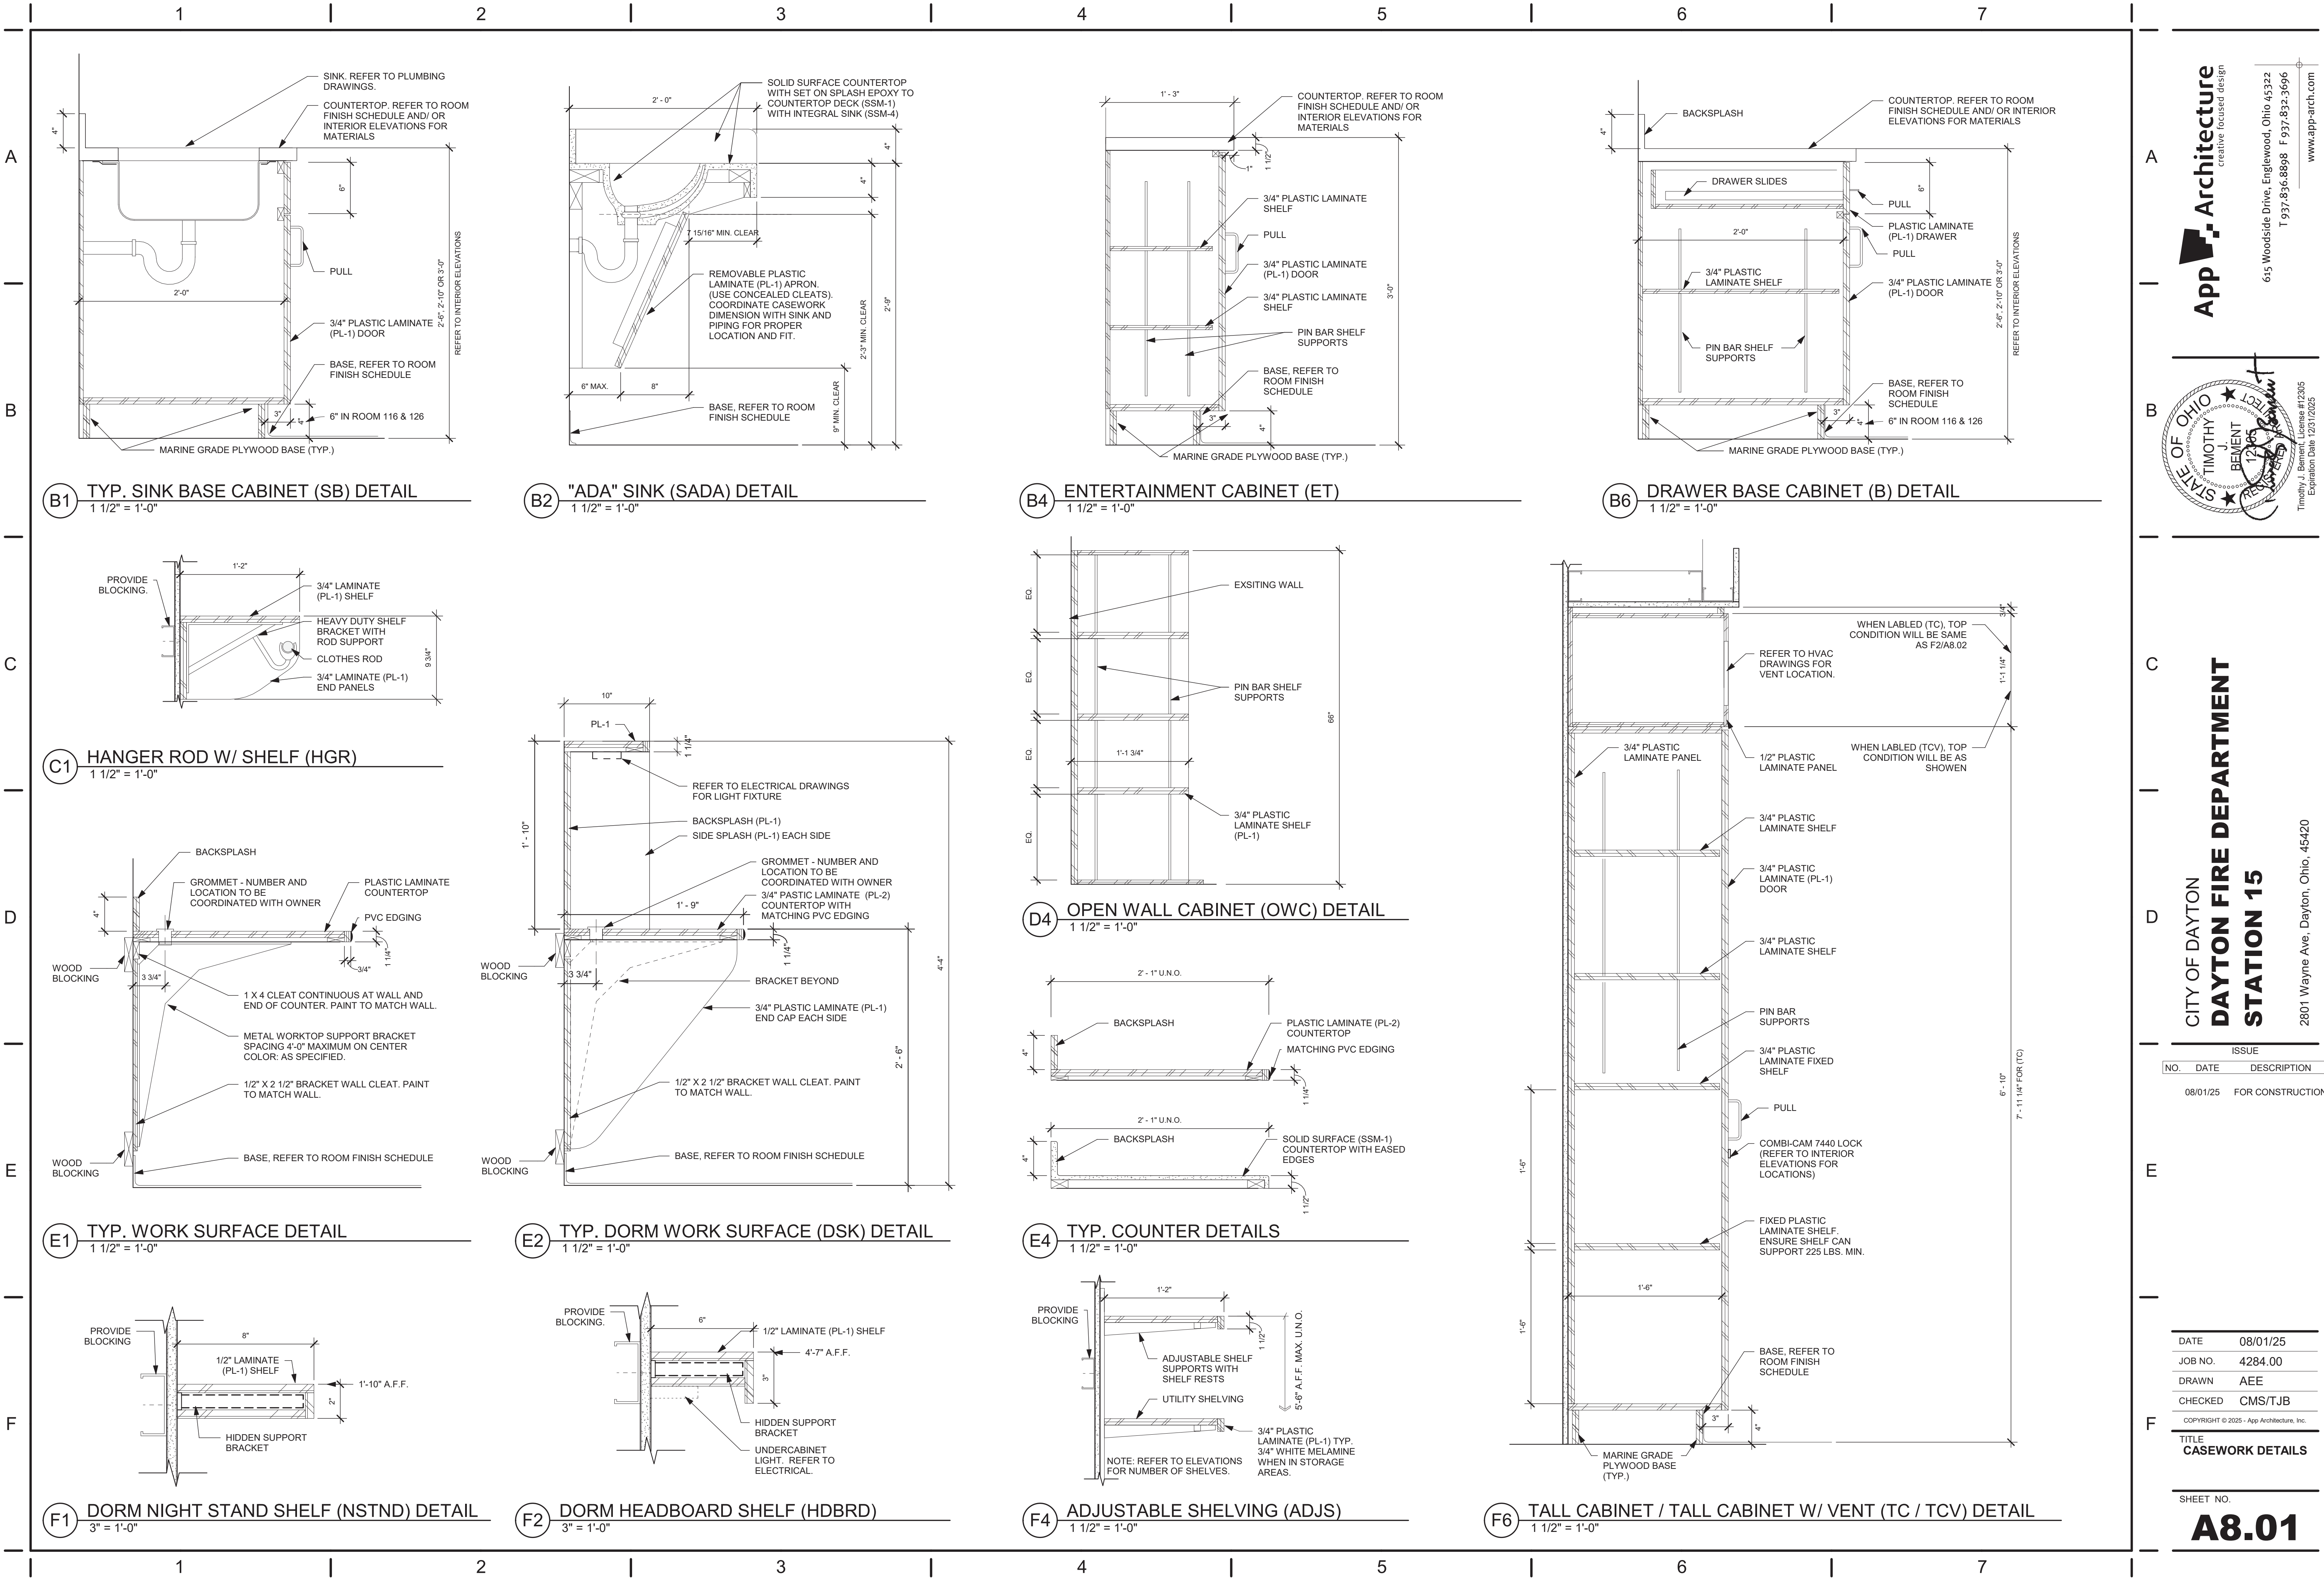

APP Architecture
creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.832.3696 F 937.832.3696
www.app-arch.com

STATE OF OHIO
TIMOTHY J. BEMENT
1205
Professional Engineer
Expiration Date 12/31/2025

CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15
2801 Wayne Ave, Dayton, Ohio, 45420


ISSUE		
NO.	DATE	DESCRIPTION
	08/01/25	FOR CONSTRUCTION

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB


COPYRIGHT © 2025 - App Architecture, Inc.
TITLE
CASEWORK DETAILS

SHEET NO.
A8.01


01/2025 1:28:42 PM

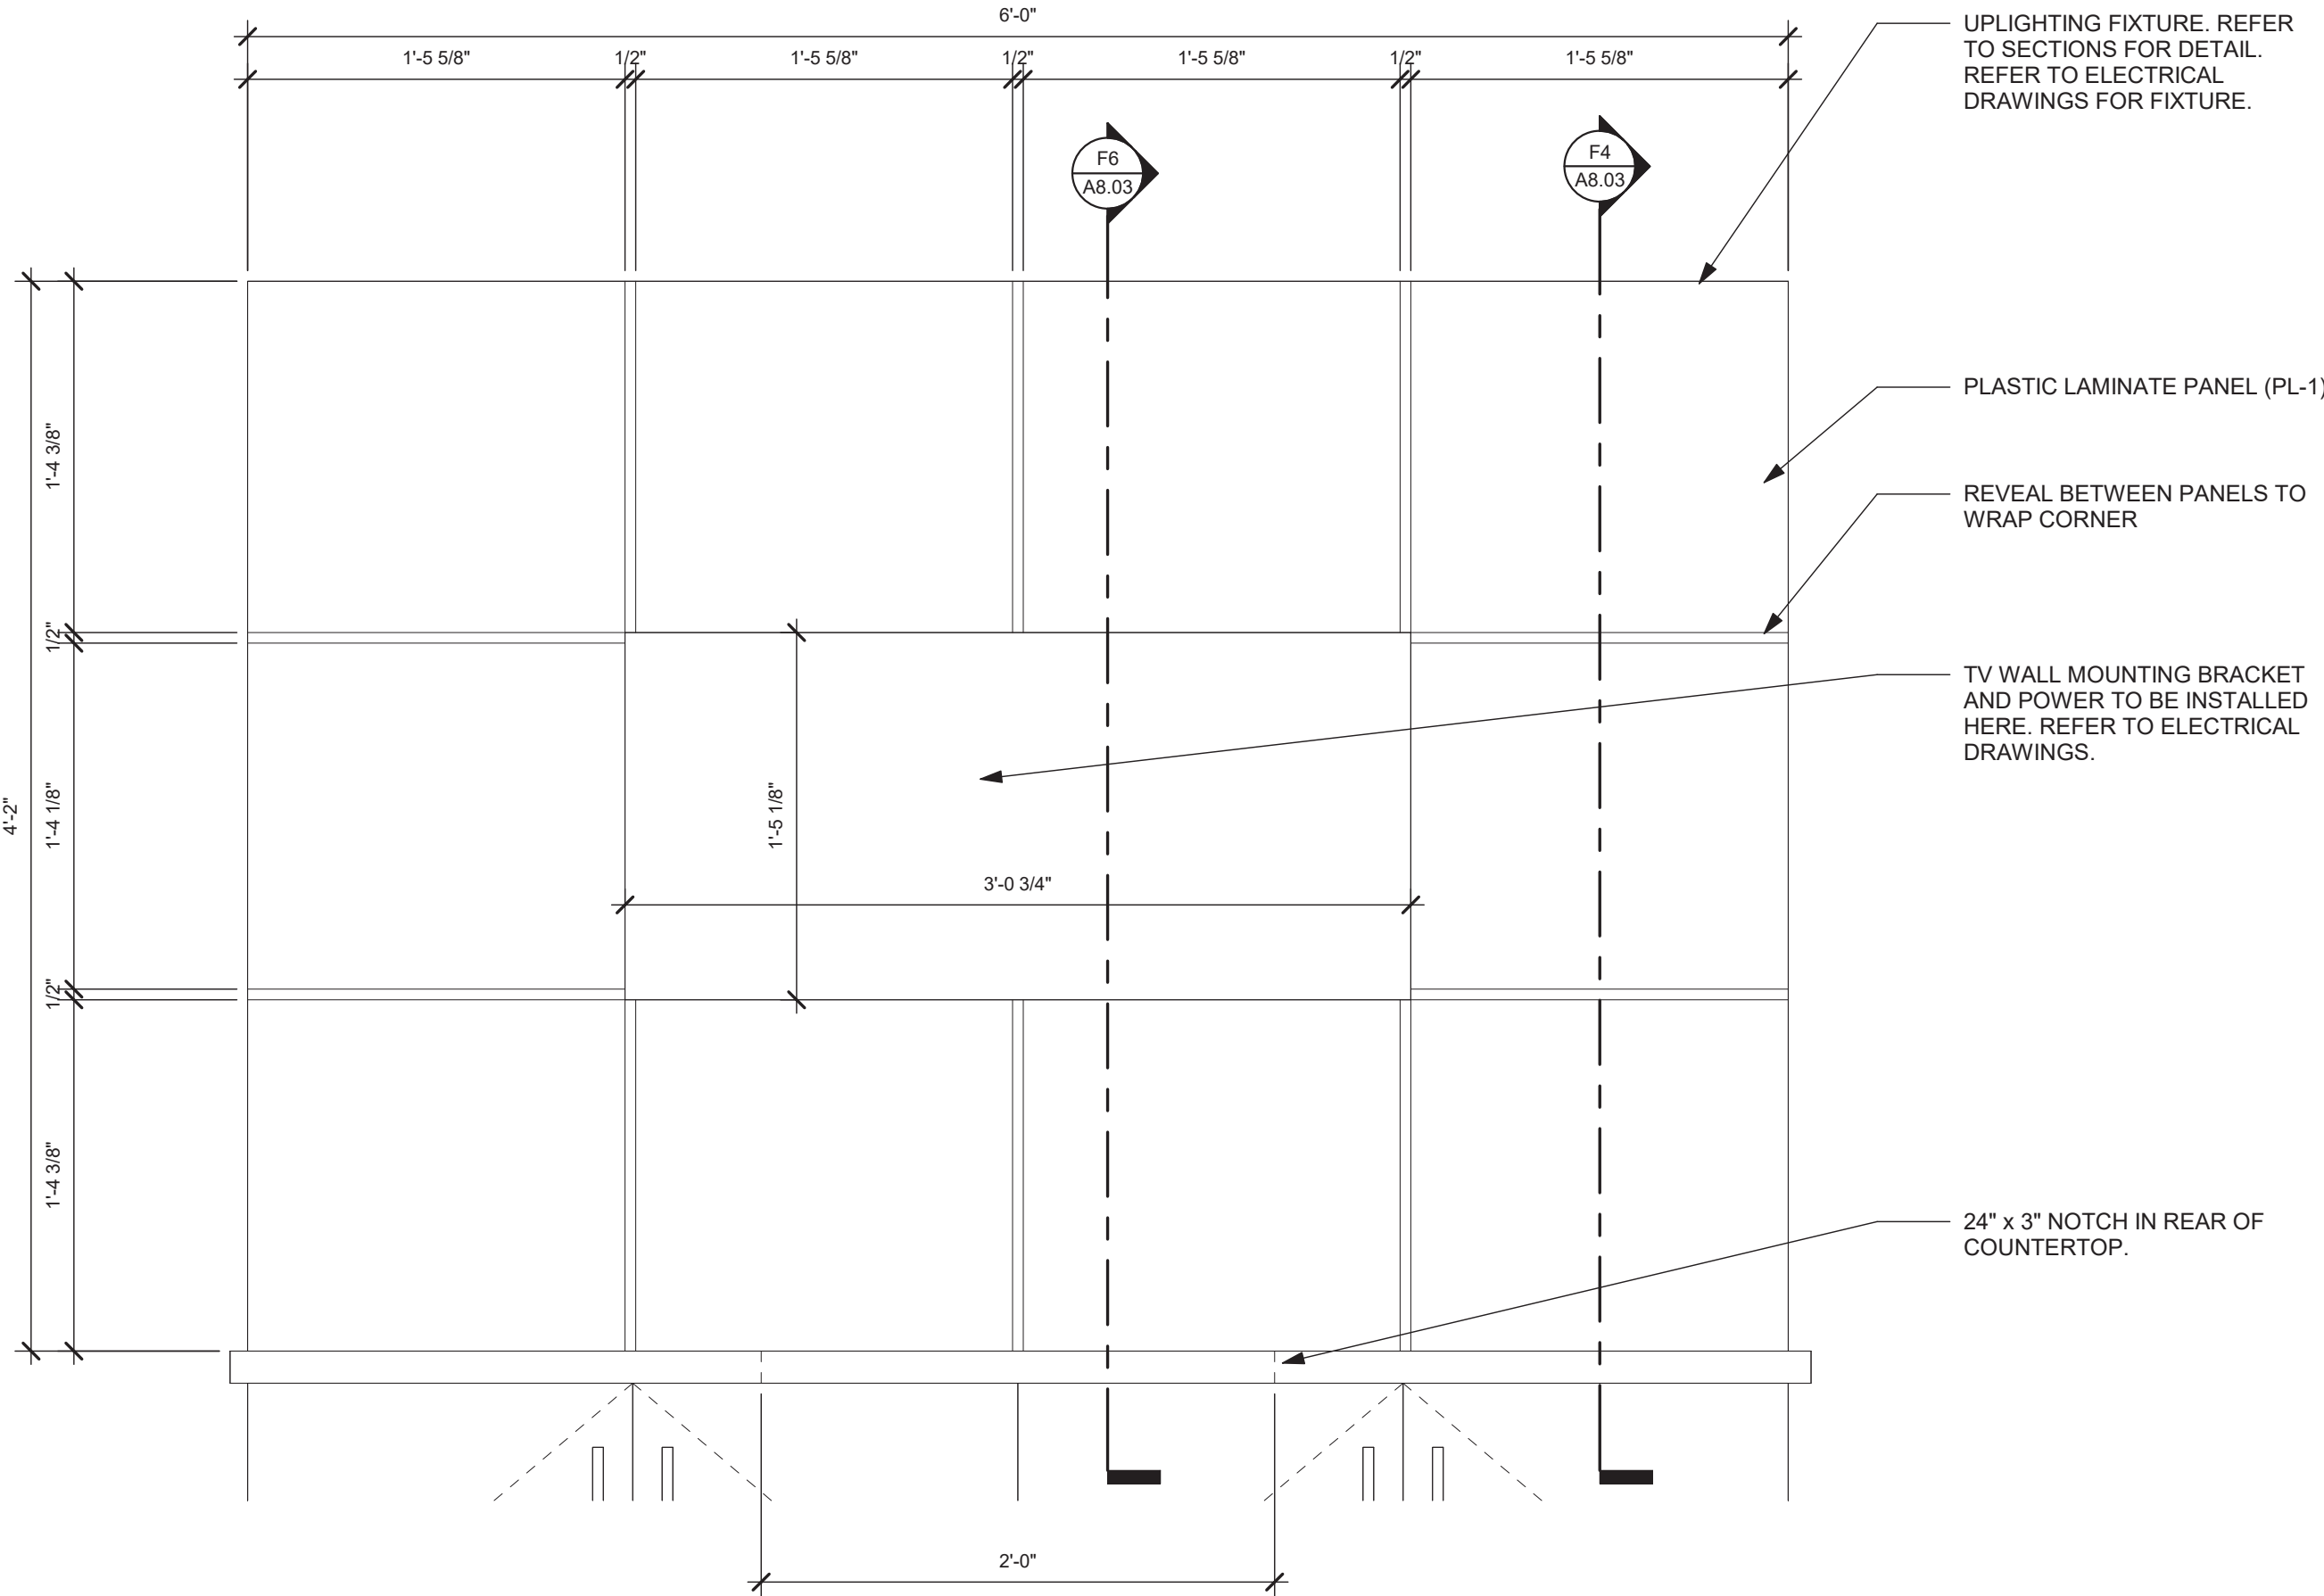

C4 TV DETAIL
1 1/2" = 1'-0"

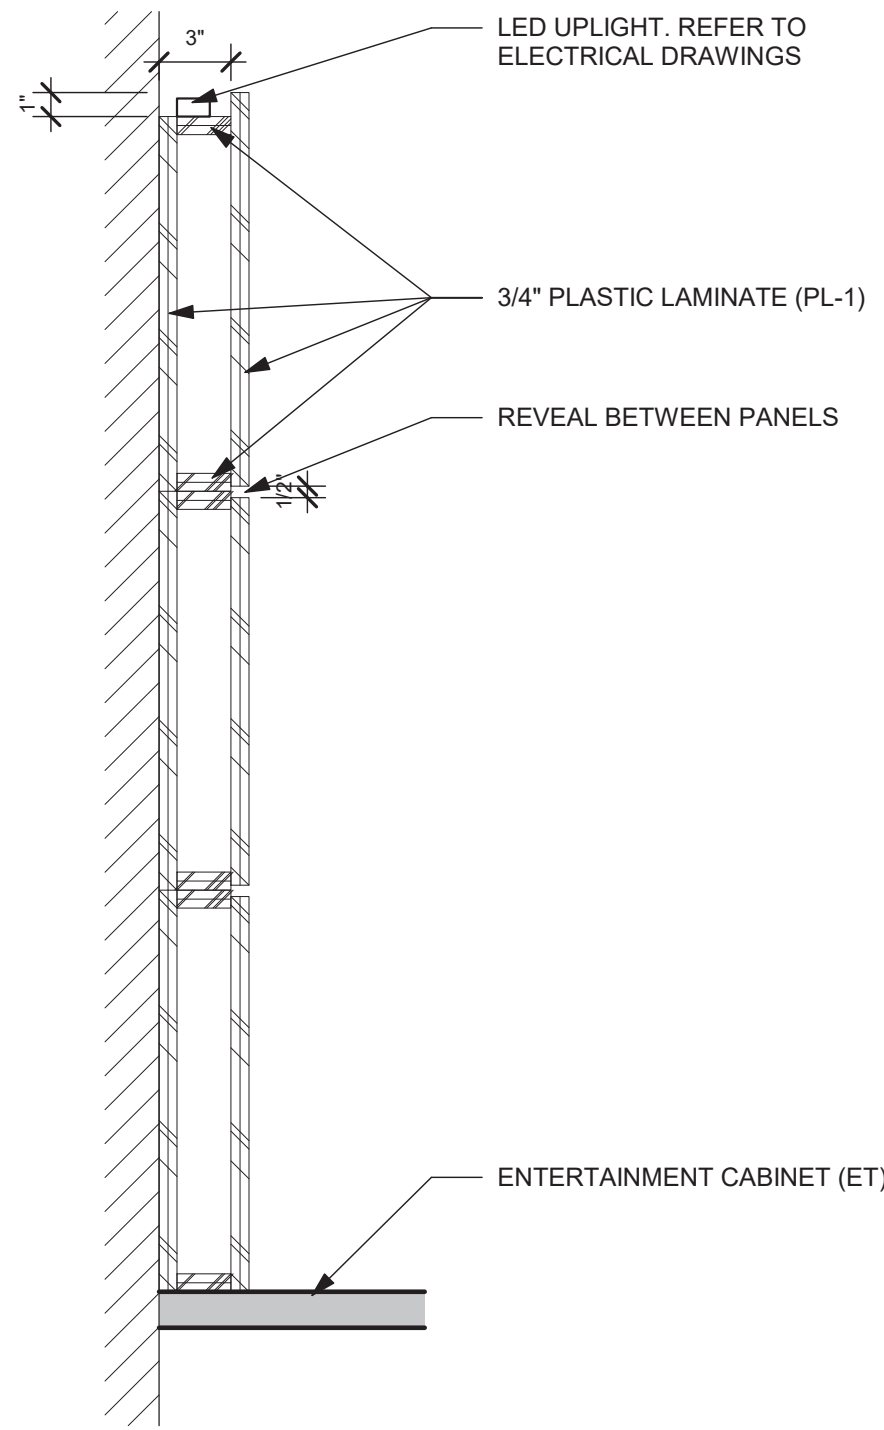

F4 TV SECTION 1
1 1/2" = 1'-0"

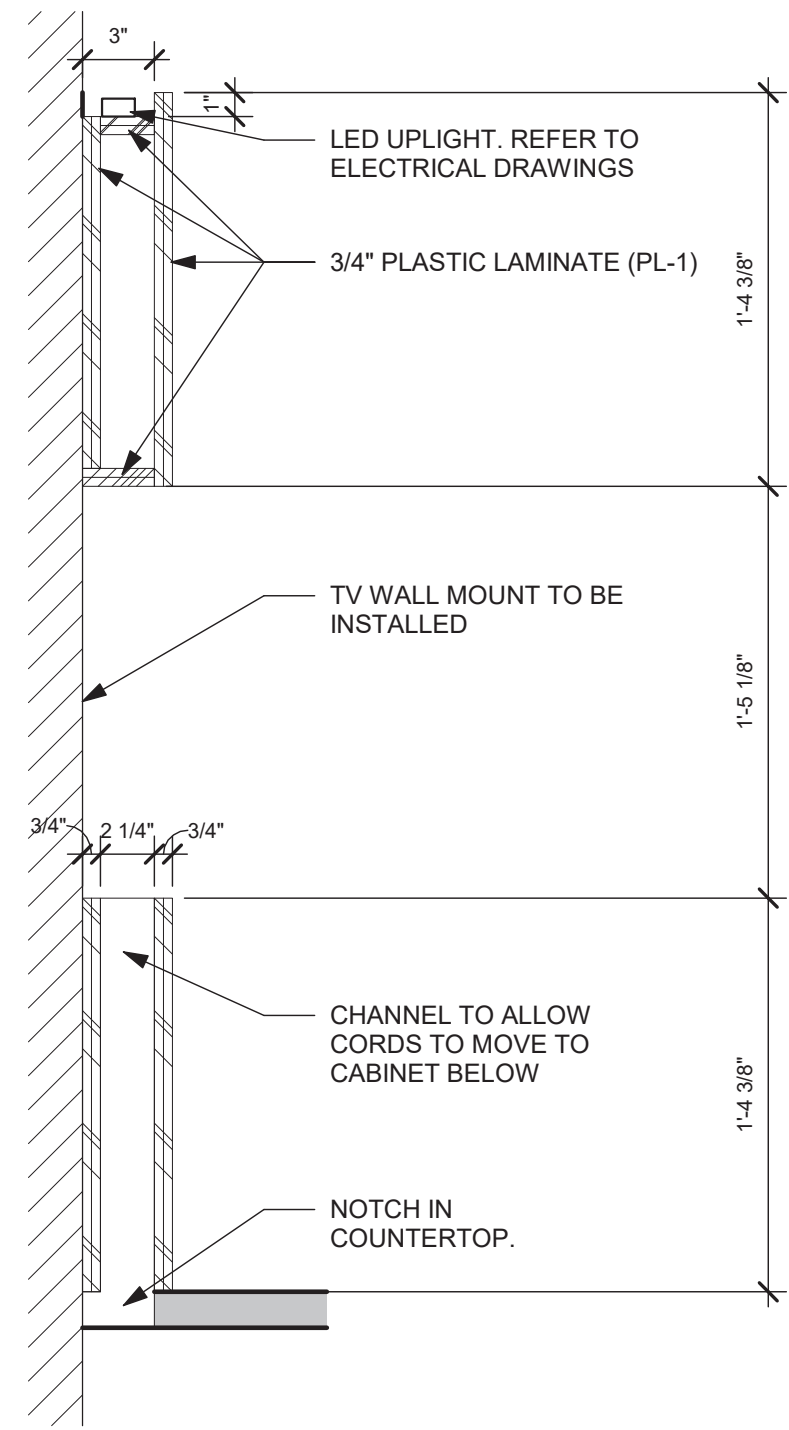

F6 TV SECTION 2
1 1/2" = 1'-0"



CITY OF DAYTON
**DAYTON FIRE DEPARTMENT
STATION 15**

2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/25	FOR CONSTRUCTION

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB

COPYRIGHT © 2025 - App Architecture, Inc.
TITLE
CASEWORK DETAILS

SHEET NO.
A8.03

1

2

3

4

5

6

7

A


B

C


D

E


F

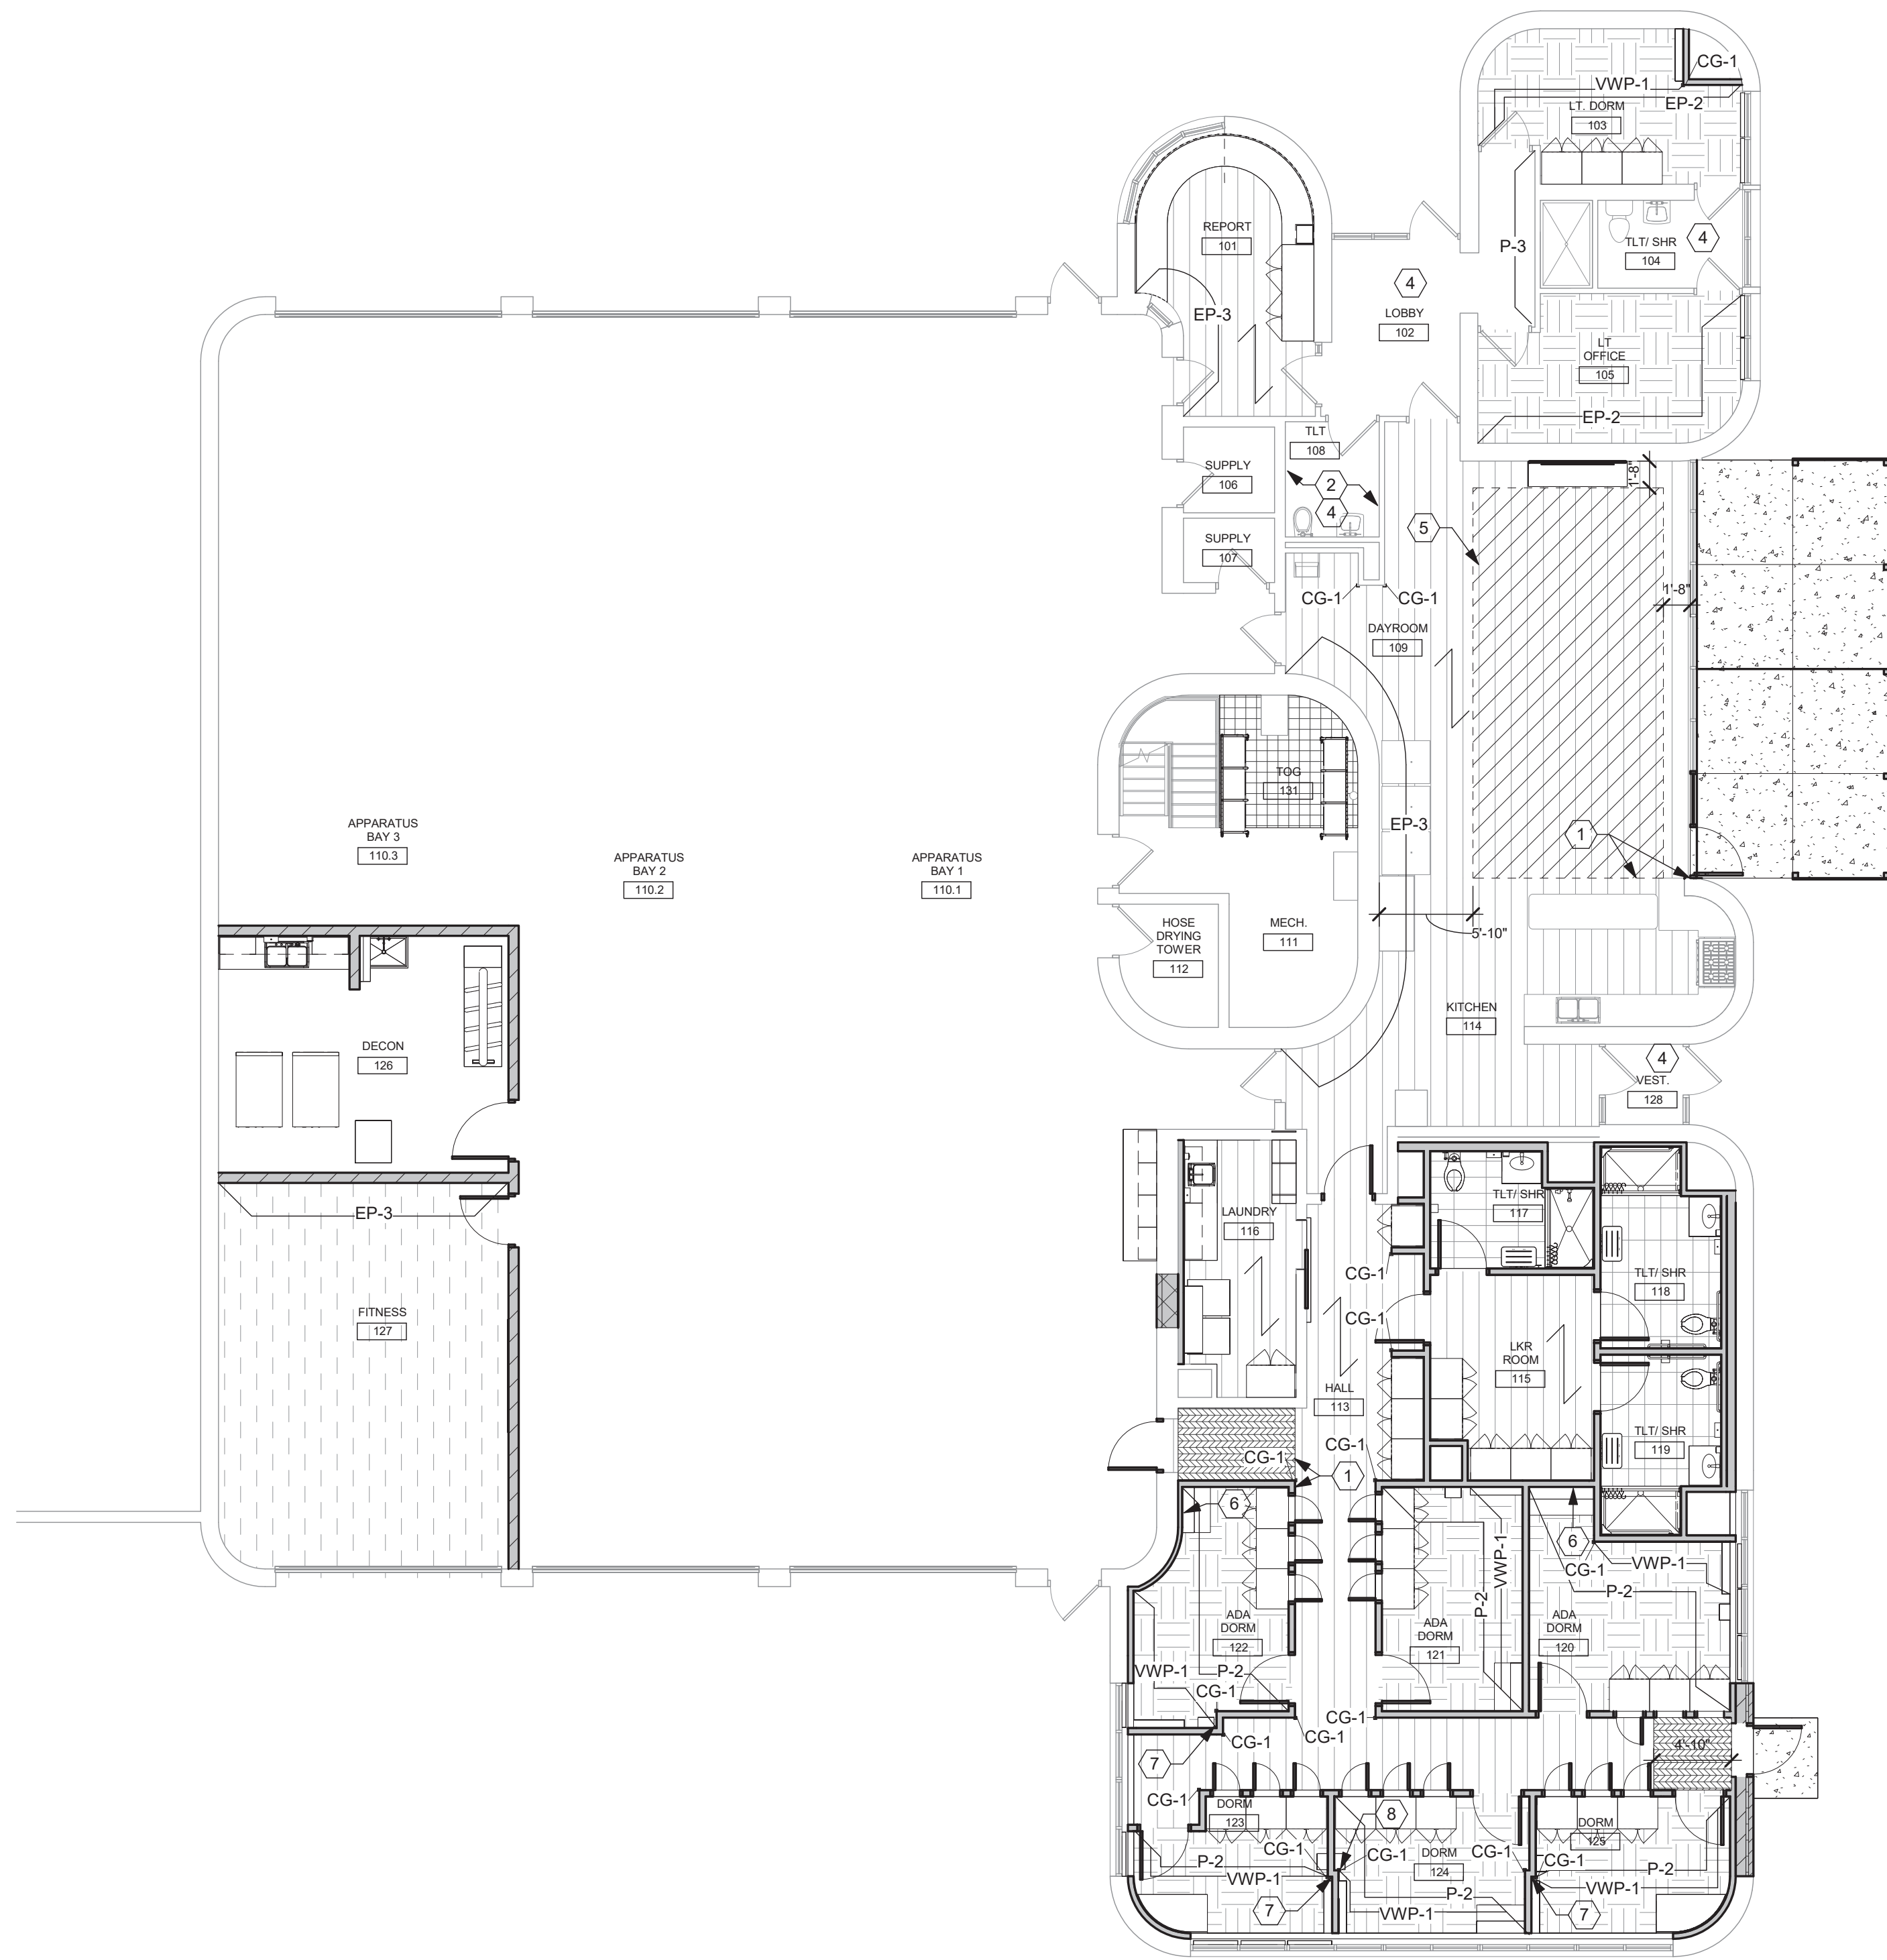


E1 FINISH FLOOR PLAN LEVEL 1
1/8" = 1'-0"

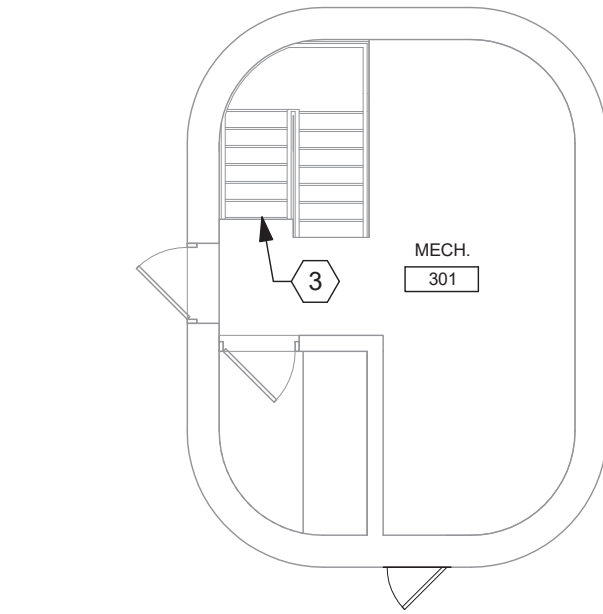

B5 LEVEL 3 FLOOR PLAN
1/8" = 1'-0"

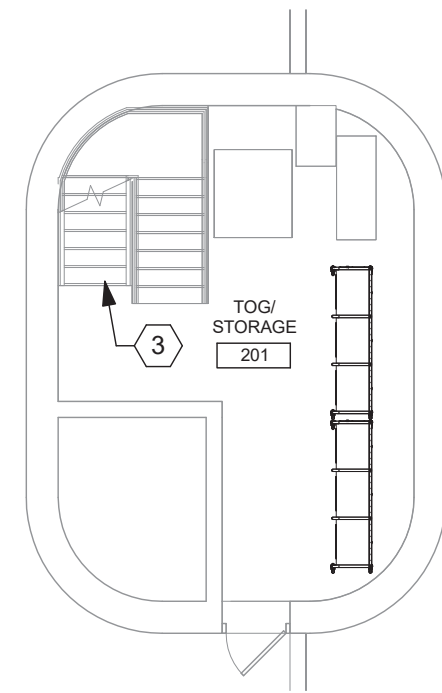

D5 LEVEL 2 FLOOR PLAN
1/8" = 1'-0"

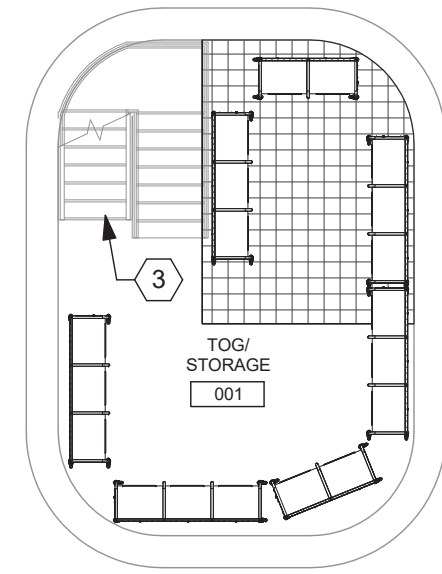

E5 BASEMENT FLOOR PLAN
1/8" = 1'-0"


CONSTRUCTION NOTES

00 INDICATES CONSTRUCTION NOTE.


- 1 ALIGN.
- 2 RETAIN EXISTING TILES. PAINT WALLS EP-2
- 3 PAINT METAL STAIR CASE EP-1
- 4 EXISTING FLOORING TO REMAIN.
- 5 EXTENTS OF LVT-1/LVT-2/LVT-3 FLOORING MIX.
- 6 VWP-1 UNDER DESK.
- 7 VWP-1 TO TERMINATE AT INNER CORNER OF WALL.
- 8 VWP-1 TO TERMINATE AT OUTER CORNER OF WALL.

GENERAL NOTES


- A. REFER TO FINISH SCHEDULE A0.02 FOR ADDITIONAL MATERIAL DETAILS A LOCATIONS.
- B. TRANSITION STRIPS ARE REQUIRED WHERE DIFFERING FLOORING TYPES MEET.
- C. REFER TO ENLARGED FLOOR PLANS FOR TILE LAYOUTS AND DIMENSIONS.




CPT-1 CARPET TILE




MAT-1 WALK OFF MAT




PT-1 PORCELAIN TILE



LVT-1 / LVT-2 LUXURY VINYL TILE
50 / 50 MIX




LVT-1 / LVT-2 / LVT-3 LUXURY VINYL TILE
40 / 40 / 10 MIX




METAL GRATE



FLOORING DIRECTION



VWP-1 VINYL WALL
PROTECTION



ACCENT PAINT COLOR /
LOCATION

A

B

C

D

E

F

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/25	FOR CONSTRUCTION

DATE	08/01/25
JOB NO.	4284.00
DRAWN	AEE
CHECKED	CMS/TJB
COPYRIGHT © 2025 - App Architecture, Inc.	
TITLE FINISHES FLOOR PLAN	
SHEET NO.	

BASEMENT FIRE SUPPRESSION

SCALE: 1/8" = 1'-0"

SECOND FLOOR FIRE SUPPRESSION

SCALE: 1/8" = 1'-0"

FIRST FLOOR FIRE SUPPRESSION

SCALE: 1/8" = 1'-0"

THIRD FLOOR FIRE SUPPRESSION

SCALE: 1/8" = 1'-0"

CONSTRUCTION NOTES

1. AREA TO BE SUPPRESSED.
2. FIRE SERVICE. SEE DETAIL THIS SHEET.

App Architecture
creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com



JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025		FOR CONSTRUCTION

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ
COPYRIGHT © 2025 - App Architecture, Inc.	

TITLE
FIRE SUPPRESSION
PLANS

SHEET NO.

F2.1

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 233-3801
PROJECT # 24065

A

B

C

D

E

F

PIPE HANGER SCHEDULE - PLUMBING

GENERAL NOTES FOR PIPE HANGERS:

DESIGN SUPPORTS FOR MULTIPLE PIPES CAPABLE OF SUPPORTING COMBINED WEIGHT OF SUPPORTED SYSTEMS, SYSTEM CONTENTS, AND TEST WATER.

DESIGN SEISMIC-RESTRAINT HANGERS AND SUPPORTS FOR PIPING AND OBTAIN APPROVAL FROM AUTHORITIES HAVING JURISDICTION.

WELDING: QUALIFY PROCEDURES AND PERSONNEL ACCORDING TO ASME BOILER AND PRESSURE VESSEL CODE: SECTION IX.

ATTACHMENT OF PIPE HANGER RODS TO THE STRUCTURE SHALL BE WITH:

1. BEAM CLAMPS FOR STEEL CONSTRUCTION EQUAL TO ANVIL FIG. 92, 93, OR 94. UTILIZE SWIVEL TYPE.

IN SLOPED STEEL CONSTRUCTION TO PROVIDE VERTICAL SUPPORT OF PIPE WITHOUT BENDING HANGER RODS.

2. SIDE BEAM BRACKET FOR WOOD CONSTRUCTION EQUAL TO ANVIL FIG. 206.

3. CHANNEL SUPPORT SYSTEM EQUAL TO UNISTRUT OR HILTI.

ATTACHMENT TO MANUFACTURED TRUSSES AND OTHER ENGINEERED STRUCTURAL MEMBERS AND SUPPORTS SHALL BE DONE IN ACCORDANCE WITH THE STRUCTURAL MANUFACTURER'S RECOMMENDATIONS. REFER TO THE ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR TYPE OF ENGINEERED STRUCTURAL SYSTEMS BEING USED. CONNECTIONS TO THESE STRUCTURAL MEMBERS SHALL BE MADE WITH CONNECTION DEVICES AND METHODS APPROVED BY THE STRUCTURAL MANUFACTURER. PROVIDE ADDITIONAL SUPPORTS WITH SUPPLEMENTAL STEEL SHAPES WHEN SPACING BETWEEN STRUCTURAL MEMBERS EXCEEDS SPECIFIED DISTANCES.

ADJUST PIPE HANGERS TO PROPER ELEVATION AND SET HANGER RODS IN A VERTICAL POSITION BEFORE PIPE INSULATION IS INSTALLED.

THE FIRST TWO HANGERS ON PIPING CONNECTING TO MOTOR DRIVEN EQUIPMENT SHALL BE FITTED WITH A STEEL SPRING AND NEOPRENE VIBRATION ISOLATION SECTION SIMILAR TO MASON INDUSTRIES, NO. 30N.

TRAPEZE HANGERS FOR NUMEROUS PIPES RUN IN PARALLEL MAY BE UTILIZED. HORIZONTAL SUPPORT MEMBERS SHALL BE UNISTRUT TYPE SECTION WITH PIPE ROLLERS (TO ALLOW FOR EXPANSION TRAVEL) AND SPRING AND NUT CONNECTORS, SUSPENDED WITH HANGER RODS AND ATTACHMENTS SIMILAR TO INDIVIDUAL PIPE HANGER SUSPENSION.


SHORTENED EXTENDED LEGS OF PIPE RISER CLAMPS AS NEEDED TO MAINTAIN CONCEALMENT OF THE CLAMP WITHIN THE PIPE CHASE. INSURE THAT ADEQUATE SUPPORT IS STILL MAINTAINED.

HANGER ASSEMBLIES EXPOSED ON COMPLETION OF THE PROJECT SHALL BE PAINTED BEFORE INSTALLATION.

PIPE SUPPORTS FOR PIPE RUNNING ACROSS THE ROOF SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND AS DETAILED. INSTALL PROTECTIVE SLIP SHEETS OF ROOFING MEMBRANE UNDER THE BASES TO SATISFY REQUIREMENTS OF BOTH THE ROOFING MANUFACTURER AND THE SUPPORT SYSTEM MANUFACTURER.

IN PIPING SYSTEMS WITH MECHANICAL JOINT COUPLINGS, PIPE HANGERS SHALL BE PROVIDED ON HORIZONTAL PIPING AT NORMAL SPECIFIED INTERVALS AND, IN ADDITION, SO THAT NO PIPE SHALL BE LEFT UNSUPPORTED BETWEEN ANY TWO COUPLINGS NOR LEFT UNSUPPORTED WHENEVER A CHANGE IN DIRECTION TAKES PLACE. VERTICAL PIPING SHALL BE SUPPORTED AT NORMAL SPECIFIED INTERVALS OR EVERY OTHER PIPE LENGTH, WHICH EVER IS MORE FREQUENT. THE BASE OF THE RISER OR BASE FITTING SHALL BE SUPPORTED.

SYSTEM & SIZE	ORIENTATION & SIZE	SPACING
STEEL PIPING	VERTICAL	AT BASE AND 15 FT MAXIMUM
	HORIZONTAL 2" & SMALLER	8 FT.
	HORIZONTAL 2.5" - 6"	10 FT.
	HORIZONTAL 8" & LARGER	12 FT.
CAST IRON	VERTICAL	AT BASE AND 15 FT MAXIMUM
	HORIZONTAL	AT 10 FT. INTERVALS. SUPPORT EACH LENGTH OF PIPE NOT MORE THAN 18" FROM THE JOINT. SUPPORT TERMINAL ENDS OF HORIZONTAL RUNS AND BRANCHES AND EACH CHANGE IN DIRECTION. 5" AND LARGER PROVIDE BRACING TO PREVENT HORIZONTAL MOVEMENT IN ACCORDANCE WITH CISPI "SOIL PIPE AND FITTINGS HANDBOOK"
COPPER TUBING	VERTICAL	AT BASE AND 15 FT MAXIMUM
	HORIZONTAL 1.25" & SMALLER	6 FT.
	HORIZONTAL 1.5" - 2"	8 FT.
	HORIZONTAL 2.5" & LARGER	10 FT.

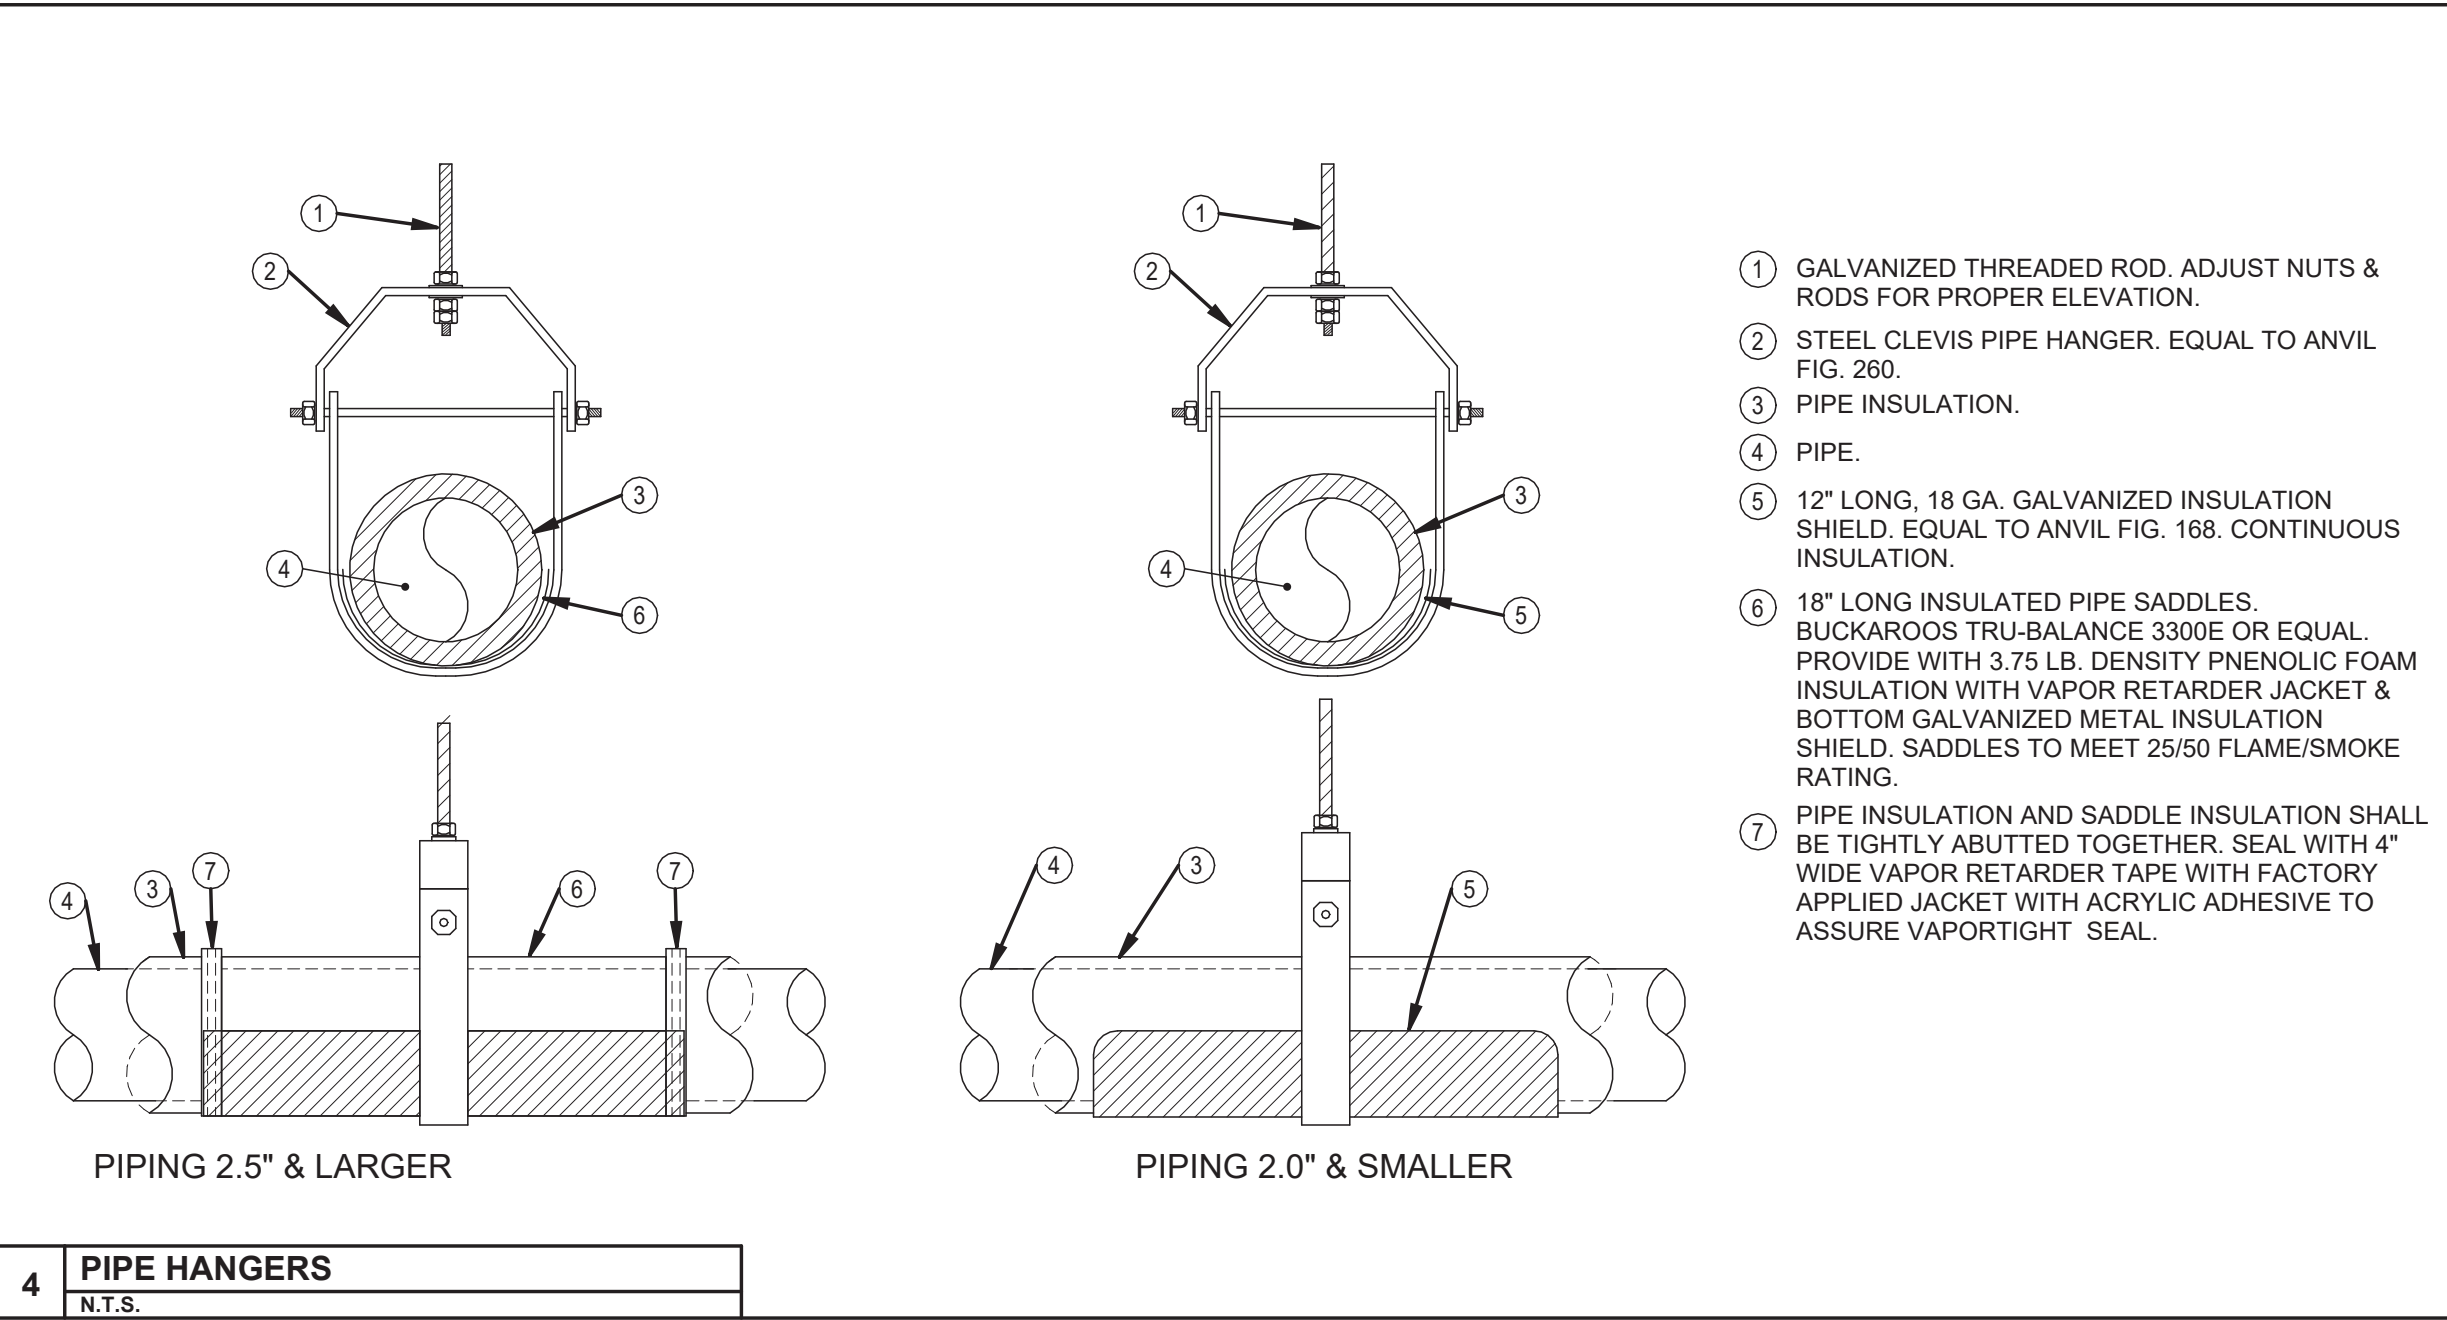

PLUMBING FIXTURE SCHEDULE

ITEM	FIXTURE DESCRIPTION	FIXTURE	SERVICES				MTG. HGT.	TRIM REQUIREMENTS						NOTES
			H.W.	C.W.	SAN.	VENT		SUPPLY	STOPS	WASTE	TRAP	CARRIERS	ACCESSORIES	
W1	WATER CLOSET/ VIT. CHINA/ FLOOR SET/ MANUAL FLUSH VALVE/ 1.6 GPF/ ELONGATED BOWL/ 16 1/2" RIM HEIGHT/ 1,000 MG M&P SCORE/ OPEN FRONT SEAT WITH LID/ ACCESSIBLE	AM. STANDARD # 3043.001	--	1"	4"	2"	--	SLOAN # SLOAN 111-1.6	UNIT	UNIT	INTEGRAL	--	SEAT BEMIS # 1950SSTDG	
L1	LAVATORY/ SOLID SURFACE/ INTEGRAL WITH COUNTERTOP/ SINGLE LEVER CAST BRASS FAUCET/ 0.5 GPM/ ACCESSIBLE	BY OTHERS	1/2"	1/2"	1 1/4"	1 1/2"	--	AM. STANDARD # 6114.116	MCGUIRE # LFBV2165	WITH TRAP	MCGUIRE # PW2150WC		POWERS # LFE480	
S1	SINK/ ST. ST./ UNDERMOUNT/ SINGLE BOWL/ 21" X 15" X 10" DEEP BOWL/ SINGLE LEVER FAUCET W PULL DOWN SPRAY	ELKAY # EFU211510T	1/2"	1/2"	1 1/2"	1 1/2"	--	AM. STANDARD STUDIO S # 4803410	MCGUIRE # LFBV2165	MCGUIRE # 151A	MCGUIRE # 8912			
S2	SINK/ ST. ST./ INTEGRAL W C'TOP/ DOUBLE BOWL/ SINGLE LEVER FAUCET W PULL DOWN SPRAY W COIL/ BASKET STRAINER/ EMERG. DRENCH HOSE WITH MIXING VALVE	BY OTHERS	(2) 1/2"	(2) 1/2"	(2) 1 1/2"	1 1/2"	--	AM. STANDARD STUDIO S # 4803350	MCGUIRE # LFBV2165	MCGUIRE # 151A (2 REQ'D)	MCGUIRE # 8912 & # 111	--	GUARDIAN # G5022-HG & G3600LF	
SH1	SHOWER/ STALL BY OTHERS/ CENTER DRAIN STYLE W NO THRESHOLD/ PRESSURE BALANCING MIXING VALVE WITH FIXED HEAD AND HAND HELD ON SLIDE BAR/ DIVERTER VALVE IN WALL	BY OTHERS	1/2"	1/2"	3"	1 1/2"	VALVE 40" HEAD 78"	POWERS #E710-M-4-N-B-W	UNIT	UNIT	SAME AS SANITARY PIPING	--	--	
SH2	SHOWER/ STALL BY OTHERS/ TRENCH DRAIN STYLE W NO THRESHOLD/ PRESSURE BALANCING MIXING VALVE WITH FIXED HEAD AND HAND HELD ON SLIDE BAR/ DIVERTER VALVE IN WALL	BY OTHERS	1/2"	1/2"	3"	1 1/2"	VALVE 40" HEAD 78"	POWERS #E710-M-4-N-B-W	UNIT	UNIT	SAME AS SANITARY PIPING	--	--	
M1	MOP SINK/ FLOOR SET/ 24" SQ. 10" DEEP/ MOLDED STONE/ VINYL CAPS/ ST.ST. WALL PANELS/ ON 2 SIDES/ WALL MOUNTED FAUCET WITH INTEGRAL CHECK STOPS	FIAT # MSB2424	1/2"	1/2"	3"	1 1/2"	36" FAUCET	AM. STANDARD # 8351.112	UNIT	UNIT	SAME AS SANITARY PIPING	--	FIAT # E-88-AA, # MSG2424	
M2	MOP SINK/ FLOOR SET/ 24" x 36", 10" DEEP/ MOLDED STONE/ VINYL CAP/ ST.ST. WALL PANELS ON 3 SIDES/ WALL MOUNTED FAUCET WITH INTEGRAL CHECK STOPS AND HOSE AND SPRAY	FIAT # MSB3624	1/2"	1/2"	3"	1 1/2"	36" FAUCET	T & S BRASS # B1068	UNIT	UNIT	SAME AS SANITARY PIPING	--	FIAT # E-88-AA # MSG3624	
WB1	WASHER UTILITY CONNECTION BOX/ 1/4 TURN BALL VALVES WITH WATER HAMMER ARRESTOR/ WASTE CONNECTION	OATEY # 38540	3/4"	3/4"	2"	1 1/2"	30"	UNIT	BALL VALVES ABOVE CEILING	UNIT	SAME AS SANITARY PIPING	--	--	

EQUALS

AMERICAN STANDARD CHINA - KOHLER, ZURN, SLOAN

AMERICAN STANDARD FAUCETS - KOHLER, ZURN, CHICAGO, T&S BRASS

SLOAN FLUSH VALVES - ZURN, DELANEY

ELKAY SINKS - JUST, ADVANCED TABCO

MCGUIRE - WATTS, BRASS CRAFT

MCGUIRE "PROWRAP" - TRUEBRO "LAV GUARD", PLUMBEREX "PROEXTREME"

OATEY SUPPLY BOXES - IPS, GUY GRAY, SIOUX CHIEF

NOTES:

1. COORDINATE EXACT MOUNTING HEIGHT WITH MASONARY COURSING.

DRAIN SCHEDULE

TAG	DESCRIPTION	MANUFACTURER	MODEL NUMBER	OUTLET SIZE	FEATURES						STRAINER/GRATE						NOTES
					ANCHOR FLANGE	FLASHING CLAMP	UNDERDECK CLAMP	DBL/ DRAINAGE	SEDIMENT BUCKET	TOP/STRAINER SIZE	FLAT	DOME	OPEN (NO GRATE)	HALF OPEN	ADJUSTABLE	FUNNEL	
ED1	FLOOR DRAIN/ CAST IRON BODY/ CAST IRON SQUARE TOP/ CAST IRON SEDIMENT BUCKET	ZURN # Z610-YC		4"	•			•		12" SQ.	•				•		
ED2	FLOOR DRAIN/ CAST IRON BODY/ NICKEL BRONZE ROUND TOP/ ADJUSTABLE	ZURN # ZN415-B7		3"	•			•		7" DIA	•				•		1.
ECO	EXTRA HEAVY DUTY CLEANOUT/ FLOOR SET/ NICKEL-BRONZE TOP/ CAST IRON BODY/ MIP THREADED CONNECTION/ ABS PLUG	ZURN # ZN1400-K		SAME AS PIPE UP TO 4"		•					•				•		

NOTES

1. PROVIDE ASSE 1072 TRAP MAINTENANCE DEVICE ON DRAIN.

GENERAL LEGEND

EC ELECTRICAL CONTRACTOR.

FC FIRE PROTECTION CONTRACTOR.

GC GENERAL CONTRACTOR.

HC HVAC CONTRACTOR.

PC PLUMBING CONTRACTOR.

TC TEMPERATURE CONTROLS CONTRACTOR.

NIC NOT IN CONTRACT.

AFF ABOVE FINISHED FLOOR - TO BOTTOM OF ITEM UNLESS INDICATED OTHERWISE IN DRAWING.

(E) EXISTING.

ES EQUIPMENT SUPPLIER.

3 NOTE SYMBOL - APPLIES ONLY TO SHEET ON WHICH IS SHOWN.

2 DETAIL NOTE SYMBOL - APPLIES ONLY TO DETAIL ON WHICH IS SHOWN.

H-1 EQUIPMENT REFERENCE SYMBOL. ELECTRICAL CONNECTION REQUIRED.

123 ROOM NUMBER.

B H2 DETAIL SYMBOL. DETAIL "B" SHOWN ON SHEET H2.

A H1 SECTION SYMBOL. SECTION "A" DESIGNATION, SHOWN ON SHEET H1.

CONNECTION, NEW TO EXISTING.

UP TO SYMBOL. UP TO "FD1", SHOWN ON FLOOR ABOVE.

--- ITEM TO BE REMOVED.

EXISTING TO REMAIN.

NEW ITEM.

PLUMBING LEGEND

--- SANITARY DRAIN

--- VENT

---ST--- STORM DRAIN

--- COLD WATER

--- HOT WATER

--- HOT WATER RETURN

--- G --- NATURAL GAS

--- A --- COMPRESSED AIR

--- SHUT-OFF VALVE, SEE SCHEDULE FOR TYPE

--- CHECK VALVE

--- BALANCING VALVE - REFER TO DOMESTIC HOT WATER RETURN BRANCH LINE VALVING DETAIL FOR ASSEMBLY REQUIRED AT EACH LOCATION

--- VALVE ON RISER

--- UNION

--- PRESSURE REGULATOR

--- PRESSURE GAUGE

--- TEMPERATURE GAUGE

--- CONNECTION, BOTTOM

--- CONNECTION, TOP

--- DIRECTION OF FLOW

--- CAP

C.O. CLEAN OUT

V.R. VENT RISER

V.T.R. VENT THRU ROOF

S.S. SOIL STACK

V.S. VENT STACK

D.S. DOWNSPOUT (STORM)

PLUMBING INDEX OF DRAWINGS

SHEET	DRAWING TITLE
P0.1	LEGENDS AND SCHEDULES
P0.2	MATERIAL SCHEDULES
P1.1	BASEMENT AND FIRST FLOOR DEMOLITION PLANS
P1.2	SECOND AND THIRD FLOOR DEMOLITION PLANS
P2.1	BASEMENT AND UNDERFLOOR PLAN
P2.2	FIRST FLOOR PLAN
P2.3	SECOND FLOOR AND UPPER APPARATUS BAY PLAN
P3.1	DETAILS
P4.1	SOIL, WASTE, AND VENT DIAGRAM

NAUMAN & ZELINSKI LLC.

204 S. Ludlow Street Suite 400 Dayton, Ohio 45402

Phone: (937) 233-3801

PROJECT # 24065

A

B

C

D

E

F

App Architecture creative focused design

615 Woodside Drive, Englewood, Ohio 45322

T 937.836.8898 F 937.832.3696

www.app-arch.com

STATE OF OHIO

JEFFERY D. ZELINSKI 63822

REGISTERED PROFESSIONAL ENGINEER

JEFFERY D. ZELINSKI, LICENSE #63822

EXPIRATION DATE 12/31/2025

CITY OF DAYTON

DAYTON FIRE DEPARTMENT

STATION 15

2801 Wayne Ave., Dayton, Ohio, 45420

ISSUE

NO. DATE DESCRIPTION

08/01/2025 FOR CONSTRUCTION

DATE 08/01/2025

JOB NO. 4284.00

DRAWN DEG

CHECKED JDZ

COPYRIGHT © 2025 - App Architecture, Inc.

TITLE

LEGENDS AND SCHEDULES

SHEET NO.

P0.1

7/31/2025, 3:18:42 PM

VALVE SCHEDULE

GENERAL NOTES FOR VALVES:

QUALITY ASSURANCE
VALVES SHALL COMPLY WITH ANSI, ASTM AND ASME.

VALVES ON DOMESTIC WATER SYSTEMS SHALL BE "LEAD FREE" IN ACCORDANCE WITH THE FEDERAL SAFE WATER ACT (S3874) DEFINITION AND CONFORM TO NSF 61.

GROOVED END VALVES SHALL CONFORM TO ANSI/AWWA C-606.

PRODUCTS
WORKING PRESSURES SHALL EXCEED THOSE IMPOSED BY THE SERVICE APPLIED.

VALVES WHICH ARE INSULATED SHALL HAVE EXTENDED SHAFTS.

PROVIDE FLOW MEASURING GAUGES WITH COCKS, HOSES & CONNECTORS FOR BALANCING VALVES. PROVIDE METERING TOOL.

PROVIDE HOSE ADAPTORS ON DRAIN VALVES.

SWEAT END VALVES OF EQUAL CONSTRUCTION ARE ACCEPTABLE IN LIEU OF SCREWED ENDS.

IN MECHANICALLY JOINED SYSTEMS, VALVES OF EQUAL CONSTRUCTION WITH COMPATIBLE ENDS ARE ACCEPTABLE AND MAY BE MANUFACTURED BY THE COUPLING MANUFACTURER.

VALVE MANUFACTURERS:
BALL VALVES - NIBCO, WATTS, MILWAUKEE, APOLLO, CONBRACO, CRANE.
BALANCING VALVES - BELL & GOSSETT, ARMSTRONG, WATTS.
CHECK VALVES - NIBCO, STOCKHAM, WATTS.

EXECUTION
VALVES SHALL BE INSTALLED WITH STEM ABOVE CENTERLINE OF PIPE.

PIPING SYSTEM	VALVE TYPE					
	BUTTERFLY	BALL	CHECK	GATE	BALANCING	LUB. PLUG
DOMESTIC WATER SERVICE 2" AND LARGER				D18		
DOMESTIC WATER (CW, HW, & HWR) 2" AND SMALLER		B11, B14	C11, C13		E12	
DOMESTIC WATER (CW, HW, & HWR) 2.5" AND LARGER		B14	C12, C14 C16			
COMPRESSED AIR (175 PSI AND LESS) 2" AND SMALLER		B15				
INTERIOR NATURAL GAS 3" AND SMALLER		B17				
INTERIOR NATURAL GAS 4" AND LARGER						P11
EXTERIOR NATURAL GAS 2" AND SMALLER		B18				P12
EXTERIOR NATURAL GAS 3" AND LARGER						P11, P12

TYPE	DESCRIPTION	TYPE	DESCRIPTION	TYPE	DESCRIPTION
B11	NIBCO T-585-80-LF, 150 W.S.P., 2 PIECE BRONZE BODY, SCREWED ENDS, BRONZE BALL AND STEM, TFE SEAT AND SEAL, HANDLE. NSF/ASME 61	C11	NIBCO T-413-Y-LF, 125 W.S.P., BRONZE BODY, SCREWED ENDS, RENEWABLE BRONZE SWING DISC WITH TFE SEAT RING. NSF 61	D18	KENNEDY KS-FW 8068A, 200 PSI, NSF 61 EPOXY COATED CAST IRON BODY, RESILIENT WEDGE, O.S & Y., FLANGED ENDS
B14	APOLLO 70LF-240, 150 WSP, 2 PIECE LEAD-FREE BRONZE BODY, 316 STAINLESS STEEL BALL AND STEM, STANDARD PORT, TEFLON SEAT AND SEAL, HANDLE, NSF/ASME 61	C12	NIBCO F-938-33, 285 PSI C.W.P., DUCTILE IRON BODY, STAINLESS STEEL TRIM, FLANGED ENDS, RENEWABLE STAINLESS STEEL SWING DISC AND SEAT RING. NSF/ANSI 61-8	E12	ADJ. THERMOSTATIC, BALANCE, CALEFFI THEROSETTER LOW-LEAD BRASS BODY WITH ISOLATION VALVES AND TEMP GAUGE, EPDM SEATS, CALIBRATED NAMEPLATE, HANDLE WITH MEMORY STOP, NSF/ASME 61
B15	NIBCO T-580-CS-R-66 1500 W.O.G., 2 PIECE CARBON STEEL BODY, SCREWED ENDS, STAINLESS STEEL BALL AND STEM, TFE SEAT AND SEAL, HANDLE.	C13	NIBCO T-480-Y-LF, 125 W.S.P., IN-LINE SPRING ACTUATED CENTER GUIDED SILENT CHECK, BRONZE BODY, SCREWED ENDS, TFE DISC AND SEAT RING, NSF/ASME 61	P11	NORDSTROM NO. 143, 200 PSI, IRON BODY, ST. ST. STEM, FLANGED ENDS, WRENCH
B17	NIBCO T-FP-600A, 600 PSI NON-SHOCK COLD., 2 PIECE, BRASS BODY, SCREWED ENDS, FULL PORT, BRASS BALL, TFE SEAT, HANDLE. UL LISTED FOR GAS. ASME B16.44	C14	NIBCO F-910-LF 125 W.O.G., IN-LINE SPRING ACTUATED CENTER GUIDED SILENT CHECK, GLOBE STYLE, IRON BODY FOR INSTALLATION BETWEEN FLANGES, BRONZE SEAT AND DISC. NSF/ASME 61	P12	NORDSTROM NO. 115, 200 PSI, IRON BODY, ST. ST. STEM, FLANGED ENDS, WRENCH ASME B16.33
B18	NIBCO T-585(OR 580)-70-UL, 600 PSI NON-SHOCK COLD, 2 PIECE, BRONZE BODY, SCREWED ENDS, FULL PORT, BRASS BALL, TFE SEAT, HANDLE. UL LISTED FOR GAS. ASME B16.33	C16	WATTS SERIES LFWCV, 125 W.S.P. BRONZE BODY, SCREWED ENDS, BRONZE SWING DISC, NSF/ASME 61		

PIPE INSULATION SCHEDULE - PLUMBING

GENERAL NOTES:

QUALITY ASSURANCE
FIRE, SMOKE RATINGS: FLAME SPREAD RATING OF 25 OR LESS, SMOKE DEVELOPED RATING OF 50 OR LESS.

THICKNESSES SHALL CONFORM TO ASHRAE 90.1 MINIMUMS.

GREEN GUARD INDOOR AIR QUALITY CERTIFIED.

EXECUTION
INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS.

COLD SERVICE PIPE INSULATION AND VAPOR BARRIER/JACKET TO BE CONTINUOUS THRU FLOOR AND WALL SLEEVES AT ALL PIPE DEVICES AND PUMP CASINGS.

INSULATION AND VAPOR BARRIER TO BE CONTINUOUS AT PIPE HANGERS AND SUPPORTS ON HORIZONTAL PIPING.

VERTICAL PIPE SUPPORTS SHALL ATTACH DIRECTLY TO PIPE. INSULATE SUPPORT AND OTHER SURFACES WITH FLEXIBLE CLOSED CELL INSULATION, SAME THICKNESS AS SYSTEM INSULATION ON COLD SERVICE PIPES TO PREVENT CONDENSATION.

INSULATION MAY BE OMITTED ON HOT WATER VALVES AND DEVICES 2" AND SMALLER PIPE SIZE.

PRIMARY AND SECONDARY ROOF DRAIN SUMPS SHALL BE INSULATED WITH 1" THICK INSULATION.

THE FIRST 10 FEET OF SECONDARY STORM PIPING AFTER THE DRAIN SHALL BE INSULATED.

SYSTEM & SIZE	INSULATION THICKNESS	TYPE	LOCATION
DOMESTIC COLD WATER 1.5" & SMALLER	0.5"	F1	INTERIOR
DOMESTIC COLD WATER 2" & LARGER	1"	F1	INTERIOR
DOMESTIC HOT WATER, TEMPERED WATER, & HOT WATER RETURN 1.25" AND SMALLER	1"	F1	INTERIOR
DOMESTIC HOT WATER, TEMPERED WATER, & HOT WATER RETURN 1.5" AND LARGER	1.5"	F1	INTERIOR
INTERIOR HORIZONTAL STORM DRAINAGE	1"	F1	INTERIOR
CONDENSATE DRAINAGE	1"	F1	INTERIOR

TYPE	BASIS OF DESIGN	APPROVED EQUALS	DESCRIPTION
F1	OWENS-CORNING SSL1-ASJ	KNAUF 1000" PIPE, JOHNS MANVILLE MICRO-LOK HP	* INORGANIC GLASS FIBER WITH RESIN BONDING. * K=0.24 @ 100 DEG. F. * 3.5 - 5.5 PCF * PREFORMED TUBULAR. * WHITE FSRK JACKET. * LONGITUDINAL LAP WITH SELF-SEALING ADHESIVE. * ELBOWS, TEES, VALVES, CAPS, ETC., WHITE ONE PIECE, PREMOLDED 25/50 0.20" PVC FITTING COVERS WITH HIGH DENSITY FIBERGLASS INSULATION INSERTS SAME THICKNESS, K=0.26 EQUAL TO ZESTON OR PROTO.

BUILDING DRAIN SYSTEMS SCHEDULE STORM, SANITARY, & VENT

GENERAL NOTES:

QUALITY ASSURANCE
PIPING SHALL CONFORM TO OBC REQUIREMENTS.

PIPING SHALL COMPLY WITH ASME B31.9 "BUILDING SERVICES PIPING".

INSTALL CAST-IRON SOIL PIPING ACCORDING TO CISPI'S "CAST IRON SOIL PIPE AND FITTINGS HANDBOOK," CHAPTER IV, "INSTALLATION OF CAST IRON SOIL PIPE AND FITTINGS."

ON PIPING 5" AND LARGER PROVIDE BRACING AT EVERY BRANCH OPENING OR CHANGE IN DIRECTION AS REQUIRED BY CISPI'S "CAST IRON SOIL PIPE AND FITTINGS HANDBOOK," CHAPTER IV, "INSTALLATION OF CAST IRON SOIL PIPE AND FITTINGS."

INSTALL PVC SOIL AND WASTE DRAINAGE AND VENT PIPING ACCORDING TO ASTM D 2665.

PRODUCTS
PVC PIPING SHALL NOT BE USED IN SPACES USED AS PLENUMS.

EXECUTION
PIPE AND TUBING SHALL BE CUT AND FABRICATED TO FIELD MEASUREMENTS AND RUN PARALLEL TO NORMAL BUILDING LINES. PIPE INTERIOR SHALL BE CLEANED OF FOREIGN MATTER AND BURRS BEFORE ERECTION OF PIPE.

ANNUAL SPACE AROUND PIPING THRU ALL WALLS SHALL BE SEALED OFF WITH PERMANENT PLIABLE CAULKING OR APPROVED PATCHING SEALANT.

PROVIDE PIPING SLEEVES AT FLOORS, WALLS & ROOFS IN NEW CONSTRUCTION. EXISTING WALLS TO BE SAW CUT TO PASS NEW PIPING.

PIPING SHALL NOT BE RUN ABOVE ELECTRICAL SWITCHGEAR OR PANELBOARDS, NOR ABOVE THE ACCESS SPACE OF SUCH EQUIPMENT - NEC ARTICLE 384.

LAY BURIED BUILDING DRAINAGE PIPING BEGINNING AT LOW POINT OF EACH SYSTEM. INSTALL TRUE TO GRADES AND ALIGNMENT INDICATED, WITH UNBROKEN CONTINUITY OF INVERT.

SUPPORT PIPING FROM BUILDING STRUCTURE WITH RODS, ANGLES & CLAMPS ATTACHED TO STRUCTURE. HANG PIPING WITH CLEVIS HANGER OR ROLLER SUPPORTS. HANGERS SHALL BE INSTALLED ON CENTERS AS RECOMMENDED BY MANUFACTURER.

SLOPE DRAINAGE PIPING AT 1/4" PER FOOT (2%) FOR PIPING SMALLER THAN 3" AND 1/8" PER FOOT (1%) FOR PIPING 3" AND LARGER.

VENT PIPING SHALL BE PITCHED FOR DRAINAGE.

CLOSE OPEN ENDS OF PIPING DURING CONSTRUCTION.

COUPLINGS AND GASKETS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

MAKE CHANGES IN DIRECTION FOR SOIL AND WASTE DRAINAGE AND VENT PIPING USING APPROPRIATE BRANCHES, BENDS, AND LONG-SWEEP BENDS. SANITARY TEES AND SHORT-SWEEP 1/4 BENDS MAY BE USED ON VERTICAL STACKS IF CHANGE IN DIRECTION OF FLOW IS FROM HORIZONTAL TO VERTICAL.

DO NOT ENCLOSE, COVER, OR PUT PIPING INTO OPERATION UNTIL IT IS INSPECTED AND APPROVED BY AUTHORITIES HAVING JURISDICTION.

TESTING
PIPING SHALL BE TESTED IN ACCORDANCE WITH THE AUTHORITY HAVING JURISDICTION.

PIPING SYSTEM		TYPE	
SANITARY PIPING BELOW FLOOR SLAB IN GRADE		P1	
SANITARY & VENT PIPING ABOVE THE FLOOR		C11, C12	
STORM DRAINAGE BELOW THE FLOOR IN SLAB		P1, C11, C12, C13	
STORM DRAINAGE ABOVE FLOOR		P1, C11, C12, C13	
INDIRECT DRAINS/CONDENSATE DRAIN LINES 1" & SMALLER		C1, C5, C8	

TYPE	DESCRIPTION	TYPE	DESCRIPTION
C11	NO-HUB CAST IRON (STD) SERVICE WEIGHT ASTM A888 OR CISPI 301 SHIELDED COUPLINGS ASTM C1277 OR CISPI 310 RUBBER SLEEVE ASTM C564	C1	SOLDERED COPPER TYPE "L" HARD COPPER ASTM B88 WROUGHT COPPER OR CAST BRONZE FITTINGS 95-5 SOLDER
C12	HUB & SPIGOT CAST IRON ASTM A74, SERVICE CLASS DWV FITTING RUBBER GASKET ASTM C564	C5	PRESS-FIT COPPER TYPE "L" HARD COPPER ASTM B88 COPPER OR BRONZE FITTINGS ASTM B16,18 OR B16,22 250 DEG. F. EPDM SEALS
P1	PVC SCHEDULE 40 PVC ASTM D2665 AND D2321 DWV FITTINGS, ASTM D3311 GLUED JOINTS	C8	TYPE "K" SOFT COPPER ASTM B88 WROUGHT COPPER OR CAST BRONZE FITTINGS 95-5 SOLDER

BUILDING SUPPLY SYSTEMS SCHEDULE WATER, COMPRESSED AIR, & GAS

GENERAL NOTES:

QUALITY ASSURANCE
PIPING SHALL CONFORM TO OBC REQUIREMENTS.

PIPING SHALL COMPLY WITH ASME B31.9 "BUILDING SERVICES PIPING".

ALL COMPONENTS OF DOMESTIC WATER SYSTEMS (CW, HW, & HWR) SHALL BE "LEAD FREE" IN ACCORDANCE WITH THE FEDERAL SAFE WATER ACT (S3874) DEFINITION AND CONFORM TO NSF 61.

PRODUCTS
DIELECTRIC CONNECTORS SHALL BE PROVIDED AT CONNECTIONS BETWEEN FERROUS & COPPER PIPING.

GAS PRESSURE REGULATORS SHALL BE CAST IRON SELF-OPERATING SPRING LOADED TYPE. VALVE 125 PSI. SPRING AND DIAPHRAGM CASINGS SHALL BE ALUMINUM. REGULATOR SHALL HAVE AN INTERNAL RELIEF VALVE ASSEMBLY, TAPPED VENT CONNECTION WITH REMOVABLE SCREEN ON THE SPRING CASING AND AN EXTERNAL PILOT OPERATOR TO AFFORD A 5% MAXIMUM DROOP. OVER-PRESSURE PROTECTION SHALL BE TEN TIMES THE INLET PRESSURE (OR HIGHER AS MAY BE REQUIRED BY THE GAS COMPANY). FISHER TYPE S102 OR S202 OR EQUAL BY SPRAGUE OR EQUIMETER.

UNIONS
COPPER TUBING - WROUGHT OR CAST COPPER, CLASS 150, SOLDERED ENDS. THREADED STEEL PIPE - MALLEABLE IRON W/GROUND SEAT, 300 LB SCREWED ENDS.

MECHANICALLY FORMED TEES AND COUPLINGS (T-DRILL) ARE NOT PERMITTED.

EXECUTION
PIPE AND TUBING SHALL BE CUT AND FABRICATED TO FIELD MEASUREMENTS AND RUN PARALLEL TO NORMAL BUILDING LINES. PIPE INTERIOR SHALL BE CLEANED OF FOREIGN MATTER AND BURRS BEFORE ERECTION OF PIPE.

ANNUAL SPACE AROUND PIPING THRU ALL WALLS SHALL BE SEALED OFF WITH PERMANENT PLIABLE CAULKING OR APPROVED PATCHING SEALANT.

PROVIDE PIPING SLEEVES AT FLOORS, WALLS & ROOFS IN NEW CONSTRUCTION. EXISTING WALLS TO BE SAW CUT TO PASS NEW PIPING.

PIPING SHALL NOT BE RUN ABOVE ELECTRICAL SWITCHGEAR OR PANELBOARDS, NOR ABOVE THE ACCESS SPACE OF SUCH EQUIPMENT - NEC ARTICLE 384.

PIPING SHALL BE PITCHED FOR DRAINAGE.

CLOSE OPEN ENDS OF PIPING DURING CONSTRUCTION.

MECHANICAL JOINT PIPING SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

GAS PRESSURE REGULATORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. PROVIDE VALVED GAUGE TAPS UPSTREAM AND DOWNSTREAM OF THE REGULATOR. VENT PIPING SHALL BE EXTENDED INDIVIDUALLY FROM EACH REGULATOR AND GAS VENTING DEVICE TO OUTSIDE THE BUILDING IN AN APPROVED LOCATION.

SUPPORT PIPING FROM BUILDING STRUCTURE WITH RODS, ANGLES & CLAMPS ATTACHED TO STRUCTURE. HANG PIPING WITH CLEVIS HANGER OR ROLLER SUPPORTS. HANGERS SHALL BE INSTALLED ON CENTERS AS RECOMMENDED BY MANUFACTURER.

CLEAN INTERIOR WATER PIPING AFTER INSTALLATION BY FLUSHING WITH CLEAN POTABLE WATER TO CLEAR ALL INTERNAL DEBRIS.

ALL NEW AND EXISTING DOMESTIC WATER PIPING SHALL BE DISINFECTED IN CONFORMANCE WITH AWWA C651-96. DOMESTIC WATER PIPING SHALL BE SANITIZED PRIOR TO PUTTING SYSTEM IN OPERATION BY A COMPANY OR PERSONNEL REGULARLY ENGAGED IN THE PERFORMANCE OF THIS SERVICE.


EXTERIOR NATURAL GAS PIPING SHALL BE PAINTED WITH 2 COATED OF EXTERIOR GRADE PAINT FOR PROTECTION.

TESTING
DOMESTIC WATER PIPING - 125 PSI FOR MIN. 6 HOURS AT THE LOW POINT IN THE SYSTEM.

NATURAL GAS PIPING - 100 PSI COMPRESSED AIR FOR 6 HOURS.

PIPING SYSTEM		TYPE	
DOMESTIC WATER SERVICE PIPING 3" & LARGER		D1	
DOMESTIC COLD, HOT AND RECIRCULATING WATER		C1, C4, C5, P2	
NATURAL GAS ABOVE GROUND AT PRESSURES 5 PSI & LESS		S1, S2, S6	
MISCELLANEOUS UNDERGROUND NATURAL GAS (OUTSIDE OF BUILDING)		PE1	


TYPE	DESCRIPTION	TYPE	DESCRIPTION
C1	SOLDERED COPPER TYPE "L" HARD COPPER ASTM B88 WROUGHT COPPER OR CAST BRONZE FITTINGS 95-5 SOLDER	S1	WELDED BLACK STEEL SCHEDULE 40, ASTM A53 TYPE E WROUGHT-STEEL WELDING FITTINGS: ASTM A 234/A 234M 150 LB. C.I. FITTINGS
C4	GROOVED COPPER TYPE "L" HARD COPPER ASTM B88 COPPER ASTM B75 UNS C12200 FITTINGS VICTAULIC STYLE 607 COUPLING	S2	THREADED BLACK STEEL SCHEDULE 40, ASTM A53 TYPE F 150 LB. C.I. FITTINGS
C5	PRESS-FIT COPPER TYPE "L" HARD COPPER ASTM B88 COPPER OR BRONZE FITTINGS: ASTM B16,18 OR B16,22 250 DEG. F. EPDM SEALS	S6	PRESS-FIT BLACK STEEL SCHEDULE 40, ASTM A53 TYPE E CARBON STEEL FITTINGS: ASTM A420 OR ASTM B16.3, ANSI LC-4/CSA 6.32, & ASTM F3226
D1	DUCTILE IRON ANSI A21.51 & AWWA CLASS 53 OR 51 250 LB. FITTINGS FLANGED FITTINGS	PE1	POLYETHYLENE PE 2306, 2406 TYPE II GRADE 3, PE 3406, 3408 TYPE III, ASTM D2513 HEAT FUSION JOINTS

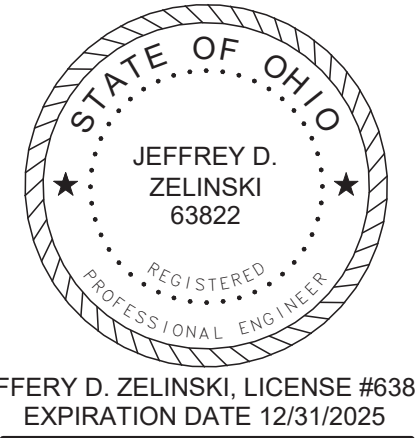

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/2025	FOR CONSTRUCTION

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ

COPYRIGHT © 2025 - App Architecture, Inc.
TITLE
MATERIAL SCHEDULES

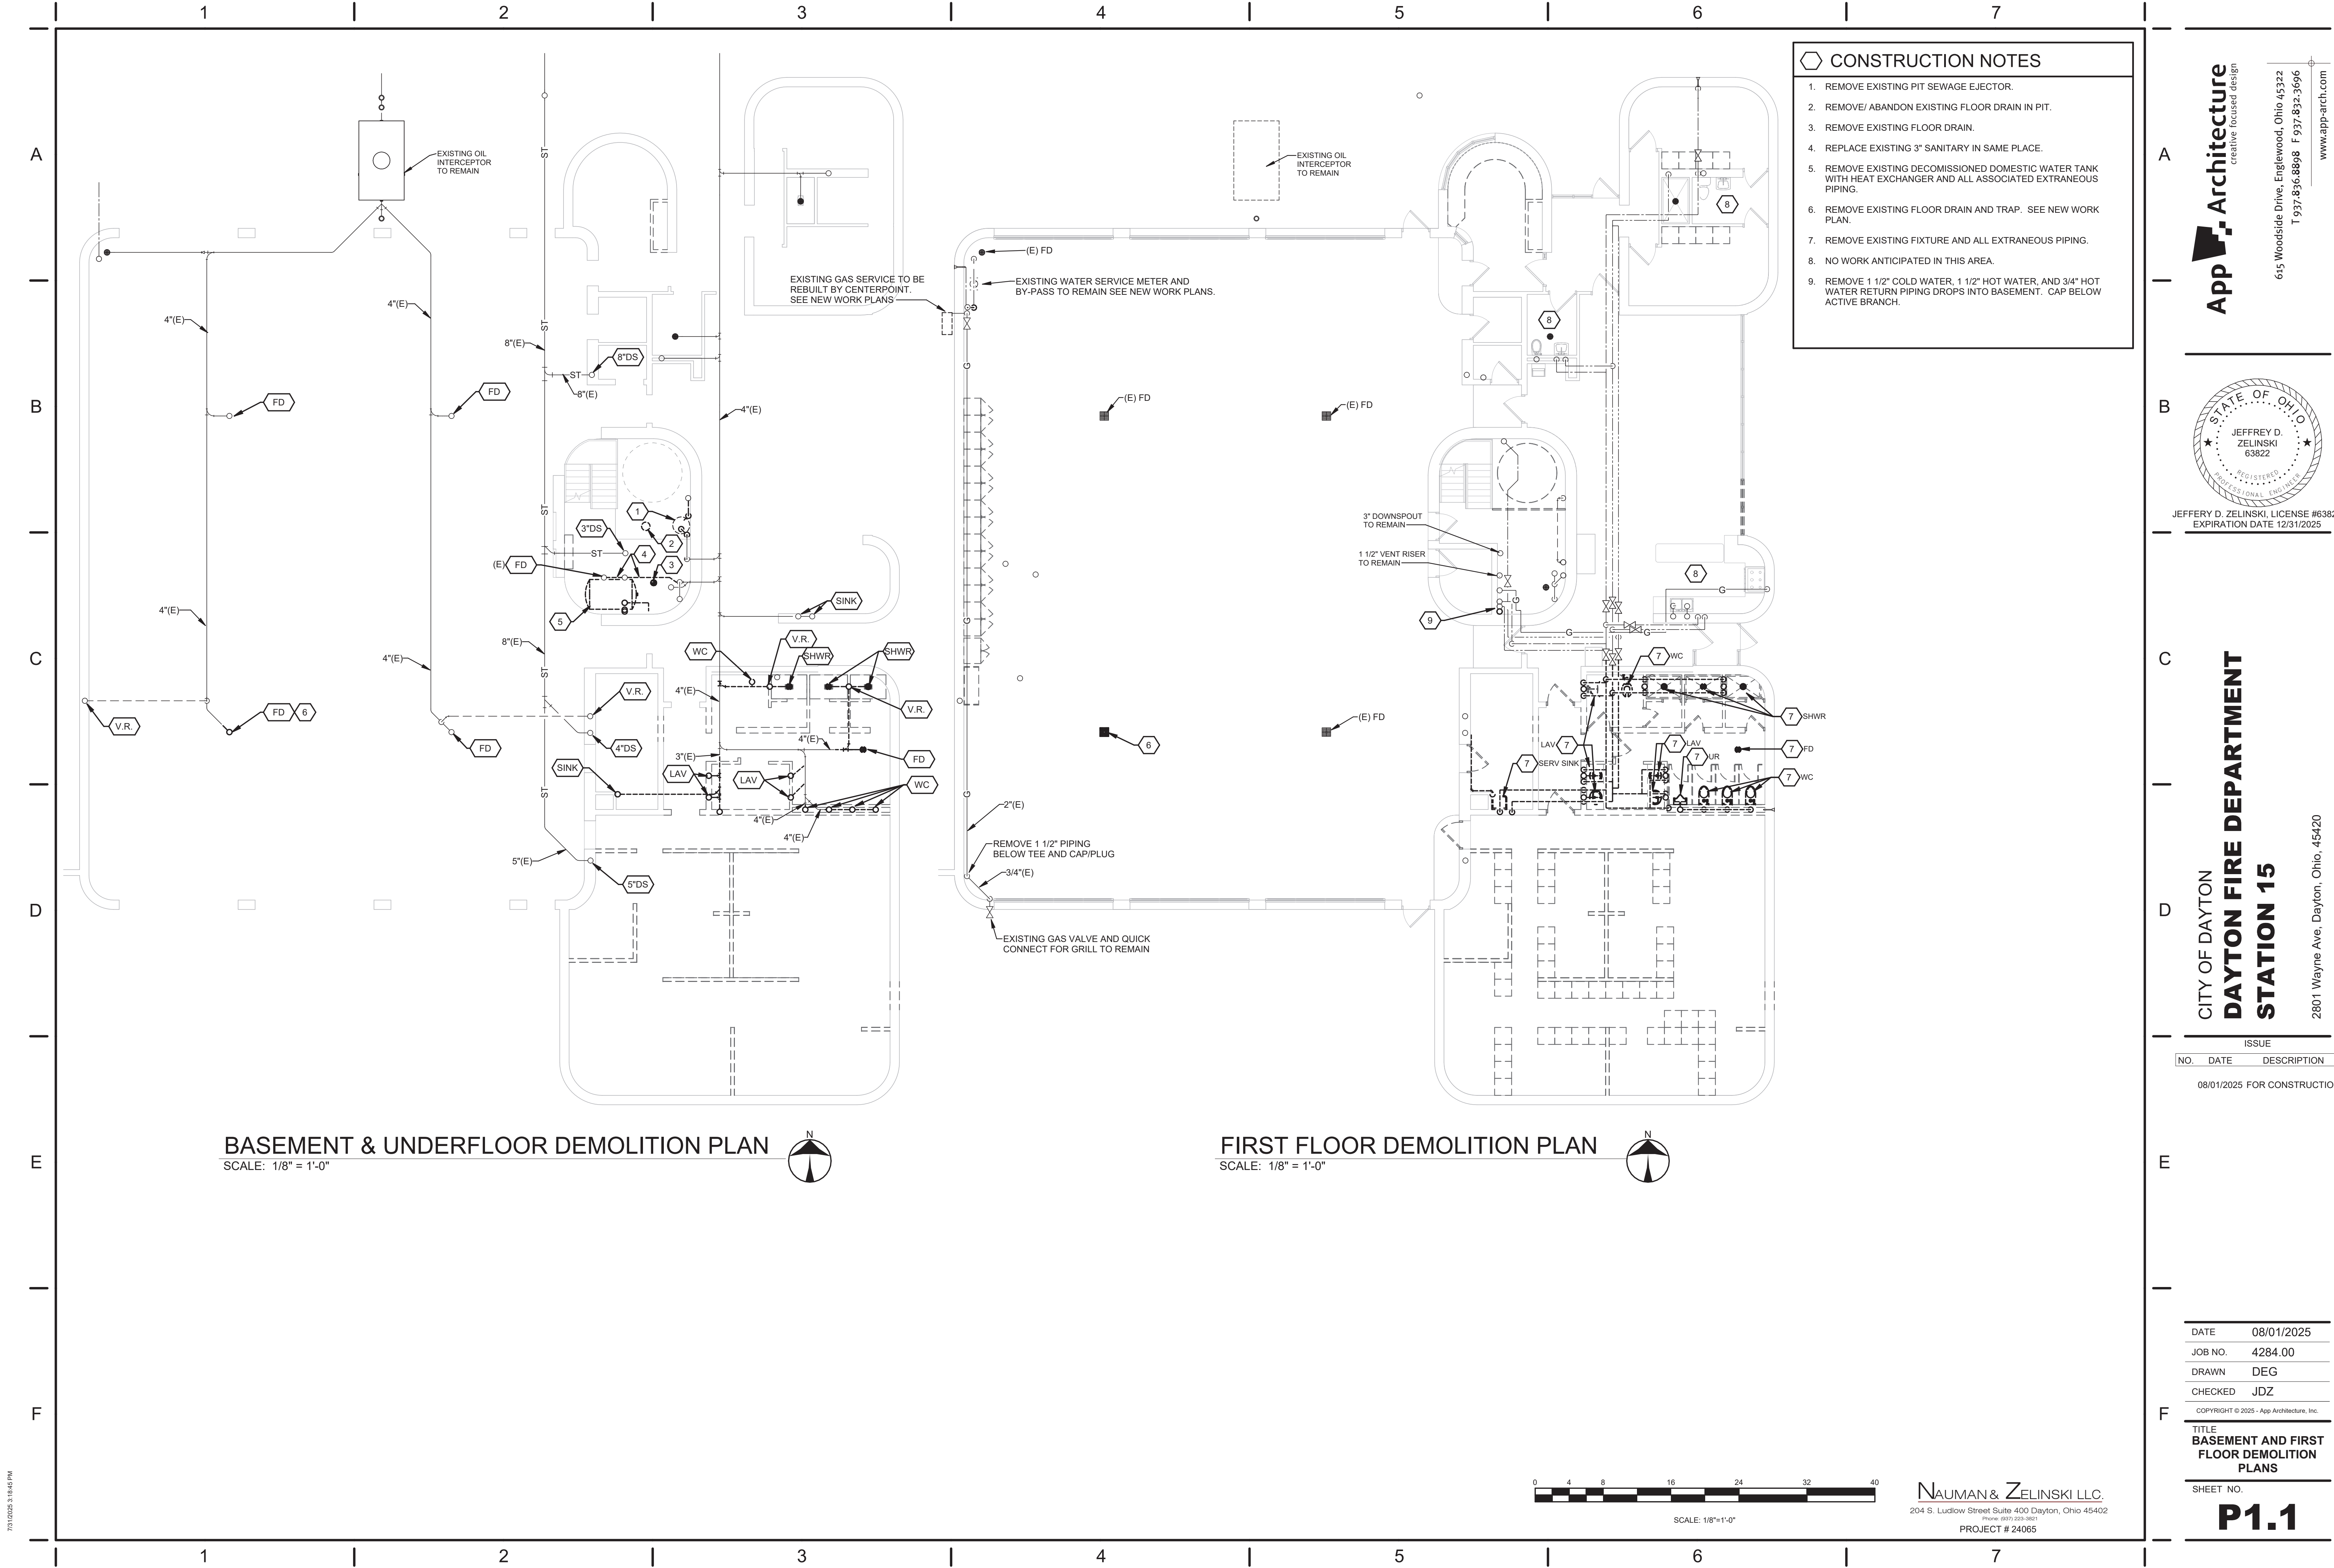

- CONSTRUCTION NOTES
1. REMOVE EXISTING PIT SEWAGE EJECTOR.
 2. REMOVE/ ABANDON EXISTING FLOOR DRAIN IN PIT.
 3. REMOVE EXISTING FLOOR DRAIN.
 4. REPLACE EXISTING 3" SANITARY IN SAME PLACE.
 5. REMOVE EXISTING DECOMMISSIONED DOMESTIC WATER TANK WITH HEAT EXCHANGER AND ALL ASSOCIATED EXTRANEIOUS PIPING.
 6. REMOVE EXISTING FLOOR DRAIN AND TRAP. SEE NEW WORK PLAN.
 7. REMOVE EXISTING FIXTURE AND ALL EXTRANEIOUS PIPING.
 8. NO WORK ANTICIPATED IN THIS AREA.
 9. REMOVE 1 1/2" COLD WATER, 1 1/2" HOT WATER, AND 3/4" HOT WATER RETURN PIPING DROPS INTO BASEMENT. CAP BELOW ACTIVE BRANCH.

App Architecture
creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com

STATE OF OHIO
JEFFERY D. ZELINSKI
63822
REGISTERED PROFESSIONAL ENGINEER


JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

CITY OF DAYTON
**DAYTON FIRE DEPARTMENT
STATION 15**

2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025 FOR CONSTRUCTION		

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ
COPYRIGHT © 2025 - App Architecture, Inc.	
TITLE BASEMENT AND FIRST FLOOR DEMOLITION PLANS	
SHEET NO. P1.1	

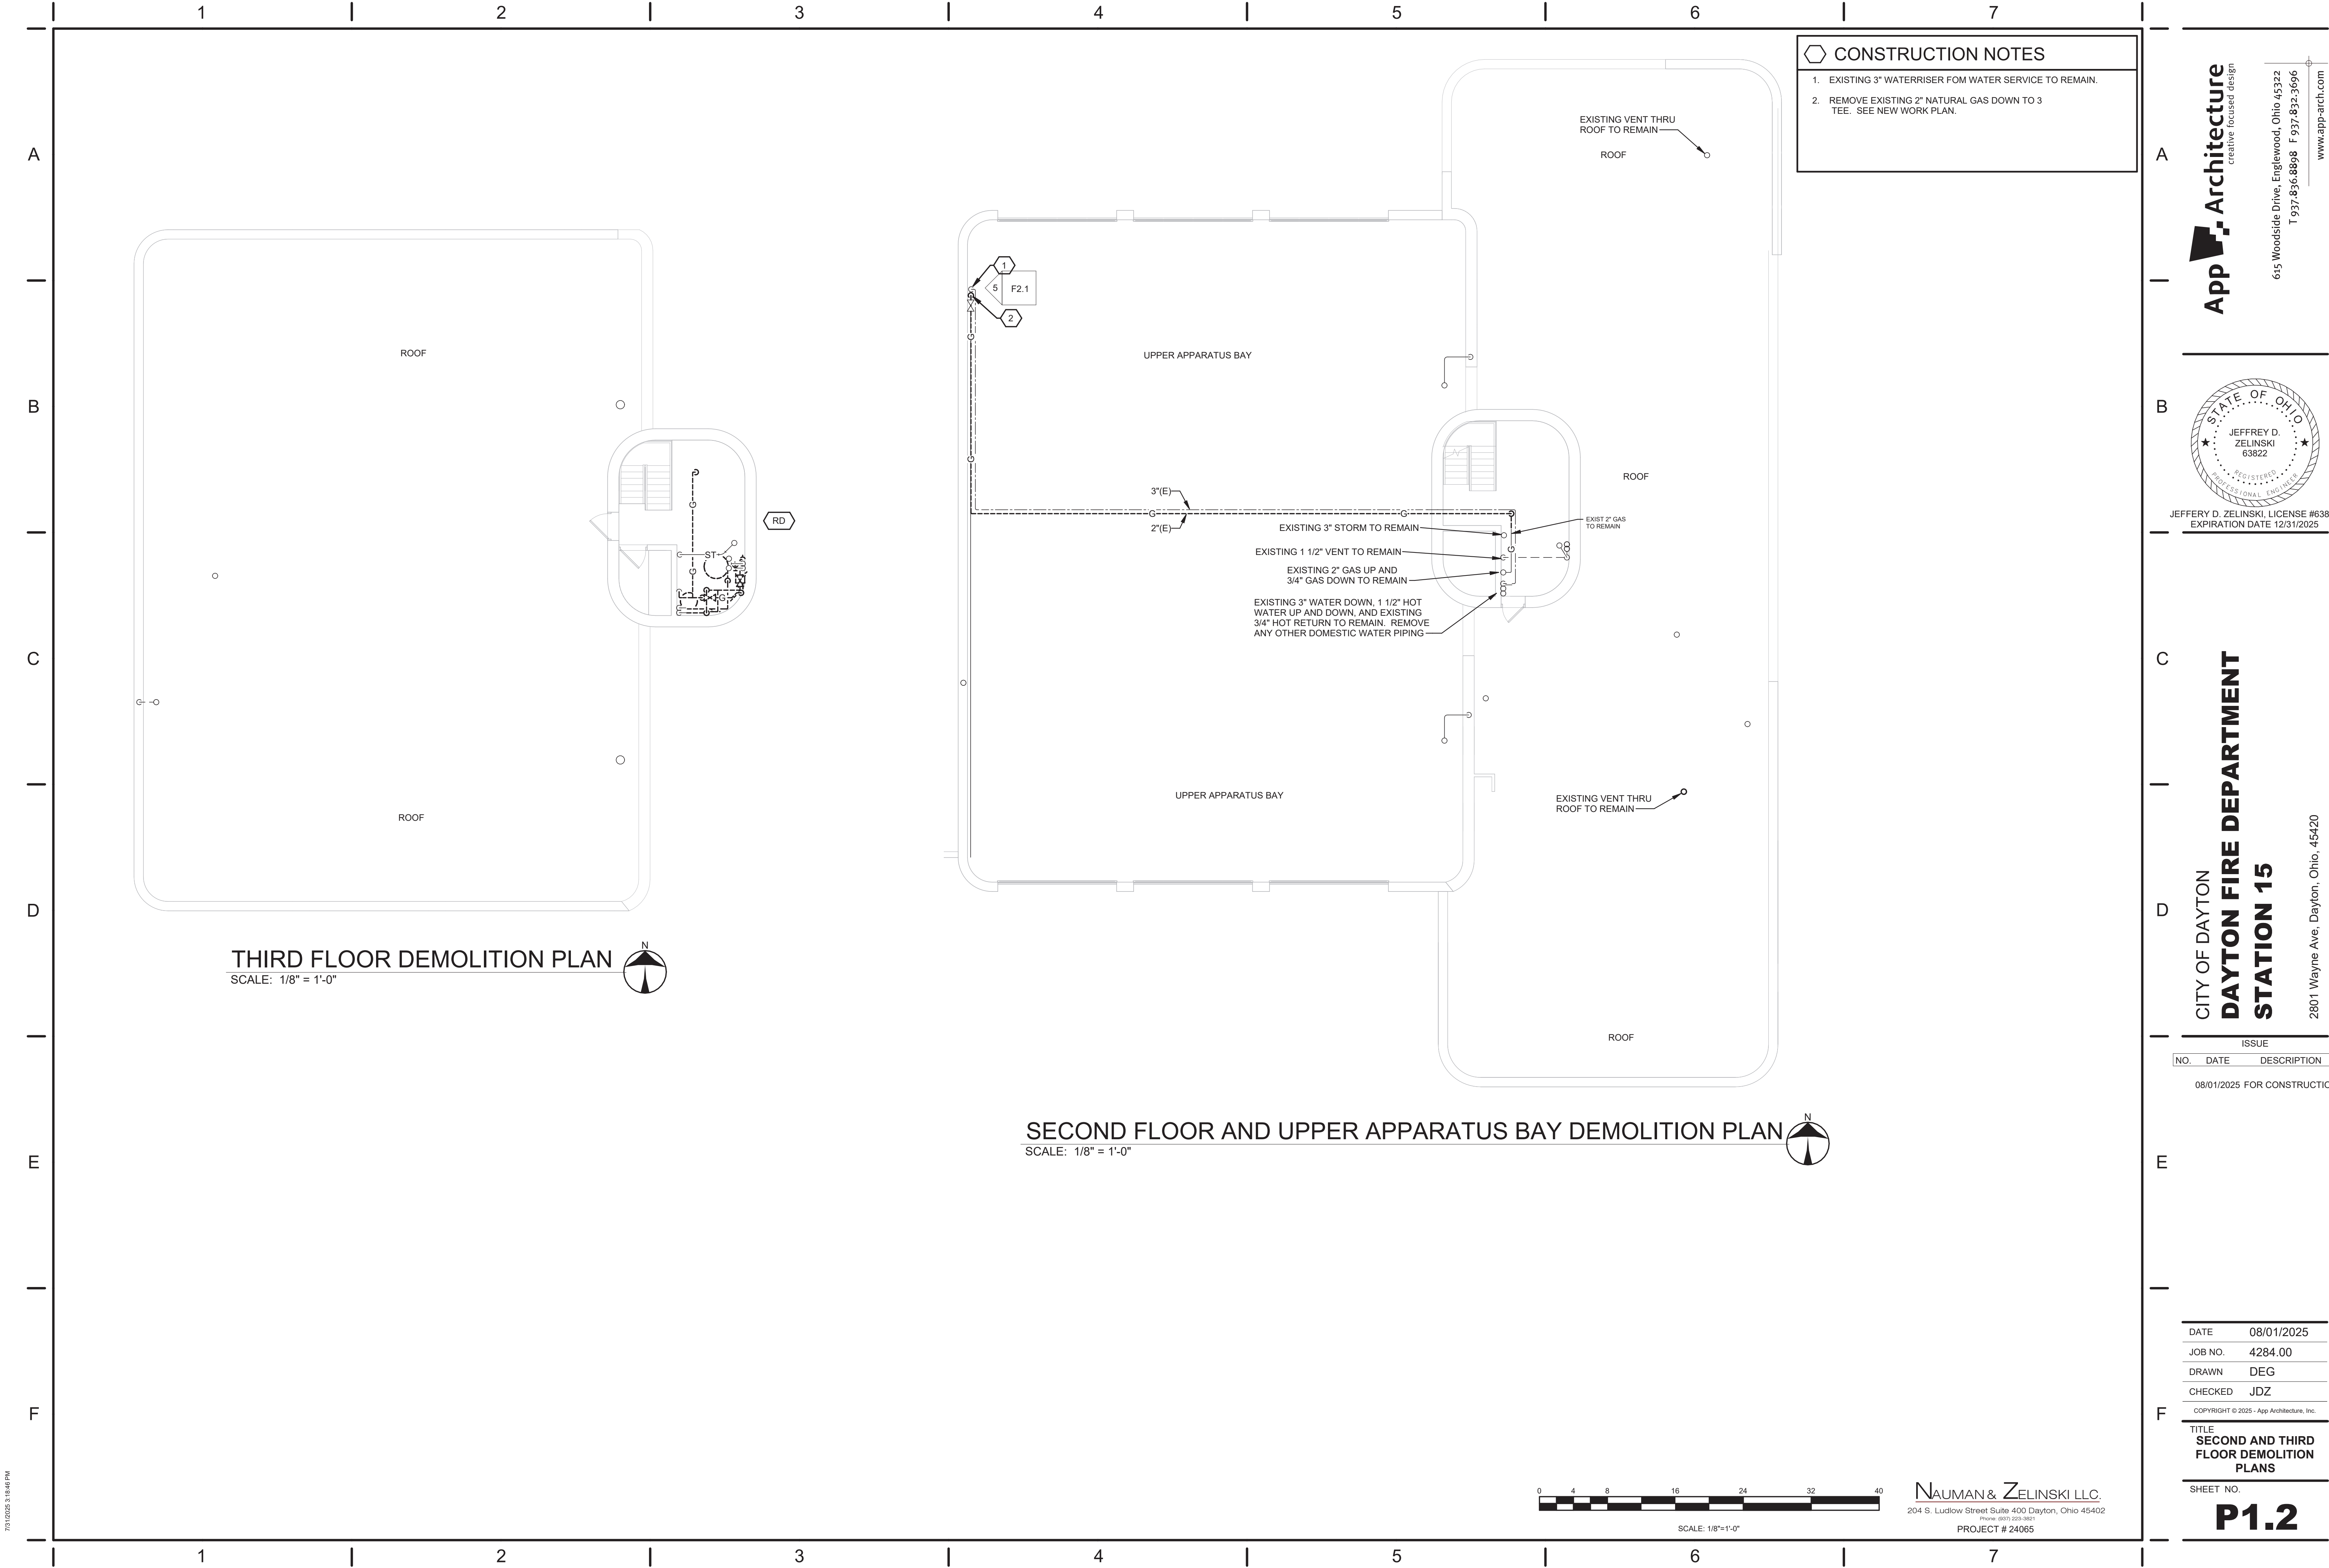


ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025 FOR CONSTRUCTION		

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ

COPYRIGHT © 2025 - App Architecture, Inc.

TITLE
SECOND AND THIRD FLOOR DEMOLITION PLANS

SHEET NO.
P1.2

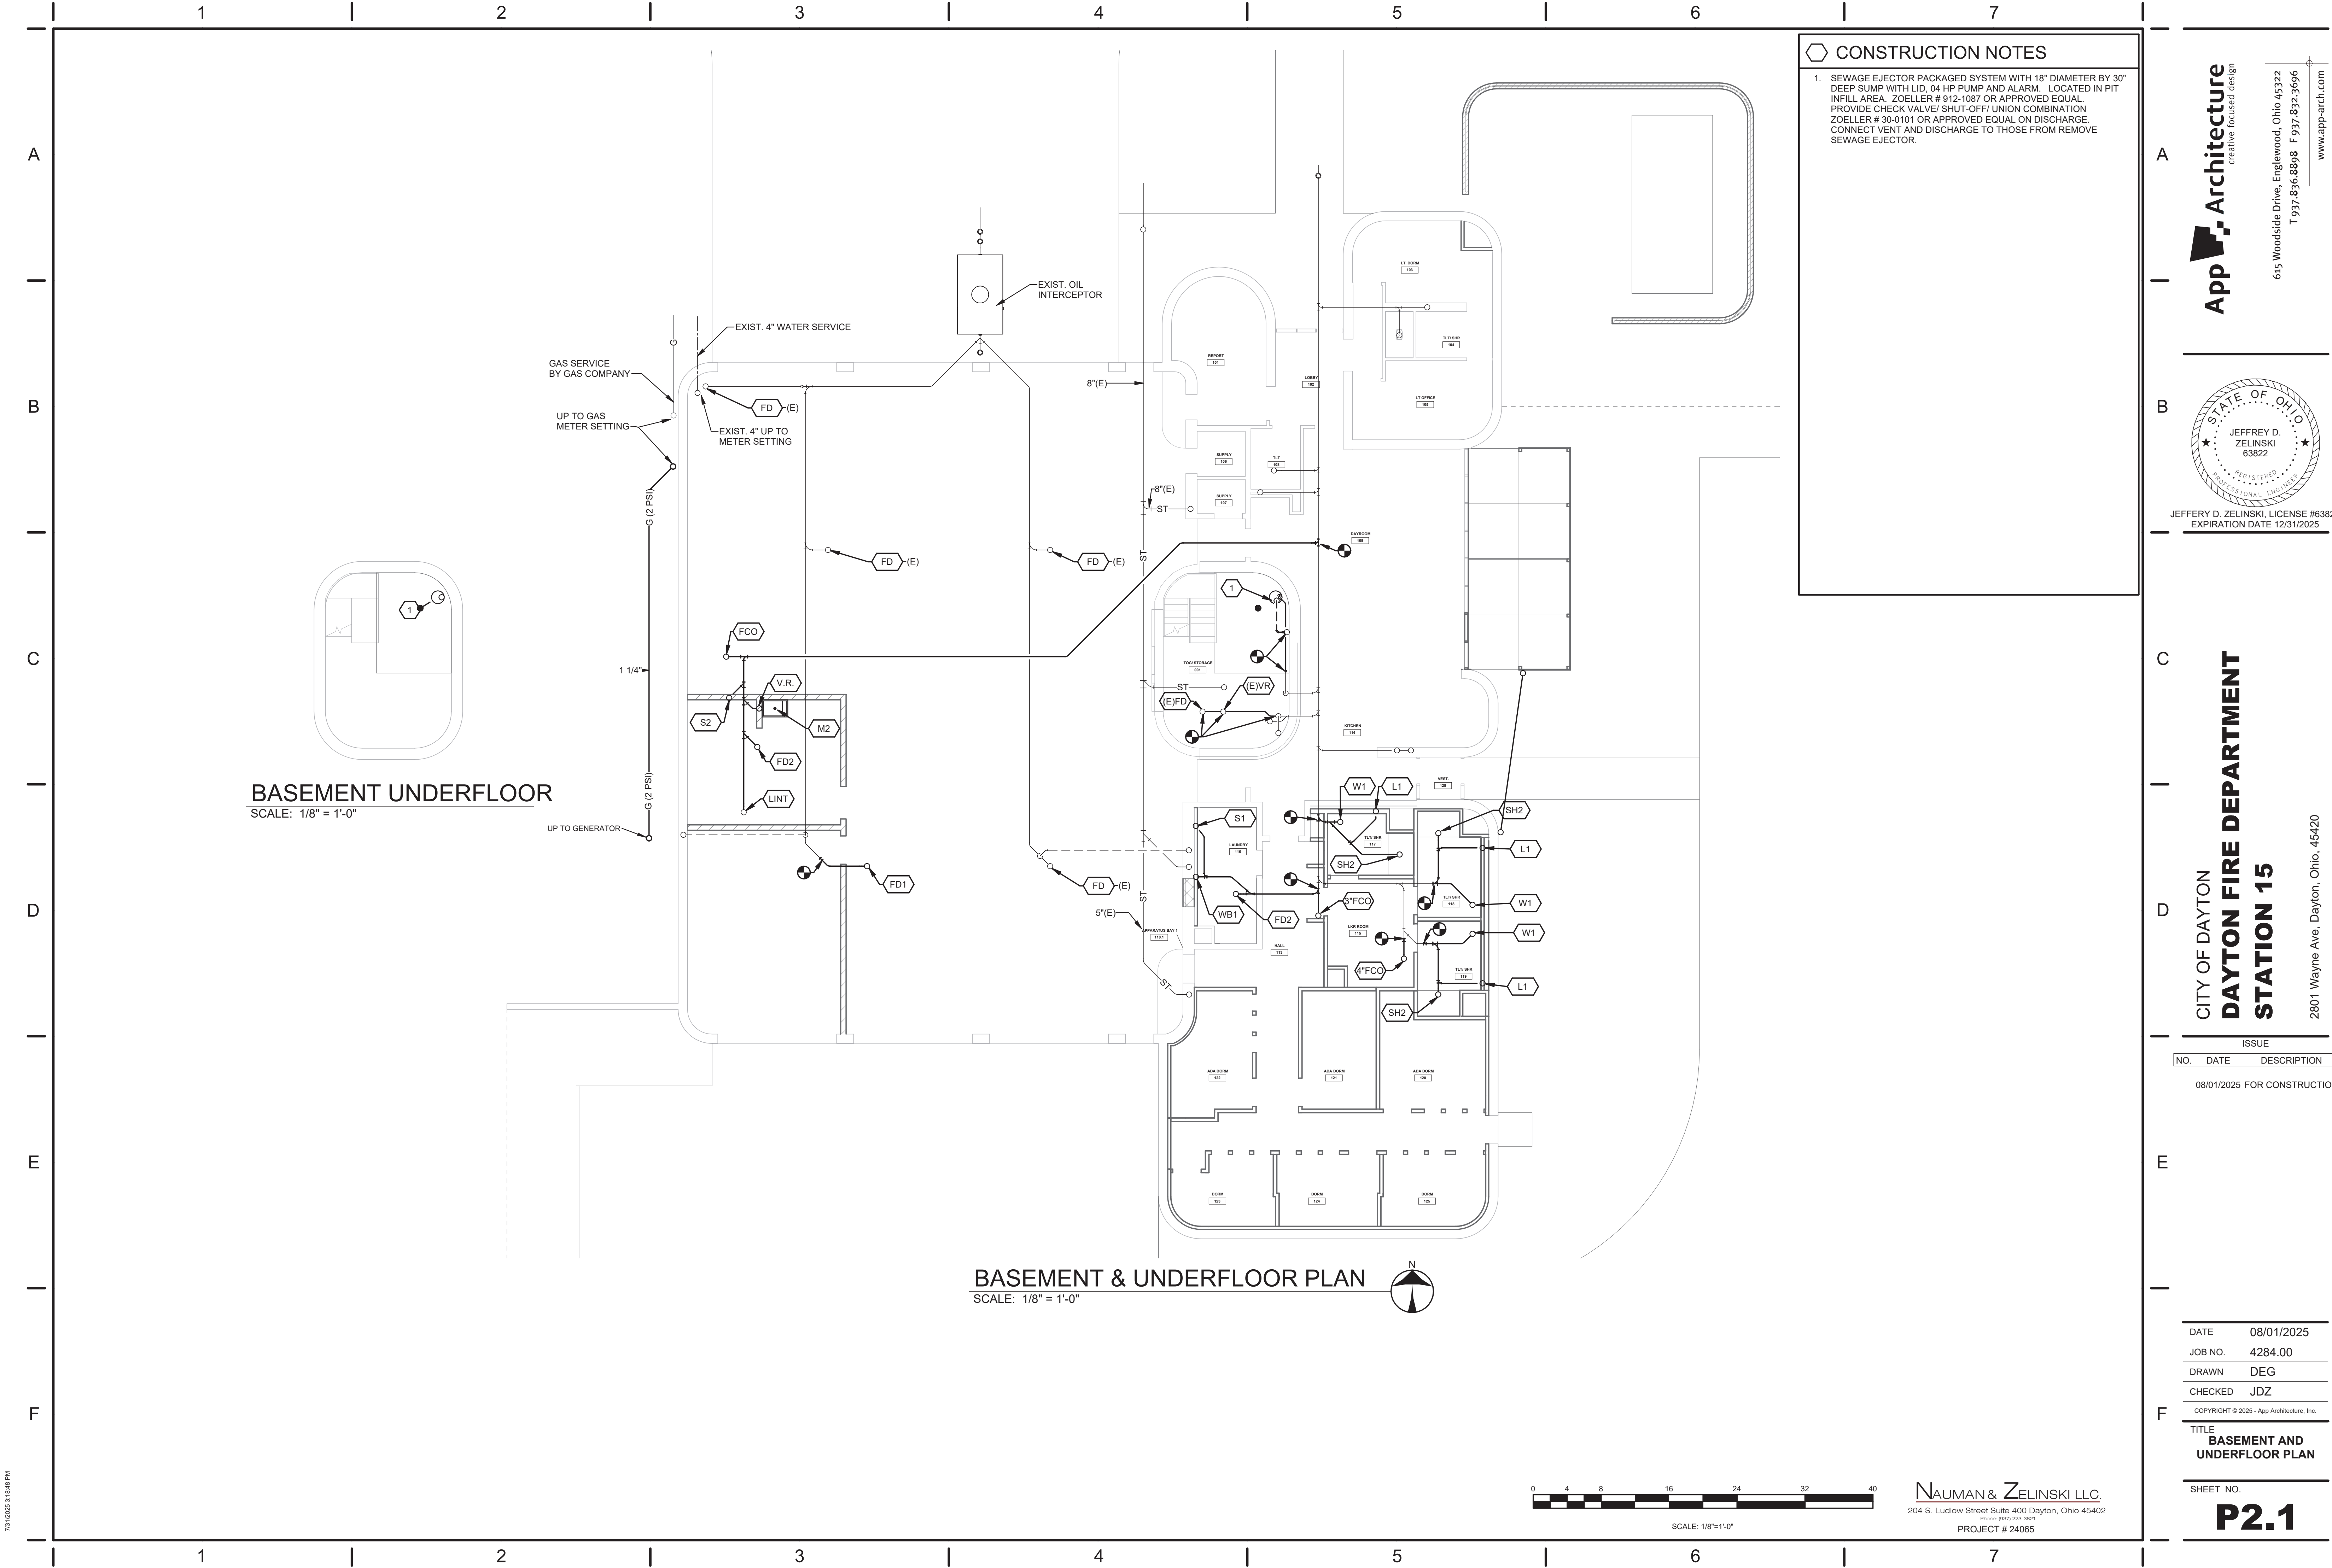

CONSTRUCTION NOTES

- SEWAGE EJECTOR PACKAGED SYSTEM WITH 18" DIAMETER BY 30" DEEP SUMP WITH LID, 04 HP PUMP AND ALARM. LOCATED IN PIT INFILL AREA. ZOELLER # 912-1087 OR APPROVED EQUAL. PROVIDE CHECK VALVE/ SHUT-OFF/ UNION COMBINATION. ZOELLER # 30-0101 OR APPROVED EQUAL ON DISCHARGE. CONNECT VENT AND DISCHARGE TO THOSE FROM REMOVE SEWAGE EJECTOR.

BASEMENT UNDERFLOOR
SCALE: 1/8" = 1'-0"

BASEMENT & UNDERFLOOR PLAN
SCALE: 1/8" = 1'-0"

ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025 FOR CONSTRUCTION		

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ

COPYRIGHT © 2025 - App Architecture, Inc.
TITLE
BASEMENT AND UNDERFLOOR PLAN

SHEET NO.
P2.1

7/31/2025 3:18:50 PM

A
B
C
D
E
F

1

2

3

4

5

6

7

1

2


3

4

5

6

7

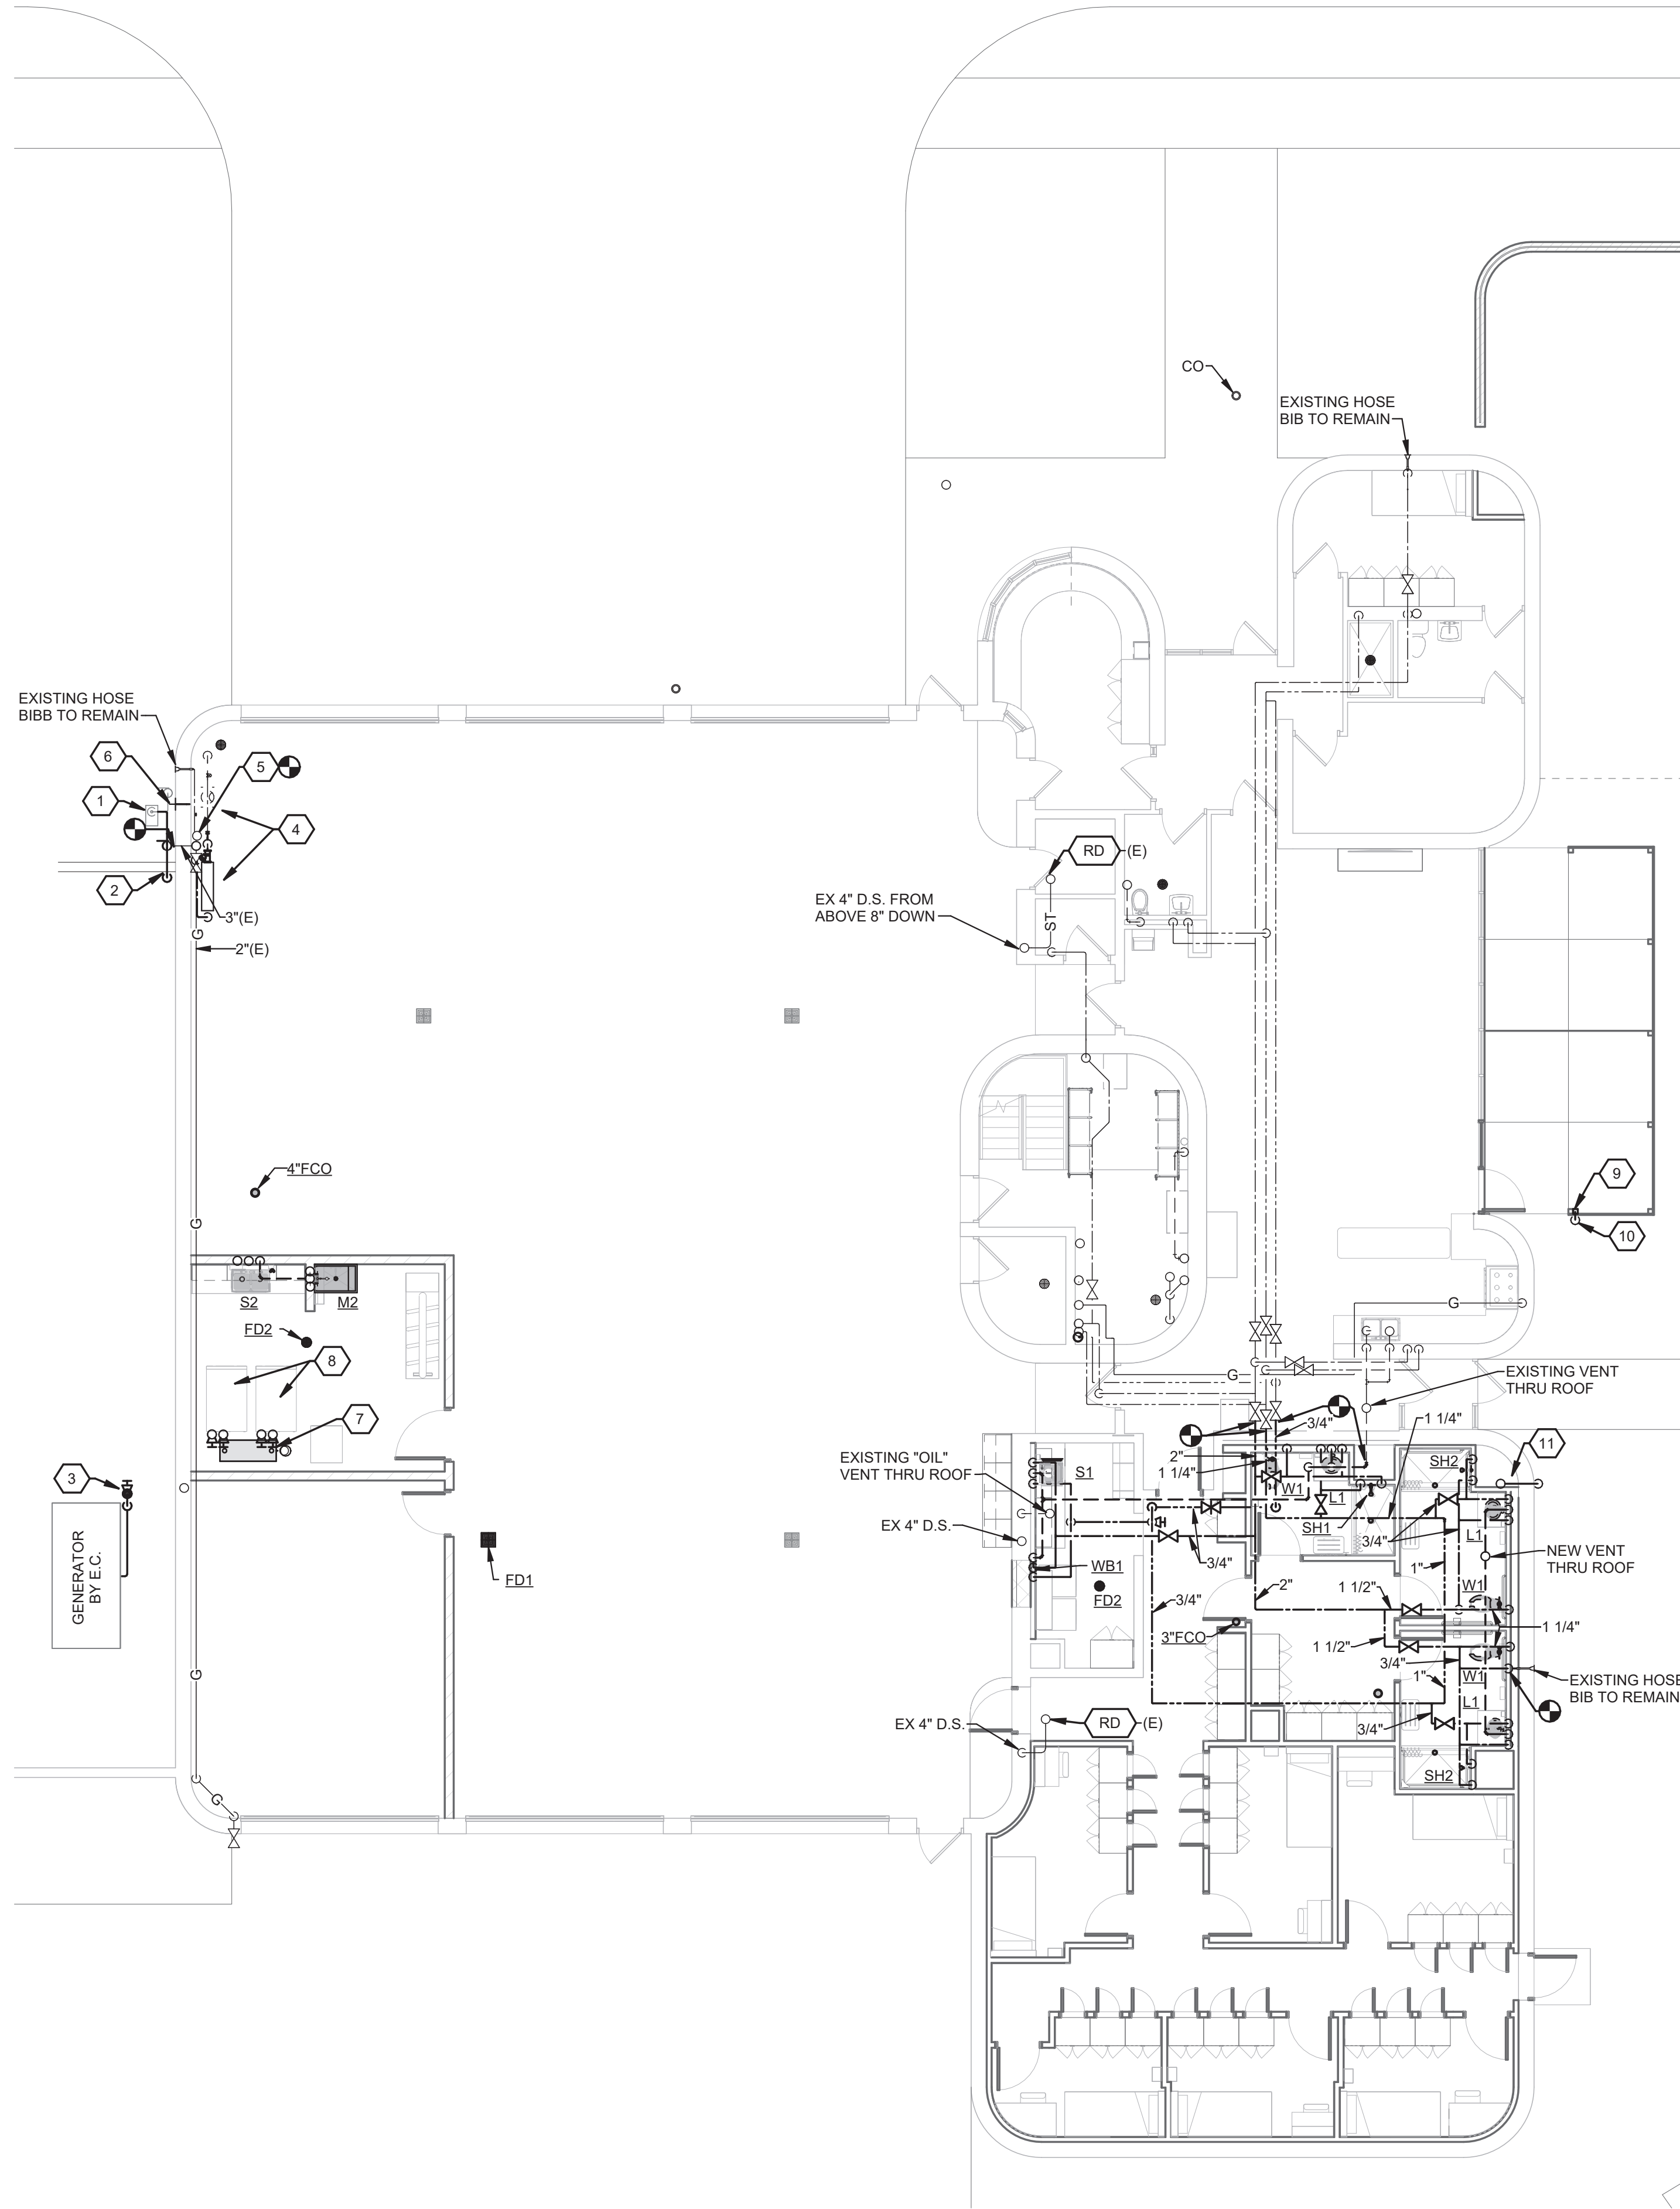

FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"



SCALE: 1/8"=1'-0"

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 233-3801
PROJECT # 24065

CONSTRUCTION NOTES

1. NEW GAS METER AND REGULATOR SETTING BY CENTERPOINT. CONNECT TO OUTLET. ALL EXPOSED METAL PIPING SHALL BE PAINTED FOR PROTECTION. REFER TO GAS SERVICE DETAIL.
2. RUN 1 1/4" GAS PIPING (@ 2 PSI) THRU WALL. SLEEVE PIPING THRU WALL (NO SEAL REQUIRED), DROP 1" GAS PIPING INTO GRADE TO SERVE GENERATOR. SEE UNDERFLOOR PIPING PLAN FOR CONTINUATION. PROVIDE ANODELESS RISER.
3. 1" NATURAL GAS FROM BELOW GRADE. PROVIDE ANODELESS RISER. VALVE AND CONNECT TO GENERATOR PROVIDE FULL SIZE DIRT LEG AND A UNION AT THE CONNECTION. SEE GAS SERVICE DETAIL SHEET P3.1. ALL EXPOSED METAL PIPING SHALL BE PAINTED FOR PROTECTION.
4. WATER SERVICE. SEE DETAIL SHEET P3.1.
5. CONNECT TO EXISTING 3" DOMESTIC WATER RISER UP TO APPARATUS BAY CEILING. SEE SECOND FLOOR PLAN FOR CONTINUATION.
6. 6" BACKFLOW PREVENTOR EMERGENCY DISCHARGE. SEE WATER SERVICE DETAIL SHEET P3.1.
7. EXISTING LINT TRAP AND ASSOCIATED PIPING TO BE RELOCATED WITH EXTRACTORS. THE P.C. IS TO RELOCATED THE UNIT AND ASSOCIATED DRAINS FROM EXTRACTORS.
8. RELOCATED EXTRACTORS. CONNECT 3/4" HOT AND COLD WATER TO UNIT.
9. GAS SUPPLY BOX FOR GRILL. BURNABY # BBQ-SS50 OR APPROVED EQUAL. MOUNT APPROX. 1'-6" A.F.F. PROVIDE 10' BBQ HOSE BURNABY # 324394.
10. DROP 1" GAS SERVING GAS GRILL INTO GRADE. PROVIDE ANODELESS RISER. SEE UNDERFLOOR PIPING PLAN FOR CONTINUATION.
11. 1" GAS PIPING FROM ROOF TO GRILL. DROP PIPING IN CHASE TO APPROX. 1' - 6" A.F.F. BEFORE LEAVING THE BUILDING AND DROP INTO GRADE. PROVIDE ANODELESS RISER.

A

B


C

D

E

F

App Architecture
creative focused design

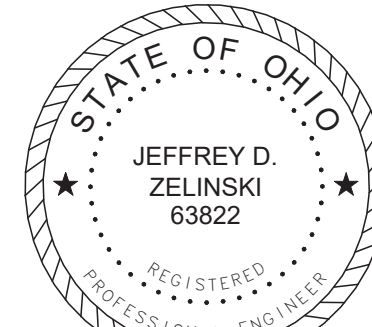

JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

CITY OF DAYTON
**DAYTON FIRE DEPARTMENT
STATION 15**

2801 Wayne Ave, Dayton, Ohio, 45420


ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025 FOR CONSTRUCTION		

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ


COPYRIGHT © 2025 - App Architecture, Inc.
TITLE
FIRST FLOOR PLAN

SHEET NO.


P2.2

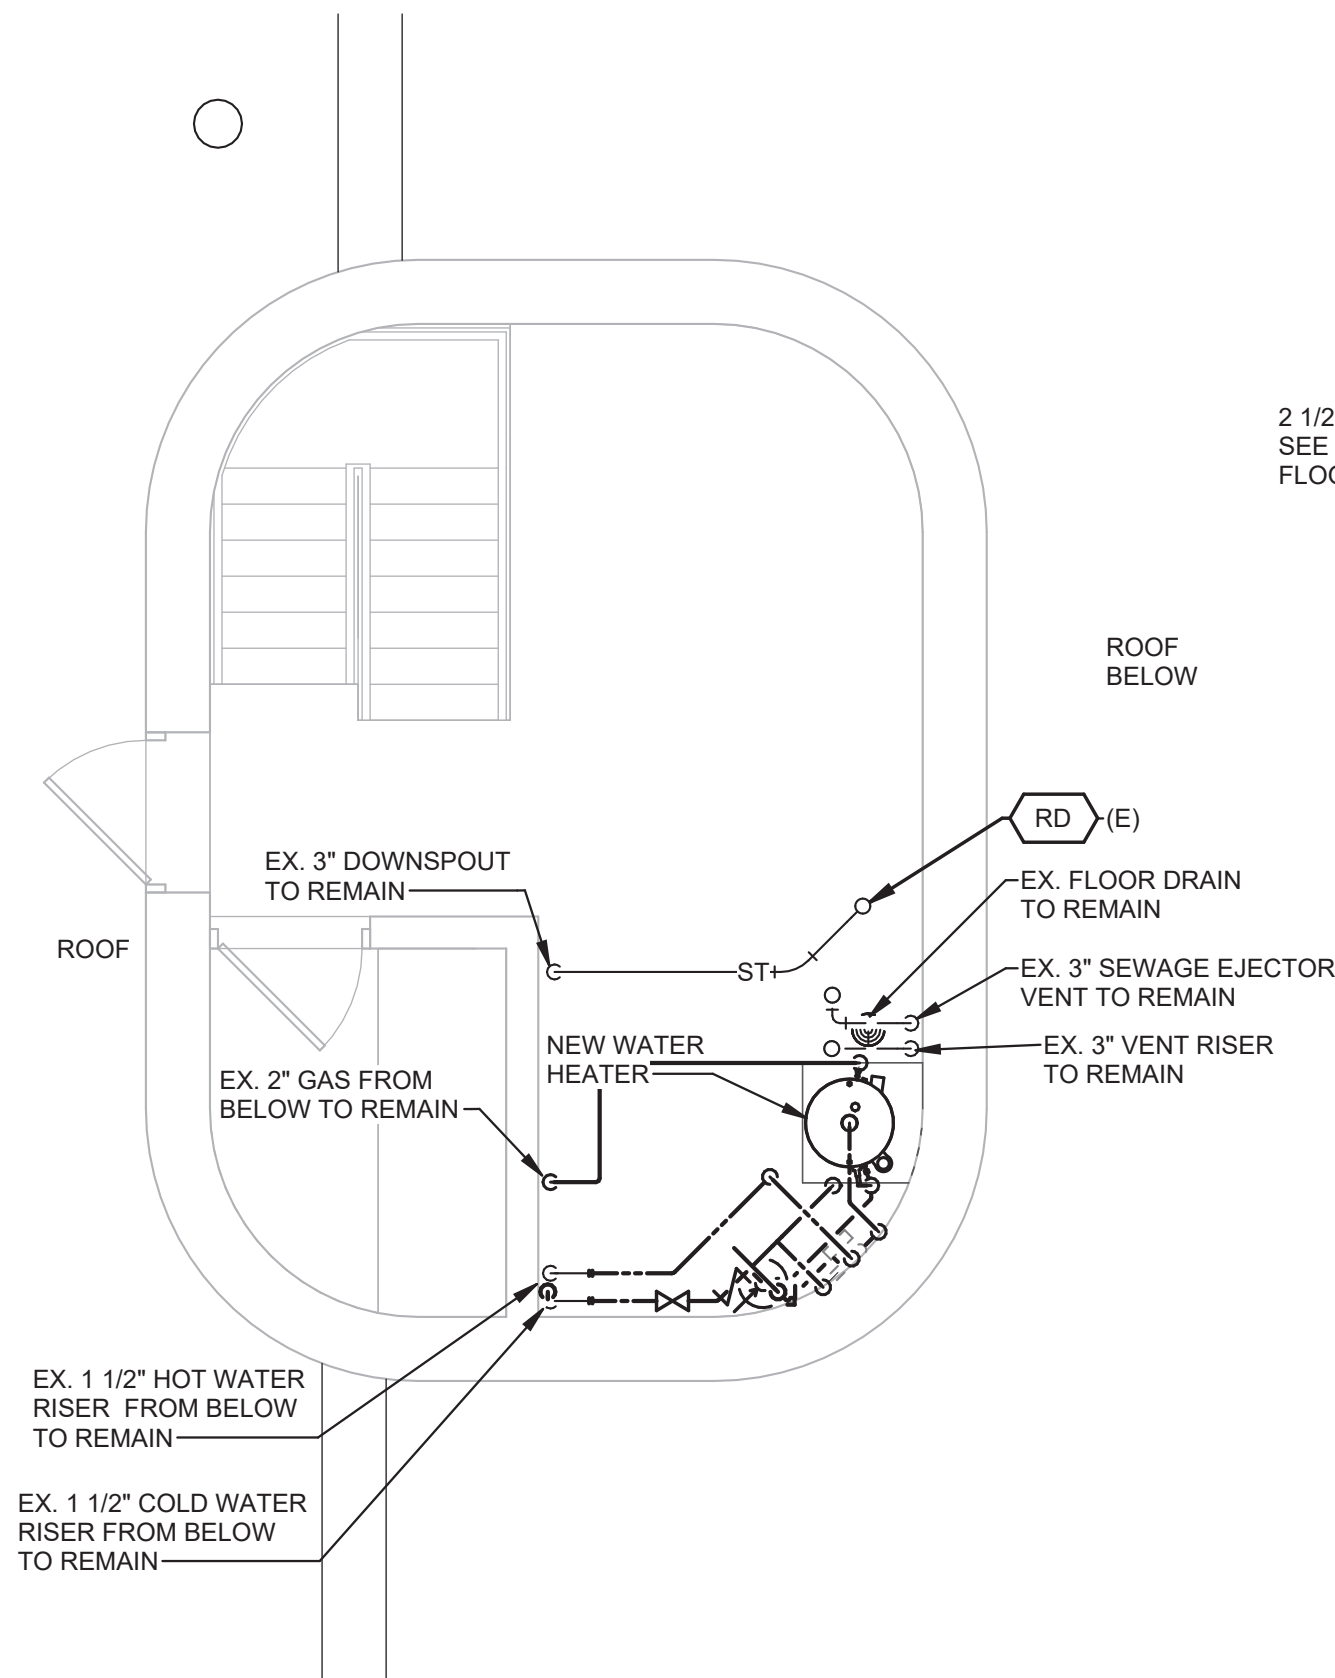

THIRD FLOOR PLAN
SCALE: 1/4" = 1'-0"

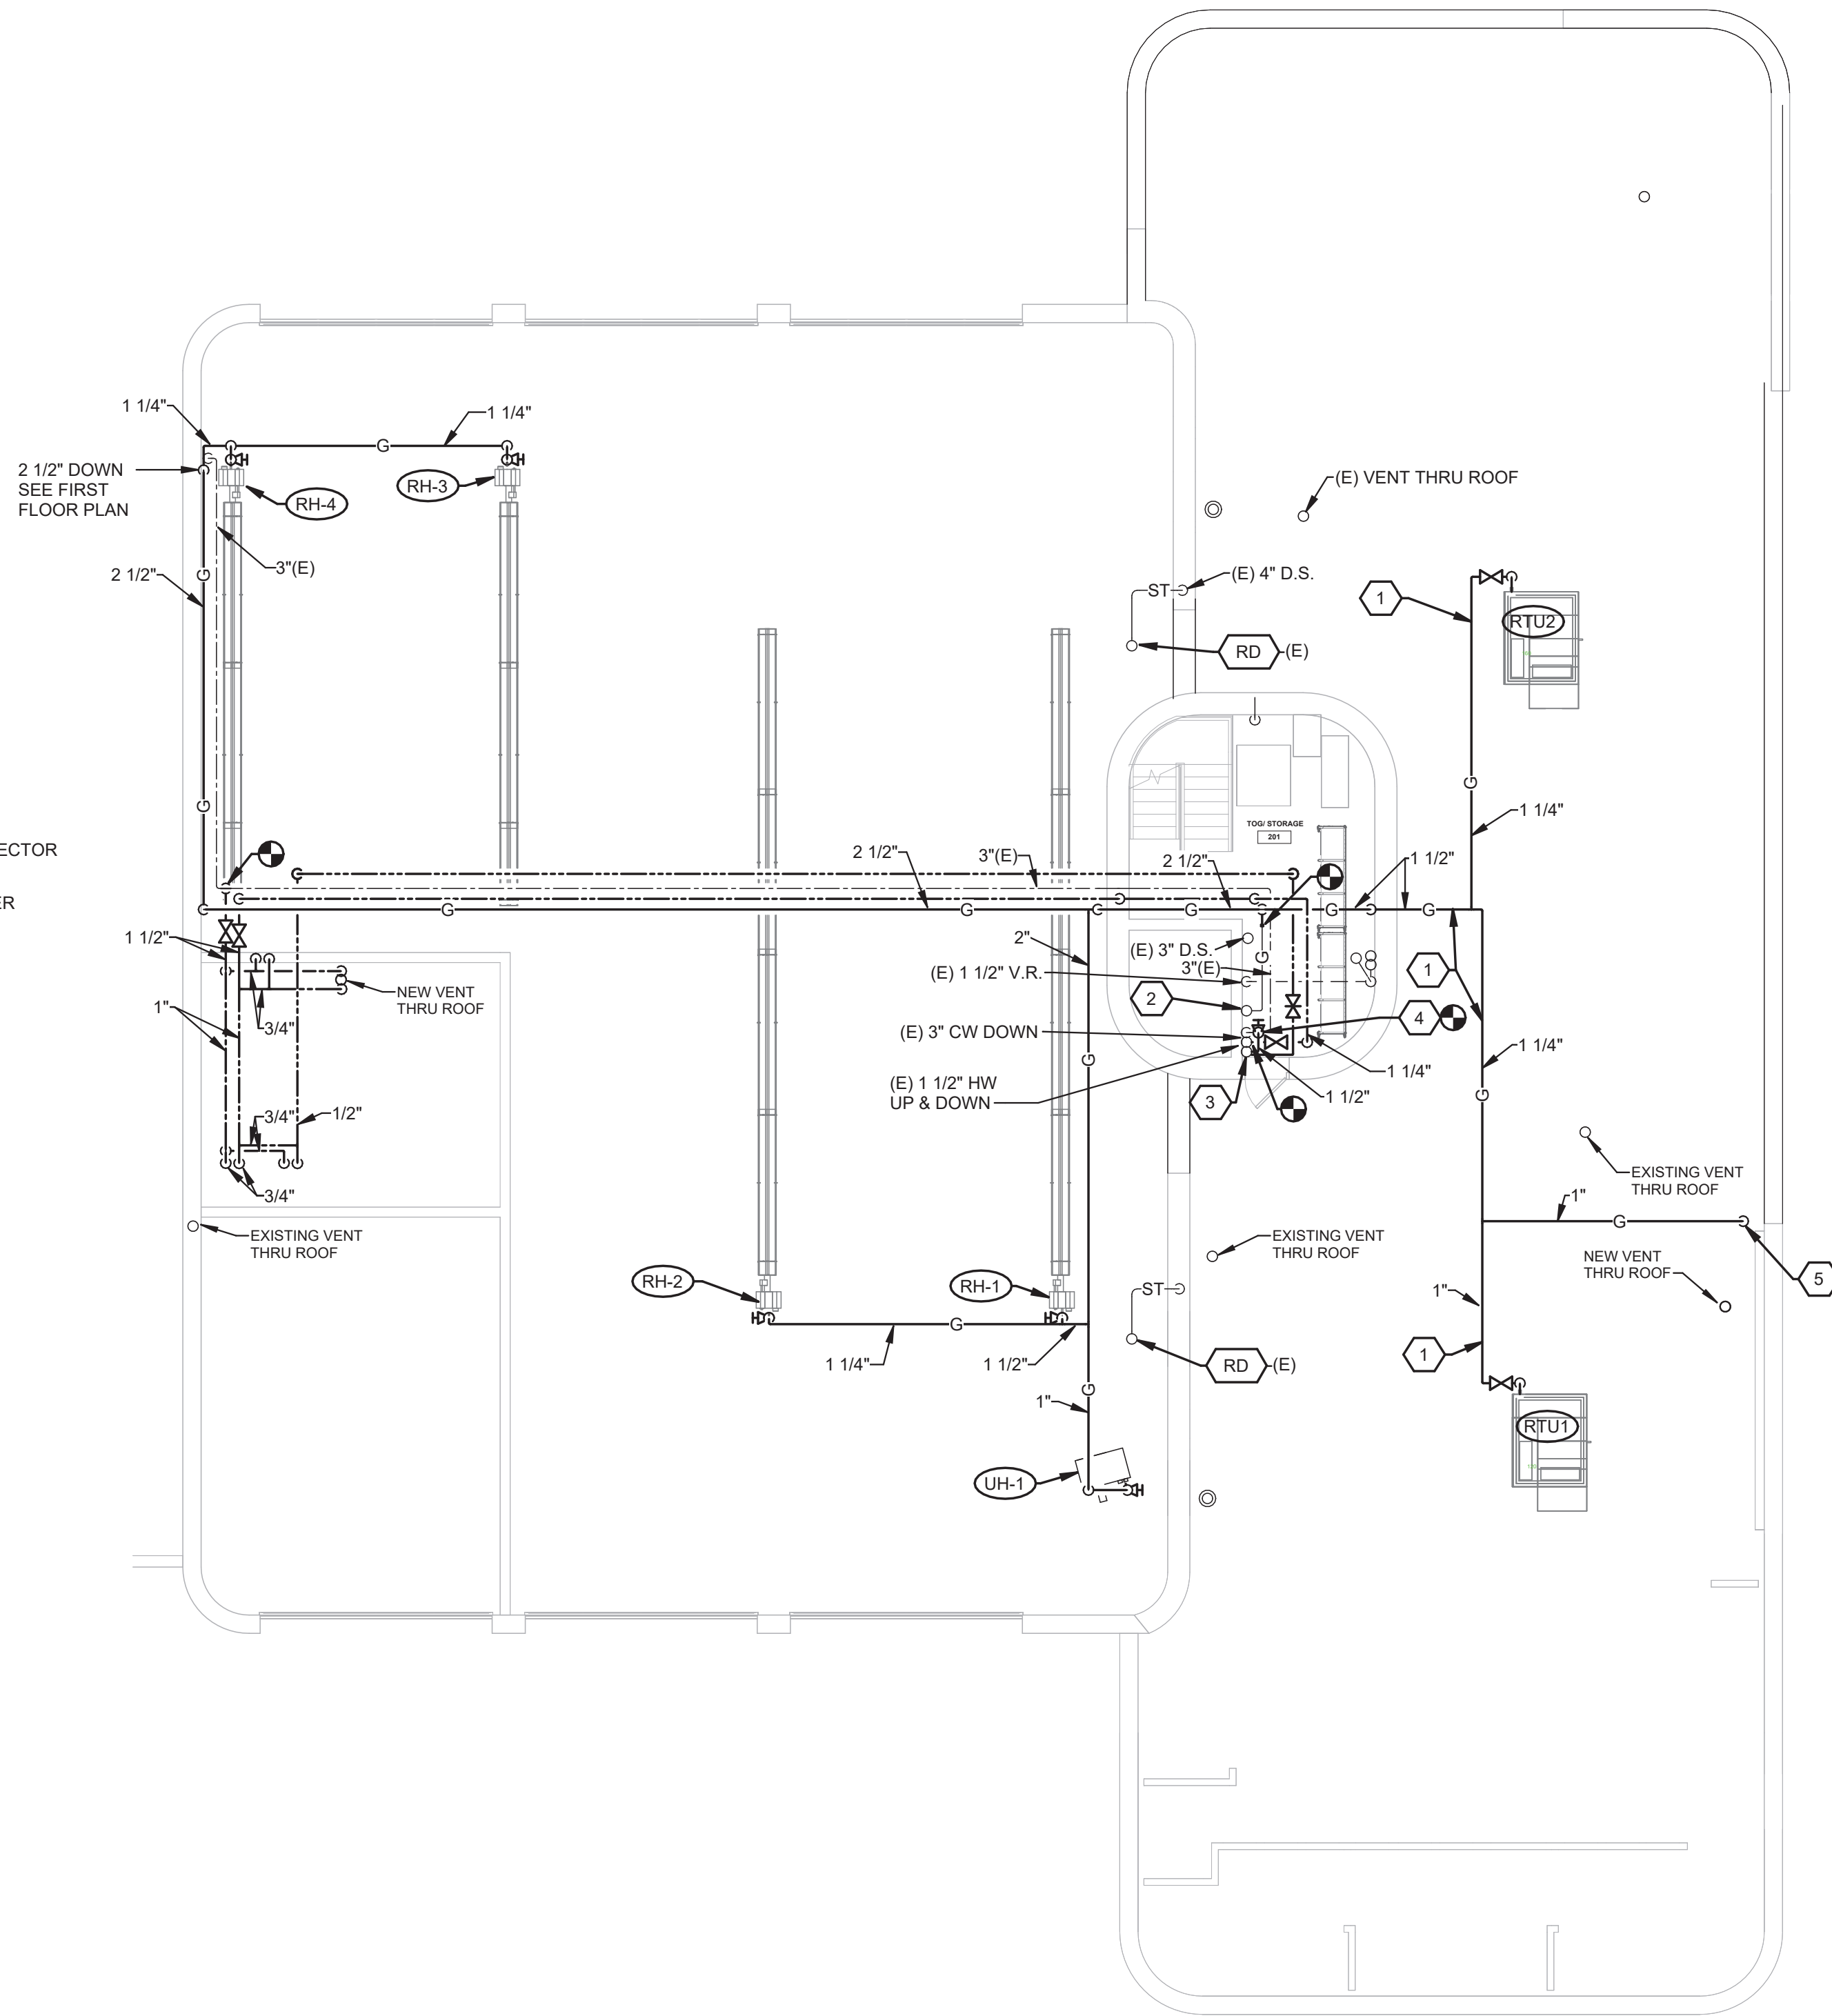

SECOND FLOOR AND UPPER APPARATUS BAY PLAN
SCALE: 1/8" = 1'-0"



SCALE: 1/8"=1'-0"


NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 233-3801
PROJECT # 24065

CONSTRUCTION NOTES

1. NEW GAS PIPING RUNNING ACROSS ROOF. PROVIDE PIPING SUPPORT (SPACED SAME AS PIPE HANGERS) MIFAB # CR10-3 OR APPROVED EQUAL.
2. EXISTING 2" GAS UP TO THIRD FLOOR AND 3/4" GAS DOWN TO FIRST FLOOR.
3. CONNECT TO EXISTING 1 1/2" COLD WATER RISER UP TO THIRD FLOOR.
4. CONNECT TO EXISTING 3" COLD WATER VALVE AND EXTEND NEW 1 1/2" COLD WATER TO EXISTING (SEE NOTE 3).
5. DROP 1" GAS THRU ROOF INTO CHASE. SEE FIRST FLOOR FOR CONTINUATION.

App Architecture
creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com

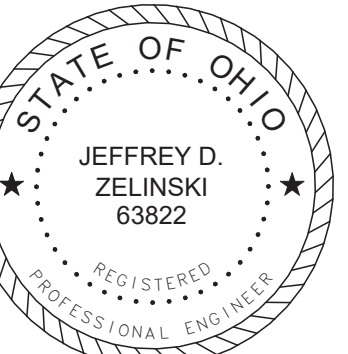

JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

CITY OF DAYTON
**DAYTON FIRE DEPARTMENT
STATION 15**
2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/2025	FOR CONSTRUCTION

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ


COPYRIGHT © 2025 - App Architecture, Inc.

TITLE
**SECOND FLOOR AND
UPPER APPARATUS BAY
PLAN**

SHEET NO.

P2.3


A

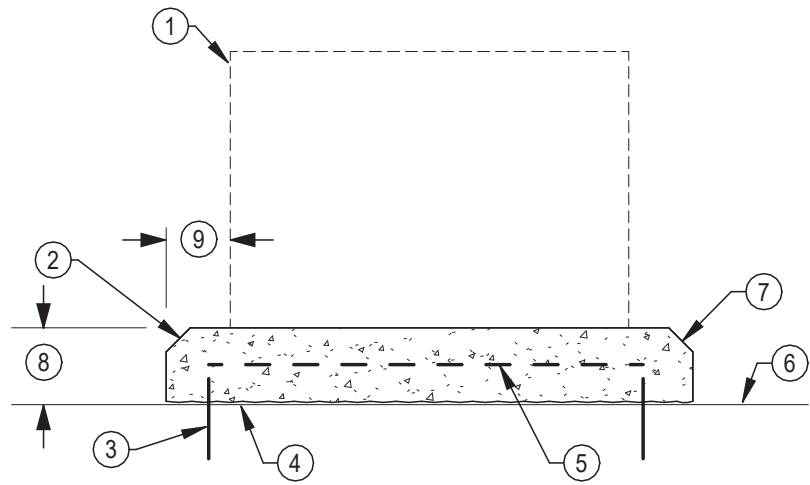

NOTE: OVERALL DIMENSION TO BE DETERMINED BY CONTRACTOR.

3 INTERIOR CONCRETE EQUIPMENT PAD
N.T.S.

B

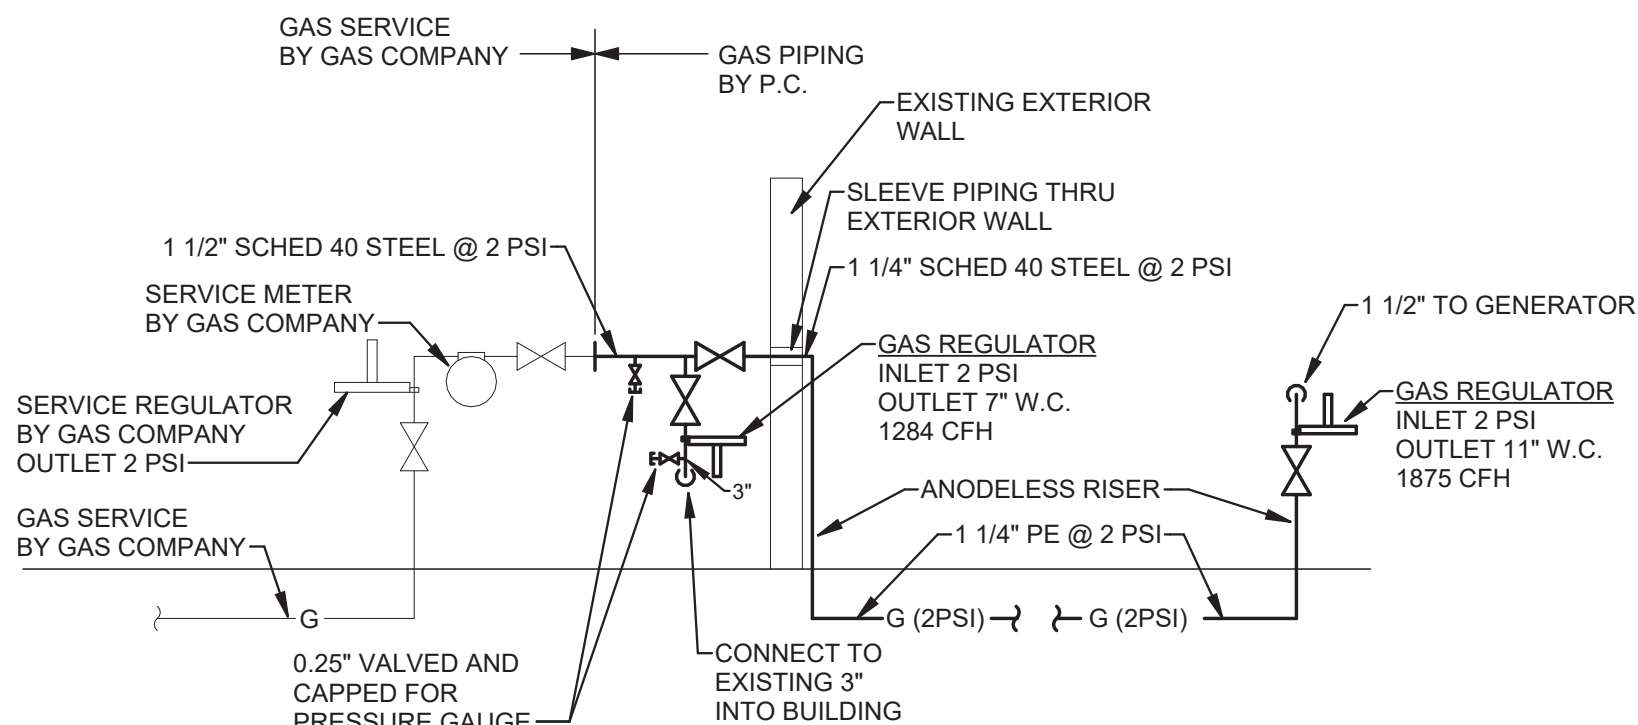


2 GAS SERVICE SCHEMATIC
N.T.S.

GAS LOAD SCHEDULE


GENERAL NOTES
• PIPING SIZED USING THE LONGEST LENGTH METHOD.
• LOW PRESSURE (7" W.C.) GAS PIPING SIZED USING TABLE 402.4(2) OF THE 2015 IFC.

ITEM	LOAD
UH-1 - GAS FIRE UNIT HEATER	125 CFH
RH-4 - 25' GAS FIRED RADIANT HEATER	85 CFH
RH-3 - 25' GAS FIRED RADIANT HEATER	85 CFH
RH-2 - 40' GAS FIRED RADIANT HEATER	155 CFH
RH1 - 40' GAS FIRED RADIANT HEATER	155 CFH
RTU-1 - ROOF TOP UNIT	120 CFH
RTU-2 - ROOF TOP UNIT	160 CFH
WH1 - WATER HEATER	199 CFH
EXISTING RANGE	200 CFH
BUILDING TOTAL	1,284 CFH
STAND-BY GENERATOR	1,875 CFH
SERVICE TOTAL	3,159 CFH

1 WATER SERVICE
N.T.S.

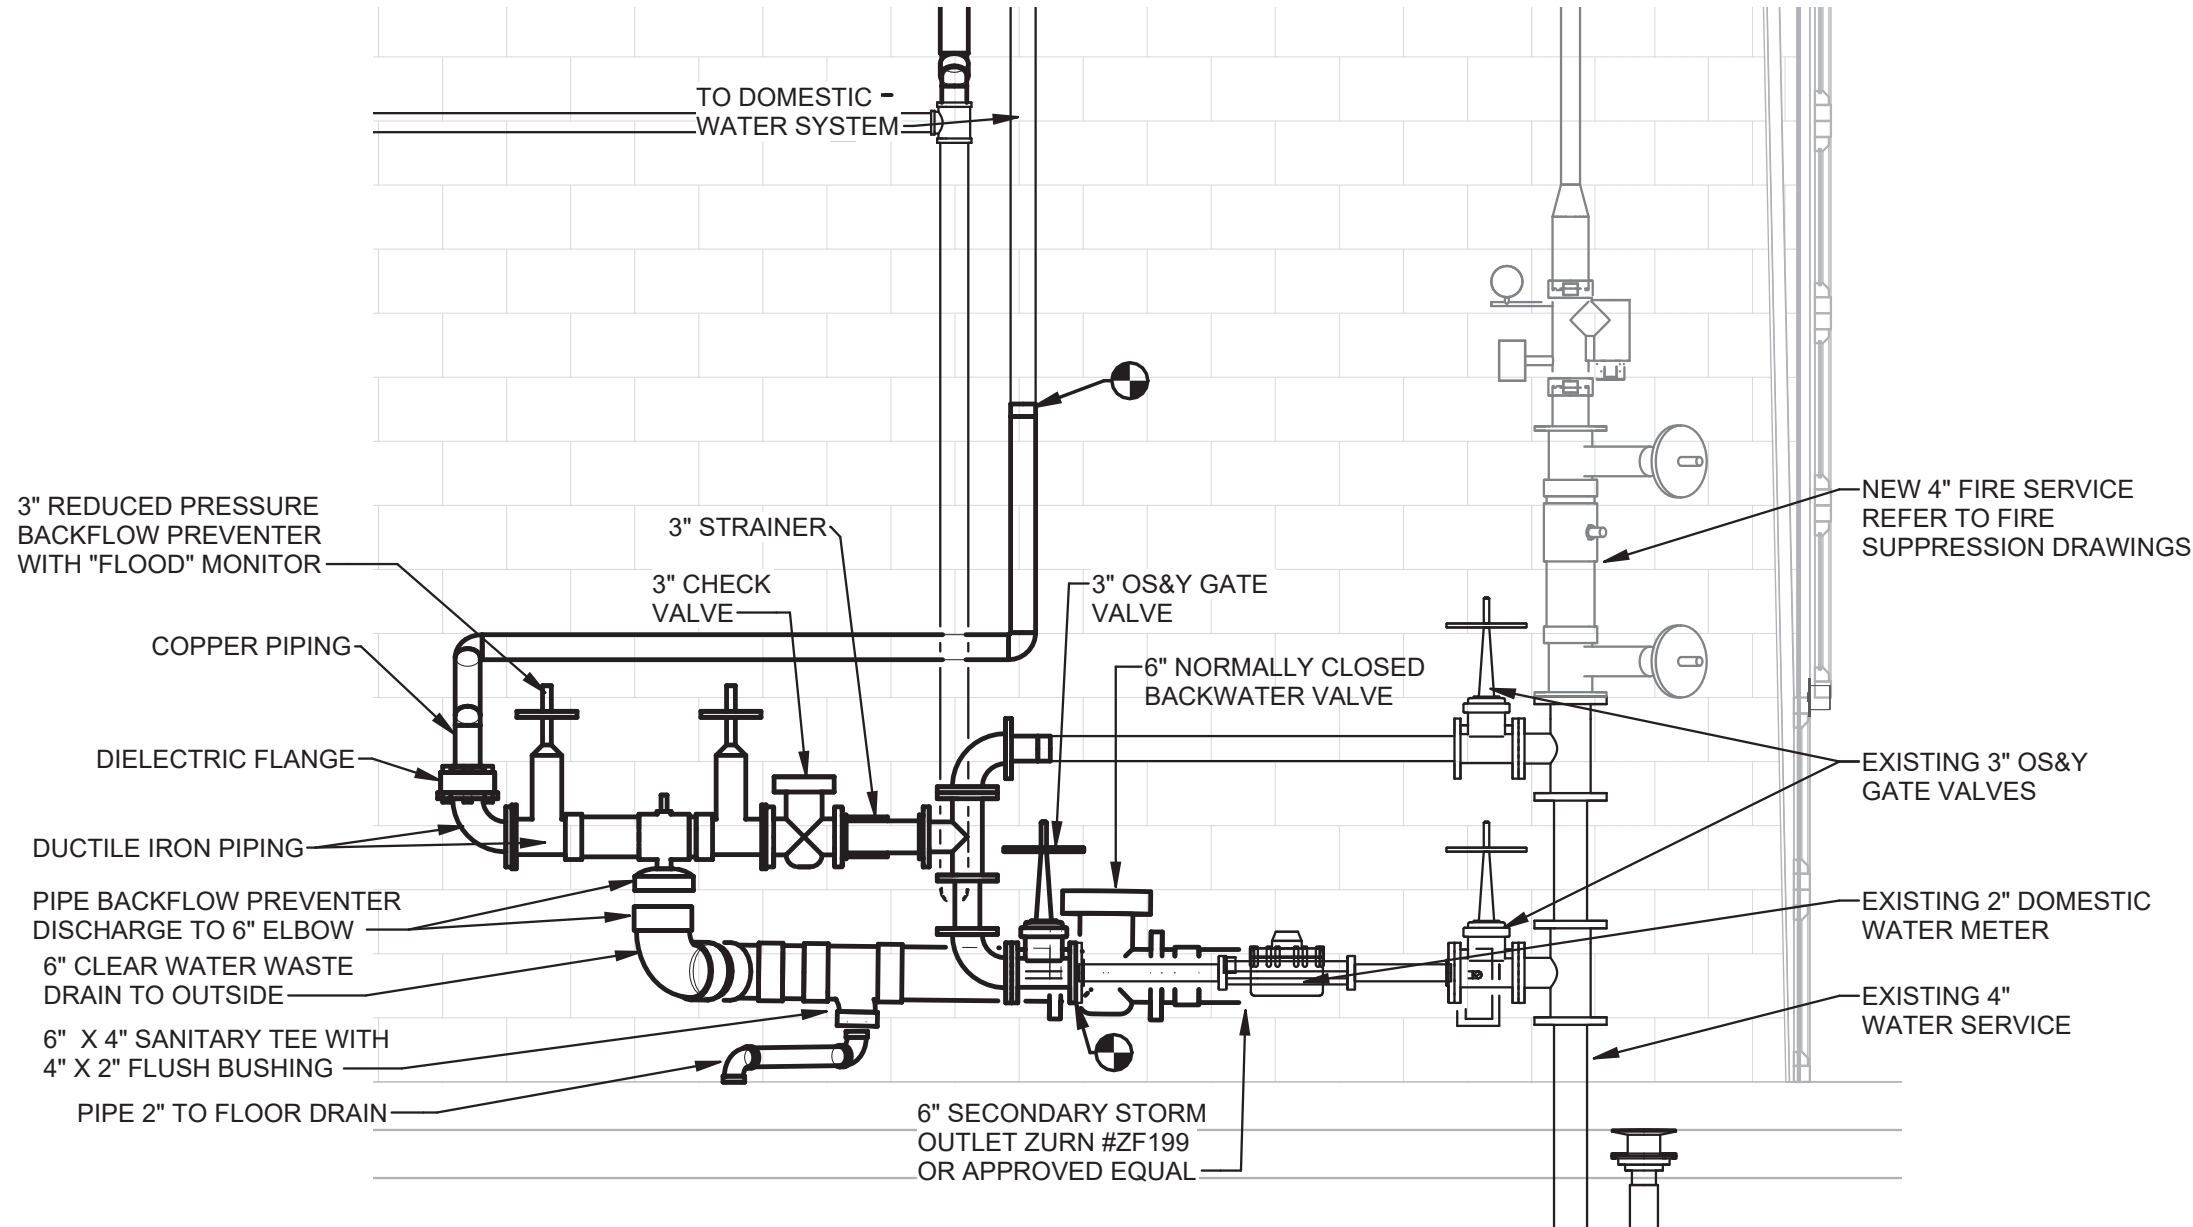


C

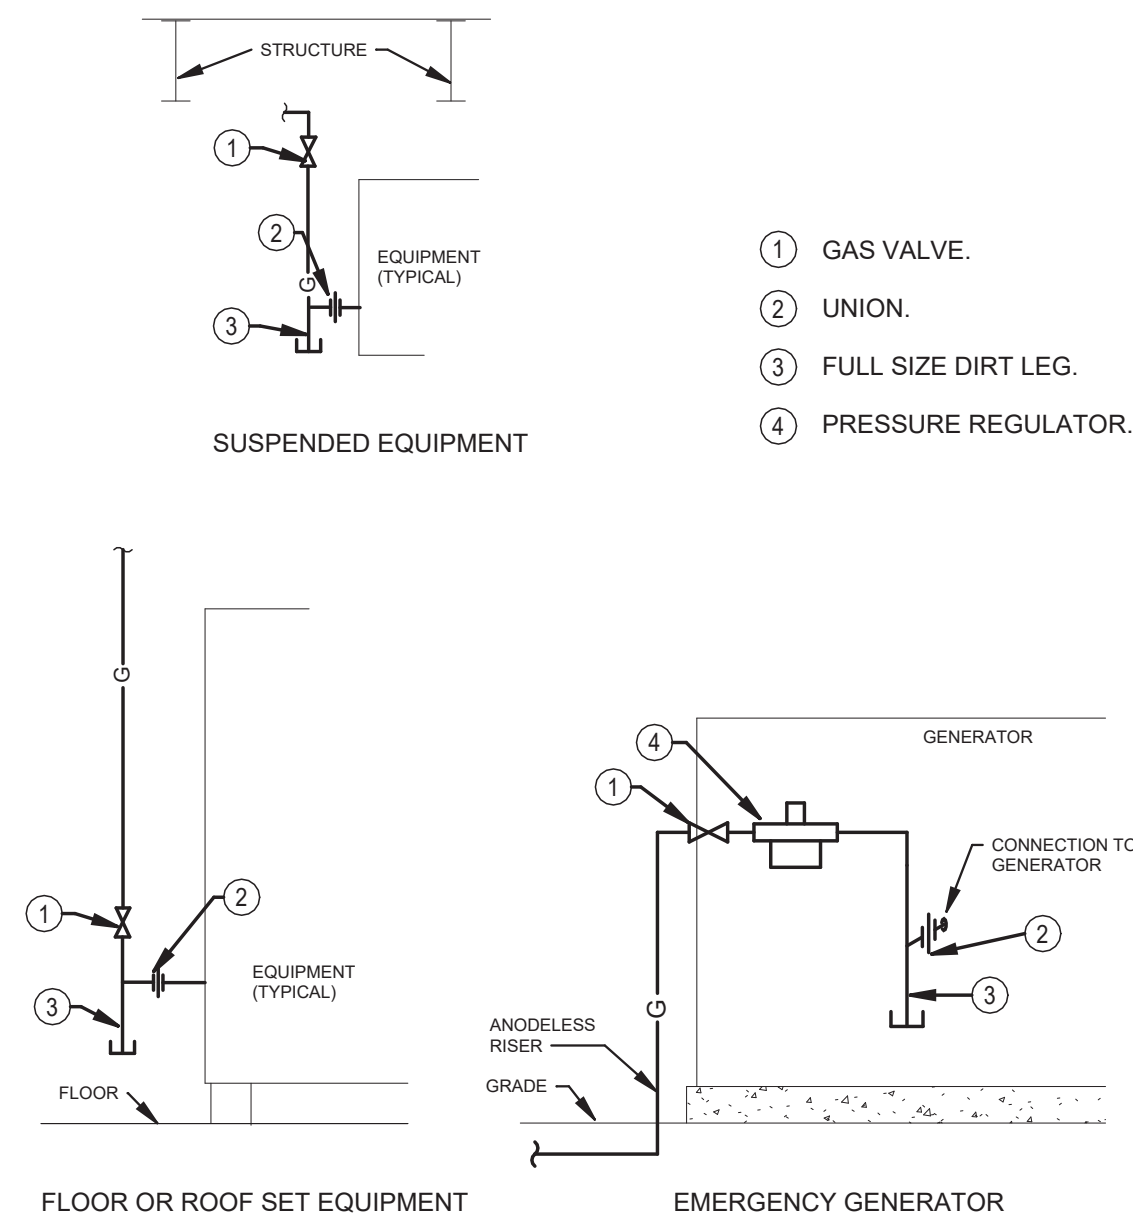


6 GAS CONNECTIONS
N.T.S.

D

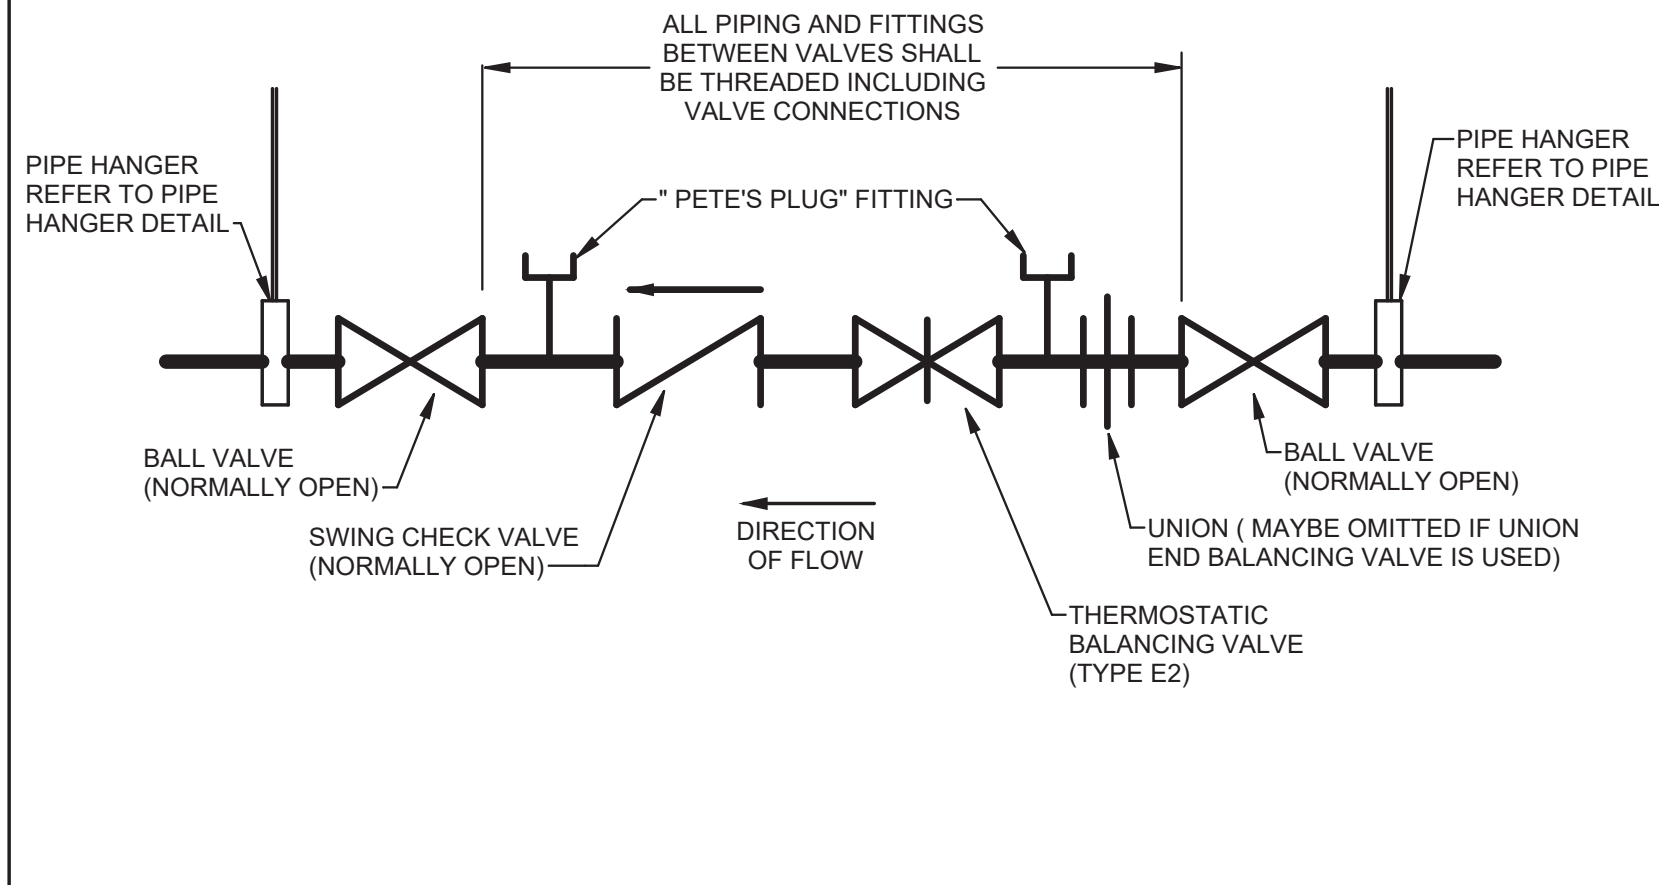


5 DOMESTIC HOT WATER RETURN BRANCH LINE VALVING
SCALE: N.T.S.

F

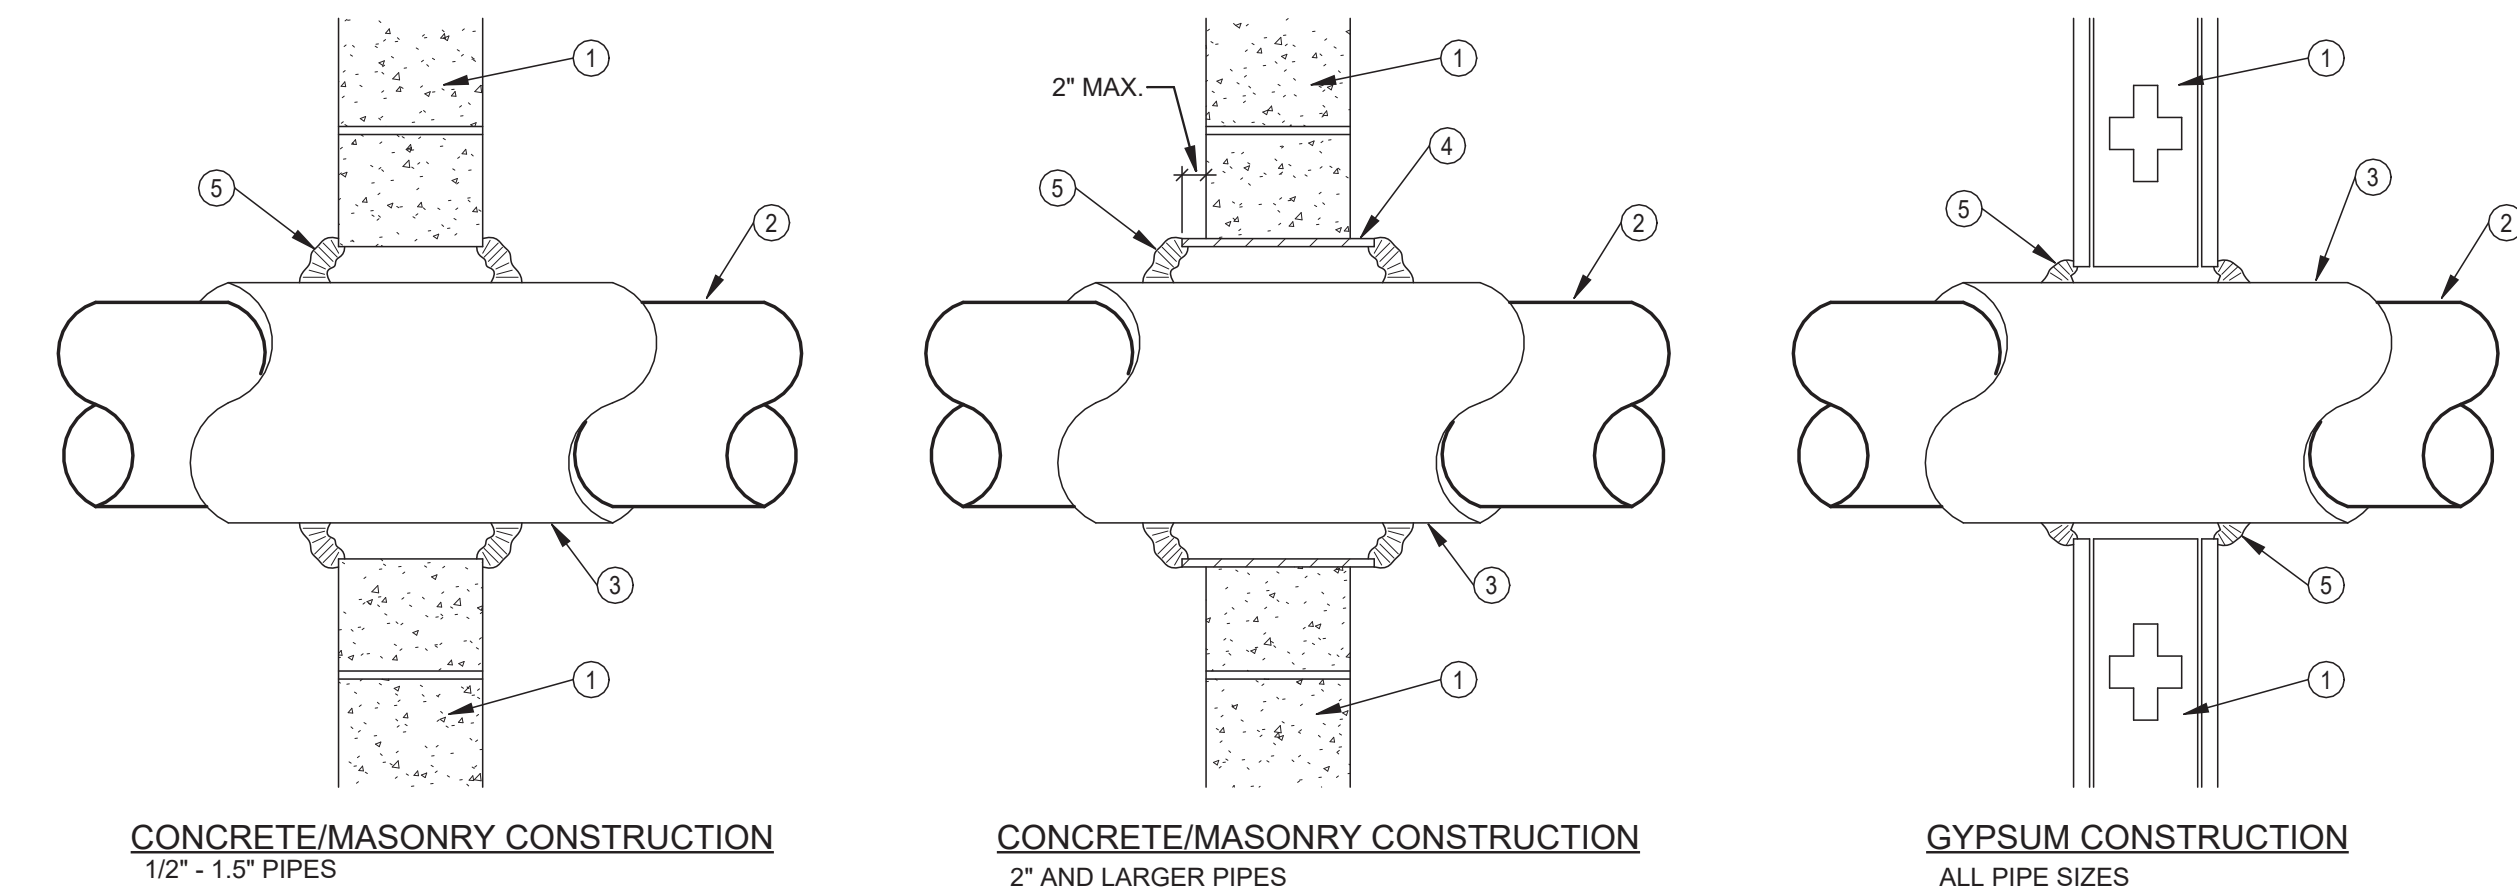

8 PIPE PENETRATIONS THRU NON-RATED WALL
N.T.S.

7 PIPE PENETRATIONS THRU FIRE RATED WALL
N.T.S.

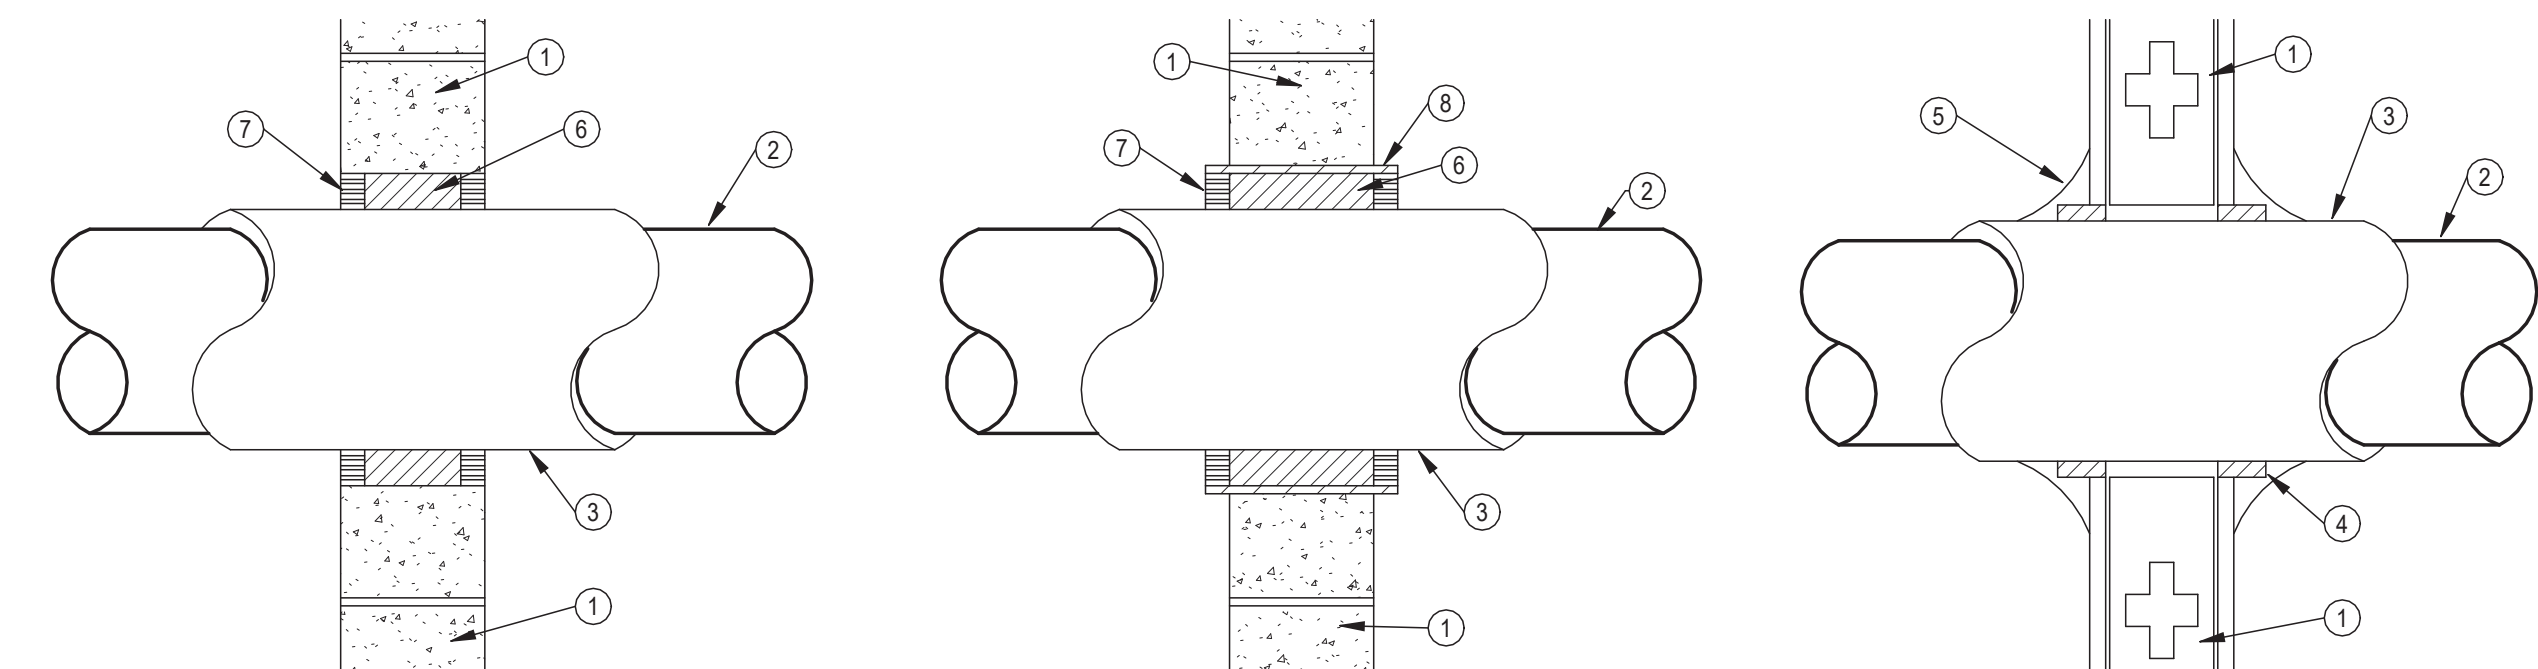

CONCRETE/MASONRY CONSTRUCTION

1/2" - 1.5" PIPES

FIRESTOPPING MATERIALS INSTALLATION

- MANUFACTURERS: 3M FIRE PROTECTION PRODUCTS HILTI FIRESTOP SYSTEMS
- FIRESTOPPING MATERIAL INSTALLATION SHALL BE PER THE MANUFACTURERS DETAILED INSTALLATION DIAGRAMS AND INSTRUCTIONS.
- F-RATING OF PENETRATION SHALL BE NO LESS THAN THE FIRE RATING OF THE WALL.
- SUBMITTAL SHALL INCLUDE PRODUCT DATA AND DETAILED INSTALLATION SYSTEM DIAGRAMS.

- 1 RATED WALL ASSEMBLY.
- 2 METALLIC PIPE OR TUBING.
- 3 PIPE INSULATION, CONTINUOUS THROUGH WALL OPENING, SEE SCHEDULE FOR THICKNESS.
- 4 APPROVED FIRESTOPPING VOID/CAVITY MATERIAL.
- 5 APPROVED FIRESTOPPING CAULK OR SEALANT.
- 6 PACKING MATERIAL, MINERAL WOOL BATT INSULATION.
- 7 APPROVED FIRESTOPPING CAULK OR SEALANT FLUSH WITH SURFACE OF WALL OR EDGE OF SLEEVE.
- 8 SCHEDULE 40 STEEL PIPE SLEEVE CAST OR GROUTED INTO WALL ASSEMBLY. ENDS FLUSH OR MAX. 2" BEYOND WALL SURFACE.

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 233-3801
PROJECT # 24065

A


B

C

D

E

F

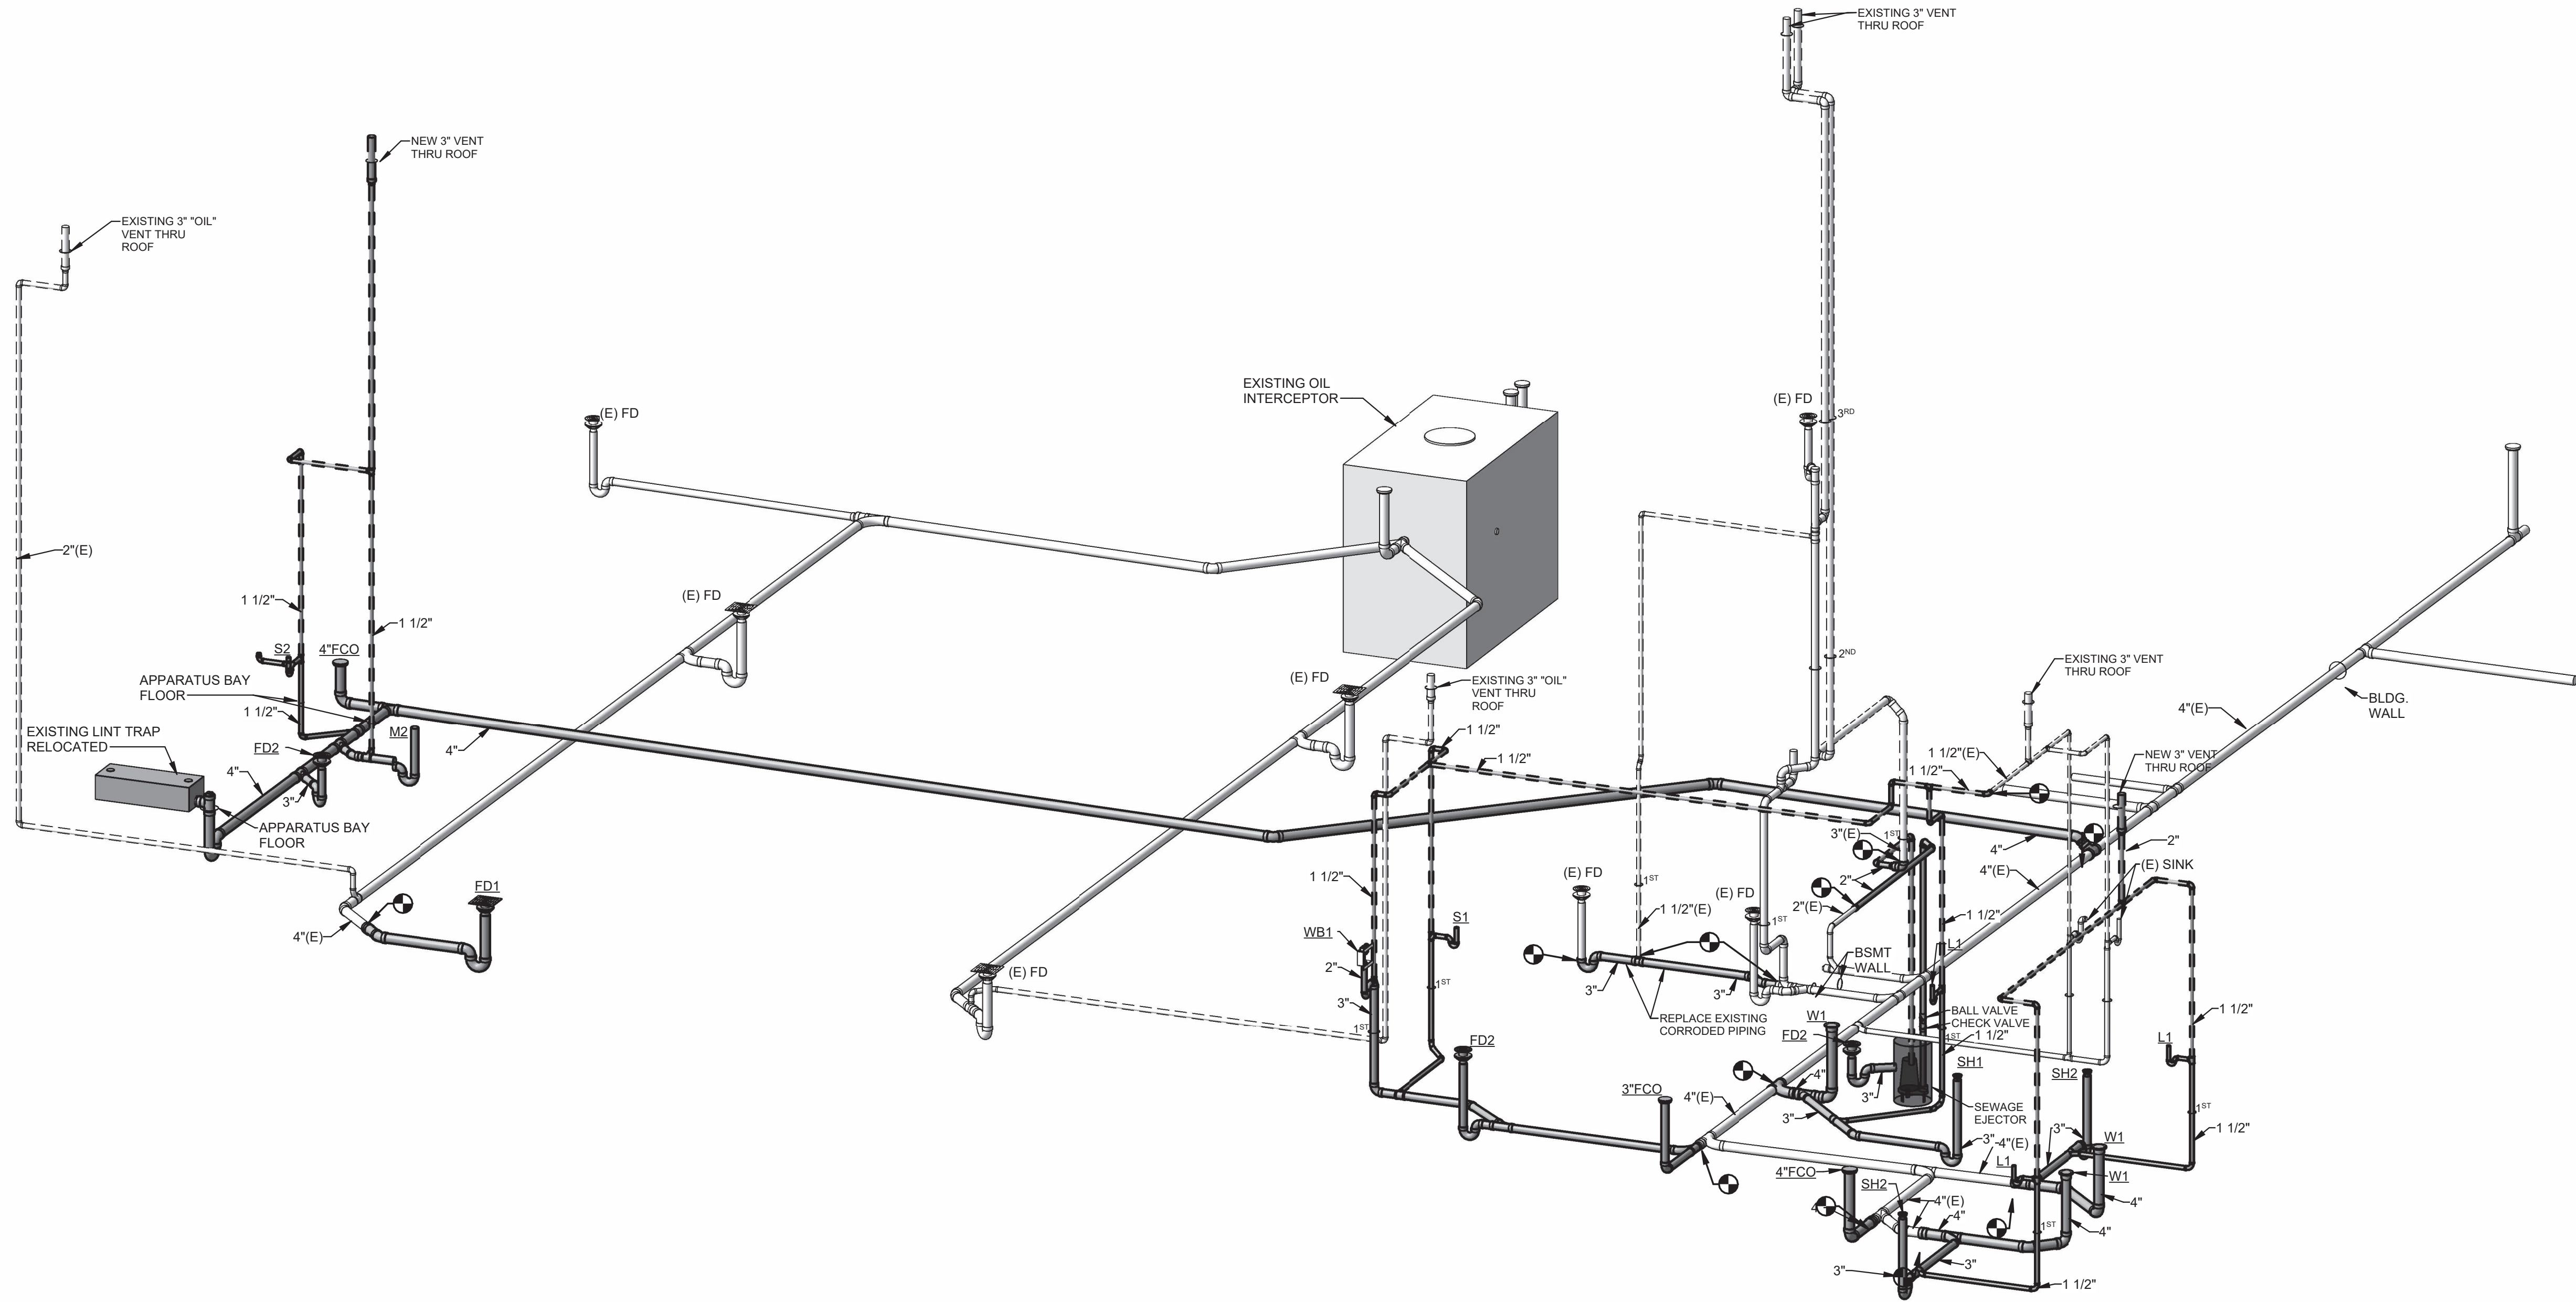

SOIL, WASTE, AND VENT DIAGRAM
N.T.S

ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025 FOR CONSTRUCTION		

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DEG
CHECKED	JDZ
COPYRIGHT © 2025 - App Architecture, Inc.	
TITLE	SOIL, WASTE, AND VENT DIAGRAM

A

B

C

D

E

F

GENERAL HVAC REMOVAL NOTES

- A. GENERAL - THIS REMOVAL PLAN HAS BEEN MADE TO ASSIST THE CONTRACTOR IN DETERMINING GENERAL SCOPE OF REMOVALS. THESE DRAWINGS SHALL NEITHER BE CONSIDERED AS SHOWING ALL REMOVAL ITEMS NOR SHALL IT BE CONSIDERED A SUBSTITUTE FOR A THOROUGH SITE INVESTIGATION. NO ALLOWANCE SHALL BE MADE FOR LACK OF KNOWLEDGE CONCERNING EXISTING SITE CONDITIONS. ALL PIPE AND/OR DUCTWORK SHALL BE MADE CONTINUOUS TO ANY ACTIVE EQUIPMENT PAST THE ITEM(S) BEING REMOVED.
- B. GENERAL REMOVALS - THE HVAC CONTRACTOR IS TO REMOVE ALL EXISTING, ACCESSIBLE UNUSED OR ABANDONED DEVICES, PIPING, WIRING, DUCTWORK AND SUPPORT HANGERS OR STRUCTURES TOTALLY BACK TO SOURCE. IN NO CASE SHALL ANY ABANDONED PIPING, WIRING, DUCTWORK, OR EQUIPMENT REMAIN WITHIN THE CONSTRUCTION AREA OR IN ADJACENT AREAS TO MECHANICAL ROOMS OR CLOSETS. ONLY ITEMS THAT ARE INACCESSIBLE SHALL BE ALLOWED TO BE ABANDONED IN PLACE WITH ALL ACCESSIBLE SERVICES APPROPRIATELY CAPPED.
- C. SUPPORTS REMOVALS - ALL SUPPORTS SHALL BE REMOVED ENTIRELY FROM DEMOLISHED PIPING, DUCTWORK AND EQUIPMENT. REMAINING ACTIVE PIPING, DUCTWORK, ETC. SHALL BE RE-SUPPORTED AS REQUIRED WHERE EXISTING SUPPORTS ARE REMOVED, AS IN THE CASE OF DUCTWORK OR PIPING, WHICH IS BEING REMOVED OR WHERE EXISTING SUPPORTS/LOCATION CONFLICTS WITH NEW UTILITIES. NEW SUPPORTS SHALL UTILIZE APPROVED AND RECOGNIZED MATERIALS AND METHODS AND BE INSTALLED IN ACCORDANCE WITH THE DRAWINGS.
- D. WALL REMOVALS - RECESSED DEVICES TO BE ABANDONED IN EXISTING WALLS WHICH ARE TO REMAIN IN FINISHED AREAS SHALL BE COVERED BY SUITABLE BLANK COVER PLATES AND PAINTED TO MATCH FINISH. WHERE REMOVALS ARE COMPLETELY REMOVED FROM FACE OF WALL, PATCH WALL CONSISTENT WITH ADJACENT FINISH. SURFACE MOUNTED REMOVED DEVICES SHALL HAVE SURFACE REPAIRED AND FINISHED TO MATCH ADJACENT EXISTING OR NEW ARCHITECTURAL FINISHES.
- E. ROOF REMOVALS - DEVICES, SERVICES, SUPPORTS & EQUIPMENT REMOVED FROM ROOF SHALL BE REMOVED. THE HVAC CONTRACTOR SHALL ENGAGE A ROOFING CONTRACTOR TO PATCH THE ROOFING CONSISTENT WITH THE EXISTING ROOF WARRANTY.
- F. ABANDONED SERVICES - ALL INACTIVE DUCT AND PIPE ABOVE CEILINGS SHALL BE REMOVED IN ENTIRETY AND CAPPED AT NEAREST ACTIVE MAINS.
- G. EQUIPMENT REMOVAL/DISPOSAL COORDINATION - COORDINATE REMOVAL ITEMS CLOSELY WITH OWNER. ANY ITEMS REMOVED WITHIN THE CONSTRUCTION AREA SHALL BE TURNED OVER TO THE OWNER IN GOOD CONDITION WHEN INDICATED HEREIN OR WHEN SO REQUESTED BY THE OWNER. ALL OTHERS WILL BECOME THE PROPERTY OF THE CONTRACTOR AND WILL BE REQUIRED TO BE DISPOSED OF ACCORDINGLY. DISPOSALS REGULATED BY EPA SHALL BE DONE IN STRICT ACCORDANCE WITH LATEST REQUIREMENTS AND DOCUMENTED.
- H. PROTECTION - EXISTING MATERIALS AND FINISHES ARE TO BE PROTECTED AND RESTORED TO MATCH ADJACENT FINISHES. PROVIDE ADEQUATE PROTECTION TO ALL EXPOSED SURFACES AND EQUIPMENT WITHIN THE REMOVAL AREA.
- I. ACTIVE EQUIPMENT & SERVICES - ANY EXISTING EQUIPMENT OR DEVICES TO REMAIN IN ADJACENT SPACES MAKE INACTIVE BY REMOVAL OF DEVICES OR WIRING WITHIN THE CONSTRUCTION AREA SHALL BE RE-FED AS REQUIRED TO MAKE DEVICES OR EQUIPMENT OPERATIONAL.
- J. DAMAGED SERVICES & INSULATION - EXISTING PIPING & DUCTWORK TO REMAIN WITH DAMAGED INSULATION ENCOUNTERED IN AREAS OF WORK SHALL HAVE DAMAGED INSULATION REMOVED AND REPLACED WITH NEW. INSULATION THICKNESS SHALL MATCH EXISTING CONDITION. WORK TO BE PERFORMED ON A TIME AND MATERIAL BASIS AS ENCOUNTERED. SERVICES DAMAGED DURING CONSTRUCTION SHALL BE REPLACED AT THE EXPENSE OF THE CONTRACTOR.
- K. OPENINGS & PATCHING - WHERE DUCTWORK, PIPING, EQUIPMENT, OR AIR DEVICES ARE REMOVED THROUGH WALLS, FLOORS, CEILINGS AND ROOF, THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE TO PATCH AND FINISH CONSISTENT WITH THE EXISTING OR NEW ARCHITECTURAL FINISHES FOR THAT AREA. OPENINGS OR HOLES EXPOSED TO EXTERIOR CONDITIONS SHALL BE MADE WEATHER-TIGHT AND WATERPROOF AND CONSISTENT WITH ADJACENT WALL FINISHES. PATCHING AND SEALING TO BE CONSISTENT WITH FIRE AND SMOKE STOPPING AND RATING.
- CMU WALLS - GROUT SMALL PENETRATIONS CLOSED. TOOTH IN WITH NEW BLOCKING FOR LARGE HOLES.
BRICK WALLS - TOOTH IN WITH NEW BRICK
GYPSUM BOARD WALLS - REPLACE WITH NEW GYPSUM BOARD
STRUCTURAL METAL ROOF/FLOOR DECKING - REPLACE WITH NEW DECKING. SAME AS EXISTING SIZE
CONCRETE FLOORS/WALLS - GROUT PENETRATIONS CLOSED
WOOD FLOORS/WALLS - PATCH CONSISTENT WITH WOOD TYPE
- L. ASBESTOS REMOVALS - ANY MATERIAL SUSPECTED OF CONTAINING ASBESTOS ENCOUNTERED DURING THE COURSE OF CONSTRUCTION SHALL IMMEDIATELY BE REPORTED TO OWNER AND PROJECT MANAGER. ALL WORK IN THAT AREA SHALL CEASE UNTIL DEEMED SAFE.
- M. CEILING REMOVALS - THE HVAC CONTRACTOR SHALL BE RESPONSIBLE FOR THE TEMPORARY REMOVAL, STORAGE AND RE-INSTALLATION OF CEILING GRID AND TILES AS REQUIRED FOR WORK. CONTRACTOR IS RESPONSIBLE FOR REPLACEMENTS, IF DAMAGED.

GENERAL NOTES - HVAC

1. PROVIDE COMPLETE AND FUNCTIONAL HVAC SYSTEMS PER HVAC PLANS INCLUDING FURNISHING, INSTALLING, TESTING AND WARRANTY OF ALL WORK.
2. WORK SHALL BE IN ACCORDANCE WITH THE 2024 OHIO BUILDING AND MECHANICAL CODES INCLUDING REFERENCED CODES AND STANDARDS, ALL FEDERAL, STATE, AND LOCAL CODES AND ALL APPLICABLE LAWS, ORDINANCES AND REGULATIONS.
3. WORK SHALL BE PERFORMED USING BEST QUALITY INSTALLATION PRACTICE BY A QUALIFIED TRADE CONTRACTOR AND THEIR QUALIFIED SUBCONTRACTORS. ALL CONTRACTORS SHALL BE LICENSED AND BE BONDED FOR THE WORK.
4. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH OSHA AND OWNER SAFETY STANDARDS AND PRACTICES. ALL ON SITE PERSONNEL SHALL BE SAFETY TRAINED AND OWNER CERTIFIED.
5. OBTAIN REQUIRED PERMITS RELATED TO THE WORK AND PAY ALL PERMIT AND INSPECTION FEES.
6. THE AUTHORITY HAVING JURISDICTION SHALL INSPECT AND APPROVE ALL WORK. PROVIDE A FINAL CERTIFICATE OF APPROVAL FROM THE AUTHORITY HAVING JURISDICTION AND PRESENT TO THE OWNER BEFORE REQUESTING FINAL PAYMENT AND RELEASE OF RETAINAGE.
7. ALL EQUIPMENT AND MATERIAL REQUIRED FOR COMPLETE AND FUNCTIONAL HVAC SYSTEMS ARE INCLUDED IN THE CONTRACT.

GENERAL REQUIREMENTS - HVAC

1. PROTECT ALL FURNISHED MATERIAL AND EQUIPMENT FROM THEFT AND DETERIORATION OR CONTAMINATION DUE TO WEATHER OR CONSTRUCTION ACTIVITIES.
2. PROTECT OWNERS PROPERTY AND PROPERTY OF OTHER CONTRACTORS.
3. REMOVE ALL CONSTRUCTION DEBRIS FROM SITE. RECYCLE DEBRIS WHERE POSSIBLE. DISPOSE OF ALL HAZARDOUS MATERIAL IN ACCORDANCE WITH ENVIRONMENTAL LAWS.
4. PROVIDE ALL CUTTING AND PATCHING REQUIRED TO INSTALL MATERIAL AND EQUIPMENT.
5. EXISTING ROOF PATCHING SHALL BE SUBCONTRACTED TO A BONDED ROOFING CONTRACTOR FAMILIAR WITH THE ROOFING SYSTEM. MAINTAIN ANY REMAINING ROOF WARRANTY.
6. PROVIDE APPROPRIATE FIRESTOPPING SYSTEM FOR ANNULAR SPACE OPENINGS AROUND DUCT AND PIPE PENETRATIONS THROUGH FIRE RESISTANCE RATED CONSTRUCTION. ANNULAR SPACE OPENINGS AT DUCT OR PIPE PENETRATIONS IN NON RATED CONSTRUCTION TO BE CLOSED AIR AND WATER TIGHT.
7. MATERIALS AND EQUIPMENT SHALL BE ONE OF THE BRAND OR MANUFACTURERS LISTED OR AN APPROVED EQUAL.
8. ELECTRONIC SHOP DRAWINGS SHALL BE PROVIDED IN .PDF FORMAT FOR THE ENGINEER'S APPROVAL FOR ALL MATERIALS AND EQUIPMENT. SHOP DRAWINGS SHALL BE SPECIFICALLY EDITED TO ELIMINATE SUPERFLUOUS INFORMATION AND SHALL CLEARLY SHOW SPECIFICS FOR THE MATERIAL AND EQUIPMENT PROVIDED.
9. COORDINATE INSTALLATION OF ACTUAL EQUIPMENT AND SYSTEMS PROVIDED WITH OTHER TRADES AND NEW OR EXISTING CONDITIONS.
10. INSTALL ALL MATERIALS AND EQUIPMENT IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND REQUIREMENTS. PROVIDE REQUIRED CLEARANCES TO MEET CODE REQUIREMENTS, MANUFACTURER'S RECOMMENDATIONS AND MAINTENANCE SERVICE.
11. ALL WORK AREAS SHALL BE CLEANED TO MATCH ORIGINAL CONDITION.
12. PROVIDE TESTING, ADJUSTING AND BALANCING (TAB) REPORTS FOR AIR AND WATER SYSTEMS. A CERTIFIED AABC OR NEBB FIRM SHALL PROVIDE THE BALANCE.
13. PROVIDE FINAL COORDINATION/INSTALLATION DRAWINGS TO THE OWNER IN BOUND PAPER AS WELL AS ELECTRONIC FORMAT FOR RECORD.
14. MAINTAIN RECORD DRAWINGS AND PROVIDE TO THE OWNER OR HIS AGENT.
15. PROVIDE TWO (2) BOUND, PAPER COPIES OF ALL OPERATING AND MAINTENANCE MANUALS. PROVIDE AN ELECTRONIC COPY OF THE OPERATING AND MAINTENANCE MANUAL.
16. PROVIDE WARRANTY FOR ALL WORKMANSHIP. EQUIPMENT AND MATERIAL. WARRANTY SHALL BE 1 YEAR FOR PART AND LABOR. PROVIDE EXTENDED WARRANTY PERIOD FOR PARTS AND/OR LABOR AS IDENTIFIED OR AS STANDARD FOR CERTAIN ITEMS OF EQUIPMENT.
17. PROVIDE TRAINING AND MAINTENANCE INSTRUCTION FOR SYSTEMS AND EQUIPMENT TO THE OWNER. TRAINING SHALL BE 16 HOURS OF TIME WITH MAXIMUM TRAINING PERIOD OF 4 HOURS.

PIPING LEGEND

	INDICATES DIRECTION OF FLOW
	CONDENSATE DRAIN
	REFRIGERANT - LIQUID
	REFRIGERANT - SUCTION
	REFRIGERANT - HIGH/LOW PRESSURE GAS
	REFRIGERANT - SUCTION & LIQUID, 2 PIPES TOTAL
	REFRIGERANT - SUCTION, LIQUID, & HOT GAS 3 PIPES TOTAL
	REFRIGERANT LINE SET BETWEEN BRANCH SELECTOR BOX AND FAN COIL UNIT. 0.375\"/>
	FLEXIBLE CONNECTION
	CAP
	CONNECTION, BOTTOM
	CONNECTION, TOP
	CONNECTION, SIDE
	ELBOW, 90°, LONG RADIUS
	ELBOW, 45°, LONG RADIUS
	ELBOW, TURNED UP
	ELBOW, TURNED DOWN
	REDUCER
	UNION, SCREWED
	PIPE HOSE THREAD CONNECTION
	PRESSURE GAUGE
	TEMPERATURE GAUGE
	AIR VENT MV = MANUAL AV = AUTOMATIC

TEMPERATURE CONTROLS LEGEND

ABBREVIATIONS	
A.I. -	ANALOG INPUT
A.O. -	ANALOG OUTPUT
AFMS -	AIR FLOW MEASURING STATION
BAS -	BUILDING AUTOMATION SYSTEM
DDC -	DIRECT DIGITAL CONTROLS
D.I. -	DIGITAL INPUT
D.O. -	DIGITAL OUTPUT
EOM -	ELECTRICALLY COMMUTATE MOTOR
E.W.T. -	ENTERING WATER TEMPERATURE
L.W.T. -	LEAVING WATER TEMPERATURE
M.C. -	MASTER CONTROLLER
N.O. -	NORMALLY OPEN
N.C. -	NORMALLY CLOSED
SCR -	SILICON CONTROLLED RECTIFIER
VFD -	VARIABLE FREQUENCY DRIVE
SENSORS & TRANSMITTERS	
	TEMPERATURE SENSOR
	HUMIDITY SENSOR
	COMBINATION TEMPERATURE & HUMIDITY SENSOR
	COMBINATION TEMPERATURE & CARBON DIOXIDE SENSOR
	PRESSURE SENSOR
	NITROGEN DIOXIDE (NO ₂) SENSOR
	CARBON DIOXIDE (CO ₂) SENSOR
	CARBON MONOXIDE (CO) SENSOR
	COMBINATION CARBON MONOXIDE & NITROGEN DIOXIDE SENSOR
	DIFFERENTIAL PRESSURE SENSOR
	ENTHALPY SENSOR
	PIPE WELL TYPE TEMPERATURE SENSOR
	PIPE WELL TYPE FLOW METER
	THERMOSTAT - LINE OR LOW VOLTAGE
	HUMIDISTAT
	RELAY
VALVES	
	MOTORIZED TWO-WAY CONTROL VALVE
	MOTORIZED THREE-WAY CONTROL VALVE
DAMPERS	
	MOTORIZED CONTROL DAMPER
OVER-RIDE TIMERS	
	VERRIDE TIMER - LINE VOLTAGE
	VERRIDE PUSH BUTTON - DIGITAL SIGNAL
GAUGES	
	PRESSURE DIAL GAUGE - REFER TO SPECIFICATION FOR RANGES • AIRFLOW UNITS: IN. W.C. • WATER UNITS: PSI
SAFETY DEVICES	
• WIRED DIRECTLY TO EQUIPMENT STARTER W/ MANUAL RESET	
	DUCTWORK SMOKE DETECTOR - RELAY & LOW VOLTAGE WIRING TO FAN CONTROLLER BY T.C.
	HIGH STATIC SAFETY SWITCH
	FLOW SWITCH
	FREEZE STAT

DUCTWORK LEGEND

	RECTANGULAR DUCT FIRST FIGURE IS SIDE SHOWN
	ROUND DUCT DIAMETER INDICATED
	STAINLESS STEEL DUCT
	INSULATED FLEXIBLE DUCT
	CHANGE OF ELEVATION R = RISE, D = DROP
	ELBOW WITH TURNING VANES
	ROUND RUNOUT DUCT TAP TO RECTANGULAR DUCT WITH SPIN-IN FITTING, SEE DETAIL
	ROUND RUNOUT DUCT FITTING IN ROUND DUCT MAIN
	VOLUME DAMPER
	AUTOMATIC CONTROL DAMPER REFER TO CONTROL DIAGRAMS FOR TYPE.
	FIRE DAMPER
	DUCT MOUNTED SMOKE DETECTOR
	SUPPLY DUCT SECTION - RISE, DROP
	RETURN DUCT SECTION - RISE, DROP
	SUPPLY AIR DEVICE S1 SEE SCHEDULE AND DETAIL 8\"/>
	TRANSFER AIR DEVICE R1 DEVICE TAG, SEE SCHEDULE AND DETAIL
	RETURN/EXHAUST DEVICE TAG: R=RETURN, E=EXHAUST 300 = REQUIRED AIR FLOW (CFM) DEVICE SIZE AS INDICATED IN AIR DEVICE SCHEDULE
	SIDEWALL AIR DEVICE SEE AIR DEVICE SCHEDULE 24\"/>
	LINEAR SLOT PLENUM S3 - DEVICE TAG, SEE AIR DEVICE SCHEDULE 6\"/>
	EXISTING AIR DEVICE REBALANCE TO AIR FLOW INDICATED

VALVE LEGEND

	SHUT-OFF VALVE, SEE SCHEDULE FOR TYPE
	CHECK VALVE
	BALANCING VALVE
	GATE VALVE
	PRESSURE REDUCING VALVE
	TWO-WAY CONTROL VALVE
	THREE-WAY CONTROL VALVE
	STRAINER, Y-TYPE
	PRESSURE RELIEF VALVE

GENERAL LEGEND

EC	ELECTRICAL CONTRACTOR.
FC	FIRE PROTECTION CONTRACTOR.
GC	GENERAL CONTRACTOR.
HC	HVAC CONTRACTOR.
PC	PLUMBING CONTRACTOR.
TC	TEMPERATURE CONTROLS CONTRACTOR.
NIC	NOT IN CONTRACT.
AFF	ABOVE FINISHED FLOOR - TO BOTTOM OF ITEM UNLESS INDICATED OTHERWISE IN DRAWING.
(E)	EXISTING.
ES	EQUIPMENT SUPPLIER.
EM	EMERGENCY.
MH	MOUNTING HEIGHT.
S	SURFACE MOUNTED.
WP	WEATHER PROOF.
	NOTE SYMBOL - APPLIES ONLY TO SHEET ON WHICH IS SHOWN.
	DETAIL NOTE SYMBOL - APPLIES ONLY TO DETAIL ON WHICH IS SHOWN.
	EQUIPMENT REFERENCE SYMBOL. ELECTRICAL CONNECTION REQUIRED.
	EQUIPMENT REFERENCE SYMBOL. NO ELECTRICAL CONNECTION REQUIRED.
	ROOM NUMBER.
	DETAIL SYMBOL DETAIL "B" SHOWN ON SHEET H2.
	SECTION SYMBOL SECTION "A" DESIGNATION, SHOWN ON SHEET H1.
	EXTERIOR ELEVATION SYMBOL ELEVATION "A" DESIGNATION, SHOWN ON SHEET H1
	CONNECTION, NEW TO EXISTING.
	UP TO SYMBOL UP TO "FD1", SHOWN ON FLOOR ABOVE.
	1 HOUR FIRE PROTECTION SEE SPECIFICATION FOR PENETRATION DETAILS
	2 HOUR FIRE PROTECTION SEE SPECIFICATION FOR PENETRATION DETAILS
	3 HOUR FIRE PROTECTION SEE SPECIFICATION FOR PENETRATION DETAILS
	ITEM TO BE REMOVED.
	EXISTING TO REMAIN.
	NEW ITEM.

HVAC INDEX OF DRAWINGS

SHEET	DRAWING TITLE
H0.1	LEGENDS AND SCHEDULES
H0.2	MATERIAL SCHEDULES
H0.3	EQUIPMENT SCHEDULES
H1.1	DEMOLITION PLANS
H2.1	NEW WORK PLANS
H3.1	DETAILS
H3.2	DETAILS
H3.3	DETAILS
H3.4	DETAILS
H3.5	DETAILS
H4.1	CONTROLS
H4.2	CONTROLS
H5.1	VENTILATION

PIPING SYSTEMS - HVAC			
PIPING SYSTEM		TYPE	
COIL CONDENSATE DRAINAGE		C3	
REFRIGERANT LINESETS		R1	
TYPE	DESCRIPTION	TYPE	DESCRIPTION
R1	COPPER COIL REFER TO SPECIFICATION 23 2300.	C3	SOLDERED COPPER TYPE "DWV" HARD COPPER ASTM B88 CAST DWV COPPER FITTINGS 95-5 SOLDER

DUCTWORK INSULATION SCHEDULE				
SYSTEM	INSULATION THICKNESS	TYPE	LOCATION	NOTES
SUPPLY AIR DUCT	1.5"	1	CONCEALED	
SUPPLY AIR DUCT	2"	2	EXPOSED	
RETURN AIR DUCT	-	-	CONCEALED	
RETURN AIR DUCT	-	-	EXPOSED	
RELIEF AIR DUCT & PLENUMS	-	-	CONCEALED	
RELIEF AIR DUCT & PLENUMS	-	-	EXPOSED	
EXHAUST AIR DUCT & PLENUMS	-	-	CONCEALED	
EXHAUST AIR DUCT & PLENUMS	-	-	EXPOSED	
TYPE	BASIS OF DESIGN	APPROVED EQUALS	DESCRIPTION	
1	OWENS-CORNING SOFT R TYPE 75	KNAUF JM CERTAIN TEED	MATERIAL FIBERGLASS DUCT WRAP ON DUCT K = 0.30 @ 75 DEG. F. DENSITY - 0.75 PCF JACKET - FOIL REINFORCED JOINTS - OVERLAPPING STAPLE ALL JOINTS AT 6" CENTERS. FASTENERS - MECHANICAL ON 24" & WIDER DUCT. ADHESIVE - NONE TAPE - 3" WIDE	
2	OWENS-CORNING TYPE 703	KNAUF JM CERTAIN TEED	MATERIAL FIBERGLASS BOARD ON DUCT K = 0.23 @ 75 DEG. F. DENSITY - 3.0 PCF JACKET - ASJ JOINTS - BUTT FASTENERS - METAL PINS & CLIPS ON 12" CENTERS ADHESIVE - NONE TAPE - 3" WIDE VAPOR PATCHED	

NOTES:

PIPE INSULATION SCHEDULE				
SYSTEM & SIZE		INSULATION THICKNESS	TYPE	LOCATION
REFRIGERANT LIQUID		0.75"	E1, E2	INTERIOR/EXTERIOR
REFRIGERANT HOT GAS		0.75"	E1, E2	INTERIOR/EXTERIOR
REFRIGERANT SUCTION		0.75"	E1, E2	INTERIOR/EXTERIOR
COOLING COIL CONDENSATE		0.5"	F1	INTERIOR
TYPE	BASIS OF DESIGN	APPROVED EQUALS	DESCRIPTION	
F1	OWENS CORNING #SSL II WITH ASJ MAX JACKET	- KNAUF - JOHNS MANVILLE - MANSION - CERTAINTEED	PREFORMED, TUBULAR, INORGANIC GLASS FIBER WITH RESIN BONDING. K=0.24 @ 100 DEG. F. 3.5 - 5.5 PCF. WHITE FSRK JACKET. LONGITUDINAL LAP, SELF-SEALING ADHESIVE. ELBOWS, TEES, VALVES, CAPS, ETC., WHITE ONE PIECE, PREMOLDED 25/50 0.20" PVC FITTING COVERS WITH HIGH DENSITY FIBERGLASS INSULATION INSERTS SAME THICKNESS, K=0.26 EQUAL TO ZESTON OR PROTO.	
E1	AEROFLEX #AEROCEL EPDM	- ARMACELL - RUBATEX	FLEXIBLE, PRE-FORMED, CLOSED CELL, EPDM ELASTOMERIC TUBULAR INSULATION, OR SHEET INSULATION. K=0.25 @ 75 DEG. F. CLEAN PIPE SURFACE WITH DENATURED ALCOHOL PRIOR TO INSULATING.	
E2	ARMACELL #AP ARMAFLEX FS	- AEROFLEX - RUBATEX	FLEXIBLE, PRE-FORMED, CLOSED CELL, ELASTOMERIC TUBULAR INSULATION. CLEAN PIPE SURFACE WITH DENATURED ALCOHOL PRIOR TO INSULATING. K=0.25 @ 75 DEG. F. 25/50 FLAME/SMOKE RATING. PROVIDE 0.20" ROLL ALLOY ALUMINUM EMBOSSED JACKET, SEAM SIDE DOWN WITH 0.50" WIDE, 0.015" S.S. STRAP AND SEALS EQUAL TO PABCO-CHILDERS METALS/GERRARD.	

DUCTWORK SYSTEMS SCHEDULE					
DUCTWORK SYSTEMS	LOCATION	MATERIAL	SMACNA CLASS.		NOTES
			SP. CONSTR.	SEAL CLASS	
RETURN AIR	CONCEALED	G1	-2"	C	
RETURN AIR	EXPOSED	G2	-2"	C	1
EXHAUST AIR	CONCEALED	G1	-2"	C	
EXHAUST AIR	EXPOSED	G2	-2"	C	1
AIR TRANSFER	ALL	G1	-1"	NOT REQ'D.	
SUPPLY AIR - CONSTANT VOLUME	CONCEALED	G1	+3"	B	
FLEXIBLE DUCTWORK - SUPPLY	CONCEALED OR UNCONDITIONED	C1	+10" -5"	N.A.	
GUH-1 COMBUSTION AIR / FLUE	ALL	P1	-2"	A	
RADIANT HEATER COMBUSTION AIR	ALL	G1	+4"	A	
RADIANT HEATER FLUE	ALL	D1	+4"	A	
DUCTWORK MATERIALS SCHEDULE					
TYPE	MATERIAL	DESCRIPTION			
C1	CHLORINATED POLYETHYLENE	BLACK INNER FABRIC WITH GALVANIZED STEEL HELIX REINFORCING, R = 6.0 (MIN.) FIBERGLASS INSULATION, REINFORCED METALIZED VAPOR BARRIER, 0.05 PERM, UL 181, CLASS 1 DUCT, MEET NFPA 90A & 90B, 25/50 FLAME/SMOKE SPREAD.			
D1	ALUMINUM ALLOY / GALVANIZED STEEL	DOUBLE WALL TYPE "B" VENT UL 441 / NFPA 54 LISTED REFER TO SPECIFICATION FOR APPROVED MANUFACTURERS.			
G1	GALVANIZED STEEL	24 GA. MIN., HOT DIPPED, GALVANIZED BOTH SIDES, G90 PER ASTM A653.			
G2	GALVANNEALED STEEL	24 GA. MIN., HOT DIPPED, HEAT TREATED GALVANNEALED BOTH SIDES PER ASTM A653, PAINT UNIFORM GRAY MATTE APPEARANCE, A40 PER ASTM A653.			
P1	POLYPROPYLENE	SCHEDULE 40 POLYPROPYLENE UL 1738 HIGH TEMPERATURE RATED, 230 DEG. F. FLUE GAS RATING CENTROTHERM INNOFLUE SINGLE WALL OR EQUAL.			

NOTES:

1. PAINT DUCTWORK TO MATCH BASE MATERIAL COLORS.

RATED ASSEMBLY PENETRATIONS									
GENERAL NOTES:									
1. REFER TO THE ARCHITECTS LIFE SAFETY DRAWING FOR INFORMATION ON RATED ASSEMBLIES ON THIS PROJECT.									
2. REFER TO SPECIFICATION 23 0004, 23 0529, 23 3300 FOR INFORMATION ON SYSTEMS SPECIFIED PER THIS SCHEDULE.									
3. FIRE, SMOKE, AND COMBINATION FIRE/SMOKE DAMPER ACCESS DOORS SHALL BE LOCATED IN AN EASILY ACCESSIBLE LOCATION. FOR HORIZONTAL PENETRATIONS, ACCESS DOORS SHALL BE LOCATED ON THE BOTTOM OF DUCTWORK. FOR VERTICAL PENETRATIONS, ACCESS DOORS SHALL BE LOCATED AT THE FLOOR LEVEL ON THE HIGHER FLOOR (I.E., A PENETRATION THROUGH THE 1ST AND 2ND FLOOR SHALL HAVE THE ACCESS DOOR LOCATED ON THE 2ND FLOOR LEVEL).									
ASSEMBLY TYPE	DUCTWORK					PIPING			NOTES
	FIRE DAMPER	FIRE STOPPING	PLIABLE CAULK	SMOKE DAMPER	COMBINATION FIRE / SMOKE	FIRE STOPPING	PLIABLE CAULK	CAST-IN PLACE FIRESTOP SYS.	
FIRE BARRIER	●	●				●			1
FIRE WALLS	●					●			
FIRE WALL HORIZONTAL EXIT					●	●			
FIRE BARRIER HORIZONTAL EXIT					●	●			
SHAFT ENCLOSURE	●	●		●	●	●			2
FIRE PARTITIONS	●					●			1
SMOKE PARTITIONS			●	●			●		
SMOKE BARRIER		●		●		●			3
RATED HORIZONTAL ASSEMBLY (FLOOR / CEILING)	●	●				●		●	4
NON-RATED HORIZONTAL ASSEMBLY (FLOOR / CEILING)	●	●				●			5

NOTES:

1. PROVIDE FIRE DAMPERS ONLY WHERE INDICATED ON DRAWINGS. FOR DUCTS WITHOUT FIRE DAMPERS, PROVIDE FIRE STOPPING.
2. PROVIDE FIRE DAMPER, SMOKE DAMPER, OR COMBINATION FIRE/SMOKE ONLY WHERE INDICATED ON DRAWINGS. DOB 7/17.5.3 EXCEPTIONS ALLOW THE ELIMINATION OF SOME DAMPERS. WHERE FIRE DAMPERS ARE NOT INDICATED, PROVIDE FIRE STOPPING.
3. PROVIDE SMOKE DAMPERS ONLY WHERE INDICATED ON DRAWING. FOR DUCTS WITHOUT SMOKE DAMPERS, PROVIDE FIRE STOPPING.
4. PROVIDE FIRE DAMPERS ONLY WHERE INDICATED ON DRAWINGS. FOR DUCTS WITHOUT FIRE DAMPERS, PROVIDE FIRE STOPPING. NOTE: DUCTS PENETRATING RATED FLOORS MAY BE WITHIN A SHAFT ENCLOSURE, REFER TO SHAFT REQUIREMENTS.
5. DUCTS PENETRATING NON-RATED, NON-COMBUSTIBLE FLOORS AND NOT ENCLOSED IN A SHAFT REQUIRE A FIRE DAMPER. DUCTS PENETRATING NON-RATED, COMBUSTIBLE FLOORS AND NOT WITHIN A SHAFT REQUIRE FIRE STOPPING.

A

B

C

D

E

F

FAN & ROOF VENTILATOR SCHEDULE

BASIS OF DESIGN - GREENHECK
REFER TO SPECIFICATIONS FOR OTHER MANUFACTURERS
VFD DRIVEN MOTORS SHALL BE PROVIDED WITH SHAFT GROUNDING RINGS, VFD DUTY MOTORS.
REFER TO INSTALLATION DETAILS.

TAG	SERVICE	AREA	DESCRIPTION	MODEL NUMBER	ROOF OPENING (L x W)	CAPACITY		ELECTRICAL		DISCONNECT	DISCONNECT WITH FAN	VFD	ECM	DIRECT BELT	ROOF CURB	BASE/FLOOR	SUSPENDED	WALL	CEILING	UL 785 GREASE RATED	UL 884 SMOKE CONTROL	HIGH TEMP (ABOVE 200 °F)	EXPLOSION PROOF	VIBRATION ISOLATION	INSULATION HOUSING	THERMAL CONTROL	SLOPING ROOF CURB	HINGED ROOF CURB	CURB EXTENSION	POWDER COAT FINISH	EPOXY INTERIOR FINISH	DDC CONNECTION	MANUAL/OFF SWITCH	DIAL SPEED CONTROLLER	HOA CONTROLLER	MOTORIZED DAMPER	GRAVITY DAMPER	NOTES
						AIRFLOW (CFM)	E.S.P. (IN. W.C.)	MOTOR HP	V/PH																													
EF-3	RESTROOMS	ROOF	DOWNBLAST CENTRIFUGAL	G-080-VG	12.5 / 12.5	225	0.5	1/10	120 / 1	●			●	●																								
EF-4	APP BAY	ROOF	UPBLAST CENTRIFUGAL	CUE-160-VG	18.5 / 18.5	2,820	1	2	208 / 3				●	●	●																●			●	●			
EF-5	APP BAY	INLINE	INLINE CENTRIFUGAL	SQ-80-VG	-	300	0.25	1/6	120 / 1	●			●	●		●							●								●			●	●			

NOTES:
1. REFER TO HOA CONTROLLER INSTALLATION DETAIL.

RADIANT HEATER SCHEDULE - GAS

GENERAL NOTES
BASIS OF DESIGN: RE-VERBER-RAY
EQUAL BY: REFER TO SPECIFICATION

UNIT NO.	MODEL #	SERVICE	MOUNTING	MODULATING RANGE (MBH)	AMPS	VOLT/PH	DIMENSIONS			WEIGHT	NOTES
							L				
RH-1	MP3-50-150	APP. BAY	CHAIN HANGER	110 - 150	4.8	120 / 1	41'-1"			190	1, 2
RH-2	MP3-50-150	APP. BAY	CHAIN HANGER	110 - 150	4.8	120 / 1	41'-1"			190	1, 2
RH-3	MP3-20-80	APP. BAY	CHAIN HANGER	65 - 80	4.8	120 / 1	21'-9"			120	1, 2
RH-4	MP3-20-80	APP. BAY	CHAIN HANGER	65 - 80	4.8	120 / 1	21'-9"			120	1, 2

NOTES:
1. MOUNT AT 14'-0" AFF.
2. WALL MOUNTED THERMOSTAT #TH-PUI.

GAS FIRED UNIT HEATER SCHEDULE

GENERAL NOTES
BASIS OF DESIGN: MODINE

UNIT NO.	SERVICE	MOUNTING	MODEL #	(MBH) INPUT/OUTPUT	CFM	AMPS	VOLT/PH	DIMENSIONS			WEIGHT	NOTES
								L (IN.)	D (IN.)	H (IN.)		
GUH-1	APP. BAY	CEILING SUSPENDED	HDS-125	125 / 102.5	1,980	4.75	120 / 1	35.5	31	21.5	85	1

NOTES:
1. CONTRACTOR CONVENIENCE PACKAGE - CONDENSATE PUMP OUTLET, UNIT DISCONNECT SWITCH, HEAT STATUS INDICATOR, EXTERNAL TERMINALS FOR DDC CONNECTION.

AIR DEVICE SCHEDULE

GENERAL NOTES
AIR DEVICES BASED ON PRICE.
EQUAL BY TITUS, TUTTLE & BAILEY
STANDARD WHITE BAKED ACRYLIC FINISH UNLESS NOTED OTHERWISE.
MAXIMUM SOUND LEVEL AT NC-25 AT INDICATED AIR FLOW.
DIFFUSERS SHALL BE 4-WAY THROW UNLESS OTHERWISE NOTED OR INDICATED ON DRAWINGS.
BALANCING DAMPER GENERALLY PROVIDED IN DUCT, NOT AT DEVICE.
VERIFY CEILING TYPE AND PROVIDE APPROPRIATE MOUNTING FRAME WHERE REQUIRED.

TAG	DESCRIPTION	MODEL NO.	MATERIAL	ACCESSORIES	NOTES
S1 & S1A	2'X2' SQUARE PLAQUE DIFFUSER ROUND DUCT CONNECTION	SPD (ASPD)	STEEL (A) = ALUMINUM	INSULATED BACKPAN (STYLE 31)	
S2 & S2A	12"X12"SQUARE PLAQUE DIFFUSER ROUND DUCT CONNECTION	SPD (ASPD)	STEEL (A) = ALUMINUM	INSULATED BACKPAN (STYLE 31)	1
S3	SUPPLY GRILLE DEVICE SIZE: REFER TO DRAWING 45° HORIZONTAL BLADES 1/2" SPACING	520	ALUMINUM	BALANCING DAMPER	
R1	RETURN GRILLE DEVICE SIZE - 24" X 24" 45° HORIZONTAL BLADES 1/2" SPACING	635	ALUMINUM	RETURN AIR CANOPY	
R2	RETURN GRILLE DEVICE SIZE - 24" X 12" 45° HORIZONTAL BLADES 1/2" SPACING BLADES PARALLEL TO LONG DIMENSION	635	ALUMINUM	RETURN AIR CANOPY	
R3	RETURN GRILLE DEVICE SIZE - 12" X 12" 45° HORIZONTAL BLADES 1/2" SPACING BLADES PARALLEL TO LONG DIMENSION	635	ALUMINUM	RETURN AIR CANOPY	
E1	EXHAUST GRILLE DEVICE SIZE - 24" X 24" 45° HORIZONTAL BLADES 1/2" SPACING	635	ALUMINUM		
E2	EXHAUST GRILLE DEVICE SIZE - 24" X 12" 45° HORIZONTAL BLADES 1/2" SPACING BLADES PARALLEL TO LONG DIMENSION	635	ALUMINUM		1
E3	EXHAUST GRILLE DEVICE SIZE - 12" X 12" 45° HORIZONTAL BLADES 1/2" SPACING	635	ALUMINUM		
E4	HEAVY DUTY GYM GRILLE DEVICE SIZE: INDICATED IN PLAN 45° HORIZONTAL BLADES 1/2" SPACING	9C	14 GA STEEL		

NOTES:
1. DEVICE TO BE SURFACE MOUNTED IN CENTER OF ACOUSTIC CEILING PAD FOR LAY-IN APPLICATION.

CONDENSING UNIT SCHEDULE

BASIS OF DESIGN: TRANE
EQUAL BY: DAIKIN, LG

UNIT	SERVICE	AREA SERVED	COOLING CAPACITY	HEATING CAPACITY	REFRIGERANT PIPING			MAX PIPING LENGTH (FT)	REFRIGERANT			ELECTRICAL			DIMENSIONS			UNIT WEIGHT (LBS)	MODEL NO.	NOTES
			MBH @ 90°F	MBH @ 0°F	GAS	LIQUID	H/L PRESSURE		TYPE	FACTORY CHARGE (LBS)	ADDITIONAL CHARGE (LBS)	V/PH	MCA	MOCP	WIDTH	DEPTH	HEIGHT			
CD-1	FC-1	FITNESS	24	20.8	5/8	3/8	-	165	R-410A	7	NOTE 2	208 / 1	24	25	37.5"	14.25"	37"	190	TRUZH0241HA10NA	1, 2
CD-2	FC-2	DECON	12	10.6	1/2	1/4	-	100	R-410A	5	NOTE 2	208 / 1	14	15	32"	12"	25"	104	TRUZA0121KA70NA	1, 2
CD-3	FC-3	TOG TOWER	18	14.7	1/2	1/4	-	100	R-410A	4	NOTE 2	208 / 1	14	15	32"	12"	25"	104	TRUZA0181KA70NA	1, 2

NOTES:
1. PROVIDE INSULATION TO REFRIGERANT LINE SETS.
2. ADDITIONAL REFRIGERANT CHARGE BY H.C.

FAN COIL UNIT SCHEDULE

BASIS OF DESIGN: TRANE. EQUAL BY: DAIKIN, LG.
- COOLING CAPACITIES BASED ON 90°F OUTDOOR AIR TEMP., HEATING BASED UPON 0°F OUTDOOR AIR TEMP.

UNIT	DESCRIPTION	MOUNTING	CONDENSING UNIT	CFM	E.S.P.	COOLING CAPACITY				HEATING CAPACITY		REFRIGERANT PIPING		ELECTRICAL			CABINET DIMENSIONS			UNIT WEIGHT (LBS)	MODEL NO.	NOTES
						SENS. MBH	TOTAL MBH	EAT (DB/WB)	LAT (DB/WB)	MBH	EAT / LAT	GAS	LIQUID	V/PH	MCA	MOCP	WIDTH	DEPTH	HEIGHT			
FC-1	WALL MOUNTED	WALL	CD-1	775	-	18.5	24	76 / 63	55 / 54	20.8	66 / 100	5/8	3/8	NOTE 1	-	-	46"	11.5"	14.5"	46	TPKAA0A0241KA80A	1, 2, 3, 4
FC-2	WALL MOUNTED	CEILING	CD-2	385	-	10.5	12	76 / 63	55 / 54	10.5	66 / 100	1/2	1/4	NOTE 1	-	-	35.5"	9.5"	11.5"	32	TPKAA0A0121LA10A	1, 2, 3, 4
FC-3	MULTI-POSITION AHU	FLOOR	CD-3	735	0.8	13.5	18	76 / 63	55 / 54	14.7	66 / 100	1/2	1/4	NOTE 1	-	-	17"	21.5"	50.25"	113	TPVAA0A0181AA70A	1, 2, 3, 4

NOTES:
1. PROVIDE FLUSH MOUNT REMOTE LCD THERMOSTAT.
2. PROVIDE BACNET INTERFACE.
3. PROVIDE CONDENSATE PUMP.
4. UNIT POWERED THROUGH OUTDOOR UNIT.


PACKAGED ROOFTOP UNITS

UNIT TAG	RTU-1	RTU-2
BASIS OF DESIGN	DAIKIN #DPS004B	DAIKIN #DPS006B
SERVICE	DORM / DECON	DAYROOM / OFFICER
DESCRIPTION	CONSTANT VOLUME	CONSTANT VOLUME
MOUNTING	ROOF CURB	ROOF CURB
EVAPORATOR FAN		
AIRFLOW (CFM)	1,650	2,400
ESP. (" W.G.)	1.25	1.25
FAN TYPE	ECM	ECM
VARIABLE FREQUENCY DRIVE	NOT REQ.	NOT REQ.
FILTER		
PRE-FILTER	2" MERV 8	2" MERV 8
FINAL FILTER	4" MERV 14	4" MERV 14
COOLING - BASED ON 90/74 (DB/WB) O.A. & 76 DB, 50% RH R.A.		
TOTAL (MBH)	51	75
SENSIBLE (MBH)	40	59
COIL AIR VELOCITY (FPM)	341	397
ENTER. AIR (DB/WB)	80.9 / 67.3	80.7 / 67.1
SUPPLY AIR (DB/WB)	57.1 / 57.1	56.7 / 56.7
EER	13.2	11.2
HEATING - REQ. NATURAL GAS INPUT PRESSURE: 4.5" W.C. MIN./14" W.C. MAX. -BASED ON 0°F O.A., 68°F R.A. CONDITIONS		
GAS INPUT (MBH)	120	160
OUTPUT (MBH)	97.2	129.6
ENTER. AIR DB	43	42
SUPPLY AIR (DB/WB)	99	94
ELECTRIC		
MCA	36.2	36.4
MOCP	50	50
VOLTAGE/HZ/PHASE	208 / 60 / 3	208 / 60 / 3
PHYSICAL UNIT DATA		
LENGTH	84.5	84.5
WIDTH	69.5	69.5
HEIGHT - NOT INCLUDING CURB	53.3	53.3
MAX UNIT OP. WEIGHT (LBS)	955	1009
UNIT OPTIONS		
ECONOMIZER HOOD	•	•
MIN. O.A. HOOD	•	•
CONSTANT AIR VOLUME	•	•
VARIABLE AIR VOLUME		
SINGLE SPEED / STAGED COMPRESSORS		
DIGITAL SCROLL COMPRESSORS		
INVERTER DUTY COMPRESSOR	•	•
STAINLESS STEEL HEAT EXCHANGER	•	•
RETURN AIR SMOKE DETECTOR		
CO2 SENSOR D.V.C.		
14" ROOF CURB ADAPTER	•	•
POWERED RELIEF FAN		
BAROMETRIC GRAVITY RELIEF DAMPER	•	•
WALL MOUNTED THERMOSTAT/HUMIDISTAT	•	•


NOTES:
1. SEE ROOFTOP UNIT MOUNTING DETAIL, DETAIL 3, SHEET H3.5.
2. COOLING COIL CONDENSATE TRAP PER DETAIL 4, SHEET H3.5.

EQUIPMENT NOTES


DS-1	DUCT SILENCER RECTANGULAR DISSIPATIVE TYPE VIBRO-ACOUSTICS #RD-MV OR APPROVED EQUAL AIRFLOW: 1,100 CFM DUCTWORK DIMENSIONS: 12"W / 10"H PRESSURE DROP: 0.25"
DS-2	DUCT SILENCER RECTANGULAR DISSIPATIVE TYPE VIBRO-ACOUSTICS #RD-MLV OR APPROVED EQUAL AIRFLOW: 2,365 CFM DUCTWORK DIMENSIONS: 30"W / 10"H PRESSURE DROP: 0.25"

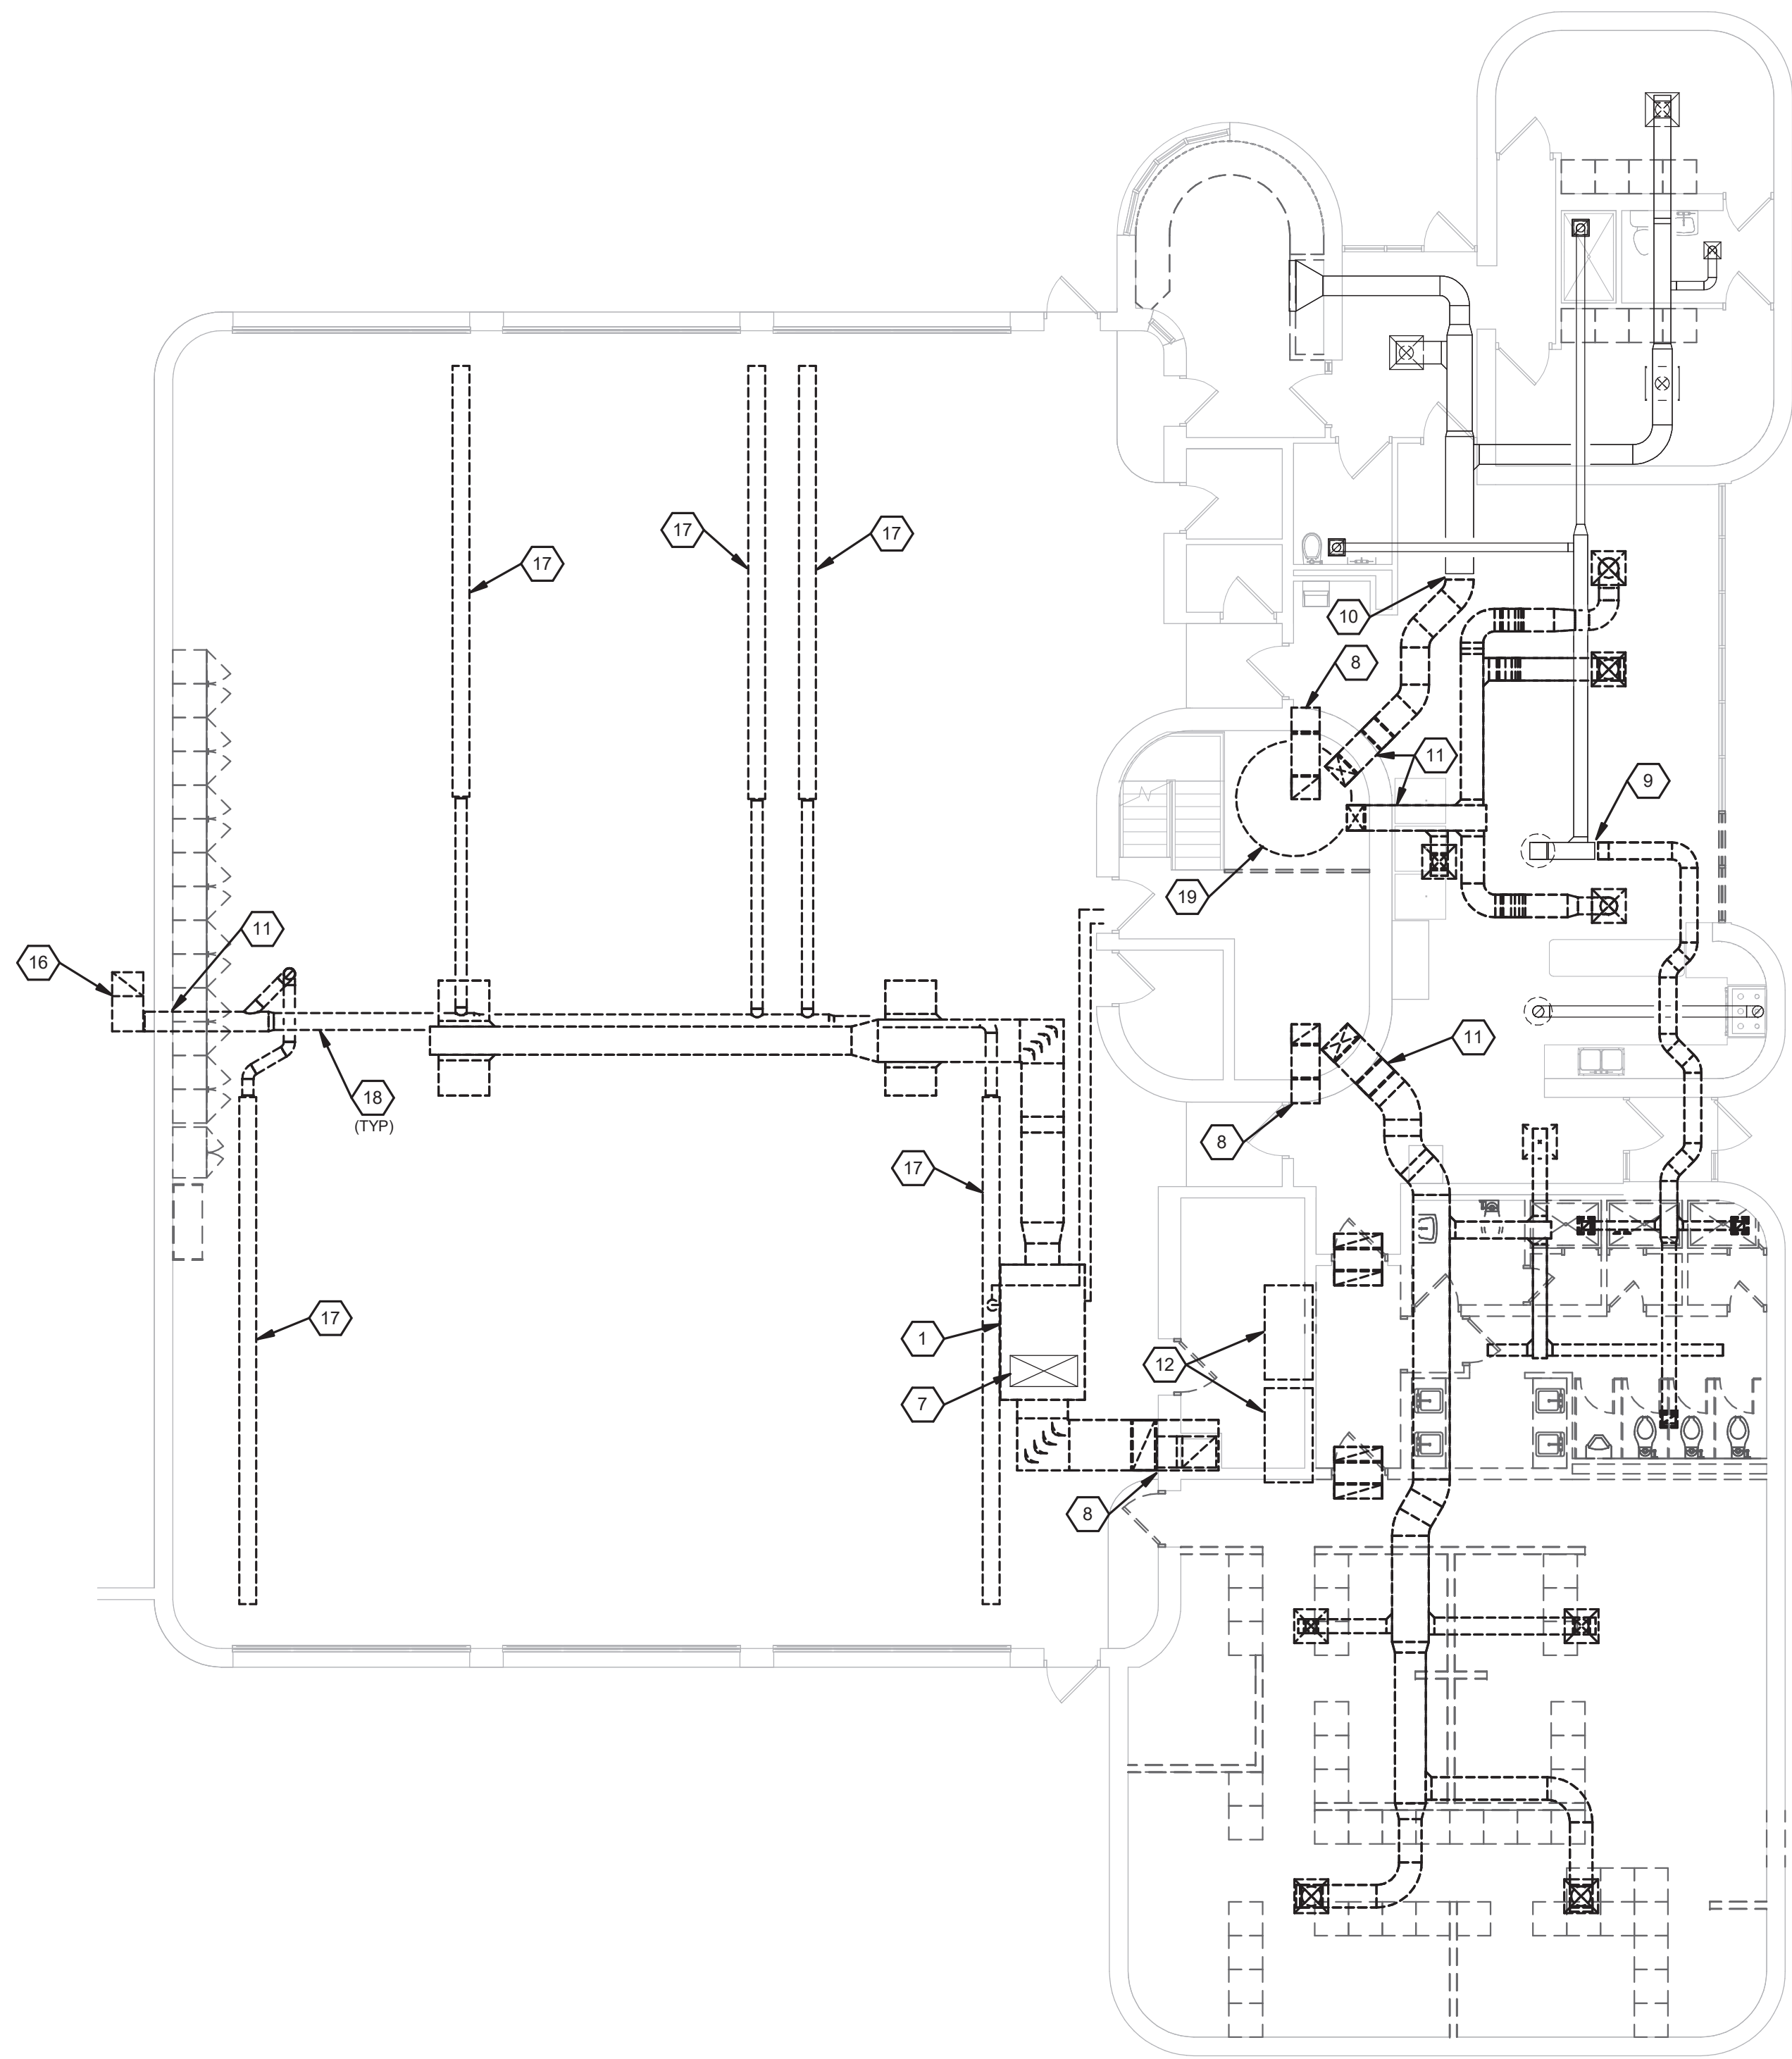


LEVEL 1 DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

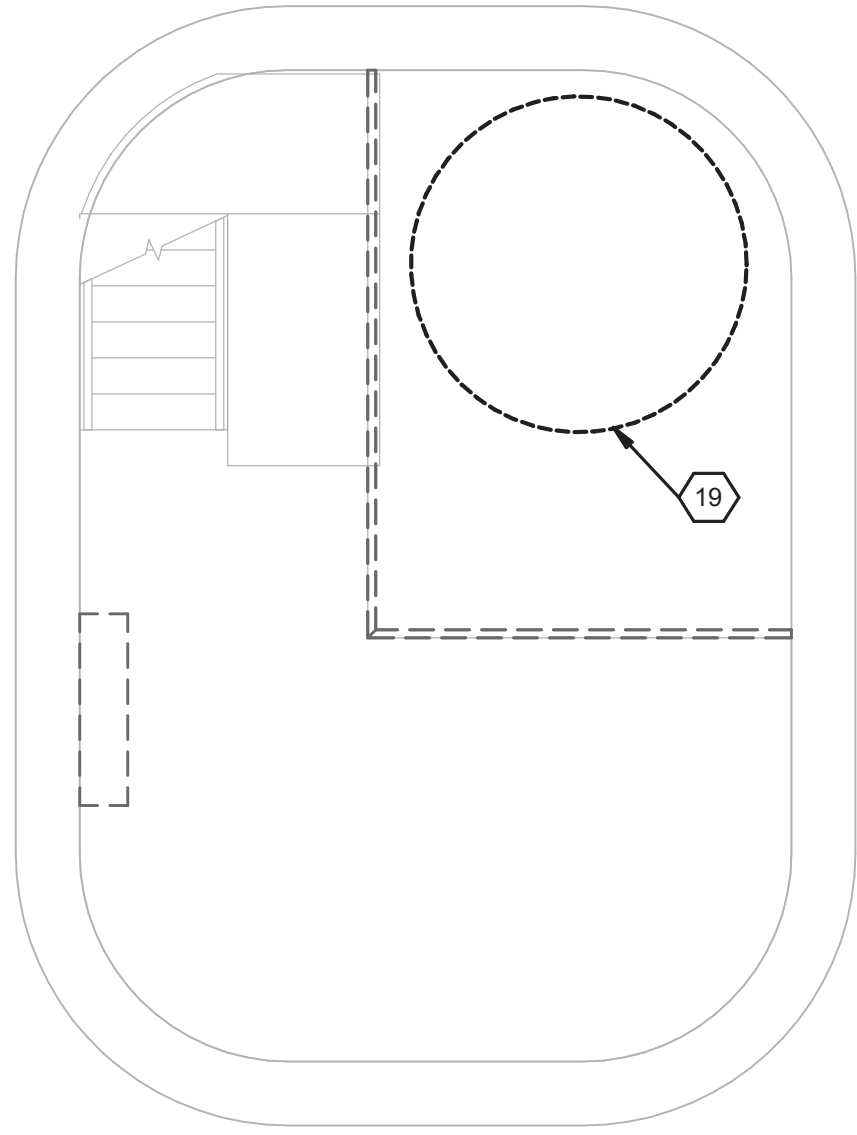

BASEMENT DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

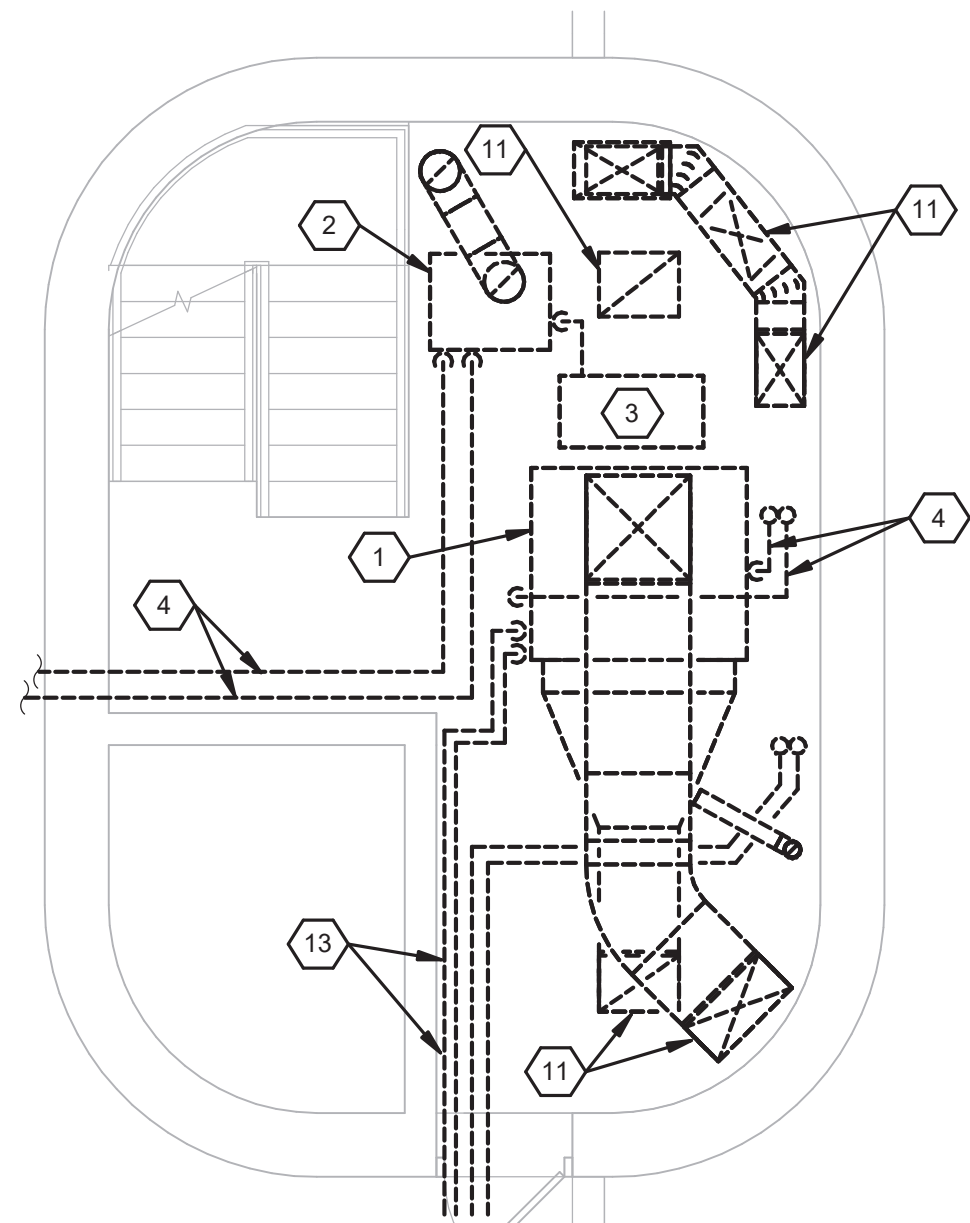

LEVEL 2 DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

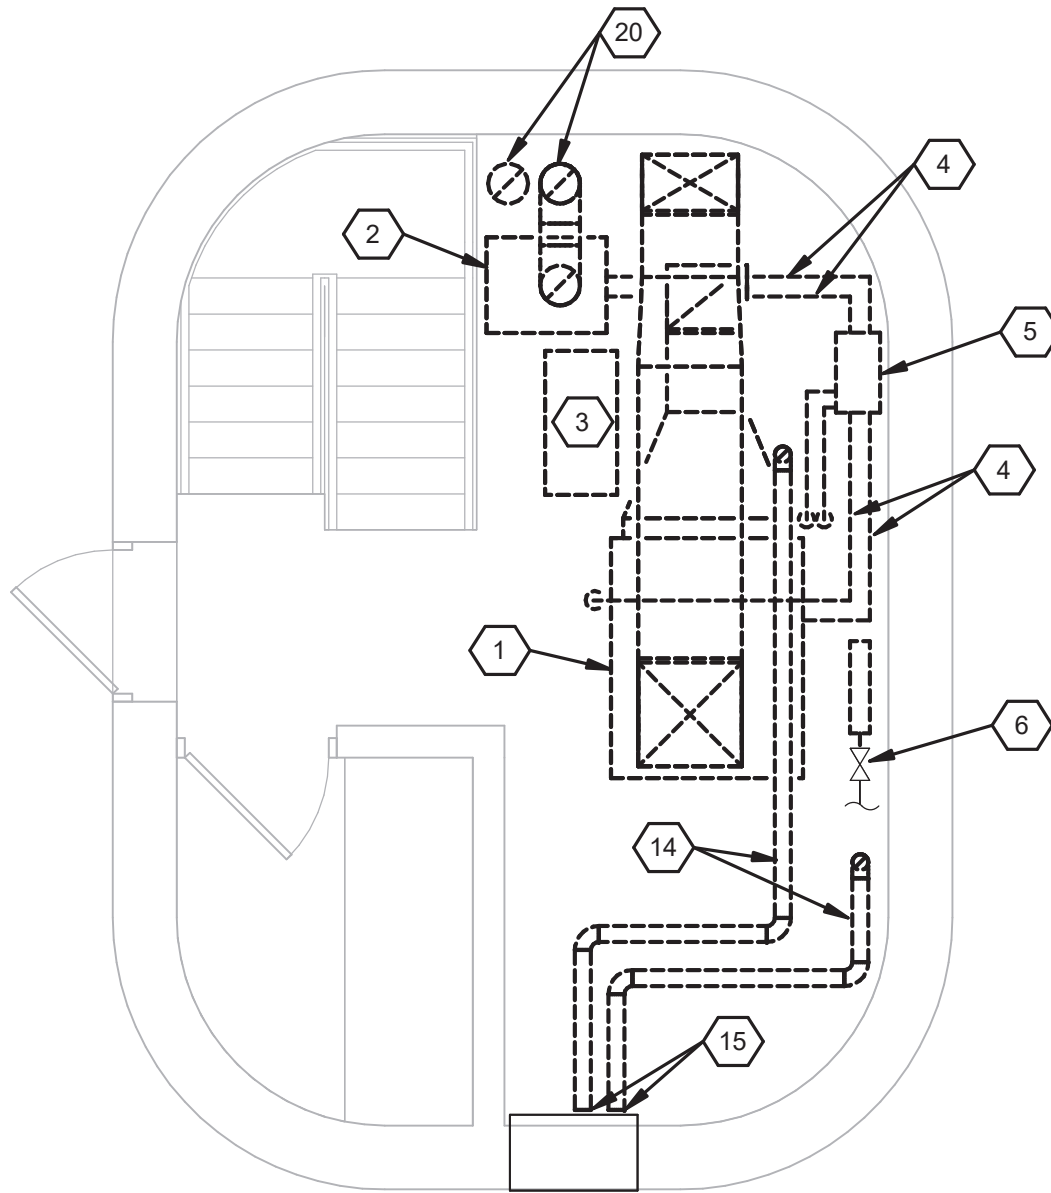

LEVEL 3 DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

- CONSTRUCTION NOTES
1. REMOVE AHU.

2. REMOVE BOILER.

3. REMOVE HOT WATER EXPANSION TANK.

4. REMOVE ALL HOT WATER PIPING.

5. REMOVE HOT WATER PUMPS.

6. REMOVE MAKE-UP WATER ASSEMBLY. CAP PIPE AT SHUT-OFF VALVE.

7. INTAKE DUCT AND ROOF HOOD TO REMAIN.

8. REMOVE GRILLE IN WALL. PATCH TO MATCH EXISTING CONSTRUCTION.

9. REMOVE TO LOCATION INDICATED AND CAP.

10. REMOVE TO LOCATION INDICATED. REFER TO NEW WORK PLAN.

11. REMOVE DUCT. PATCH PENETRATION TO MATCH EXISTING CONSTRUCTION.

12. REMOVE CONDENSING UNITS ON ROOFTOP.

13. REMOVE REFRIGERANT PIPING IN TOWER AND ON ROOF. PATCH EXTERIOR WALL PENETRATION TO MATCH EXISTING CONSTRUCTION.

14. REMOVE OUTSIDE AIR DUCT.

15. CAP WALL LOUVER PLENUM.

16. REMOVE VEHICLE EXHAUST FAN. OWNER HAS RIGHT OF FIRST REFUSAL OF ALL EXHAUST SYSTEM COMPONENTS.

17. REMOVE EXHAUST RAIL AND HOSE. OWNER HAS RIGHT OF FIRST REFUSAL OF ALL EXHAUST SYSTEM COMPONENTS.

18. REMOVE VEHICLE EXHAUST DUCT.

19. REMOVE WATER STORAGE TANK. REMOVAL REQUIRES TANK TO BE CUT INTO PIECES.

20. REMOVE BOILER FLUE. PATCH ROOF TO MATCH EXISTING CONSTRUCTION.

APP Architecture
creative focused design

645 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com

STATE OF OHIO
JEFFREY D. ZELINSKI
63822
REGISTERED PROFESSIONAL ENGINEER

JEFFREY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, OH 45420

ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025 FOR CONSTRUCTION		

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DJZ
CHECKED	JDZ

COPYRIGHT © 2025 - App Architecture, Inc.
TITLE
DEMOLITION PLANS

SHEET NO.
H1.1

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone (937) 293-3651
PROJECT # 24065

7/31/2025 8:51:44 AM

A

B

C

D

E

F

1

2


3

4


5

6


7

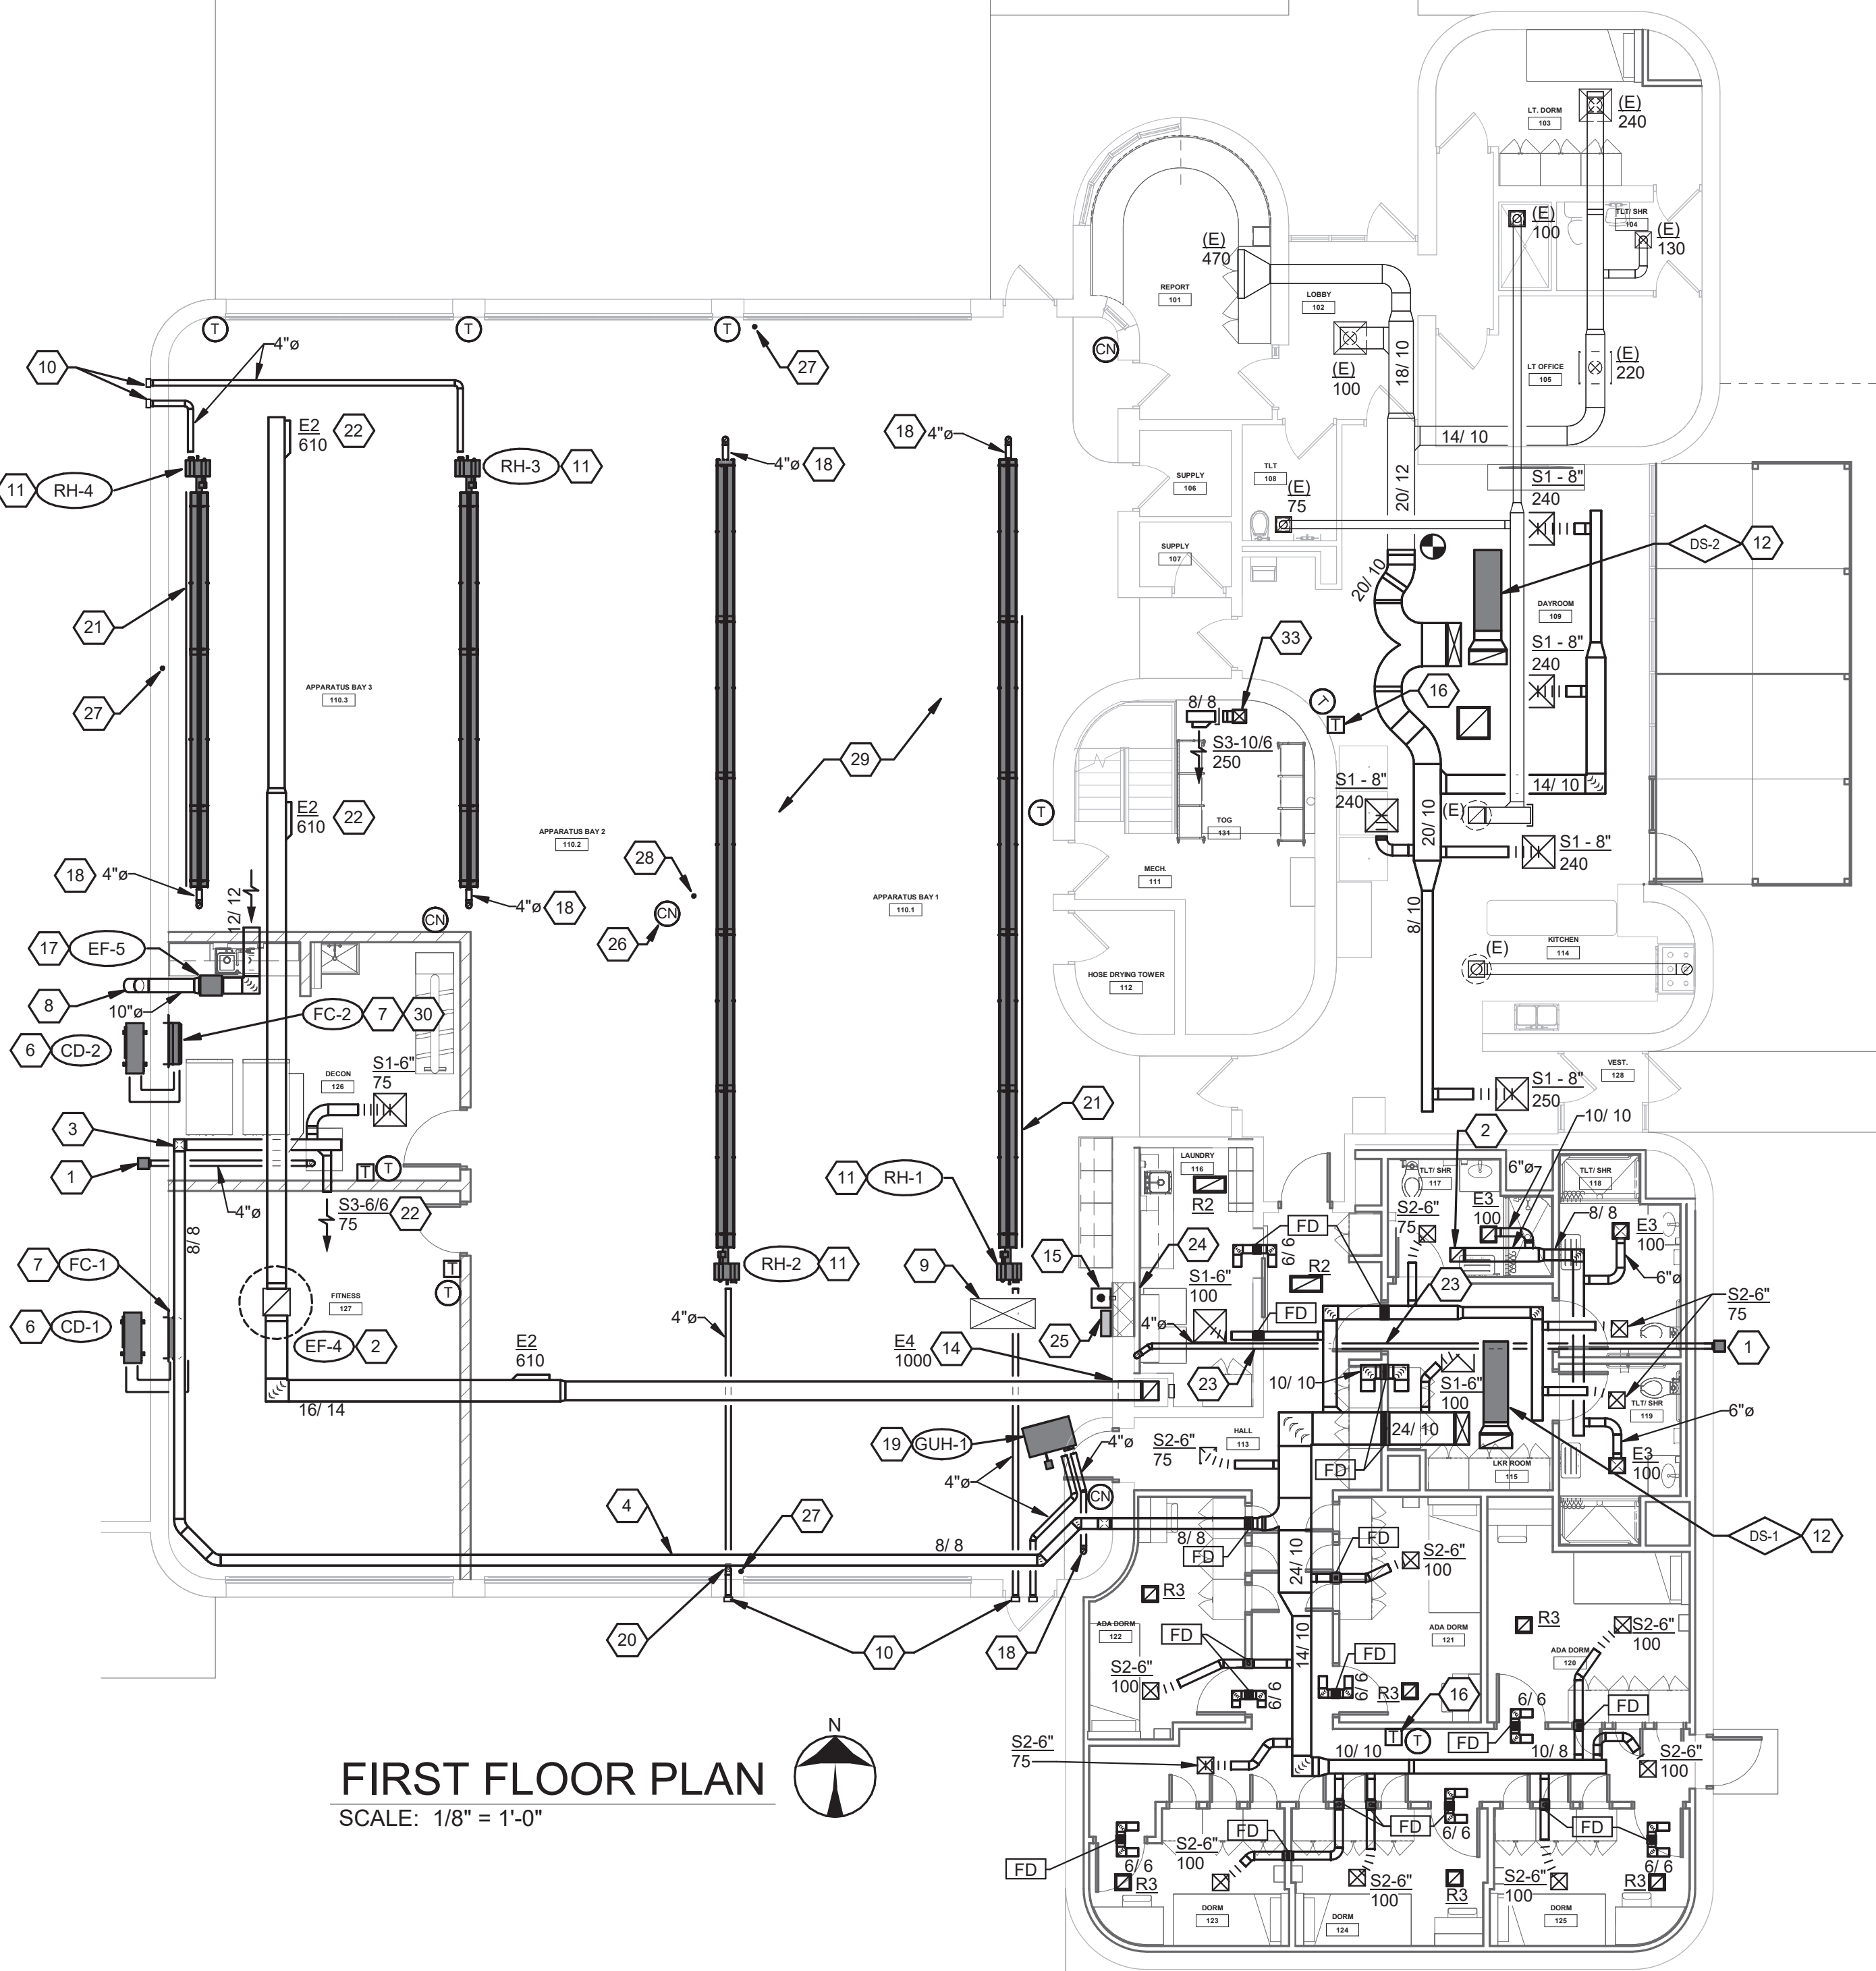


FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"

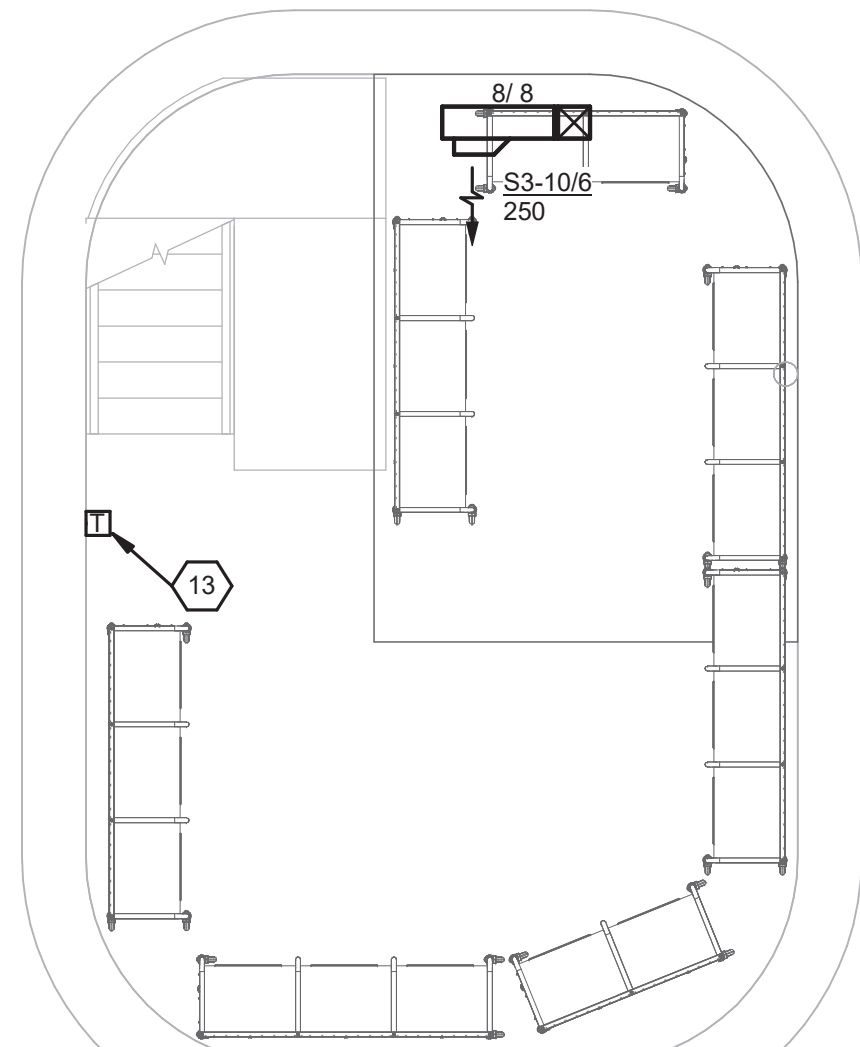

BASEMENT PLAN
SCALE: 1/4" = 1'-0"

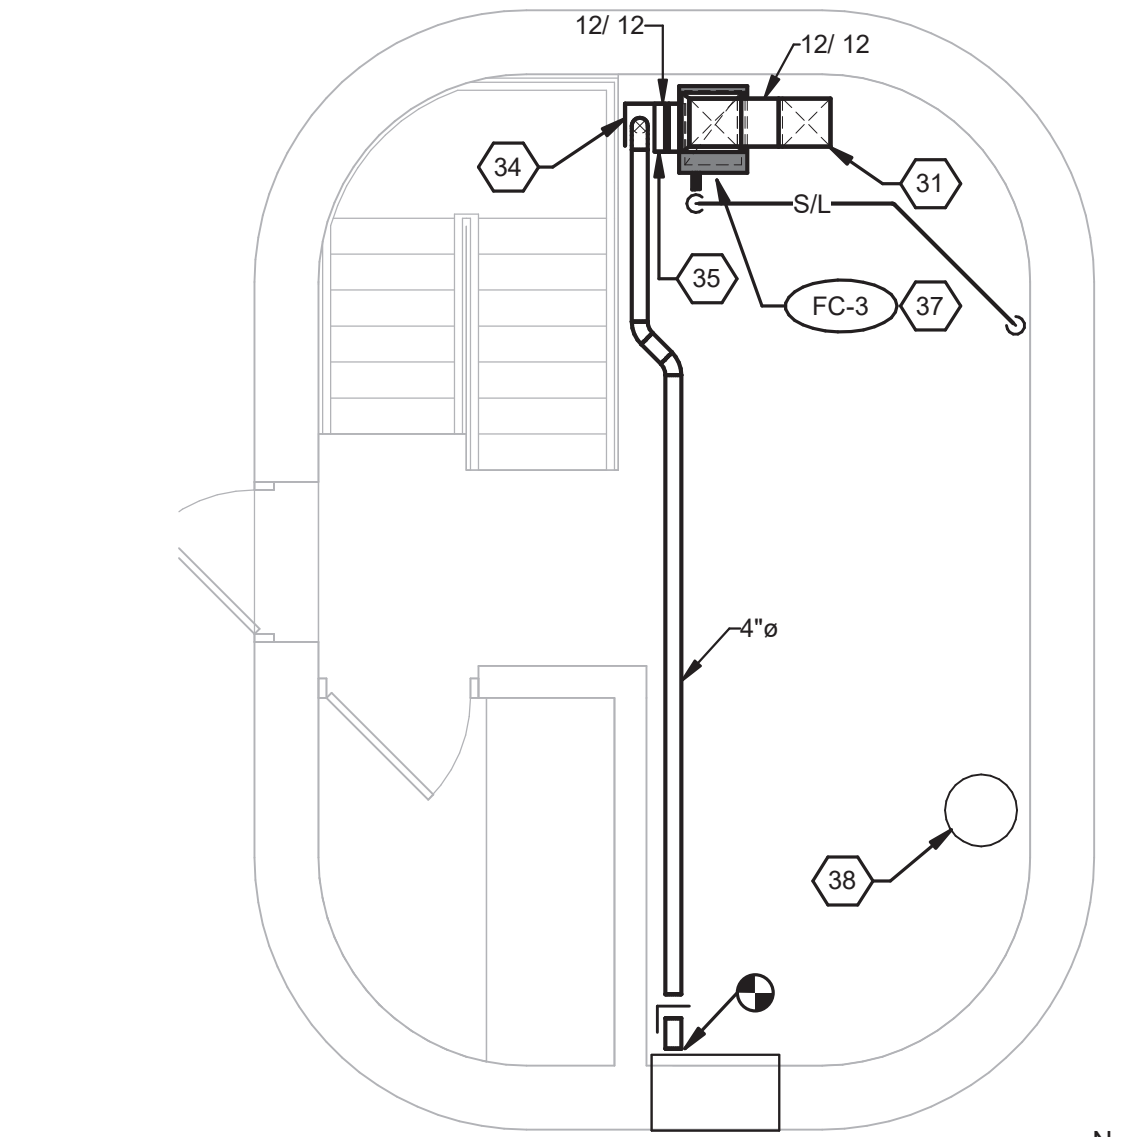

LEVEL 3 FLOOR PLAN
SCALE: 1/4" = 1'-0"

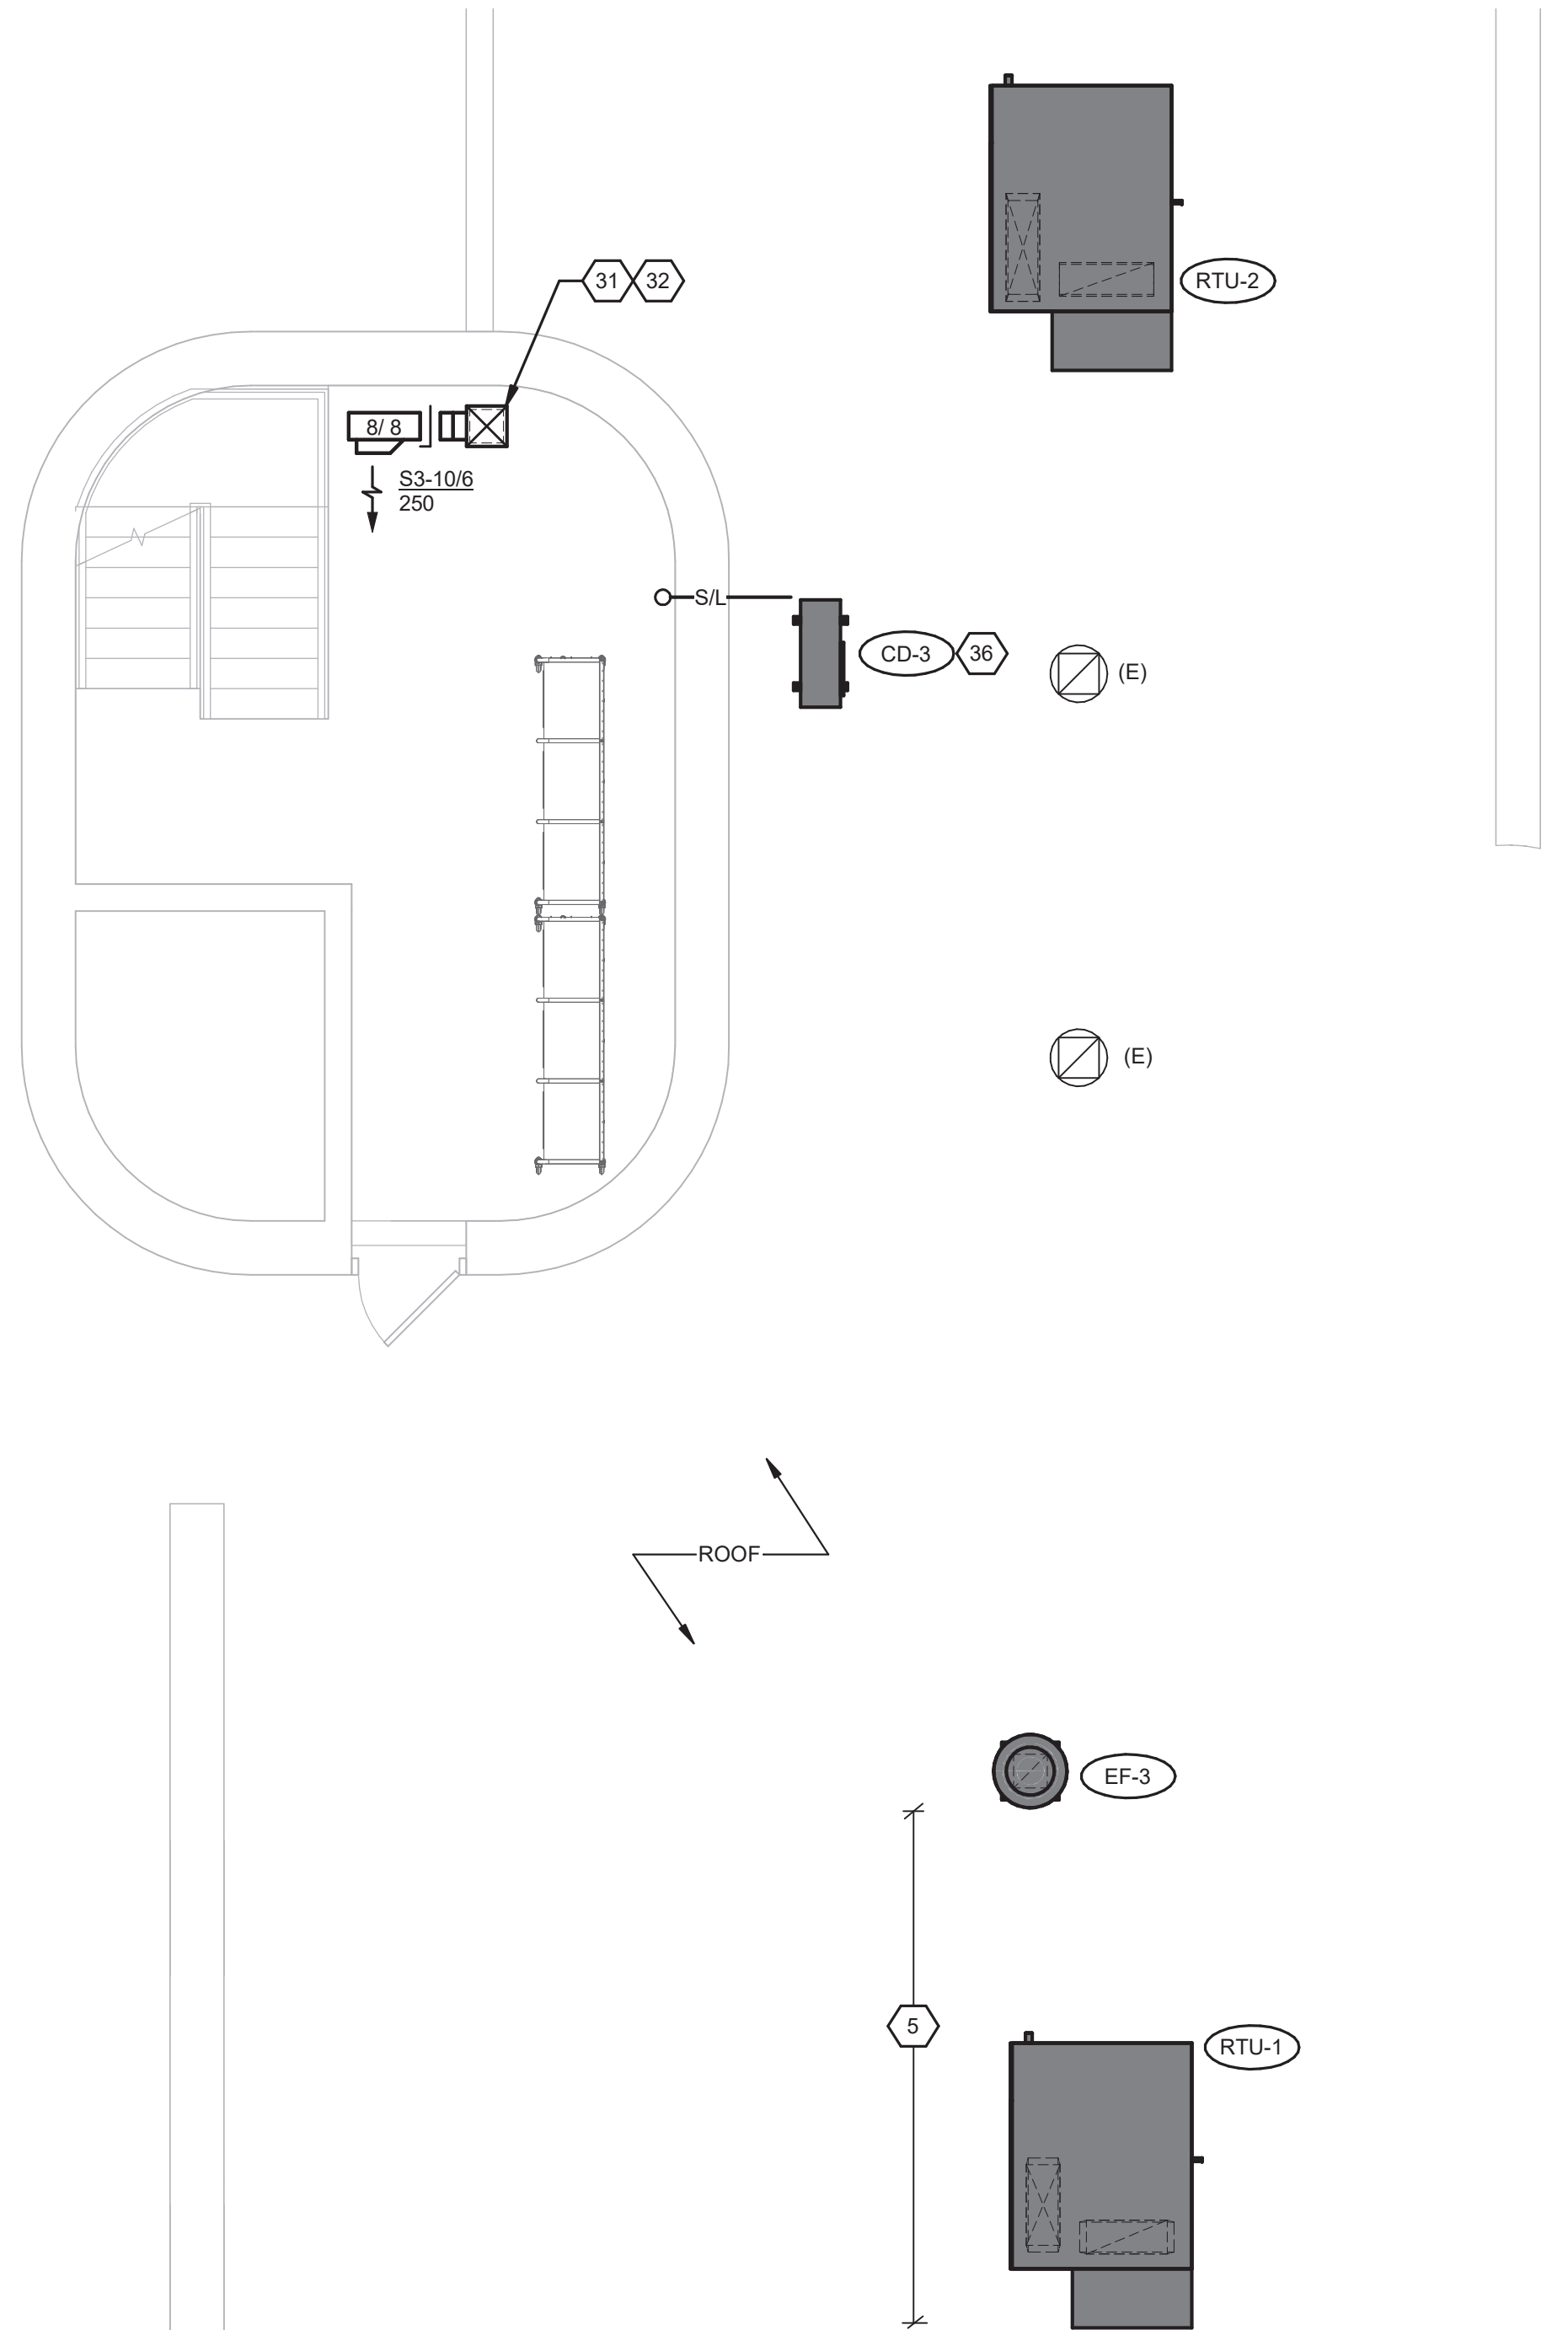

PARTIAL LEVEL 2 FLOOR PLAN
SCALE: 1/4" = 1'-0"

CONSTRUCTION NOTES

1. DRYER VENT. REFER TO DETAIL.
2. EXHAUST FAN ON ROOF.
3. DUCT RUN TIGHT TO APPARATUS BAY WALL.
4. DUCT RUN ABOVE GARAGE DOORS.
5. MAINTAIN 10' MINIMUM CLEARANCE BETWEEN INTAKE AND EXHAUST FAN.
6. MOUNT CONDENSING UNIT TO BUILDING SIDEWALL WITH UNISTRUT FRAME.
7. EXTEND CONDENSATE DRAIN INTO DECON ROOM AND TIE INTO EXTRACTOR DRAIN. COORDINATE WITH THE P.C. FOR TERMINATION POINT.
8. REUSE PENETRATION THROUGH WALL FOR NEW 10"Ø EXHAUST DUCT.
9. PROVIDE CONTROL DAMPER ON EXISTING INTAKE HOOD DUCT IN APPARATUS BAY.
10. WALL INTAKE HOOD. PAINT TO MATCH BUILDING COLOR.
11. INSTALL IN AISLE WAY BETWEEN GARAGE DOORS. MOUNTING HEIGHT APPROXIMATELY 14' A.F.F.
12. DUCT SILENCER END OPEN TO PLENUM.
13. FC-3 THERMOSTAT.
14. REUSE EXISTING WALL OPENING. SIZE EXHAUST AIR DEVICE TO MATCH EXISTING OPENING SIZE.
15. EF-5 OVERRIDE PUSH BUTTON.
16. PROGRAMMABLE THERMOSTAT FOR NEW RTU.
17. DUCT FAN INTAKE INTO APPARATUS BAY THROUGH FULL HEIGHT WALL AND TERMINATE OPEN.
18. FLUE THROUGH ROOF.
19. HANG UNIT TIGHT TO BOTTOM OF STRUCTURE.
20. COMBUSTION AIR DUCT RISES BETWEEN GARAGE DOOR RAILS AND PENETRATES EXTERIOR WALL ABOVE RETRACTED DOOR PLANE.
21. PROVIDE PROTECTIVE SIDE SHROUD TO DEFLECT RADIANT HEAT FROM SIDEWALL.
22. PROVIDE INTEGRAL BALANCING DAMPER WITH AIR DEVICE.
23. FIRE DAMPER NOT REQUIRED NOR PERMITTED IN DRYER VENT DUCT PER OMC 504.2. SEAL PENETRATION WITH FIRE STOPPING SYSTEM.
24. PROVIDE WALL RECESSED DRYER VENT BOX. REFER TO DETAIL.
25. CO/NO₂ DETECTION SYSTEM CONTROLLER.
26. MOUNT CO/NO₂ SENSOR TO STRUCTURE.
27. PROVIDE NEDERMAN RECEIVER GENIIB #89115581. MOUNT 12'-0" A.F.F.
28. PROVIDE NEDERMAN RECEIVER GENIIB #89115581. MOUNT TO STRUCTURE ADJACENT TO CO/NO₂ DETECTOR.
29. PROVIDE FIVE (5) TRUCK TRANSMITTERS. TURN OVER TO OWNER FOR INSTALLATION ON VEHICLES.
30. BOTTOM OF FAN COIL UNIT 6'-8" A.F.F.
31. DUCT DOWN THROUGH FLOOR LEVEL. REUSE EXISTING DUCT OPENING FROM OLD AHU.
32. DUCT TRANSITIONS TO 10/10 AFTER BRANCH TO AIR DEVICE.
33. DUCT TRANSITIONS TO 8/8 AFTER BRANCH TO AIR DEVICE.
34. RETURN DUCT OPEN TO TOWER.
35. PROVIDE 1" CAMFIL FILTER BANK IN RETURN DUCT. PROVIDE 1" CARBON FILTER EQUAL TO CAMFIL #CC-PG-LGX048.
36. MOUNT CONDENSING UNIT ON 12" ROOF RAIL CURB.
37. PROVIDE 1/2" CONDENSATE DRAIN FROM FC-3 TO FLOOR DRAIN ON TOWER 3RD FLOOR LEVEL.
38. LOCATION OF DOMESTIC WATER HEATER CIRCULATION PUMP.

A

B

C

D

E

F

APP Architecture
creative focused design



JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

DAYTON FIRE DEPARTMENT STATION 15

2801 Wayne Ave, Dayton, OH 45420

ISSUE		
NO.	DATE	DESCRIPTION
08/01/2025	FOR CONSTRUCTION	

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DJZ
CHECKED	JDZ
COPYRIGHT © 2025 - App Architecture, Inc.	
TITLE NEW WORK PLANS	

SHEET NO.

H2.1

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone (937) 223-3851
PROJECT # 24065

A

B

C

D

E

F

1

2

3

4

5


6

7


FIRESTOPPING MATERIALS/INSTALLATION

- MANUFACTURERS: REFER TO THE SPECIFICATION.
- FIRESTOPPING MATERIAL INSTALLATION SHALL BE PER THE MANUFACTURERS DETAILED INSTALLATION DIAGRAMS AND INSTRUCTIONS.
- F-RATING OF PENETRATION SHALL BE NO LESS THAN THE FIRE RATING OF THE WALL.
- SUBMITTAL SHALL INCLUDE PRODUCT DATA AND DETAILED INSTALLATION SYSTEM DIAGRAMS.


- 1 RATED WALL ASSEMBLY.
- 2 METALLIC PIPE OR TUBING.
- 3 PIPE INSULATION, CONTINUOUS THROUGH WALL OPENING. SEE SCHEDULE FOR THICKNESS.
- 4 APPROVED FIRESTOPPING VOID/CAVITY MATERIAL.
- 5 APPROVED FIRESTOPPING CAULK OR SEALANT.
- 6 PACKING MATERIAL, MINERAL WOOL BATT INSULATION.
- 7 APPROVED FIRESTOPPING CAULK OR SEALANT FLUSH WITH SURFACE OF WALL OR EDGE OF SLEEVE.
- 8 SCHEDULE 40 STEEL PIPE SLEEVE CAST OR GROUTED INTO WALL ASSEMBLY. ENDS FLUSH OR MAX. 2" BEYOND WALL SURFACE.

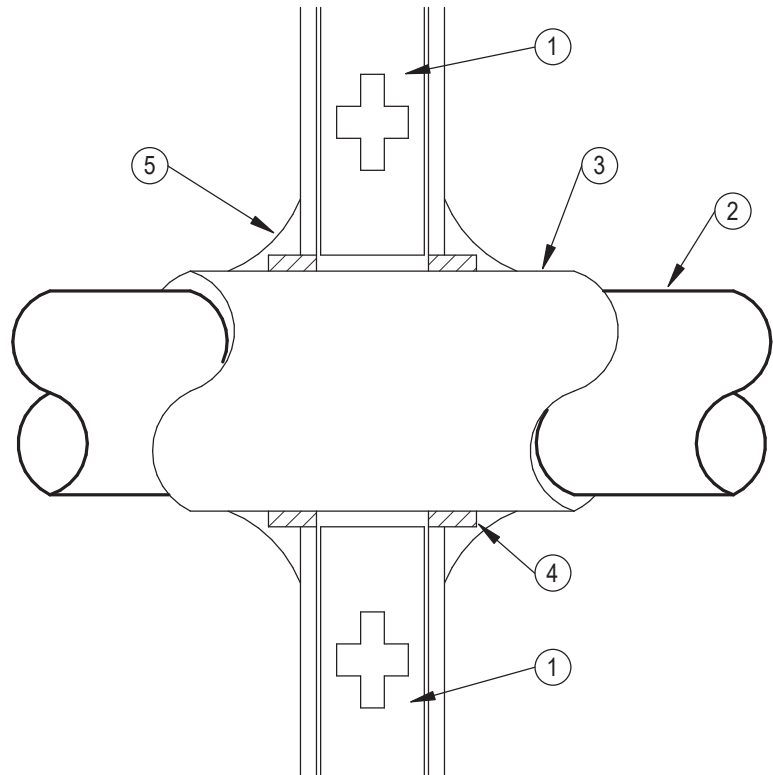

GYPSUM CONSTRUCTION
ALL PIPE SIZES

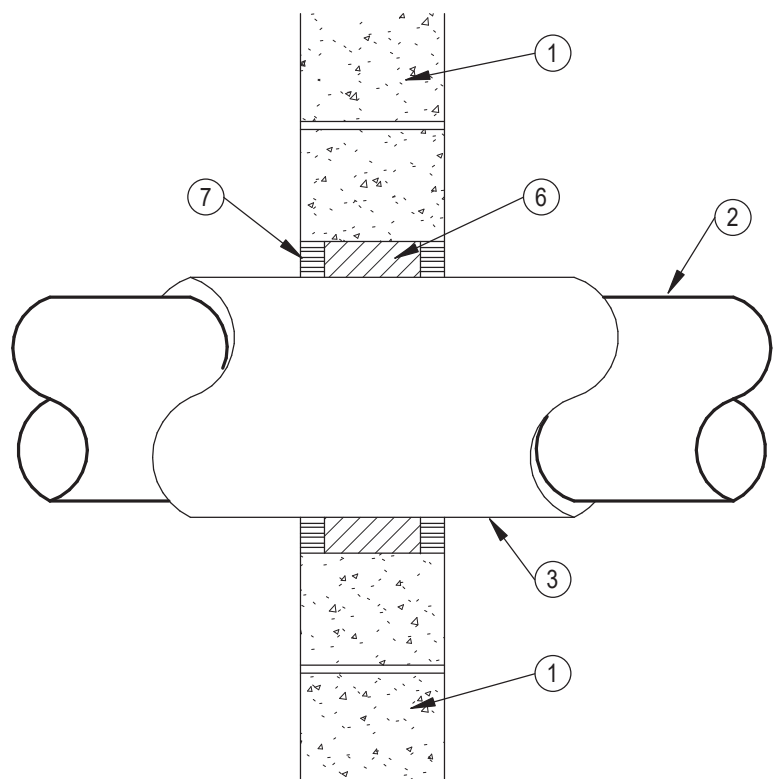


CONCRETE/MASONRY CONSTRUCTION
1/2" - 1.5" PIPES

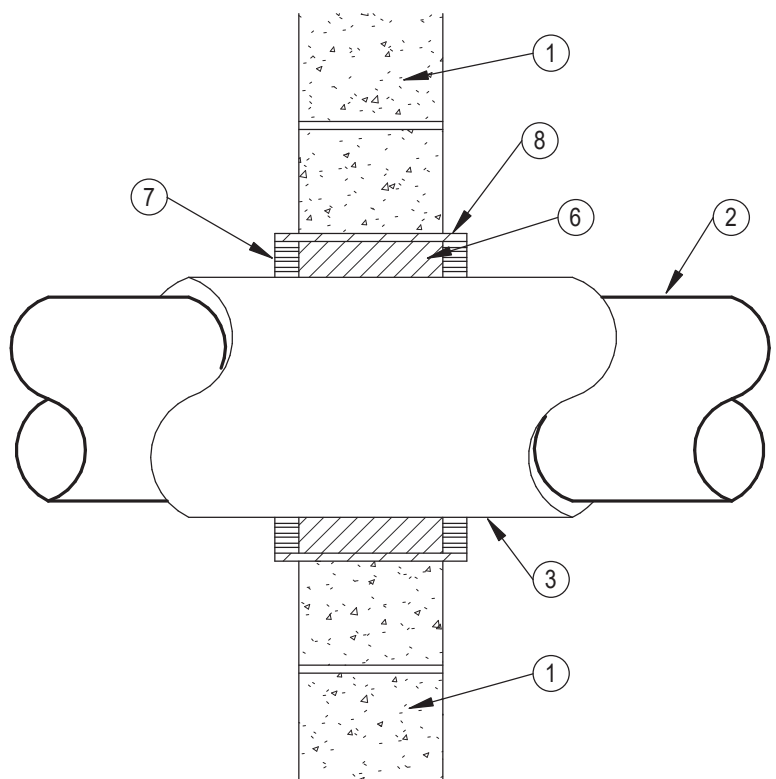


CONCRETE/MASONRY CONSTRUCTION
2" AND LARGER PIPES


1 PIPE PENETRATIONS THRU FIRE RATED WALL
N.T.S.

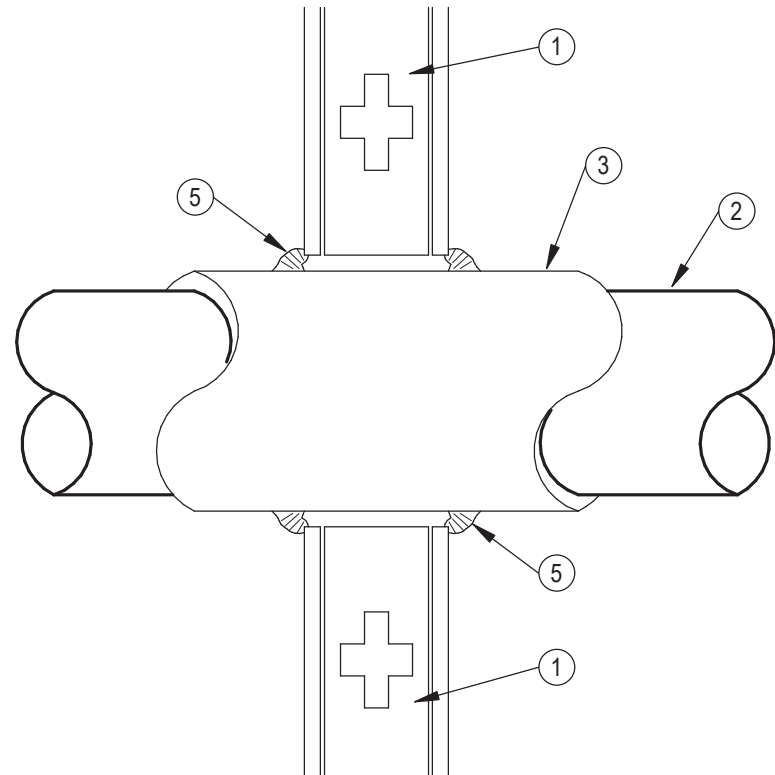

GYPSUM CONSTRUCTION
ALL PIPE SIZES

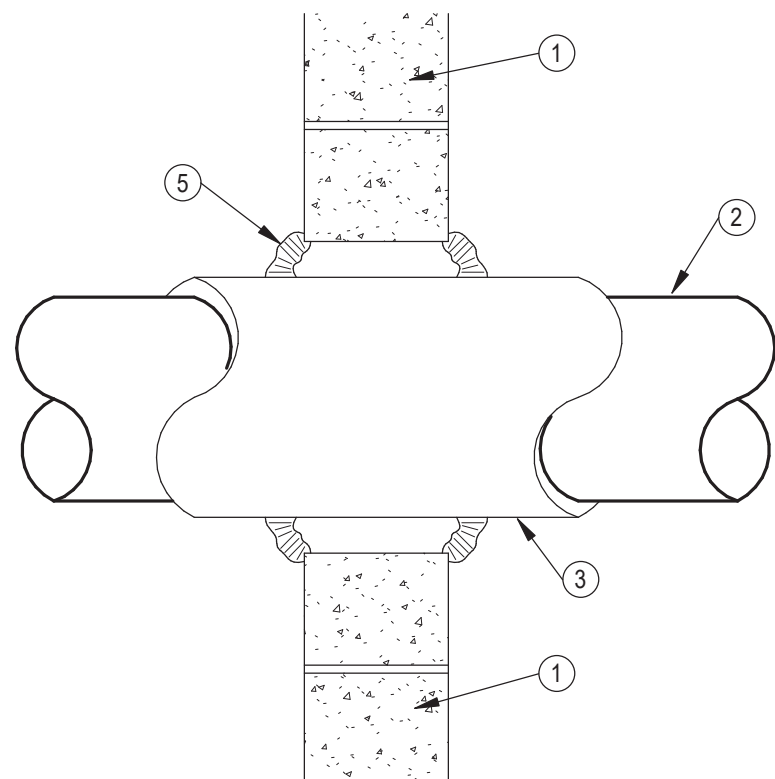


CONCRETE/MASONRY CONSTRUCTION
1/2" - 1.5" PIPES

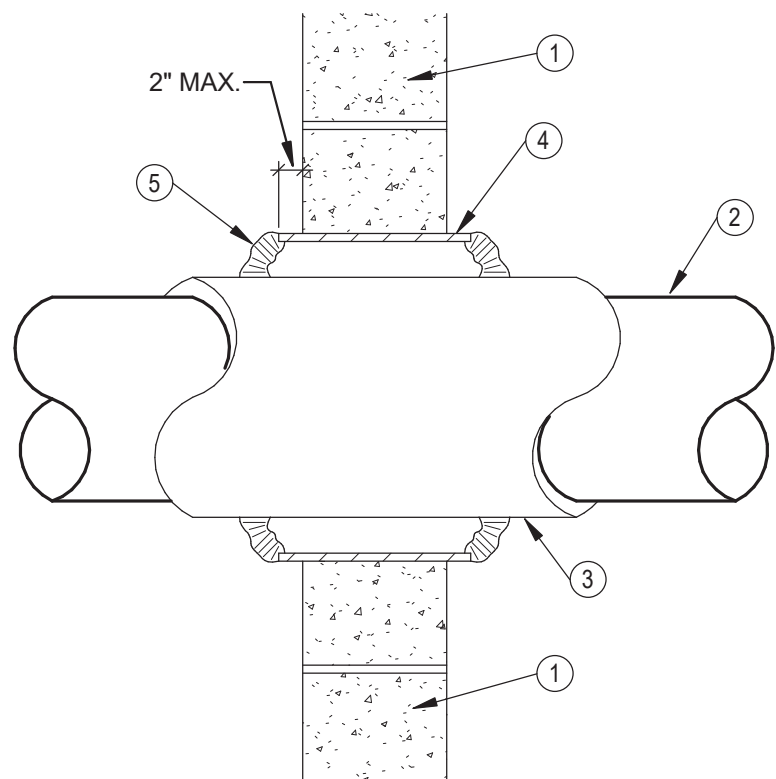

CONCRETE/MASONRY CONSTRUCTION
2" AND LARGER PIPES

2 PIPE PENETRATIONS THRU NON-RATED WALL
N.T.S.

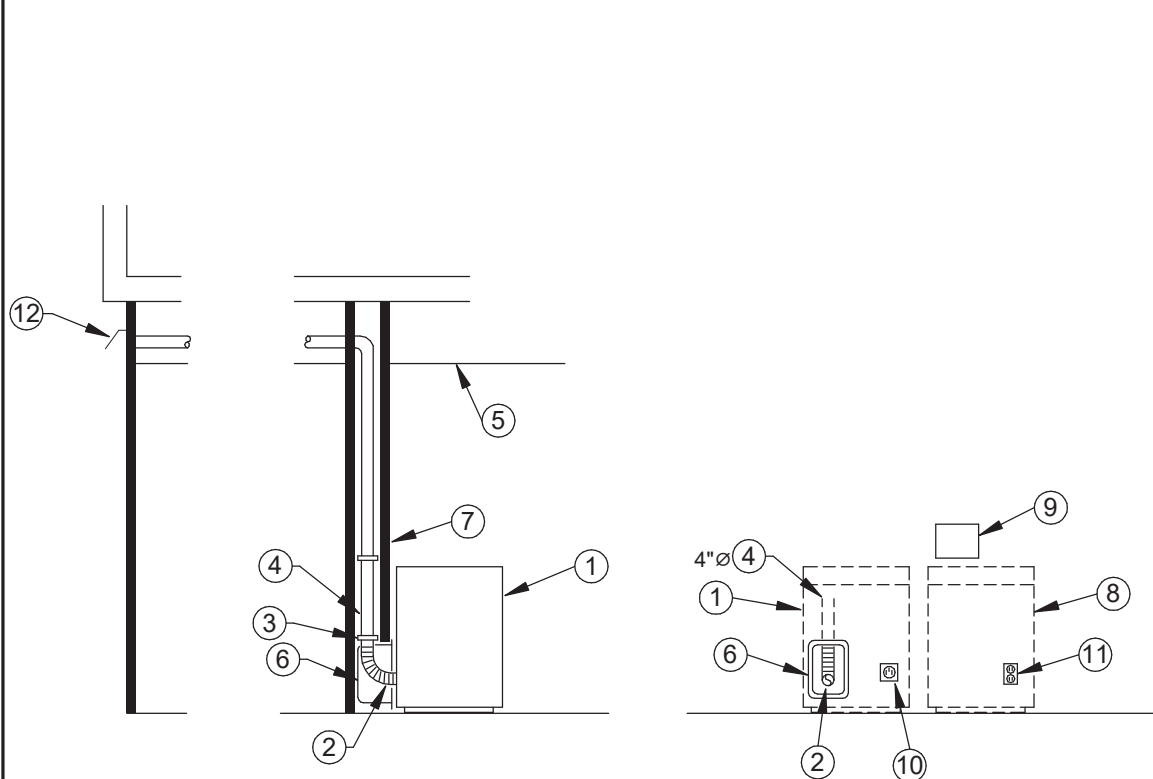


NOTE:
1. COORDINATE LOCATION OF VENT BOX WITH WASHER & DRYER PROVIDED AND WITH ELEC. & PLB.G. CONTRACTORS ON LOCATION OF RECEPTACLES & WASHER BOX.

4" SIZE EXCEPT LARGER IF RECOMMENDED BY DRYER MANUFACTURER.

- 1 DRYER.
- 2 FLEXIBLE ALUMINUM DUCT WITH METAL DRAWBAND CONNECTORS.
- 3 STAINLESS STEEL DUCT SUPPORT. SUPPORT AT 4' INTERVALS.
- 4 4" Ø ALUMINUM SPIRAL DUCT. DUCT SHALL NOT BE JOINED WITH SCREWS OR FASTENERS THAT PORTRUDE MORE THAN 1/8" INTO THE INSIDE OF THE DUCT.
- 5 LAY-IN CEILING.
- 6 RECESSED DRYER VENT BOX. FLUSH MTD. IN 6" STUD WALL. 22 GA. ALUMINIZED STEEL WITH FLANGE, 4" DIA. TOP OUTLET, 9"Wx18"Hx5.5"D.P. INSIDE DIMENSION. FASTEN TO WALL AT FLANGE TO CONNECT TO STUDS. AMERICAN ALDES MODEL PN OR BY IN-O-VATE TECHNOLOGIES OR EQUAL. MOUNT BOTTOM AT 4" ABOVE FLOOR.
- 7 DRYWALL OR MASONRY ENCLOSURE BY G.C.
- 8 WASHER.
- 9 WASHER UTILITY BOX BY P.C.
- 10 220/208 VOLT OUTLET BY E.C.
- 11 DOUBLE DUPLEX OUTLET BY E.C.
- 12 SIDEWALL DRYER VENT HOOD WITH DAMPER. AMERICAN ALDES #22-404 OR EQUAL. HOOD IS GALVANIZED, PAINTING BY G.C., FINAL CUSTOM COLOR SELECTION BY ARCHITECT.

3 DRYER VENT
N.T.S.

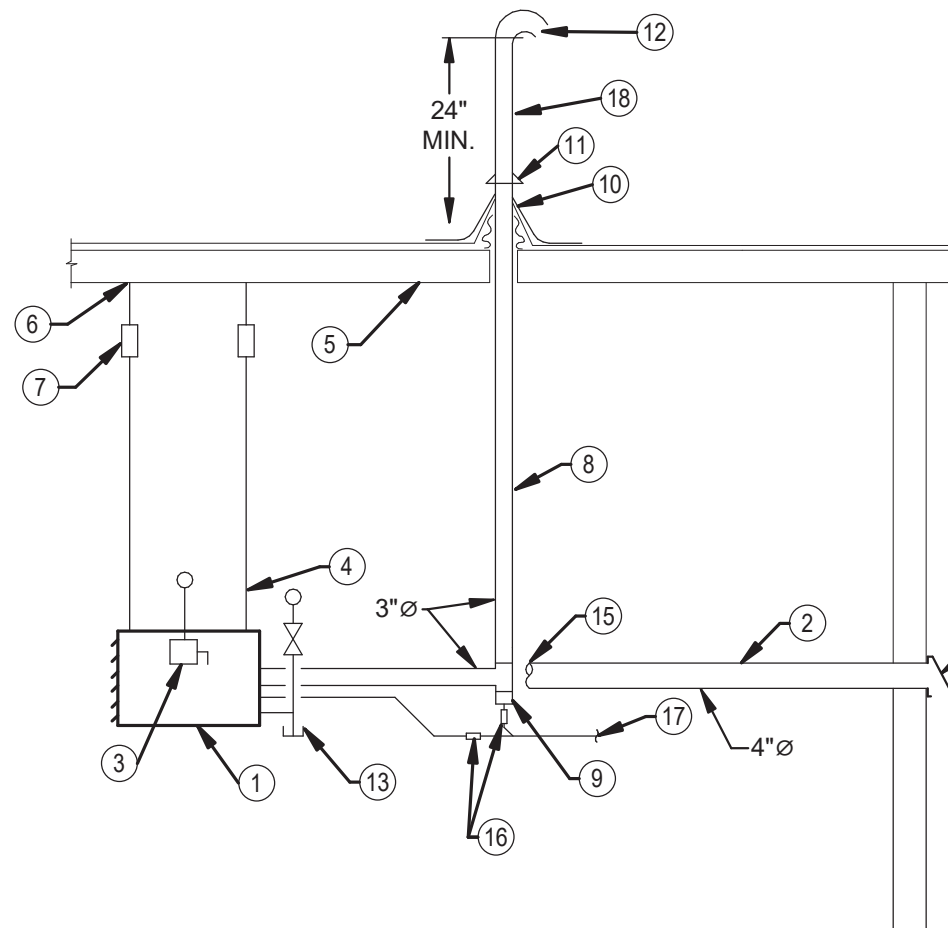

- 1 GAS FIRED UNIT HEATER.
- 2 4"Ø COMBUSTION INTAKE DUCT.
- 3 DISCONNECT SWITCH WITH UNIT.
- 4 THREADED ROD HANGER.
- 5 ROOF STRUCTURE.
- 6 SECURE TO STRUCTURE.
- 7 VIBRATION ISOLATOR.
- 8 4"Ø VENT DUCT.
- 9 CLEAN OUT CAP WITH STANDARD VENT DRIP LEG.
- 10 S.S. FLASHING CONE. SEAL PENETRATION THROUGH ROOF WATERTIGHT.
- 11 STORM COLLAR.
- 12 GOOSENECK AND BIRD SCREEN ON FLUE VENT.
- 13 NATURAL GAS CONNECTION, SHUTOFF VALVE, AND DIRT LEG BY P.C.

- 14 4"Ø INTAKE CAP WITH BIRD SCREEN. COLOR BY ARCHITECT, PAINTING BY G.C.
- 15 EXTEND COMBUSTION AIR DUCT TO UNIT HEATER.
- 16 WATERLESS CONDENSATE TRAPS PROVIDED WITH UNIT. INSTALL PER MANUFACTURER'S RECOMMENDATION.
- 17 EXTEND CONDENSATE DRAIN TO FLOOR DRAIN IN TOWER.
- 18 CUSTOM PAINT COLOR SELECTED BY ARCHITECT, FINAL PAINTING BY G.C.

4 GAS FIRED UNIT HEATER
N.T.S.

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 223-3851
PROJECT # 24065

A

B

C

D

E

F

A

B

C

D

E

F

A


B

C

D

E


F

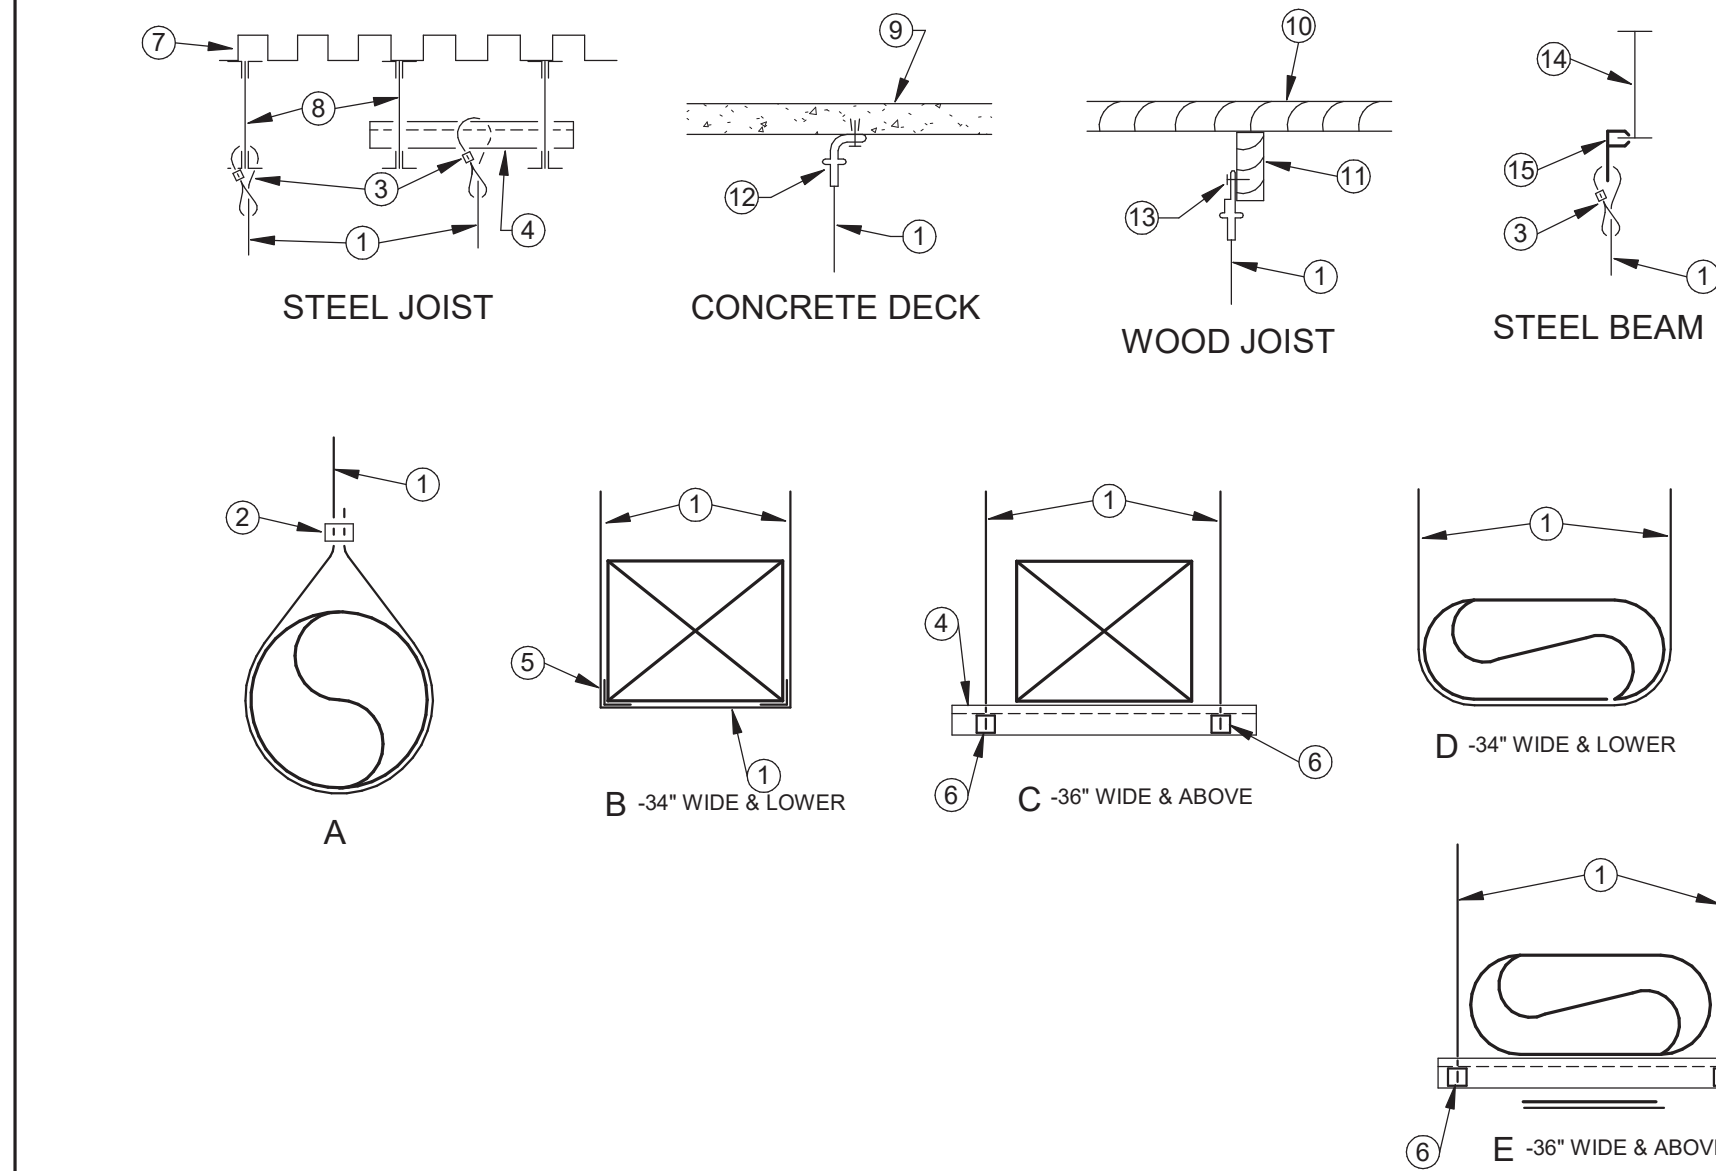

- 1/8" DIA. OR 3/16" DIA. GALVANIZED STEEL CABLE, AISI 316 (GRIPPLE NO. 3 OR NO. 4).
- CABLE LOCKING FASTENER, PERMITTED ONLY ON ROUND DUCT (GRIPPLE HF).
- CABLE LOOP WITH LOCKING FASTENER (GRIPPLE HF).
- UNISTRUT CHANNEL.
- CORNER SADDLE (GRIPPLE).
- GRIPPLE TRAPEZE SUPPORT (GRIPPLE NO. 3).
- METAL DECK.
- METAL JOIST.
- CONCRETE SLAB.
- WOOD DECK.
- WOOD JOIST.
- 90 DEG. EYELET, FASTEN TO CONC. WITH SCREWS, BOLTS OR POWER ACUATED TOOLS. (GRIPPLE 90 DEG. EYELET).
- EYELET, FASTEN TO WOOD WITH SCREWS, BOLTS OR NAILS. (GRIPPLE EYELET).
- STEEL BEAM.
- BEAM CLIP - GRIPPLE GCB.


* HVAC CONTRACTOR SHALL BE RESPONSIBLE FOR DESIGN & LAYOUT OF DUCT HANGERS & SUPPORTS.
* ALL SUPPORT MATERIALS SHALL BE PAINTED, COATED OR GALVANIZED.
* STRUCTURE CONNECTIONS SHALL BE AT STRUCTURAL ELEMENTS ONLY. PROVIDE SPANNING STRUCTURAL ELEMENTS WHERE REQUIRED.
* SINGLE CHANNEL DUCT TRAPEZE CONNECTION DEVICES ARE NOT APPROVED.
* PROVIDE HANGER SPACING AS REQUIRED FOR SUPPORT. MAXIMUM 8 FT. SPACING EXCEPT FOR DUCT DIAMETER OR WIDTHS 36" & LARGER SHALL BE MAXIMUM 4 FT. SPACING.
* DESIGN SHALL MAINTAIN SUPPORT UPON FAILURE OF ANY INDIVIDUAL HANGER.
* STEEL CABLE DUCT SUPPORT SYSTEM A, B OR D SHALL BE UTILIZED WHERE DUCTS ARE EXPOSED IN NON MECHANICAL AREA.
* USE OF STRAP OR THREADED ROD HANGERS PER SMACNA ARE ALSO ACCEPTABLE IN ABOVE CEILING LOCATIONS.
* CABLE SUPPORTS & ACCESSORIES SHALL BE MANUFACTURED BY GRIPPLE OR EQUAL BY DUCTMATE OR DURODYNE.
* CABLE SUPPORTS & ACCESSORIES SHALL NOT BE PAINTED.

1 DUCT HANGERS & SUPPORTS
N.T.S. WIRE HANGERS

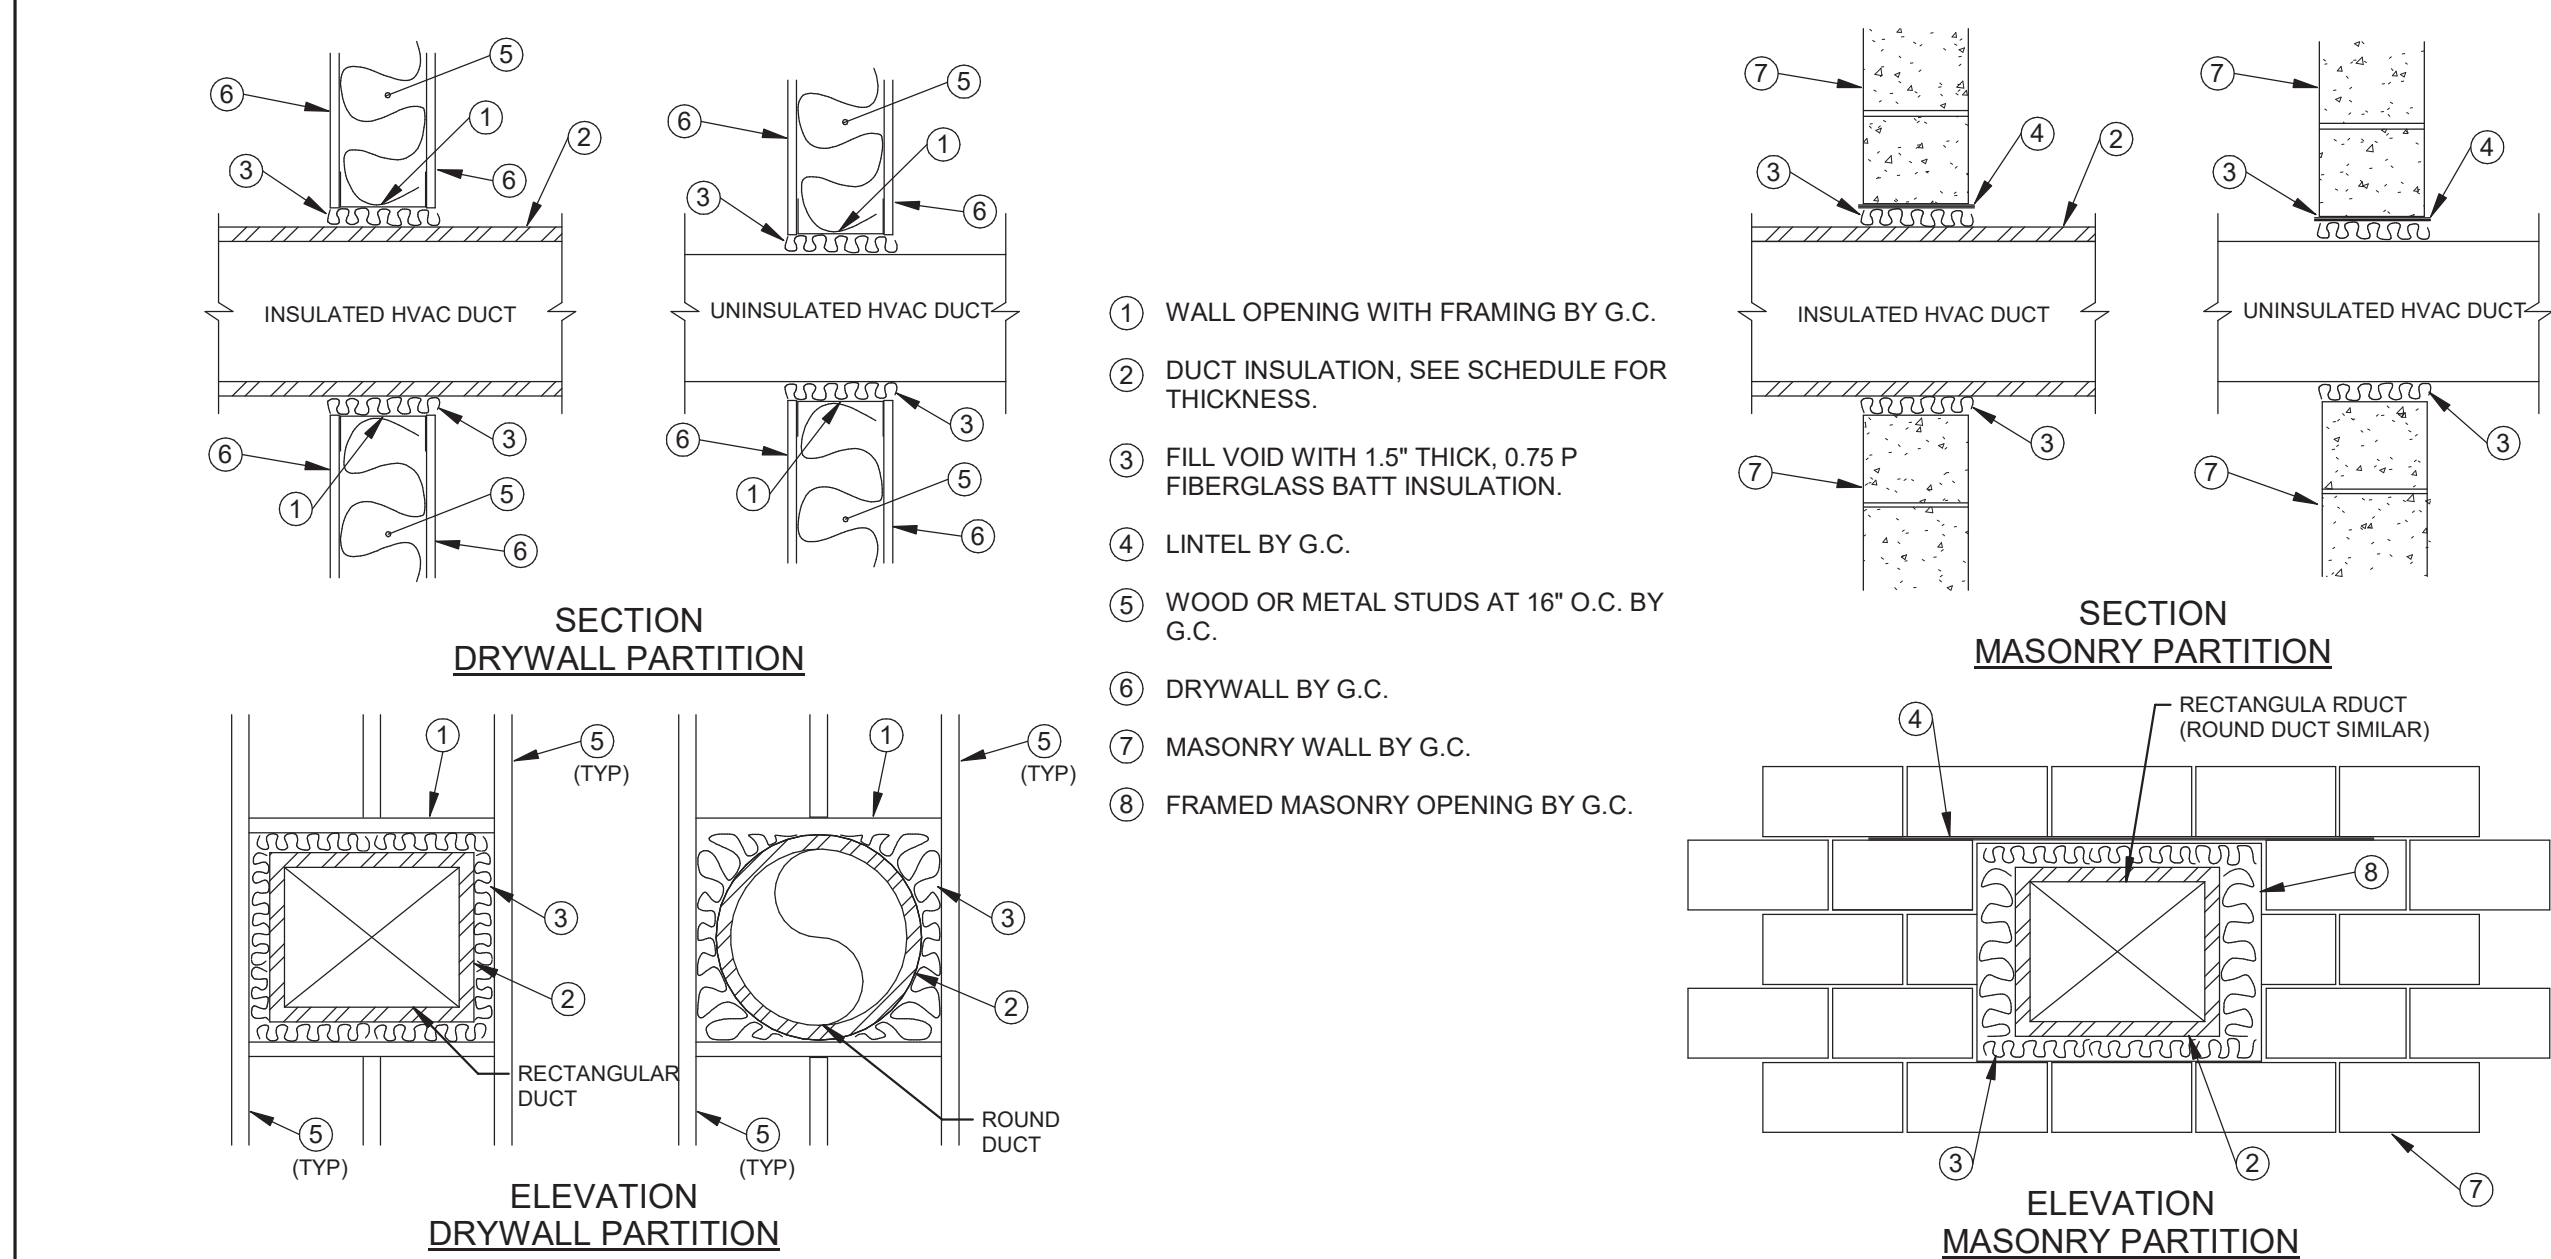

- WALL OPENING WITH FRAMING BY G.C.
- DUCT INSULATION, SEE SCHEDULE FOR THICKNESS.
- FILL VOID WITH 1.5" THICK, 0.75 P FIBERGLASS BATT INSULATION.
- LINTEL BY G.C.
- WOOD OR METAL STUDS AT 16" O.C. BY G.C.
- DRYWALL BY G.C.
- MASONRY WALL BY G.C.
- FRAMED MASONRY OPENING BY G.C.


3 DUCT SEALING THRU NON-FIRE RATED WALL
N.T.S. * NEW CONSTRUCTION, FRAMED OPENING, DUCT SIDE OR DIA. ≥ 12"

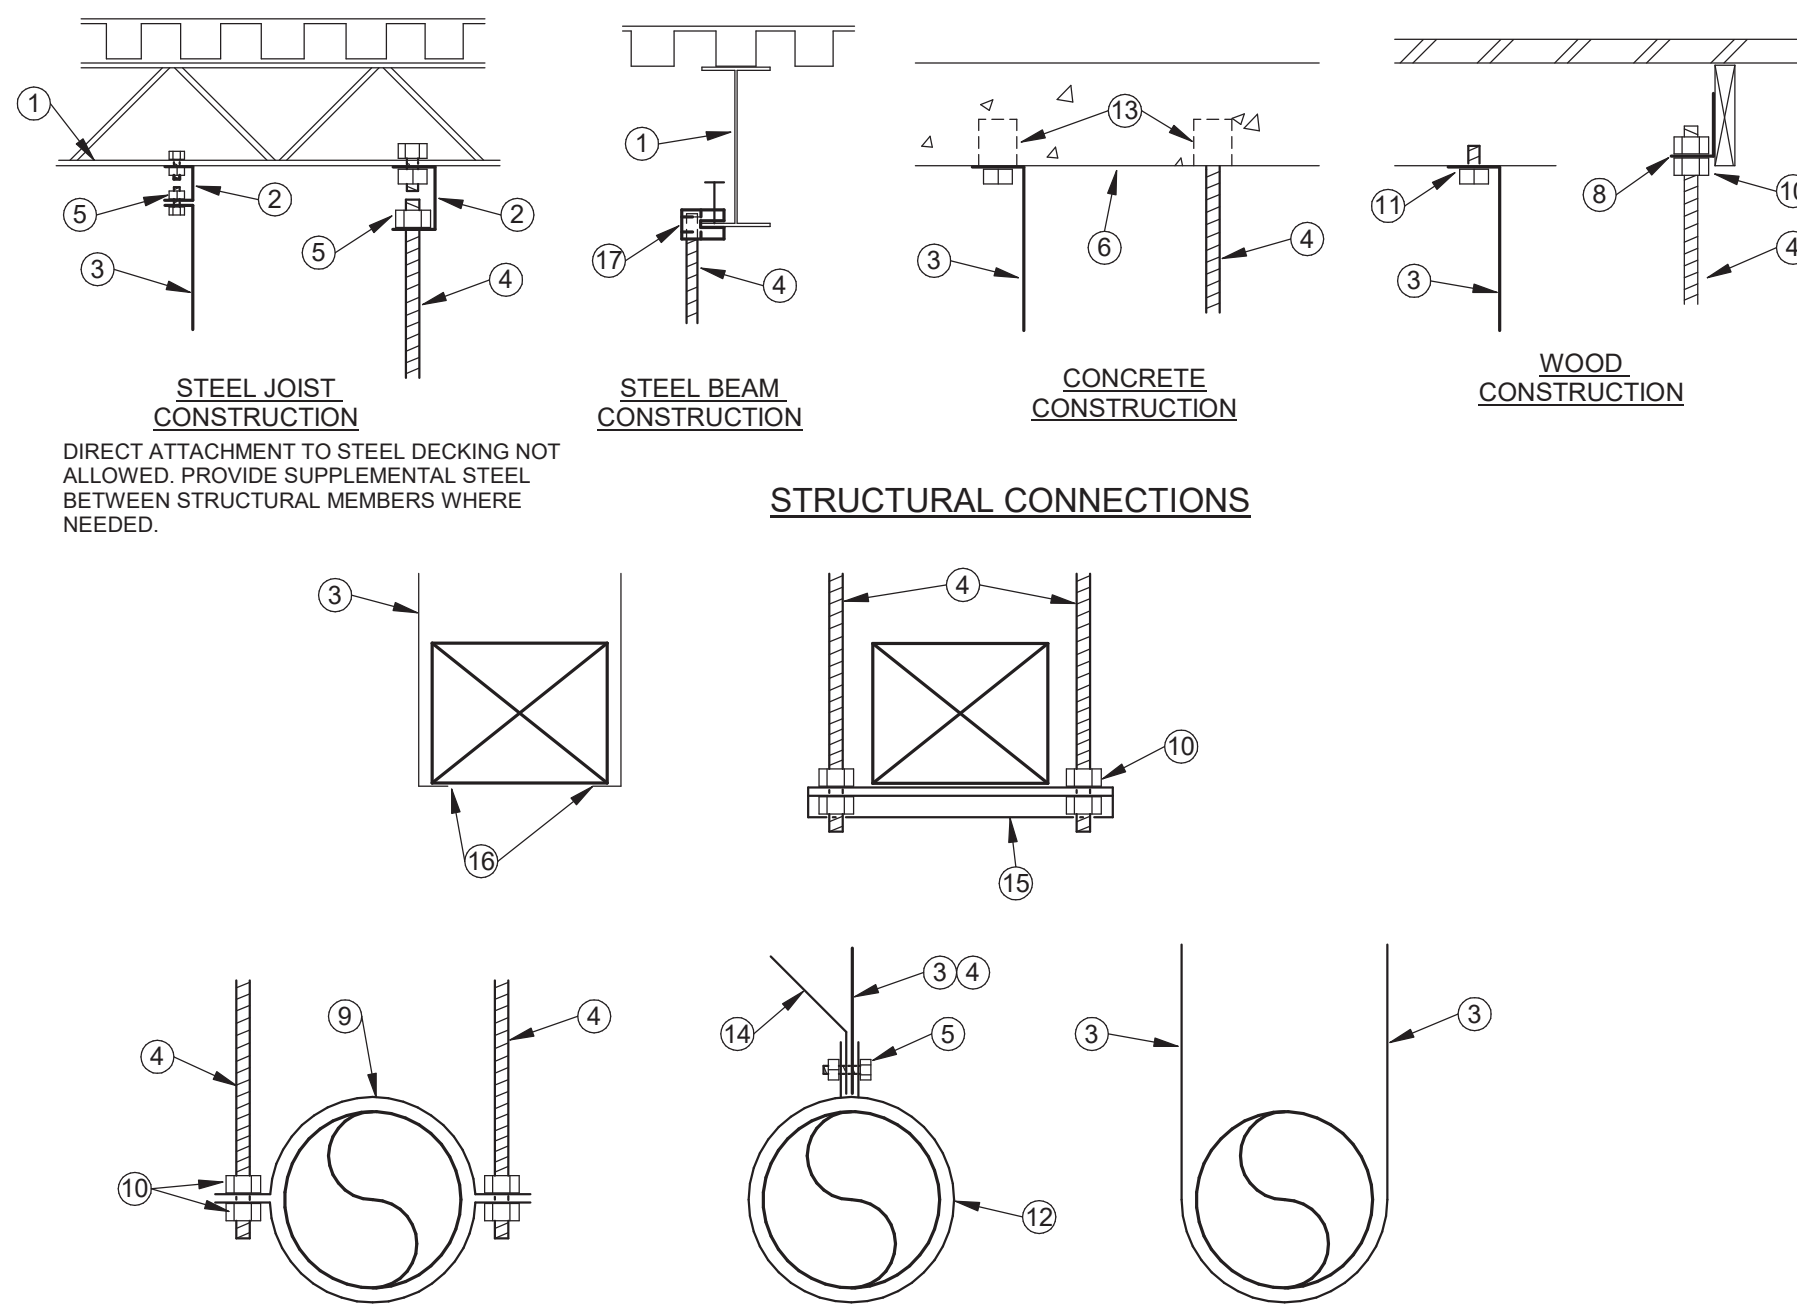

- STEEL JOIST OR BEAM.
- UNISTRUT CHANNEL SPANNING TWO JOIST OR BEAMS. ATTACH TO BOTTOM CHORDS OF TWO BEAMS OR JOIST WITH "C" CLAMP.
- GALVANIZED SHEETMETAL STRAP HANGER.
- GALVANIZED THREADED ROD.
- GALVANIZED BOLT & NUT.
- CONCRETE SLAB.
- WOOD DECK & BEAM.
- STEEL ANGLE CLIP ENGINEERED FASTENER FOR THREADED ROD INTO WOOD.
- TWO GALVANIZED BAND HANGERS.
- RETAINING NUTS & WASHERS.
- ATTACH TO BOTTOM OF WOOD BEAM OR JOIST WITH LAG BOLT.
- ONE PIECE GALVANIZED STEEL BAND HANGER.
- CONCRETE EXPANSION ANCHOR OR CONCRETE INSERT IN NEW CONSTRUCTION.
- SEISMIC SWAY BRACE ATTACHED TO STRUCTURE.
- PAINTED STEEL UNISTRUT CHANNEL.
- GALVANIZED STEEL RESTRAINT PER SMACNA REQUIREMENTS.
- THREADED ROD BEAM CLAMP.

NOTE:
ALL HANGERS & SUPPORT OF DUCT SHALL BE IN ACCORDANCE WITH SMACNA HVAC DUCT CONSTRUCTION STANDARDS SECOND ADDITION - 1995.

2 DUCT HANGERS & SUPPORTS
N.T.S. METAL STRAP & ROD HANGERS

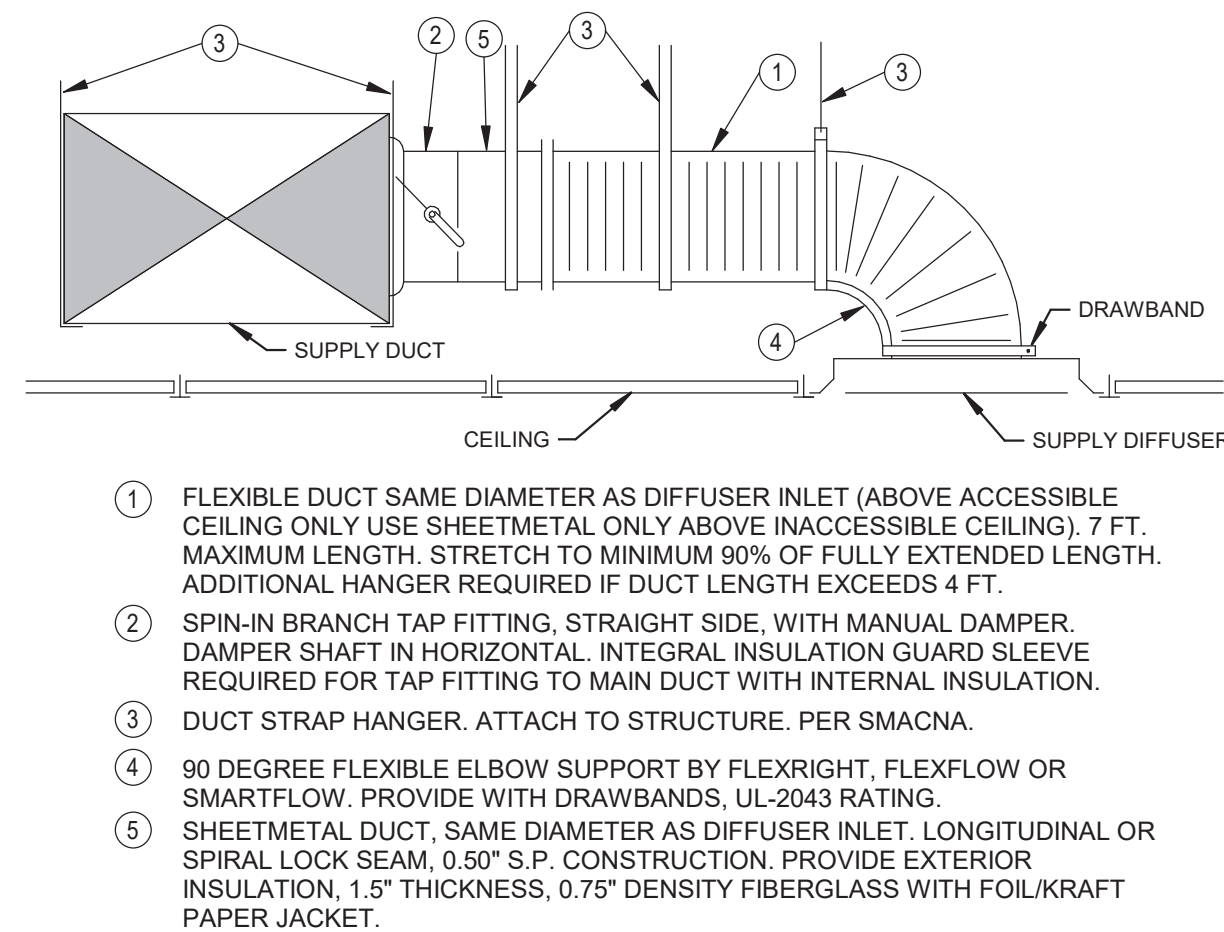

- FLEXIBLE DUCT SAME DIAMETER AS DIFFUSER INLET (ABOVE ACCESSIBLE CEILING ONLY USE SHEETMETAL ONLY ABOVE INACCESSIBLE CEILING). 7 FT. MAXIMUM LENGTH. STRETCH TO MINIMUM 90% OF FULLY EXTENDED LENGTH. ADDITIONAL HANGER REQUIRED IF DUCT LENGTH EXCEEDS 4 FT.
- SPIN-IN BRANCH TAP FITTING, STRAIGHT SIDE, WITH MANUAL DAMPER. DAMPER SHAFT IN HORIZONTAL. INTEGRAL INSULATION GUARD SLEEVE REQUIRED FOR TAP FITTING TO MAIN DUCT WITH INTERNAL INSULATION.
- DUCT STRAP HANGER. ATTACH TO STRUCTURE. PER SMACNA.
- 90 DEGREE FLEXIBLE ELBOW SUPPORT BY FLEXRIGHT, FLEXFLOW OR SMARTFLOW. PROVIDE WITH DRAWBANDS, UL-2043 RATING.
- SHEETMETAL DUCT, SAME DIAMETER AS DIFFUSER INLET. LONGITUDINAL OR SPIRAL LOCK SEAM, 0.50" S.P. CONSTRUCTION. PROVIDE EXTERIOR INSULATION, 1.5" THICKNESS, 0.75" DENSITY FIBERGLASS WITH FOIL/KRAFT PAPER JACKET.

4 CEILING DIFFUSER
N.T.S.

A

B









C

D

E

F

7/3/2025 8:57:46 AM

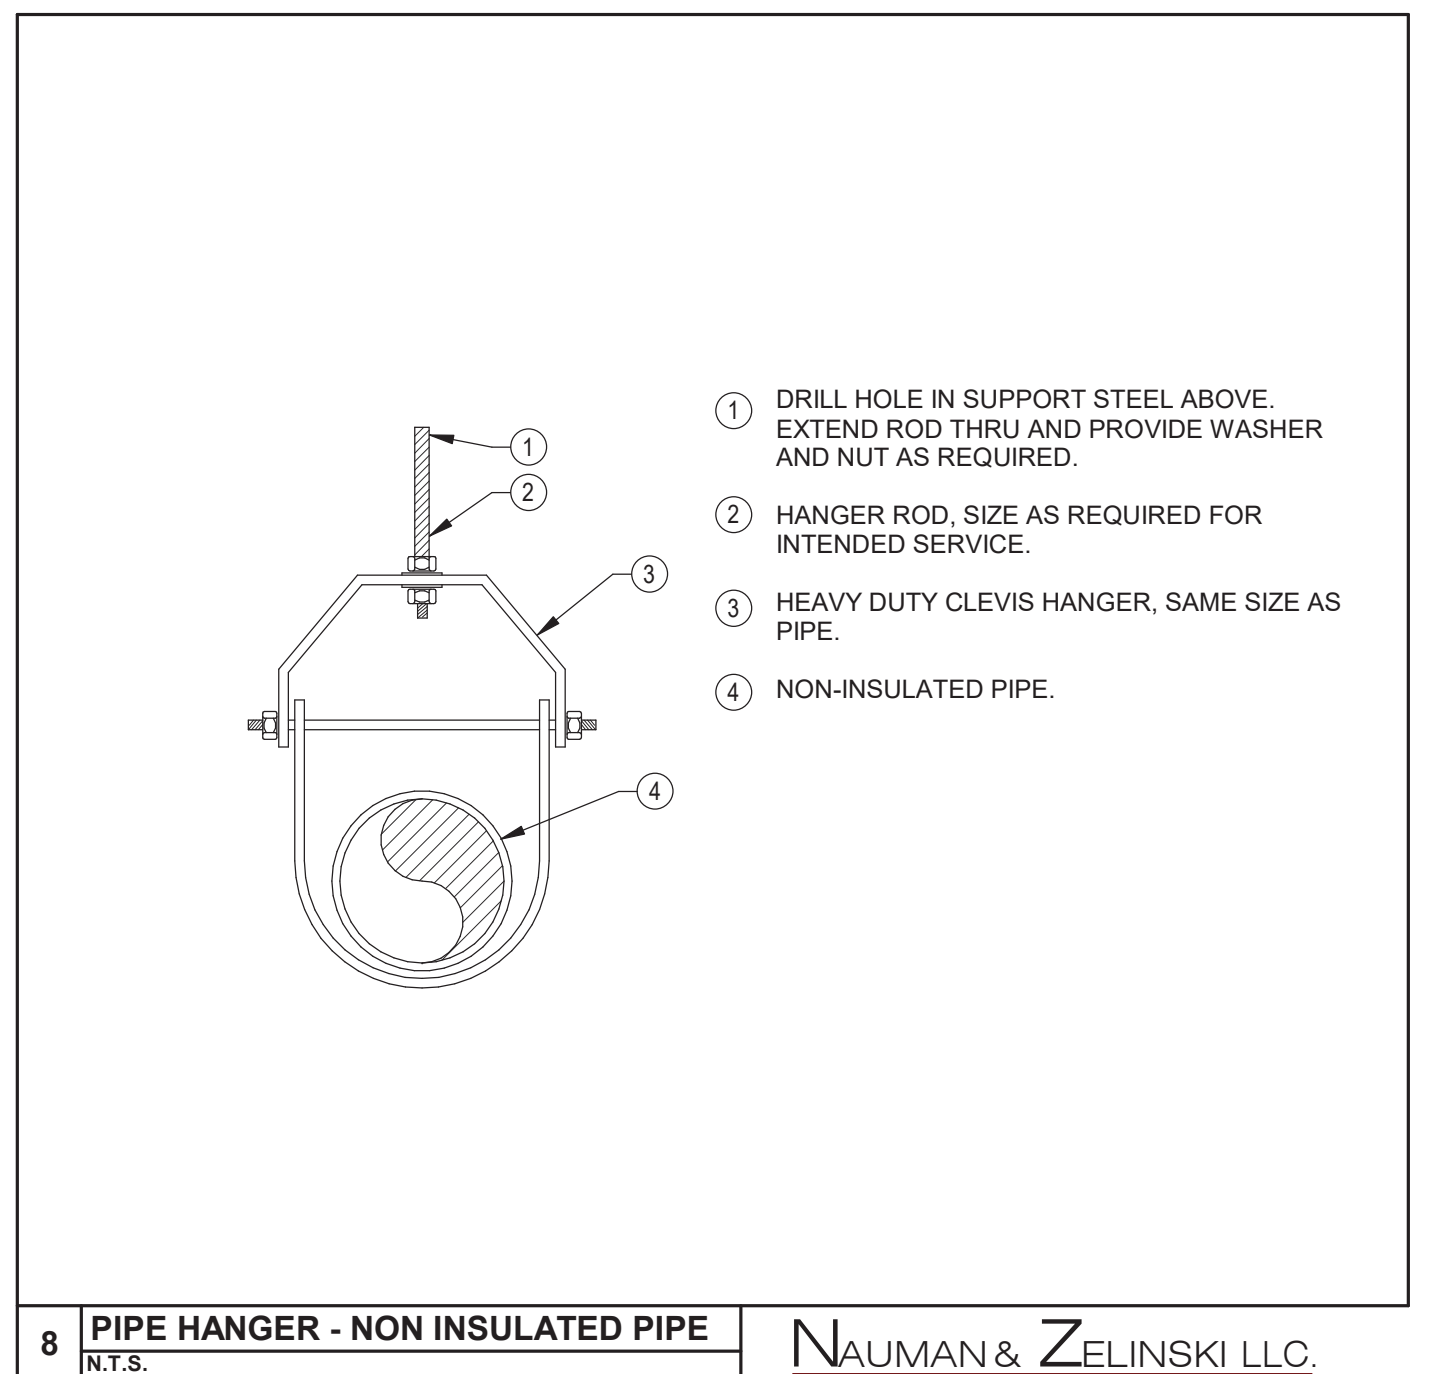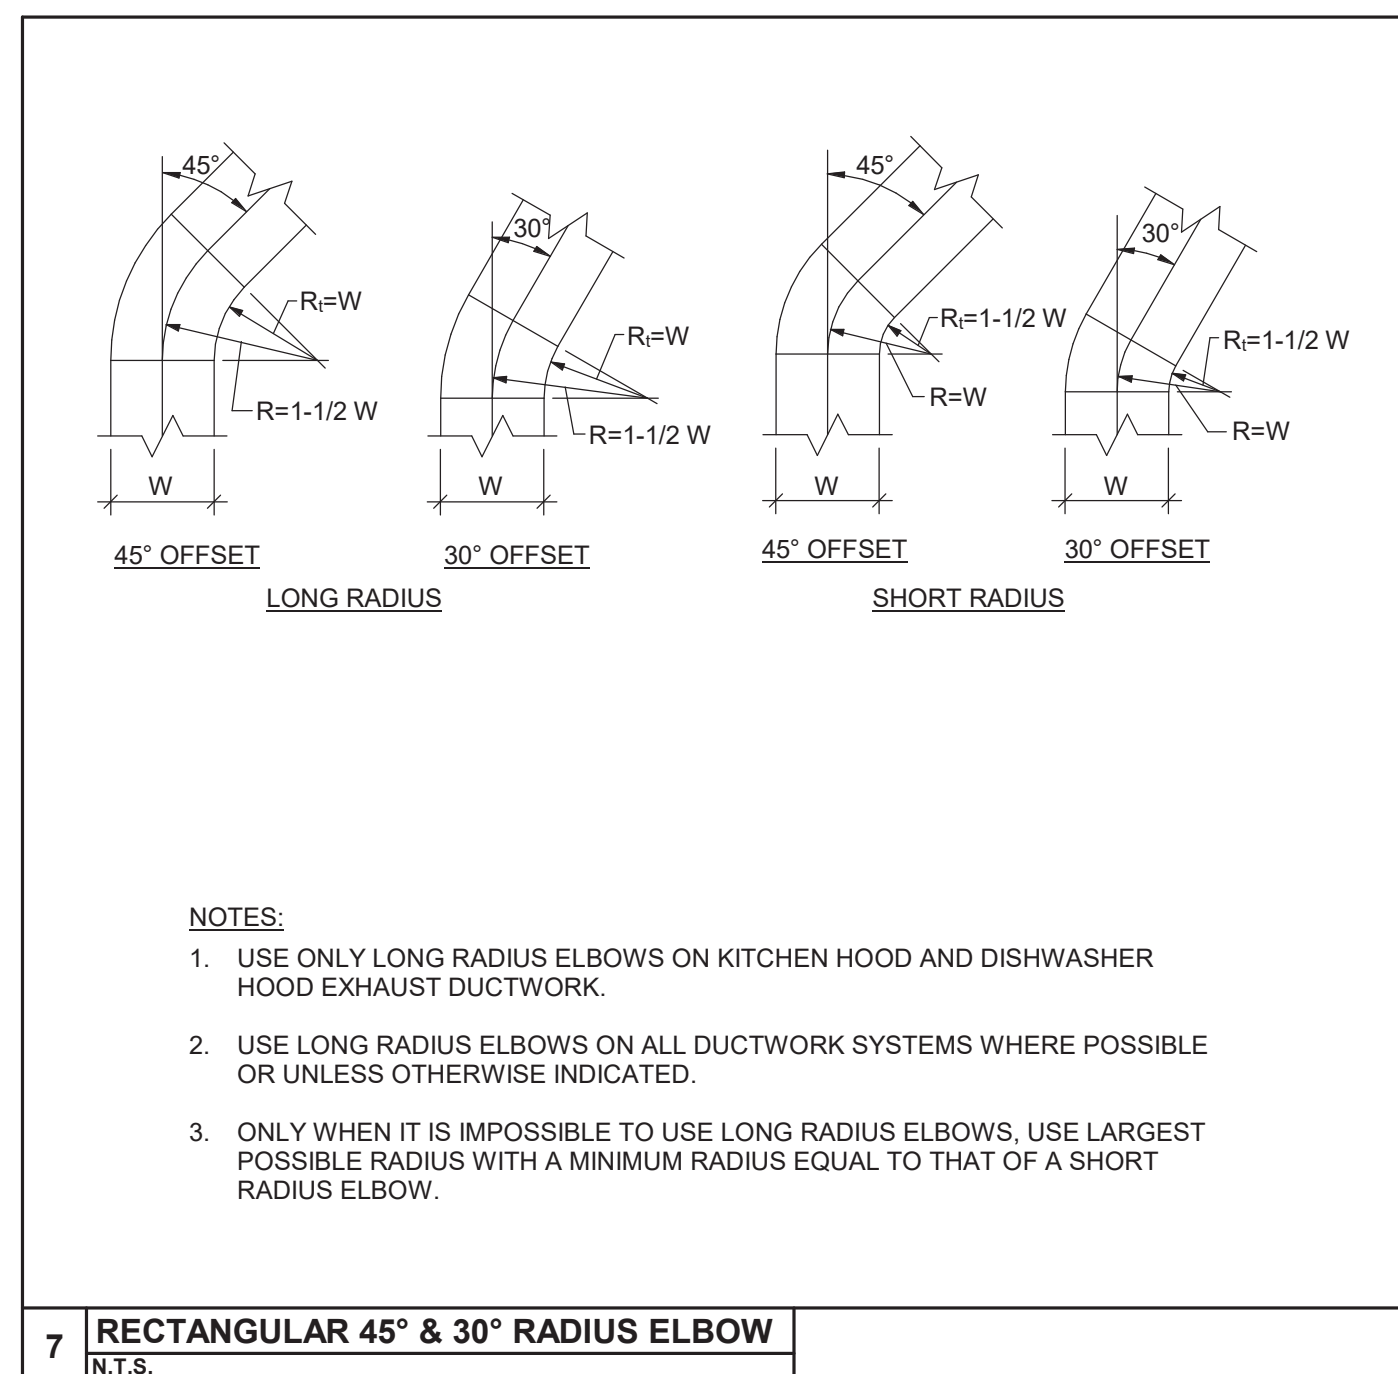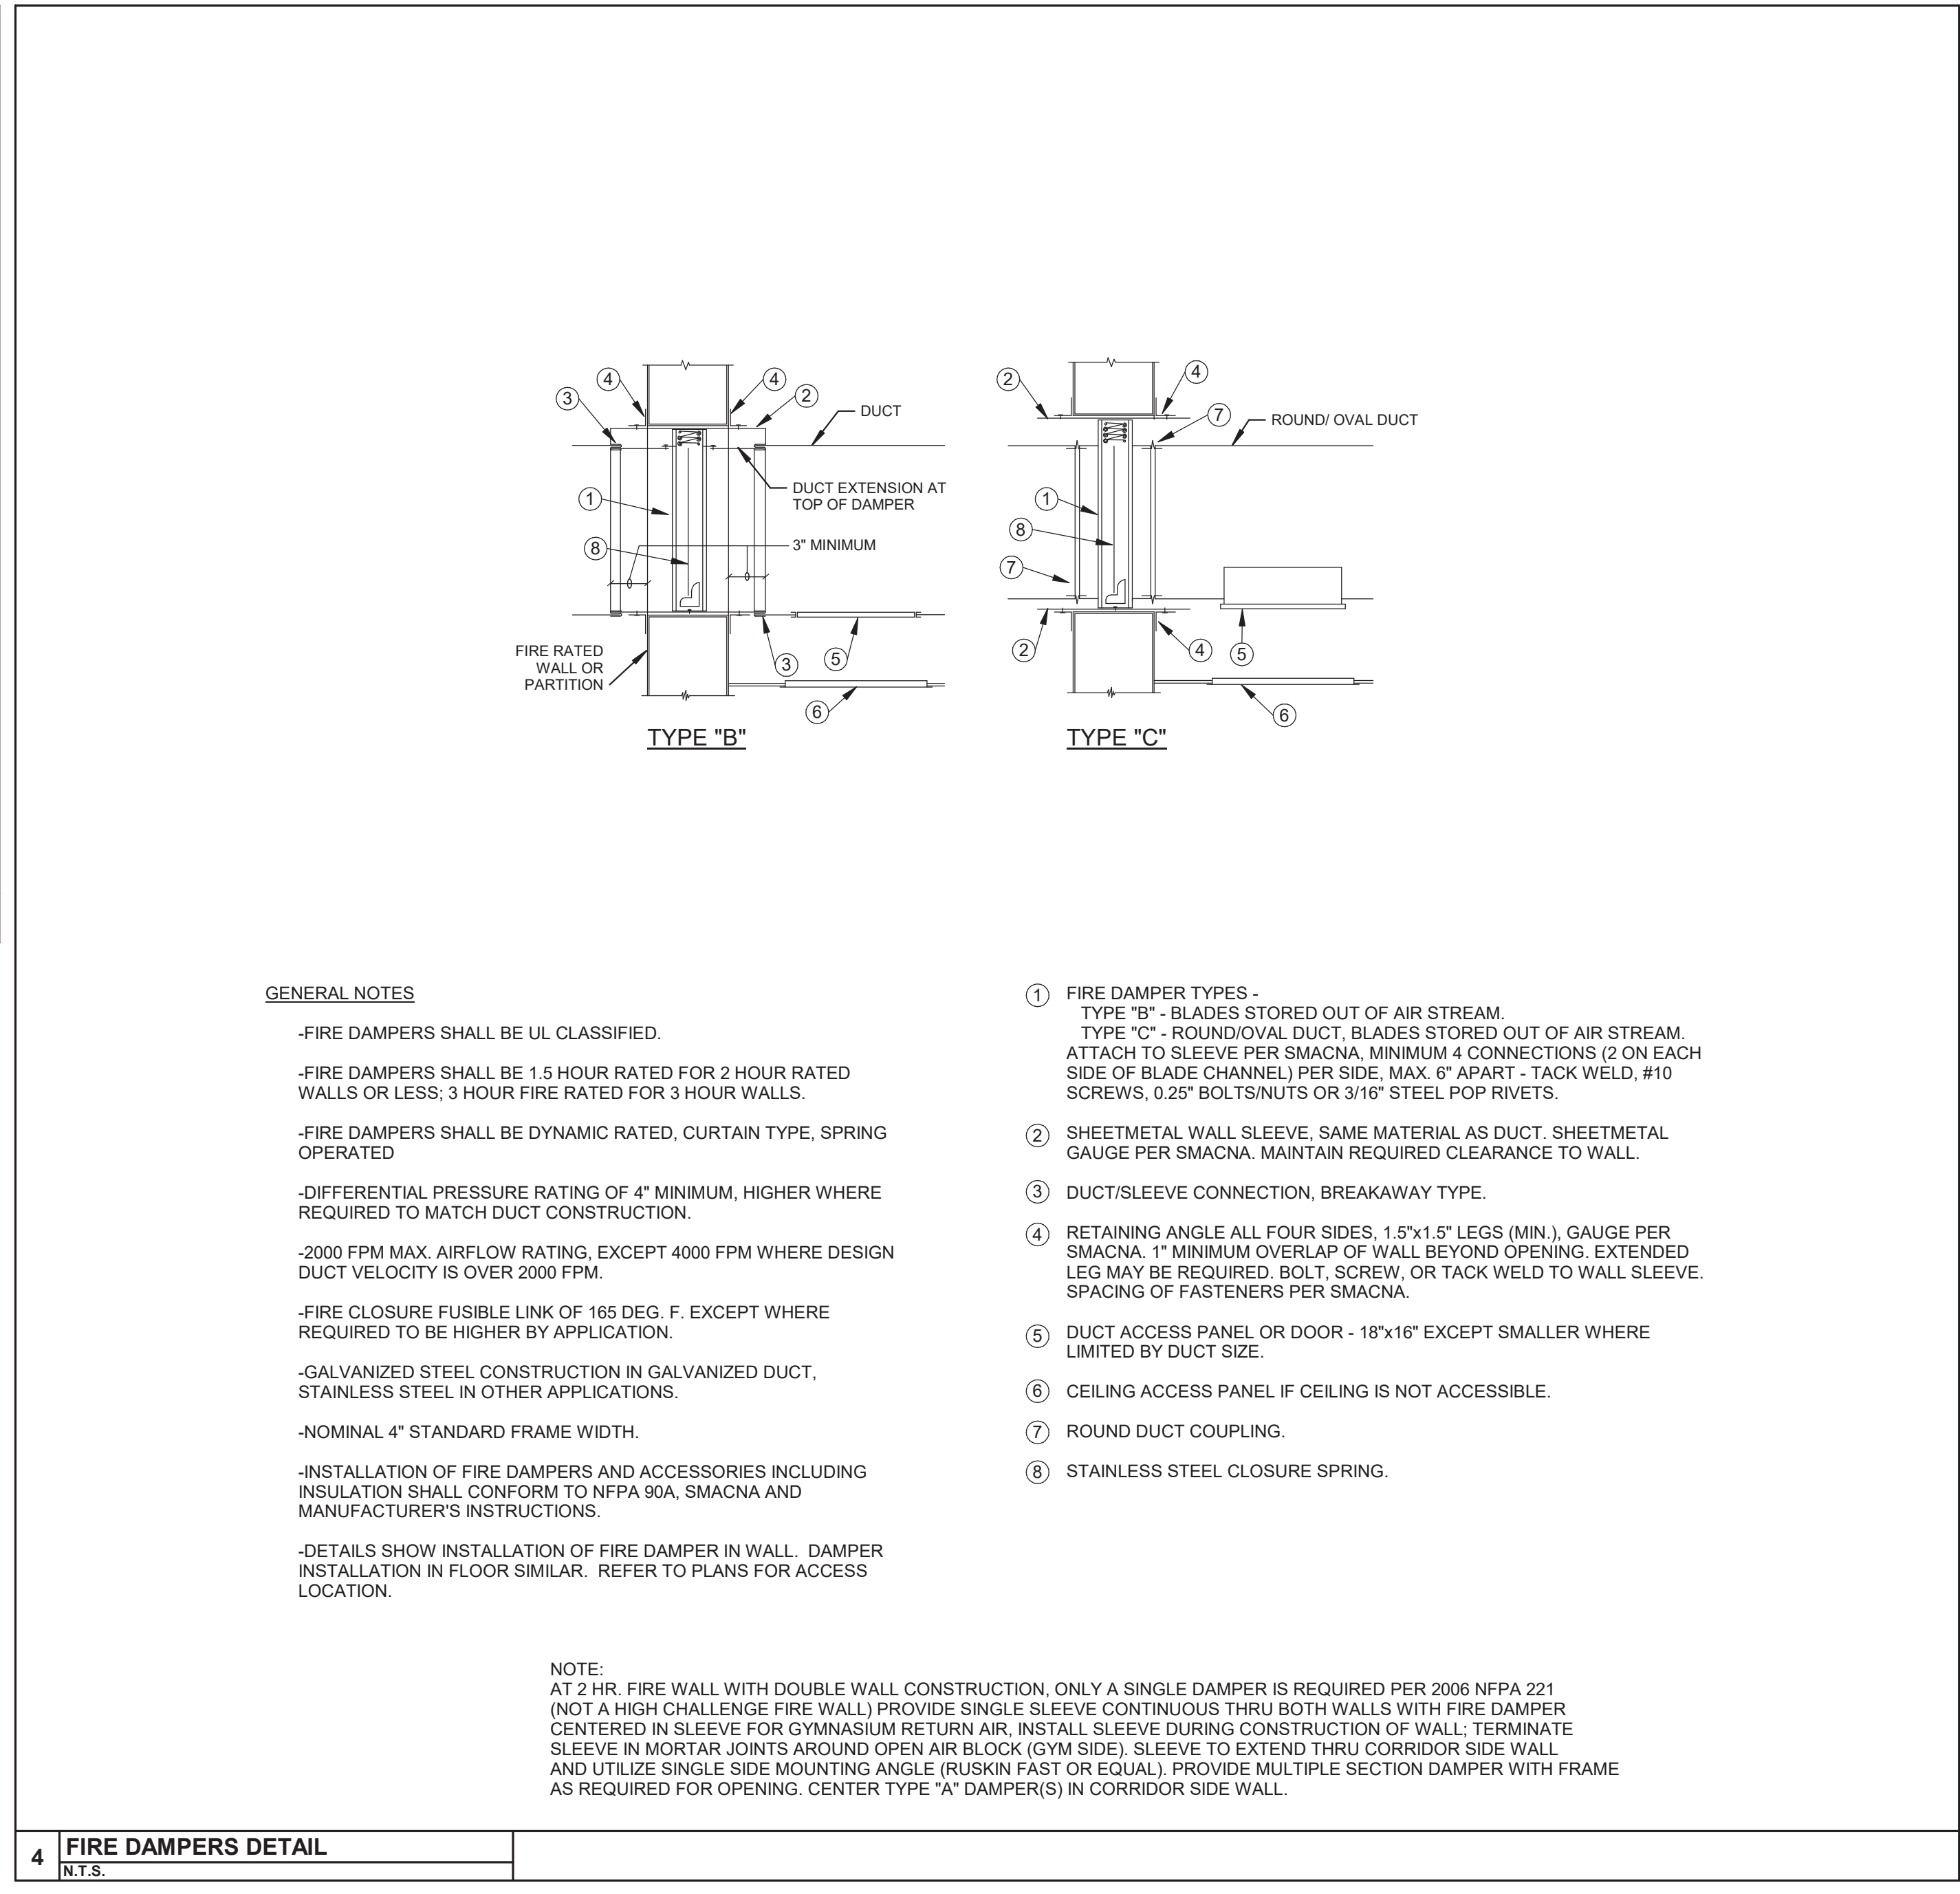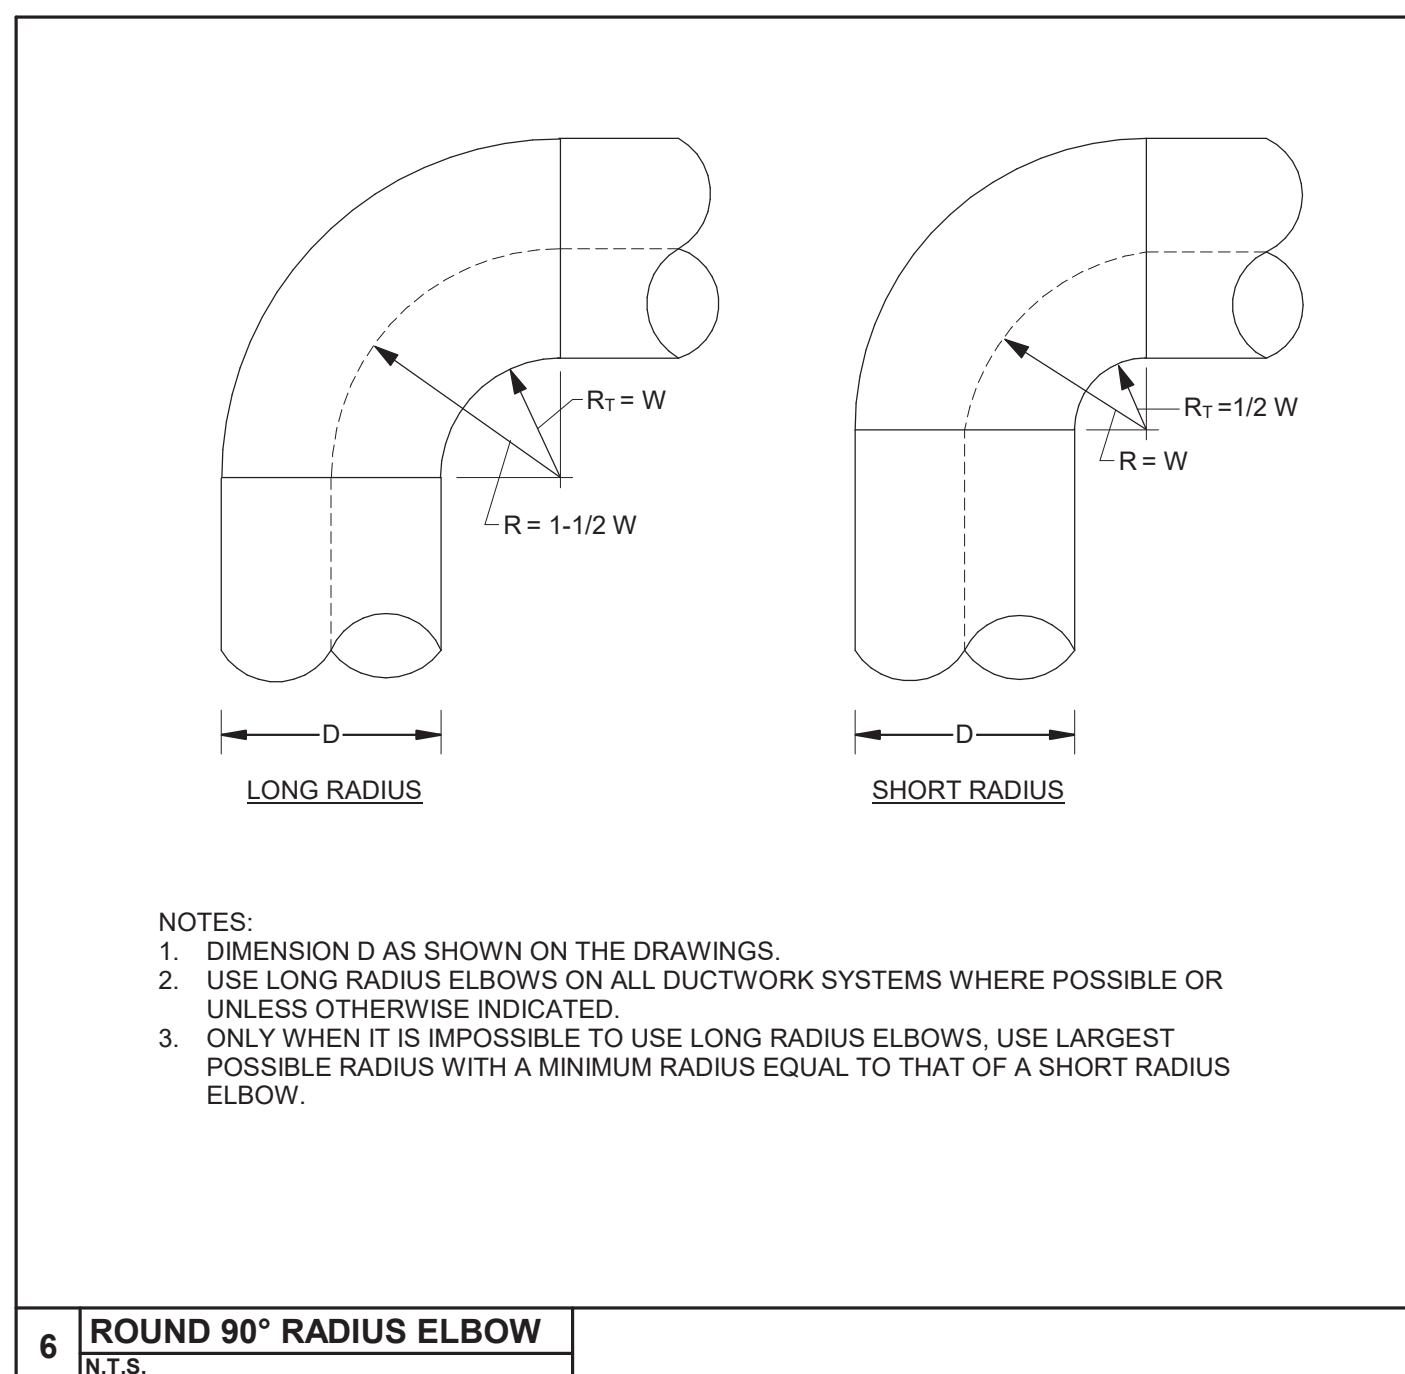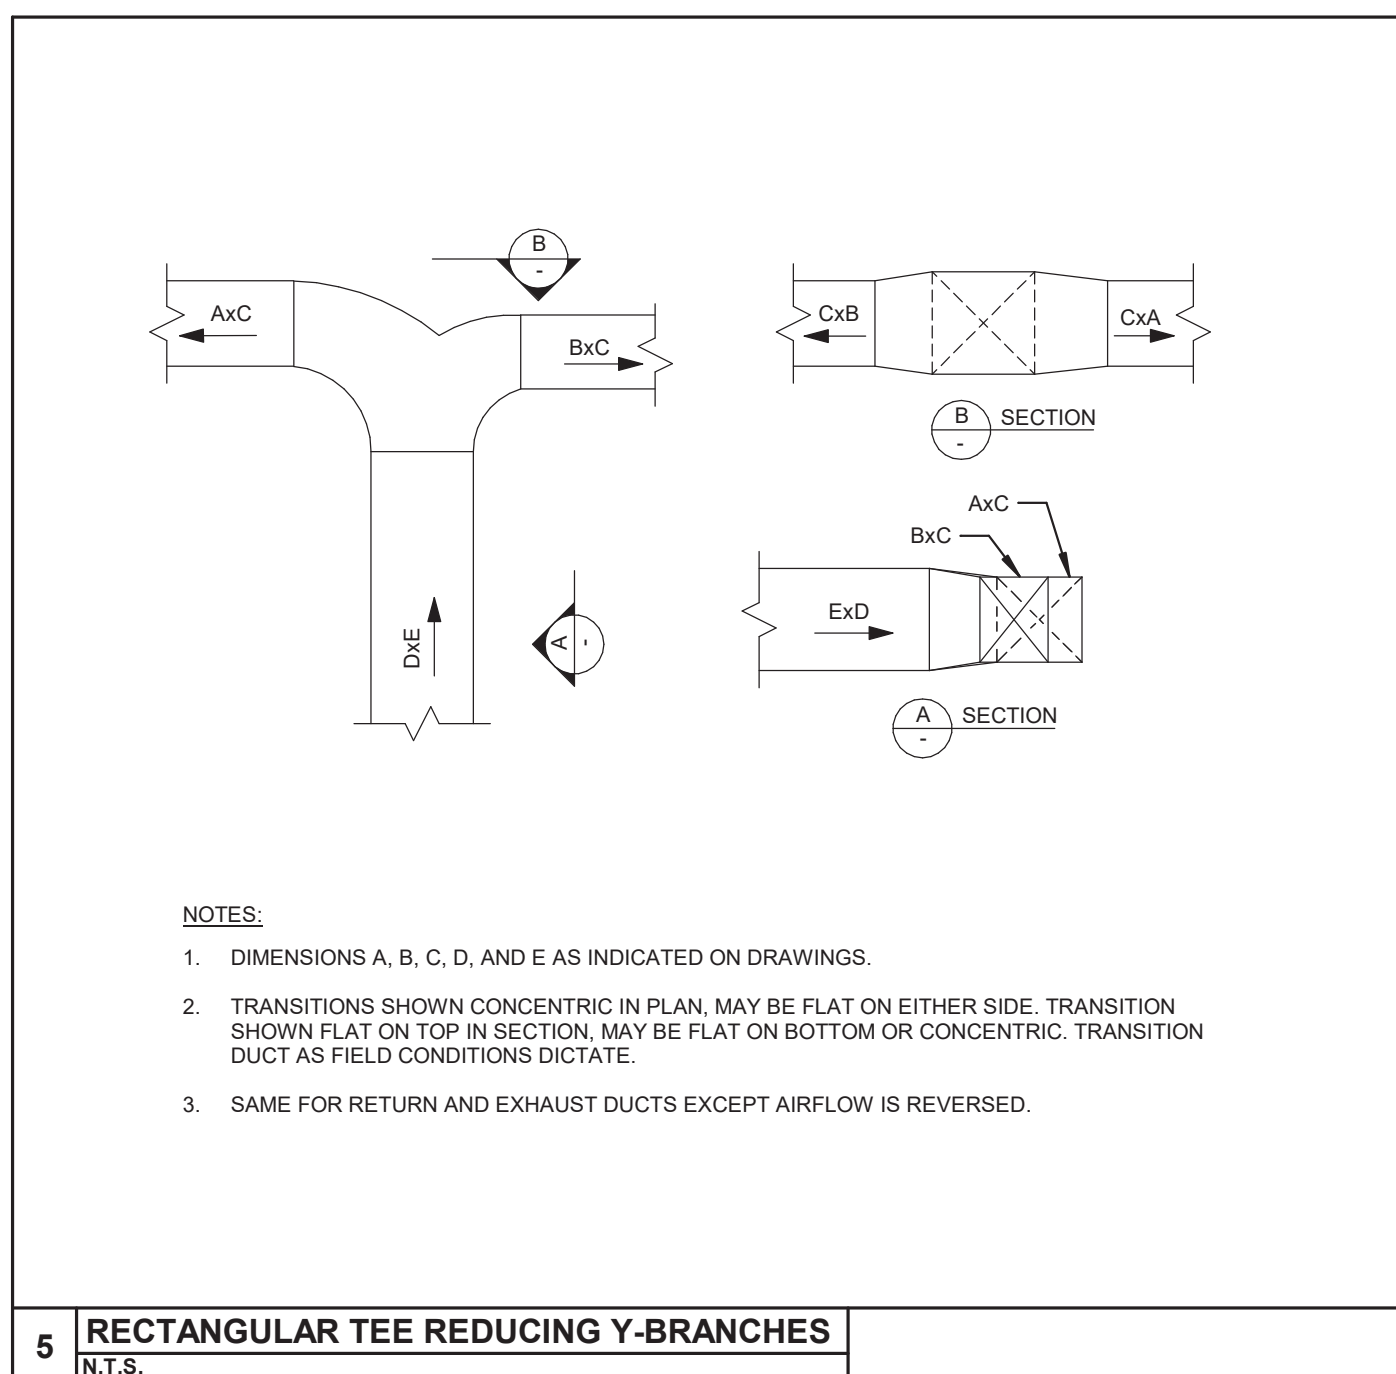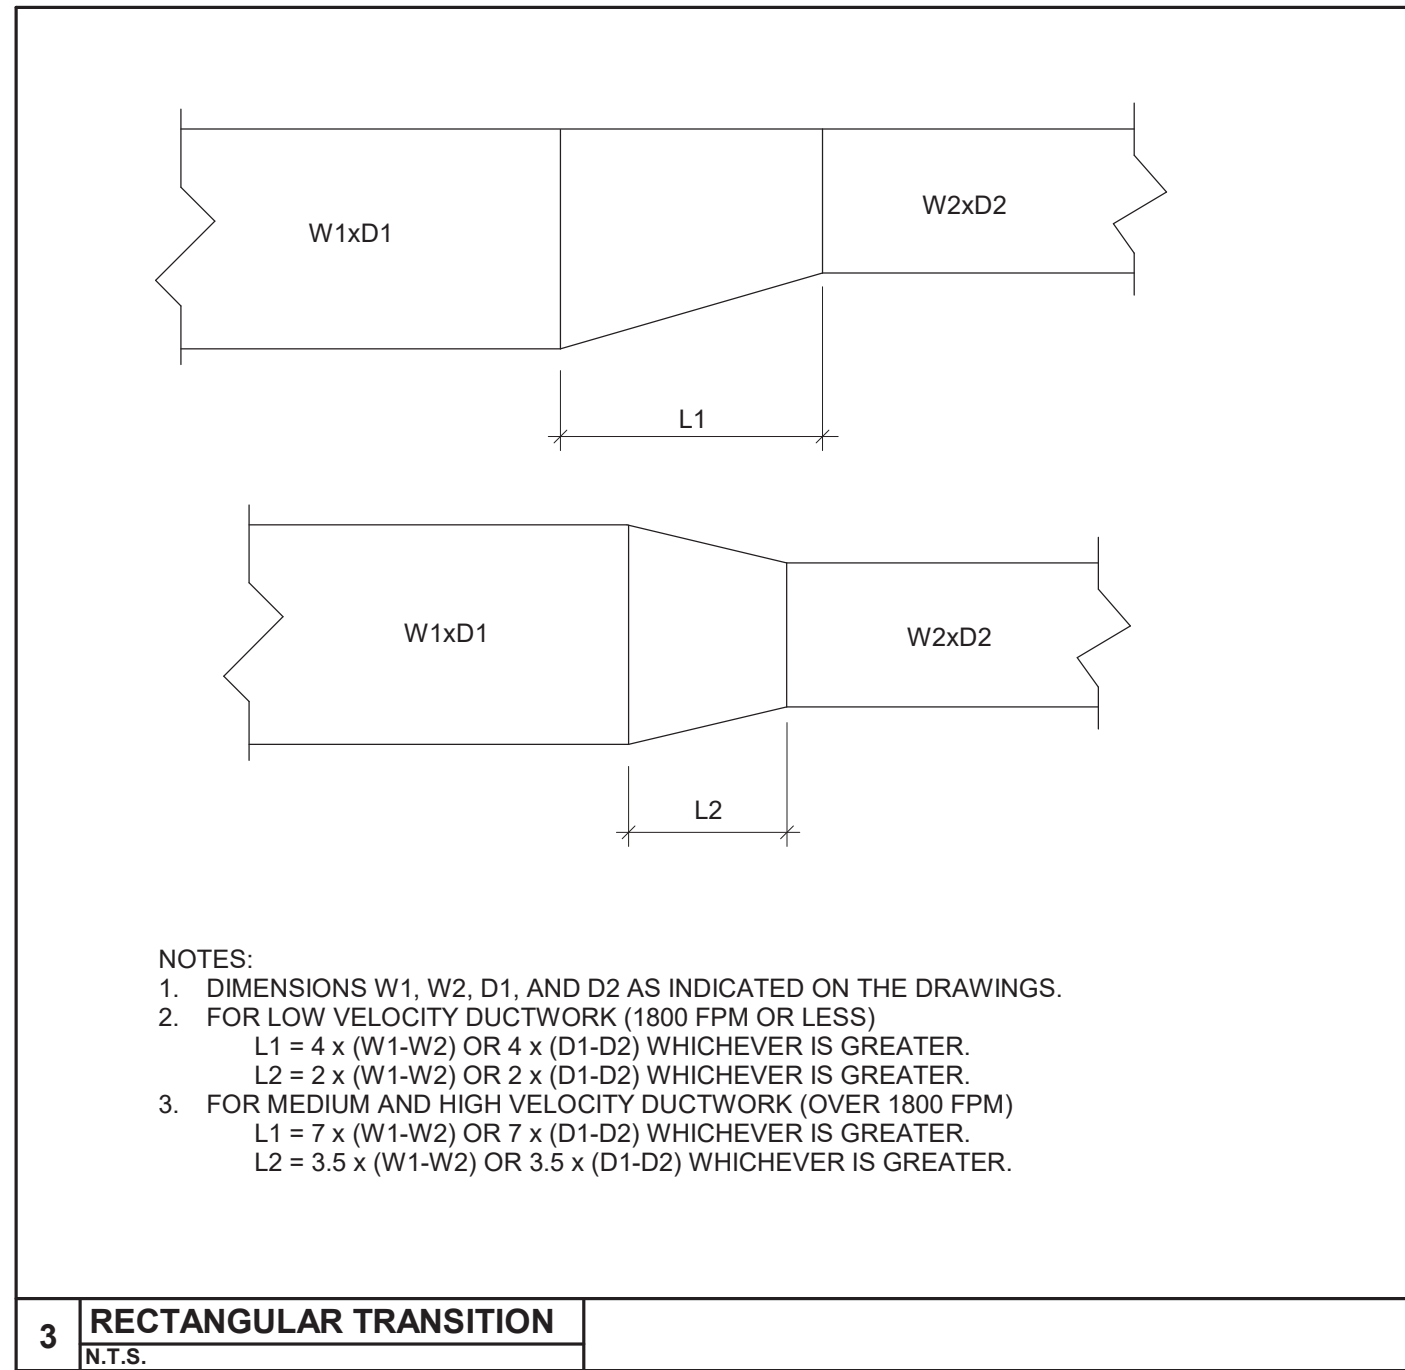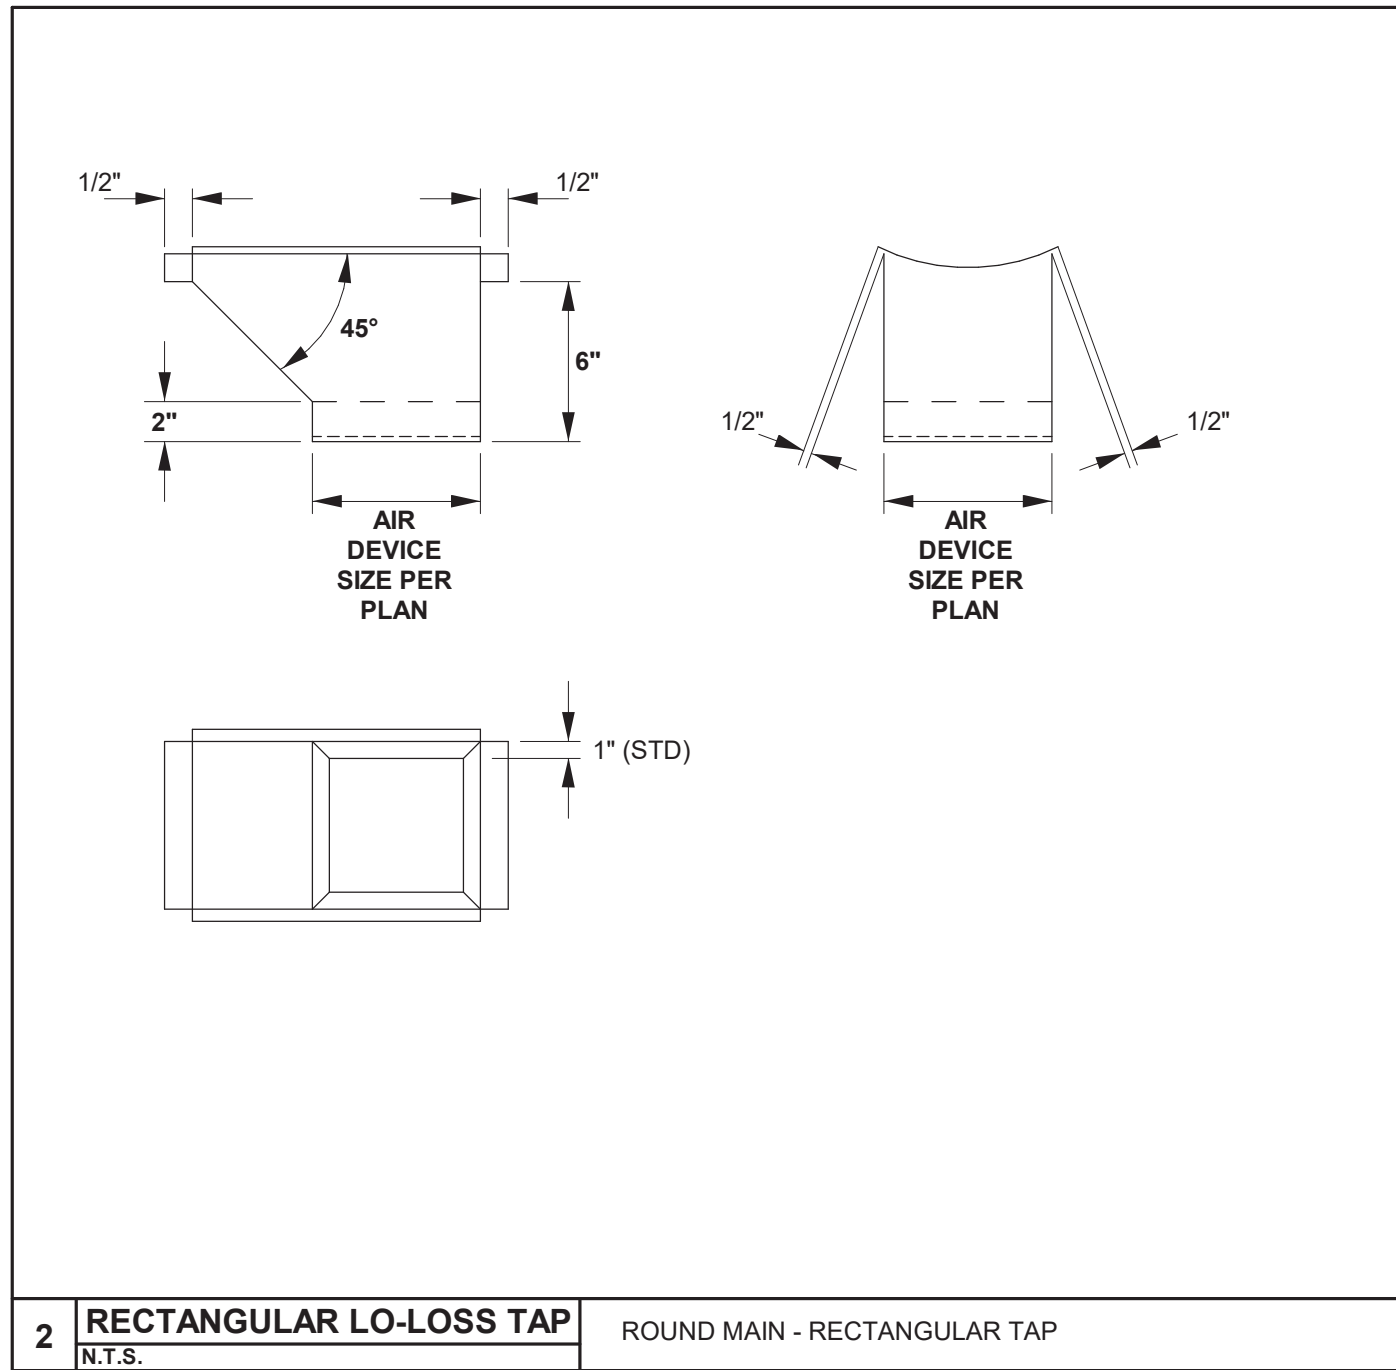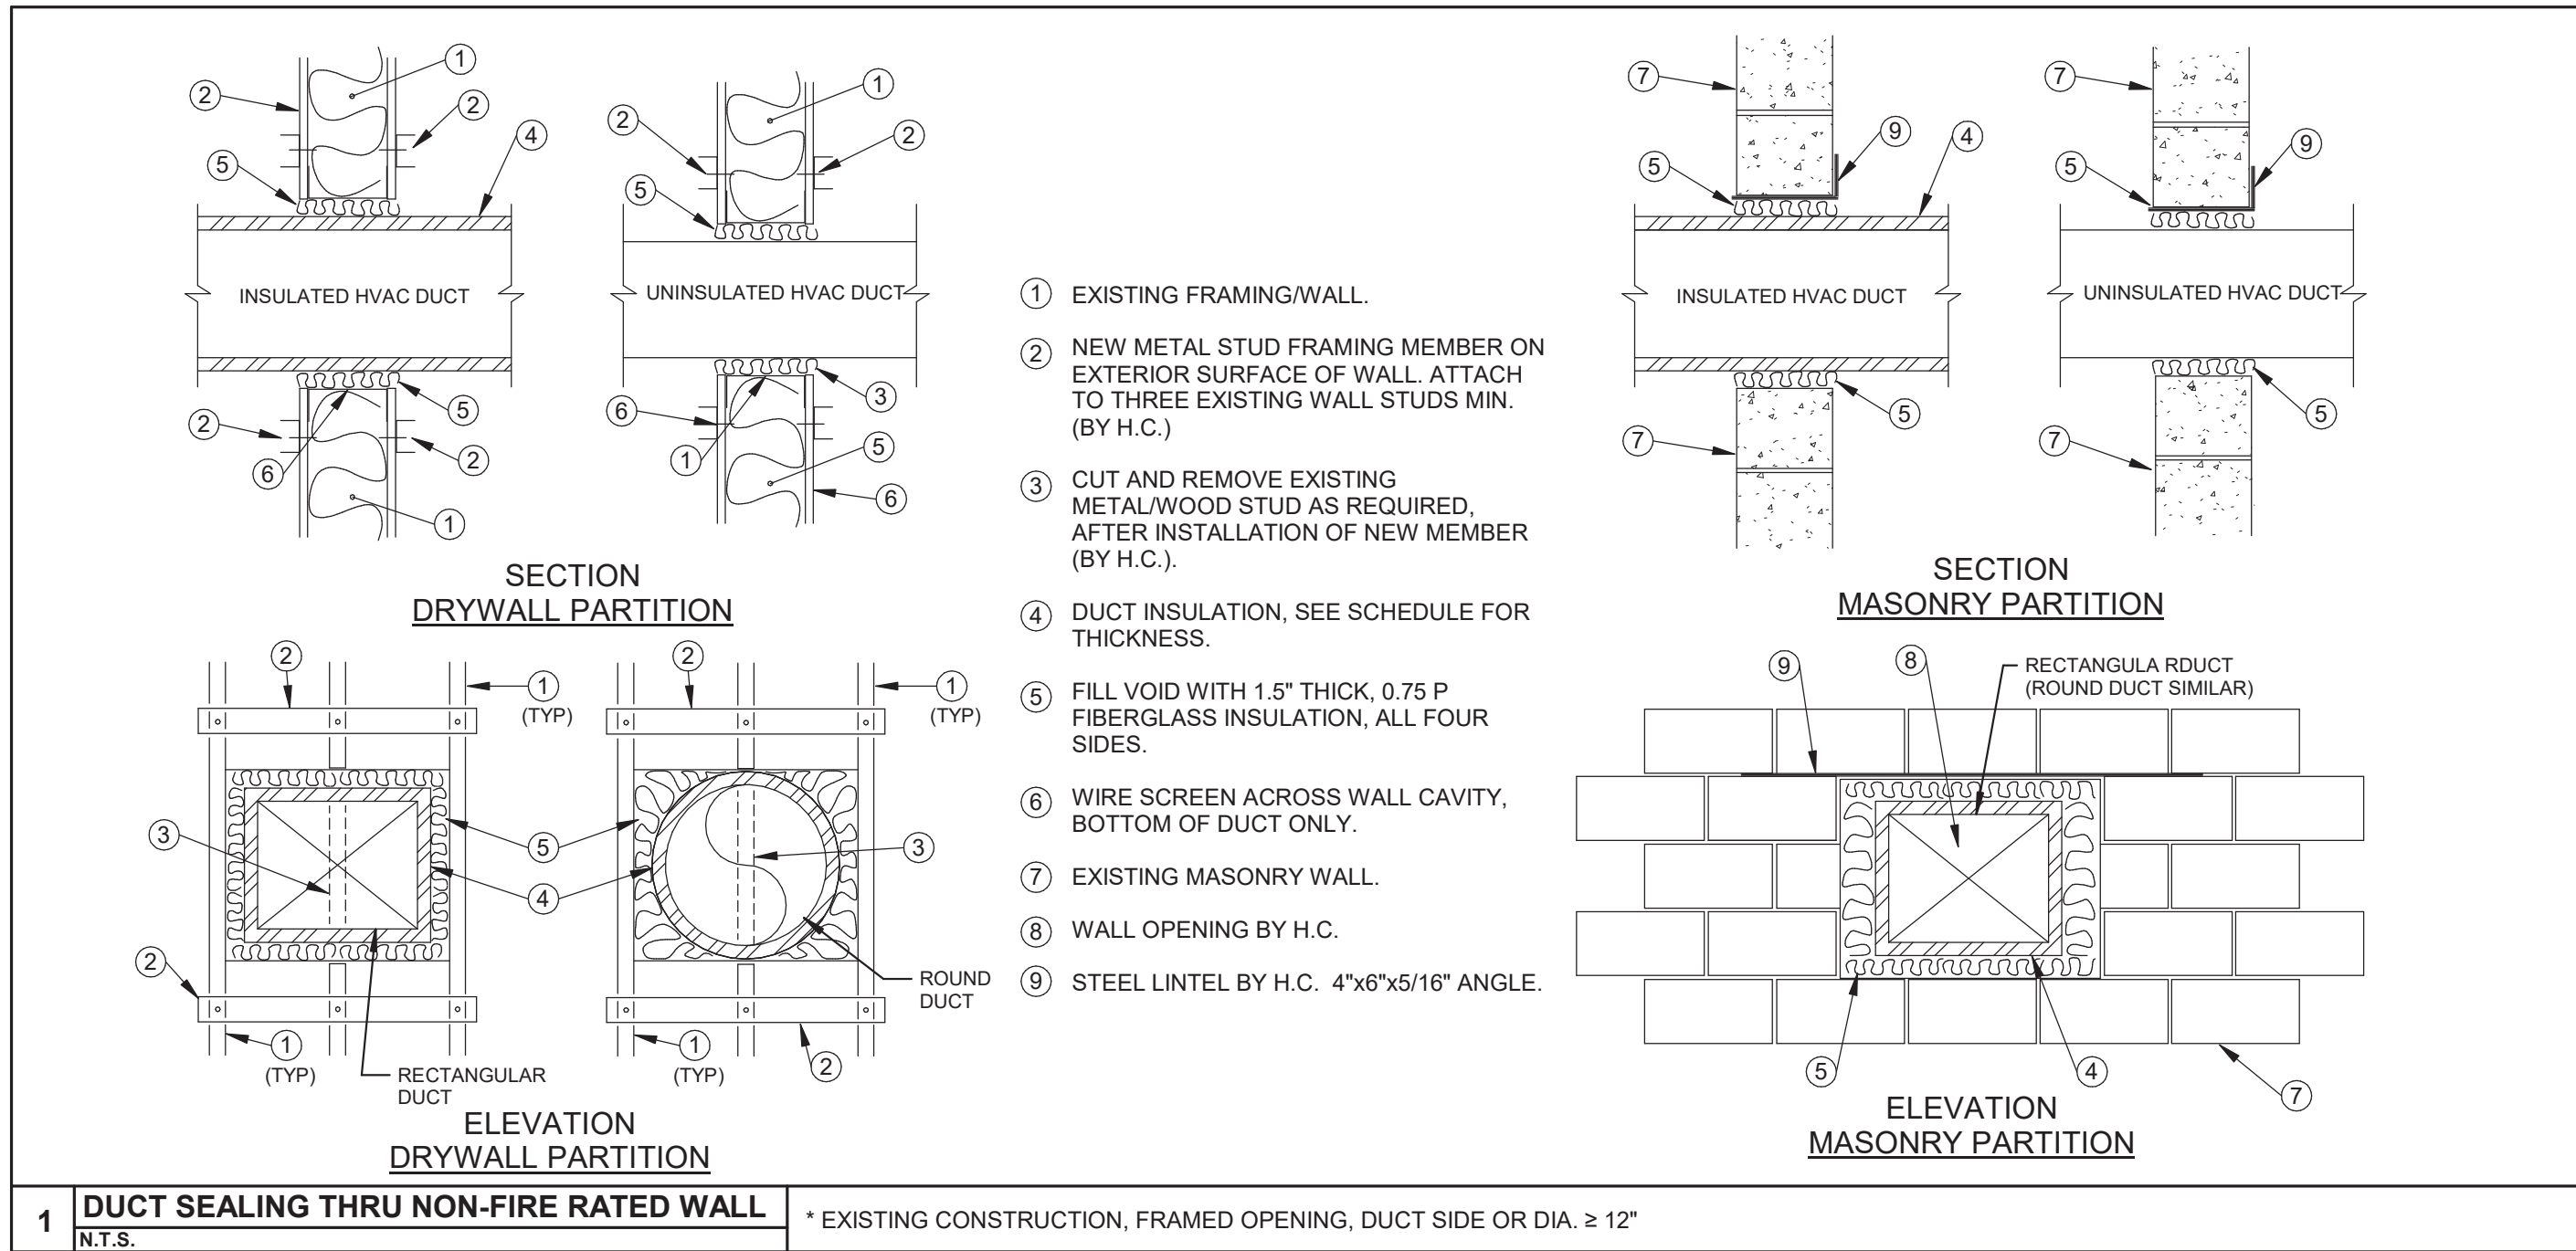

7/3/2025 8:57:45 AM

A












B

C

D

E

F

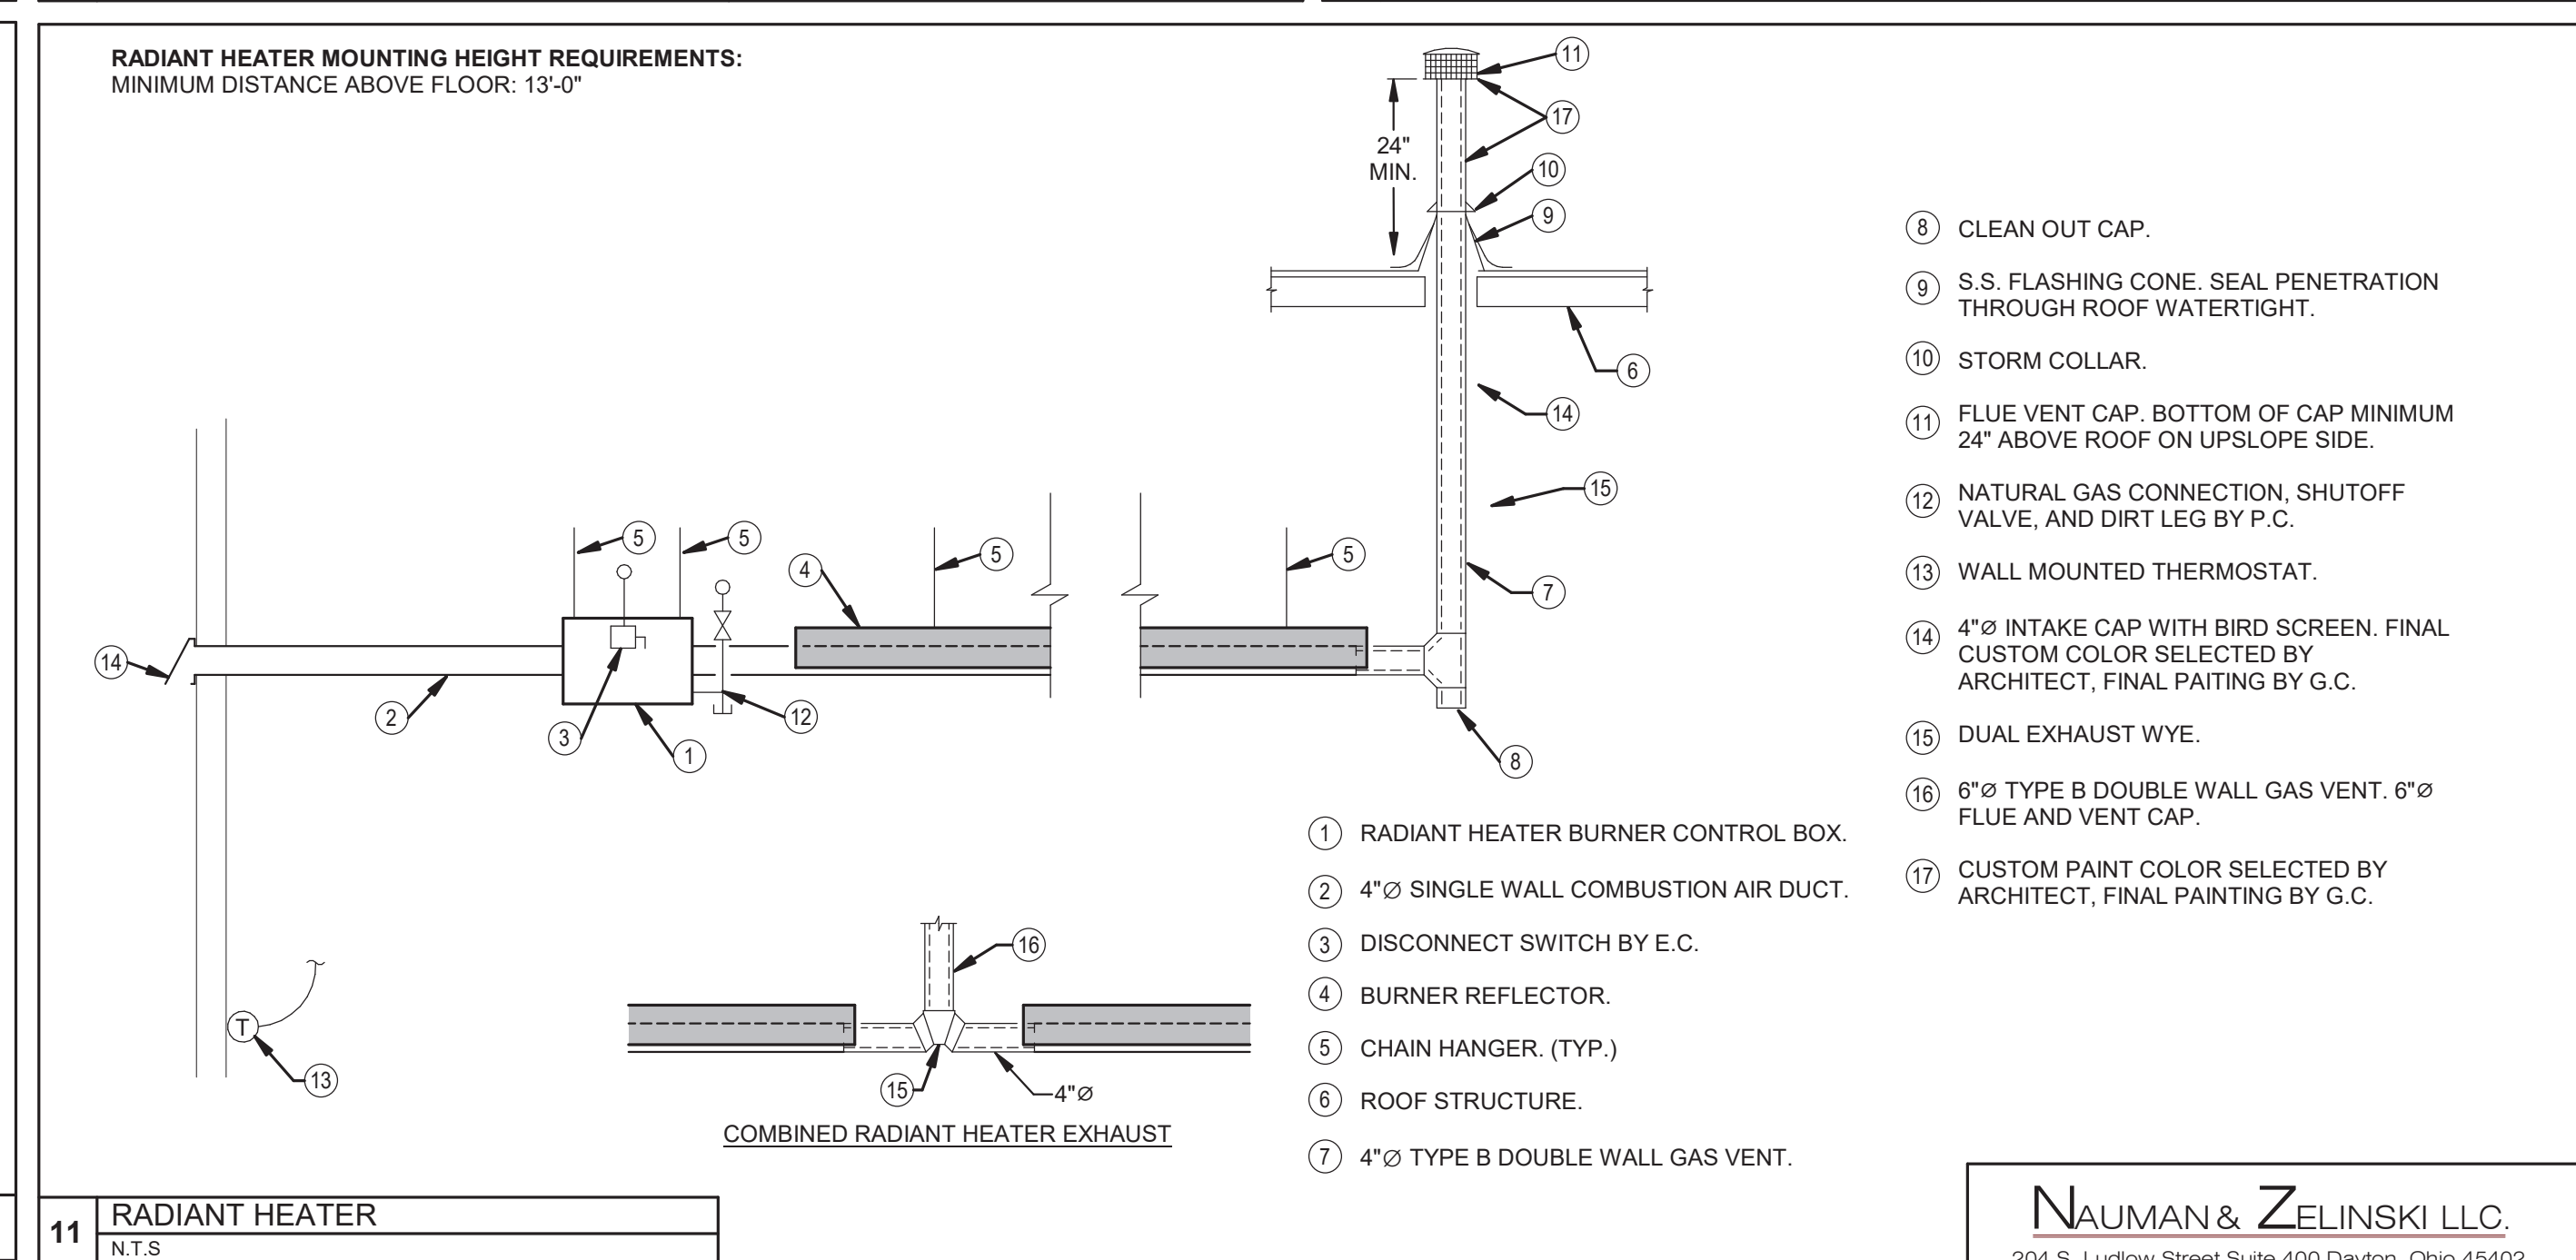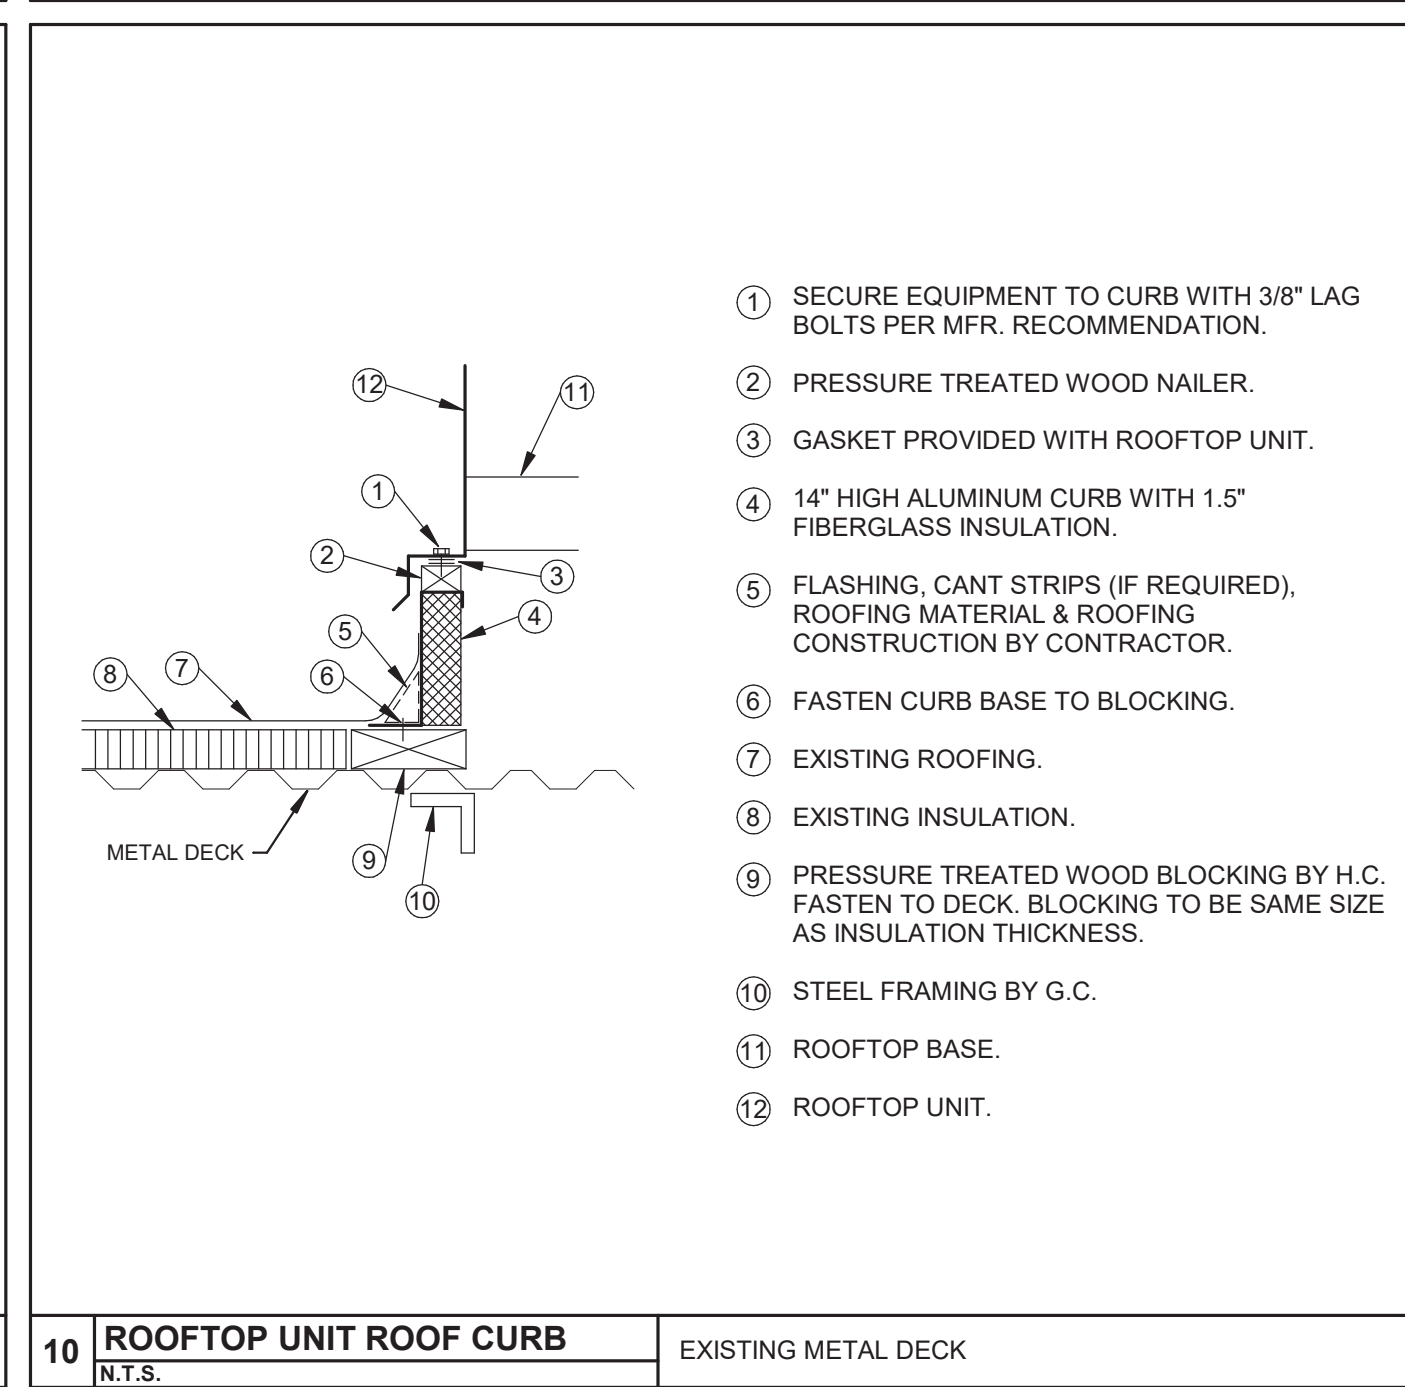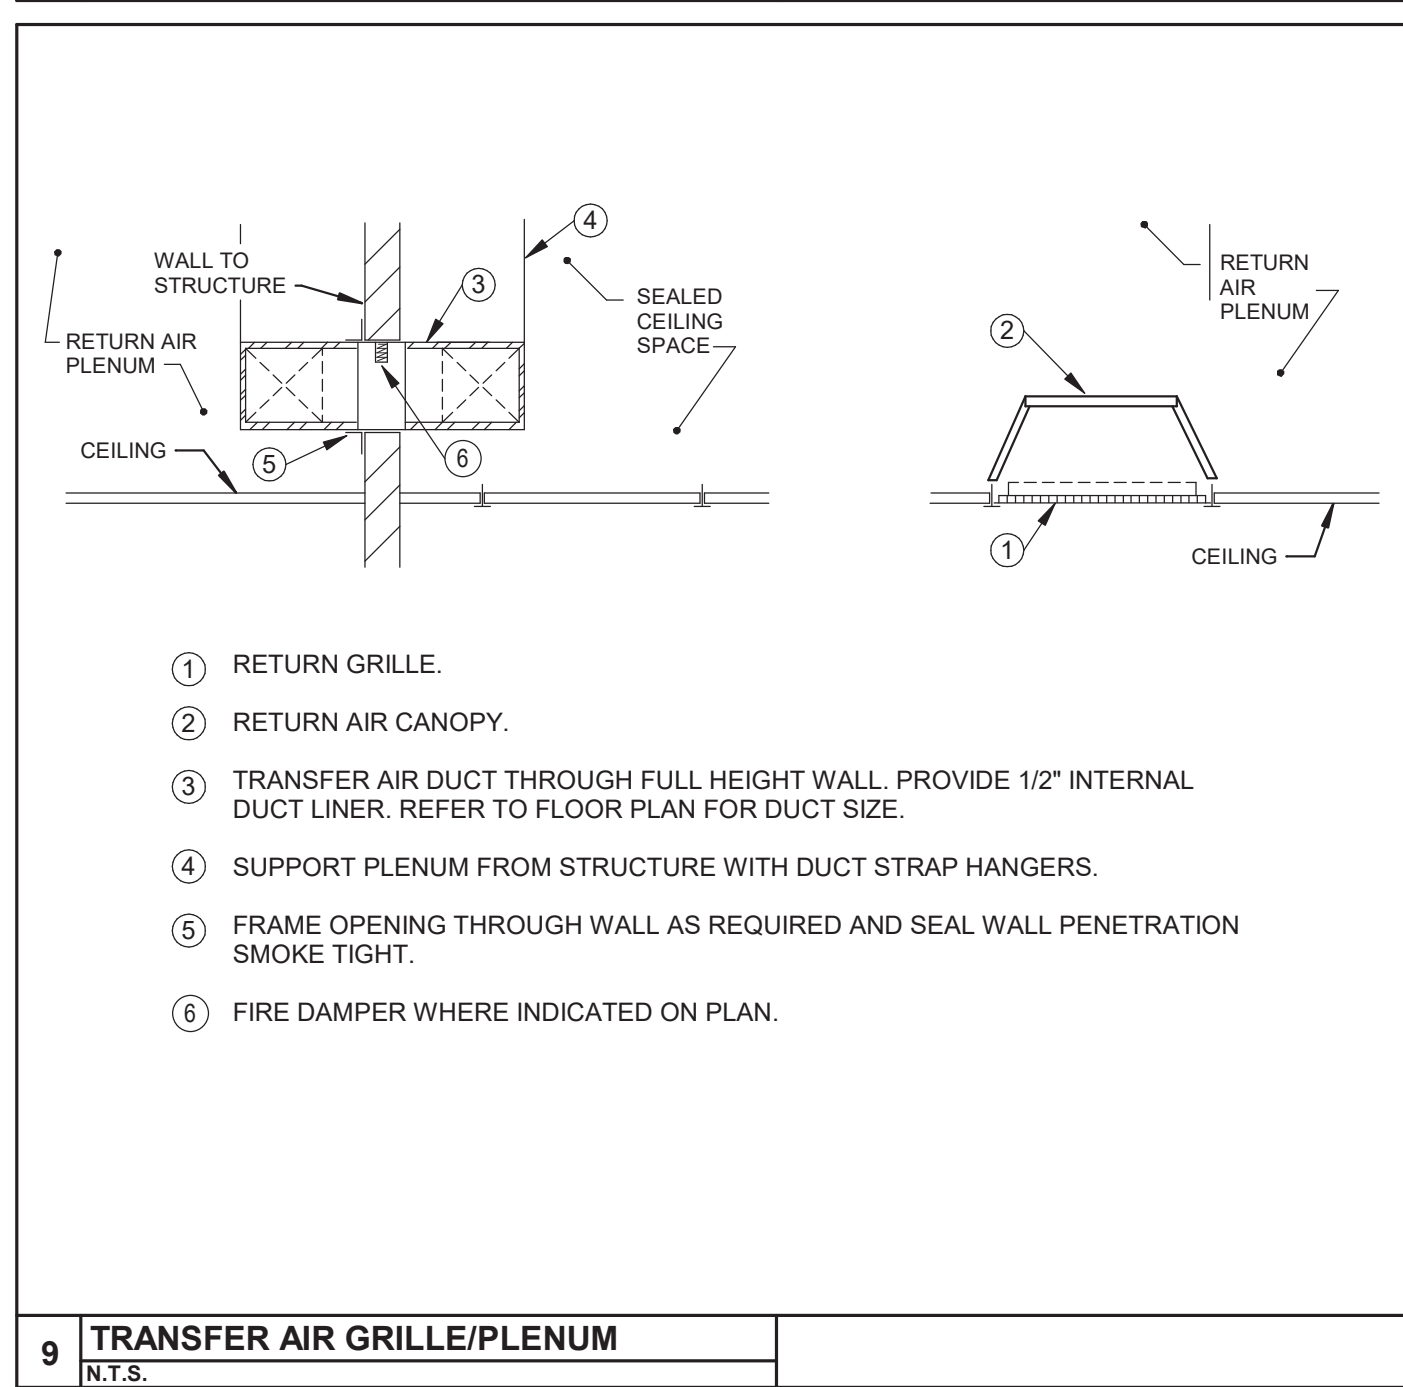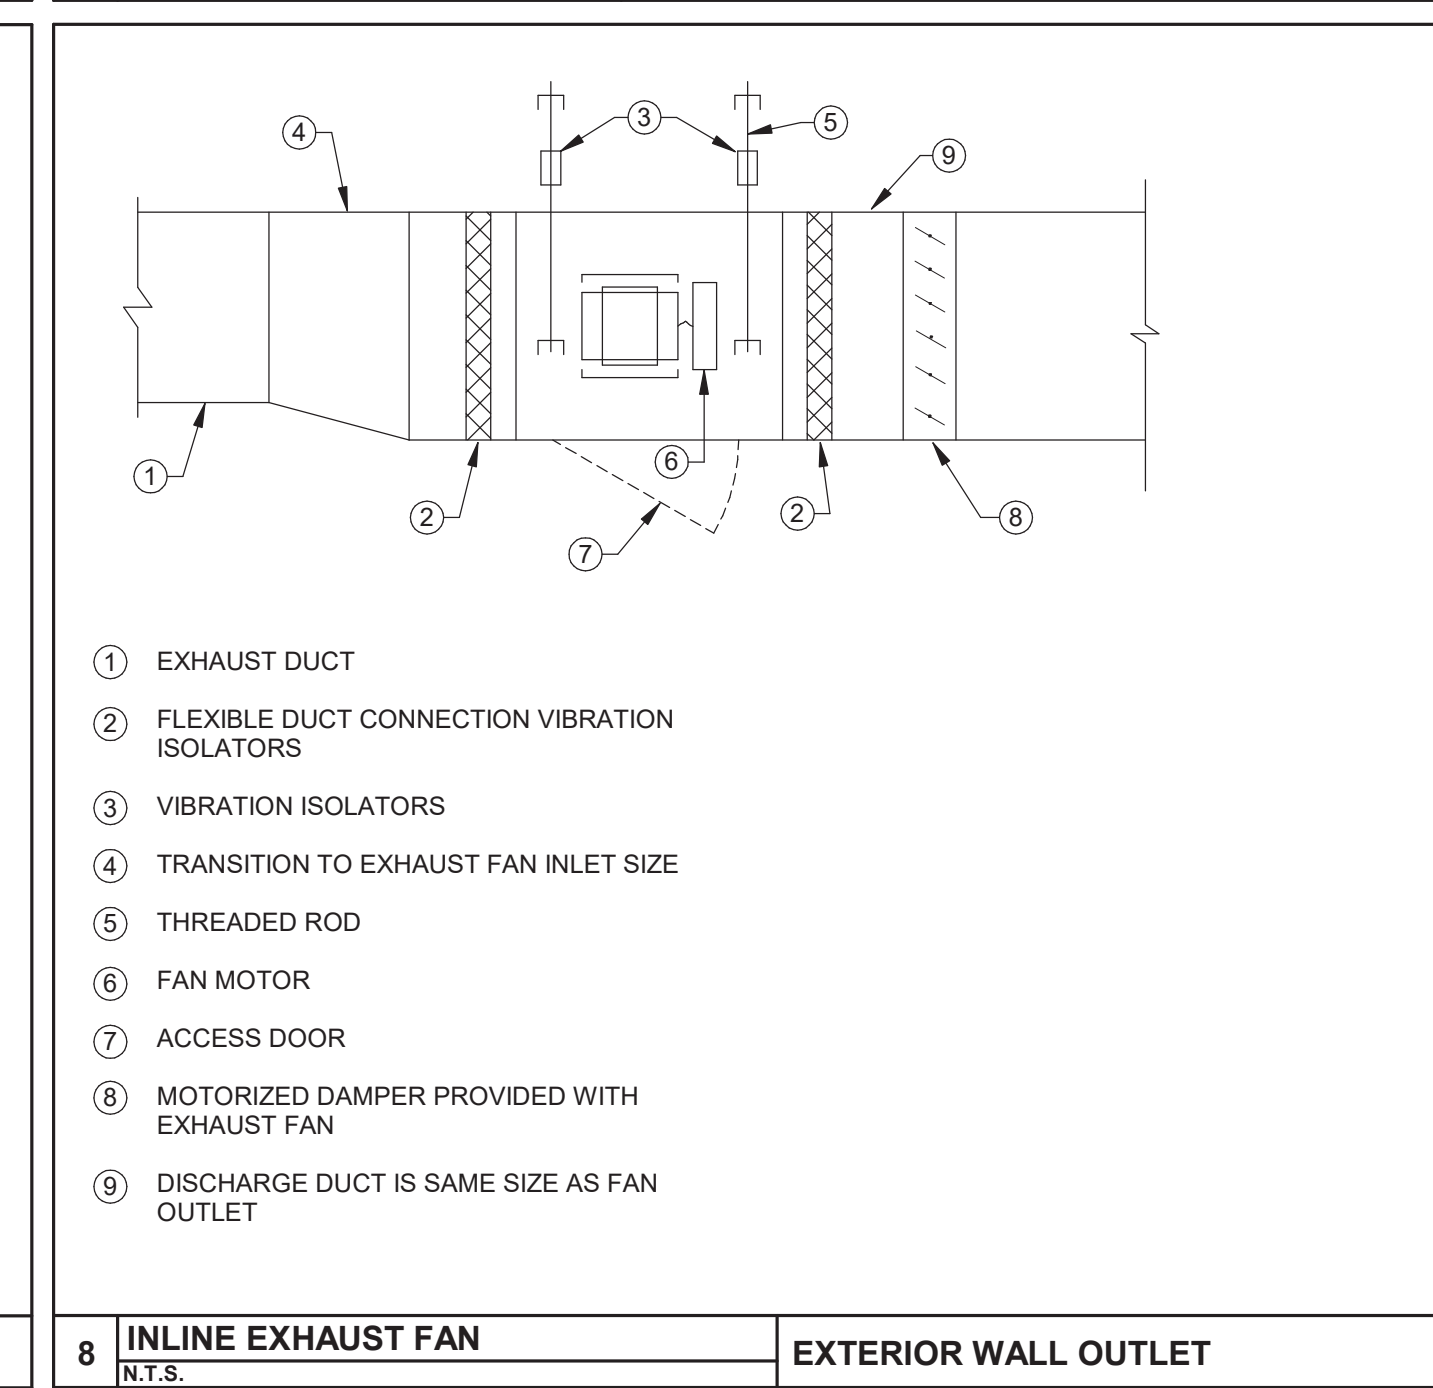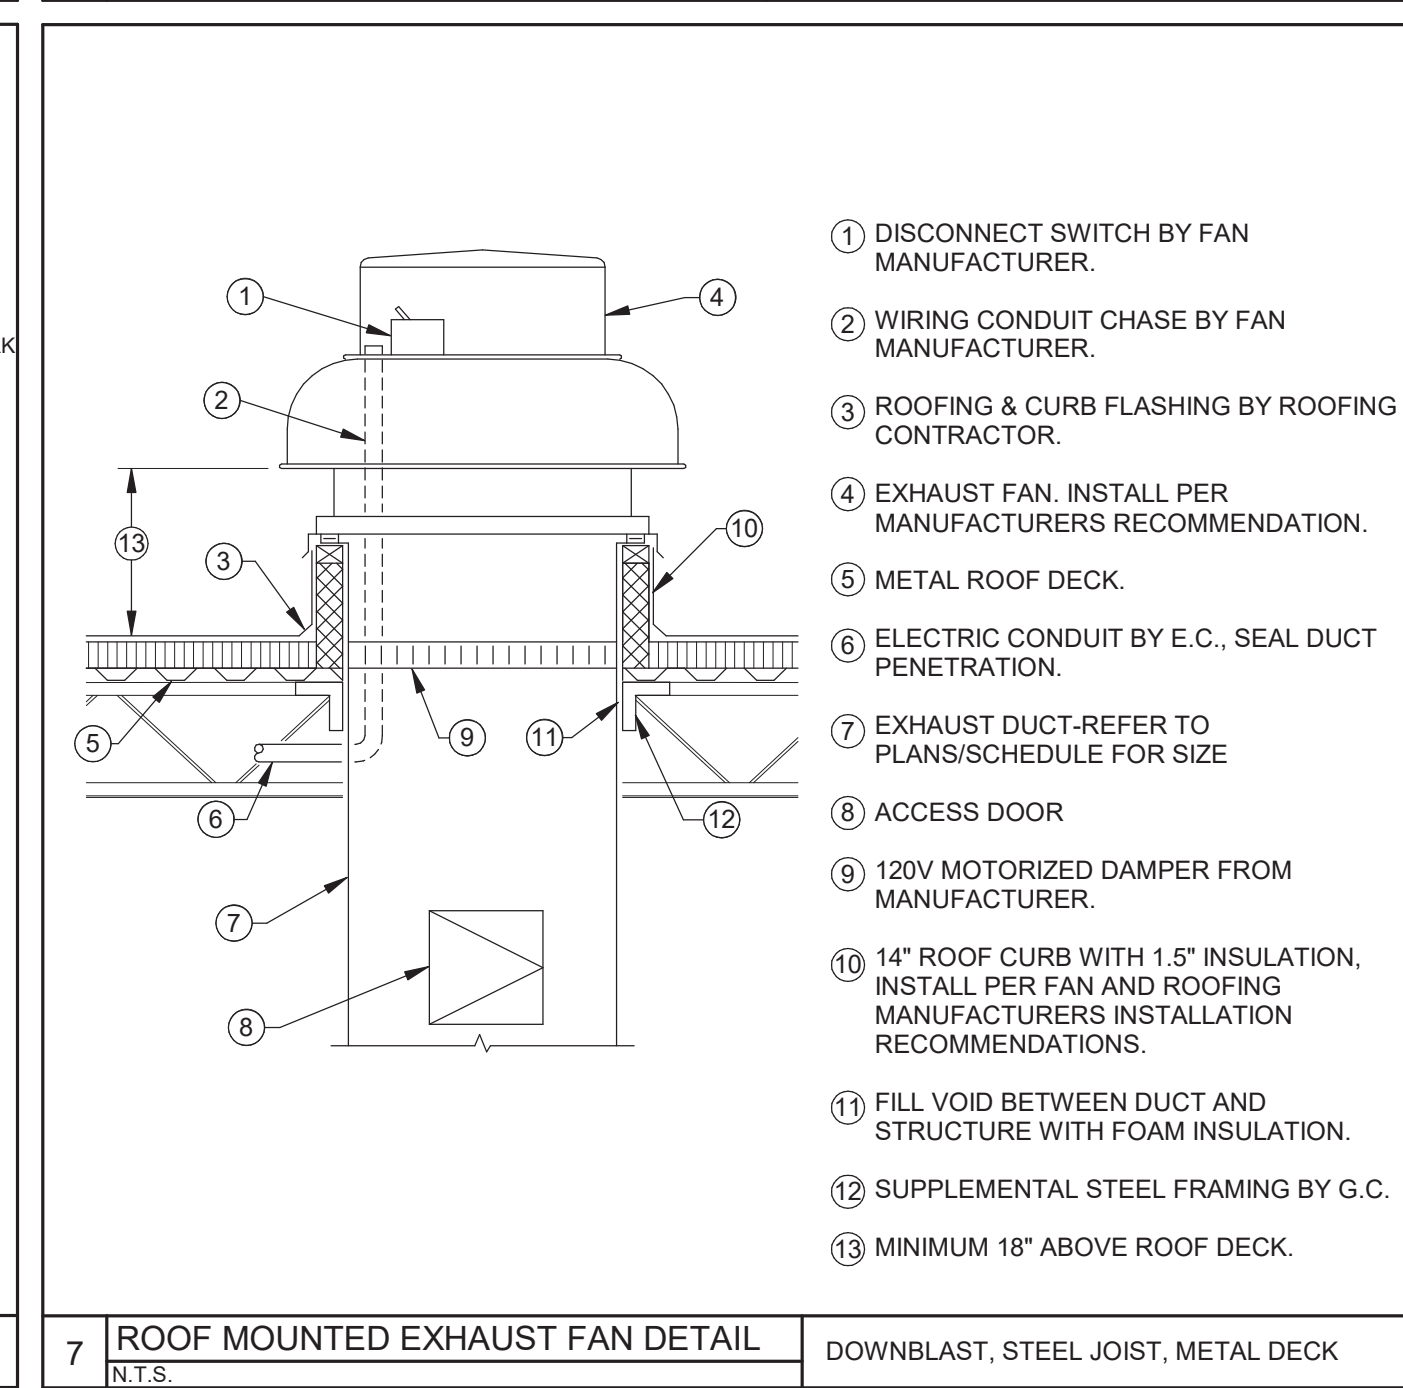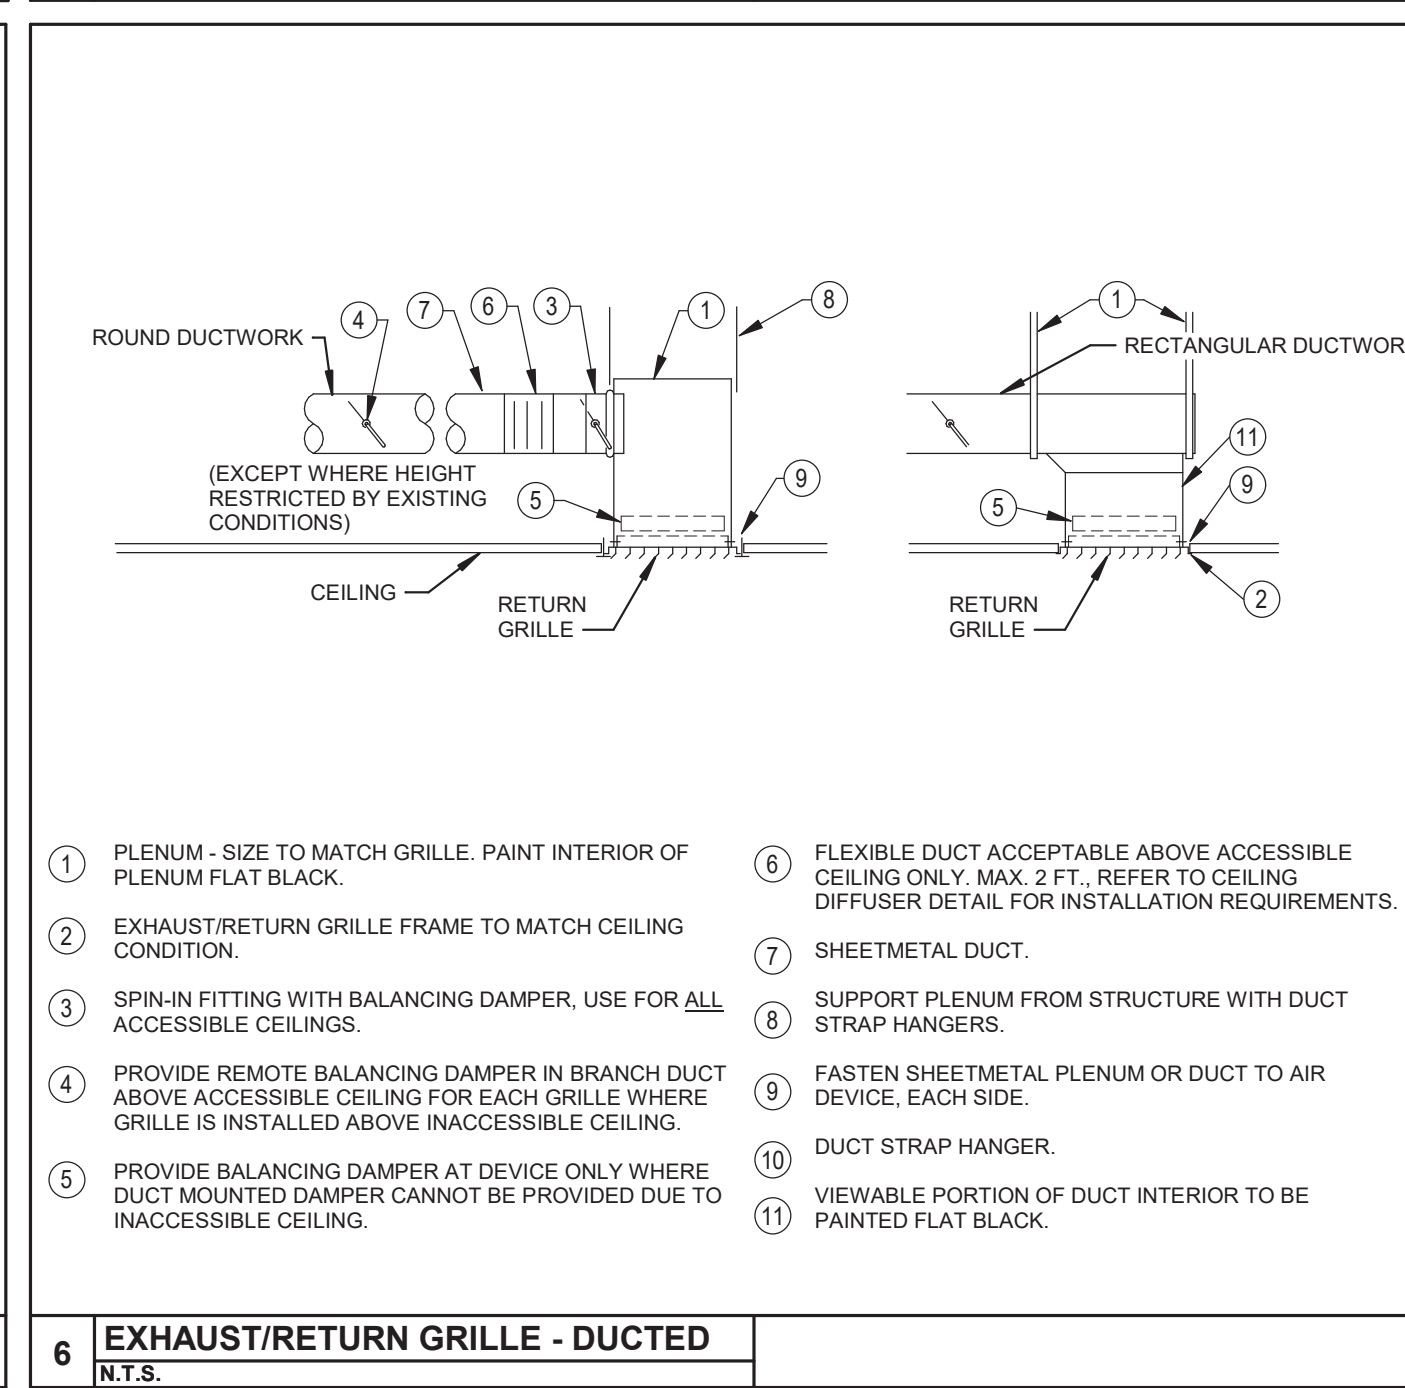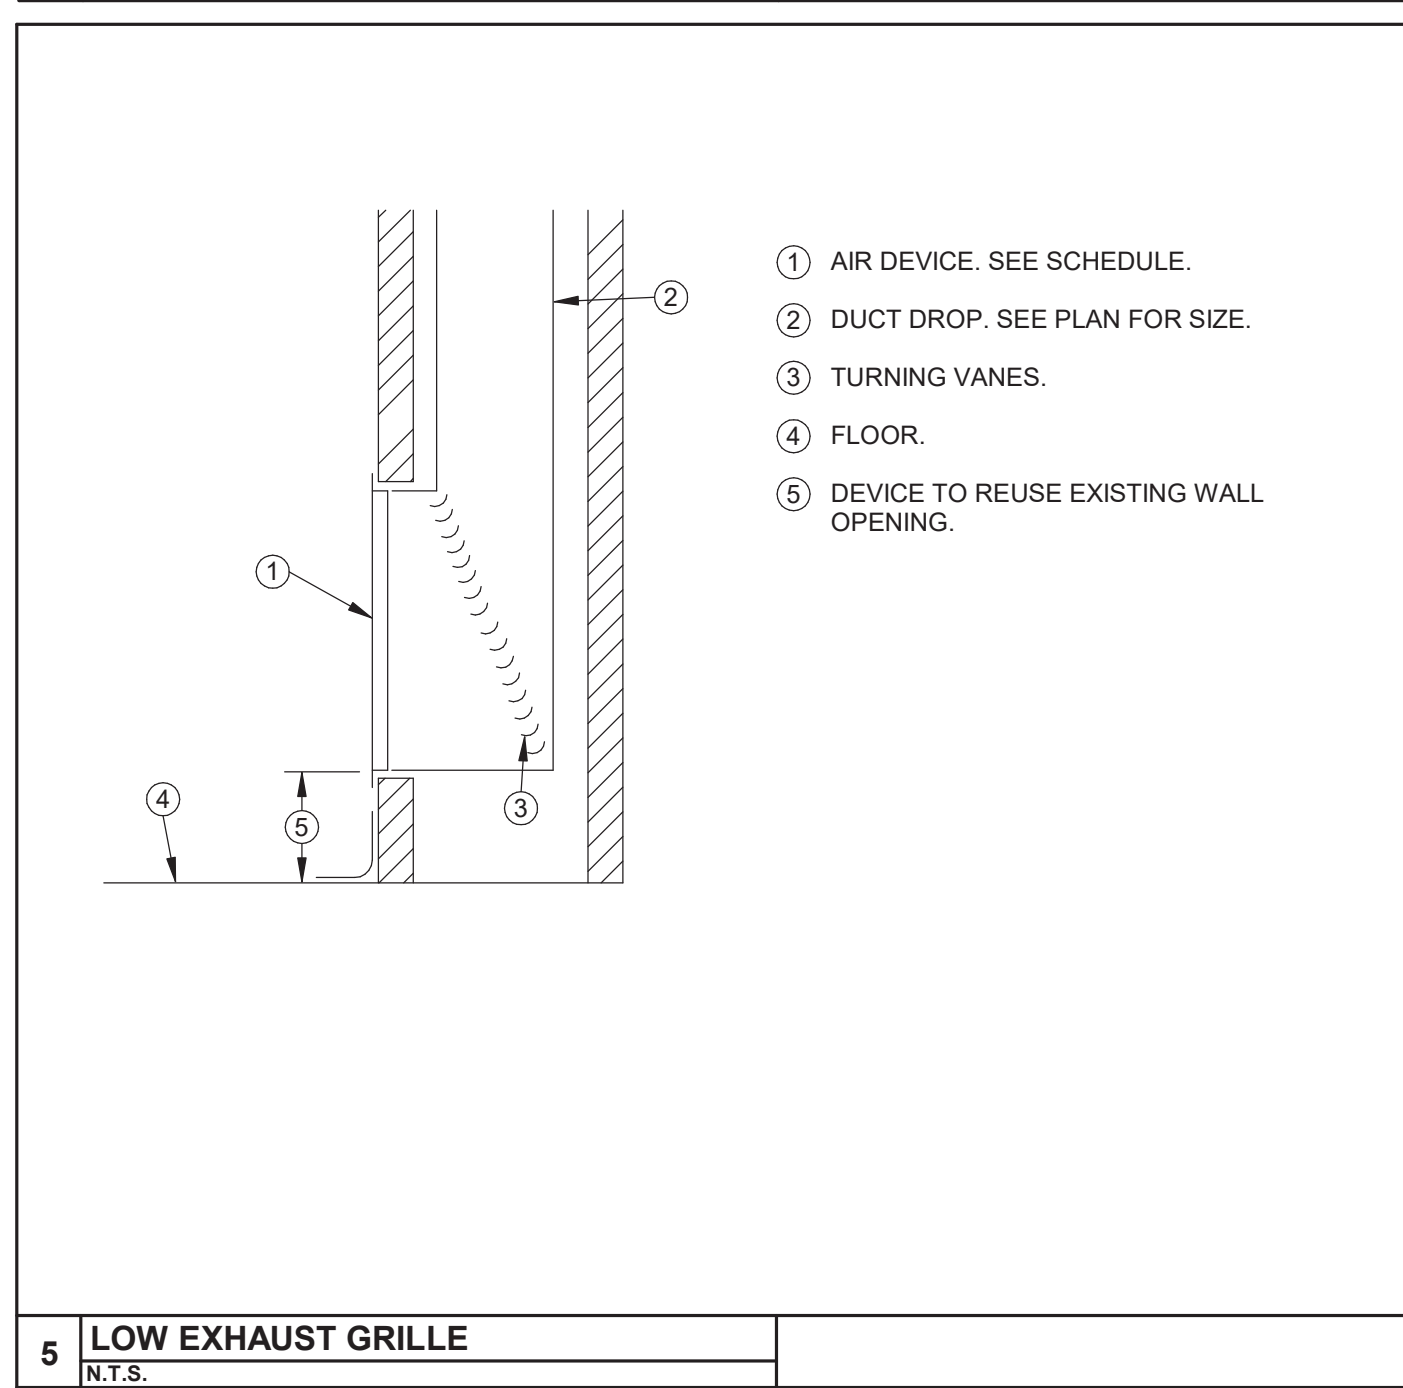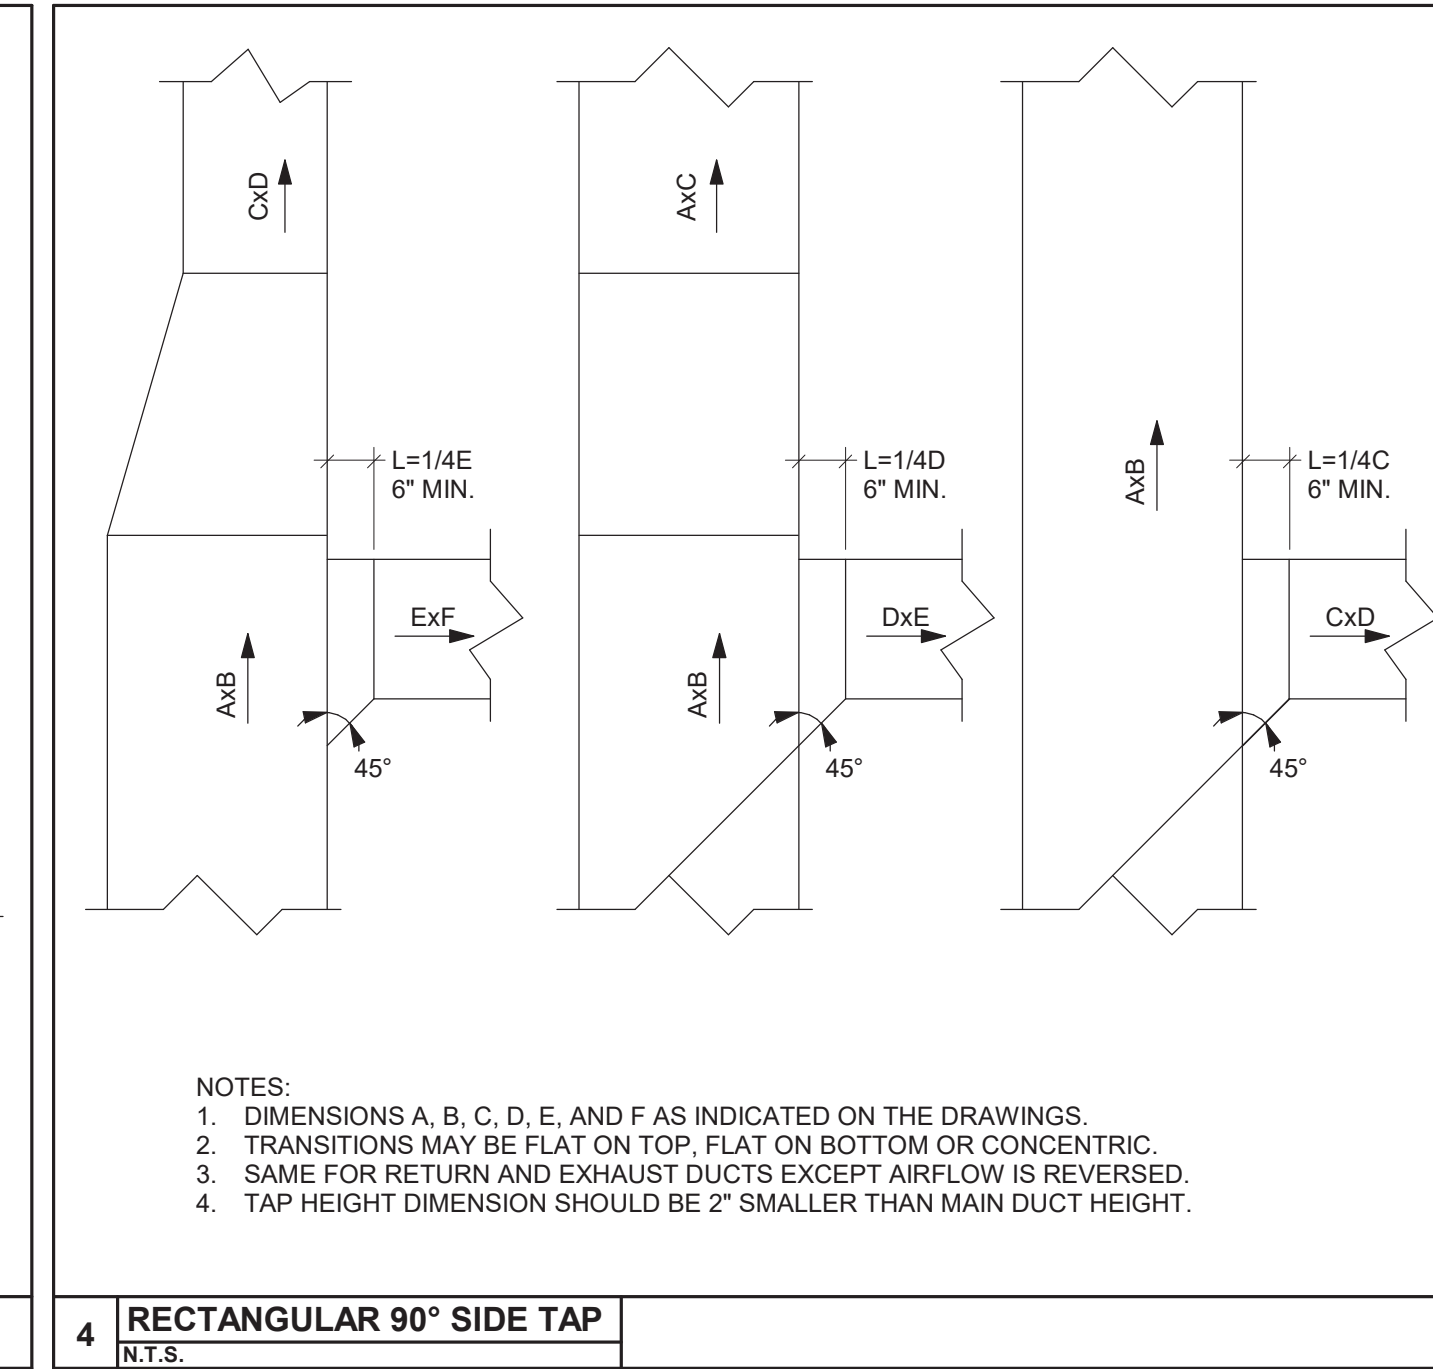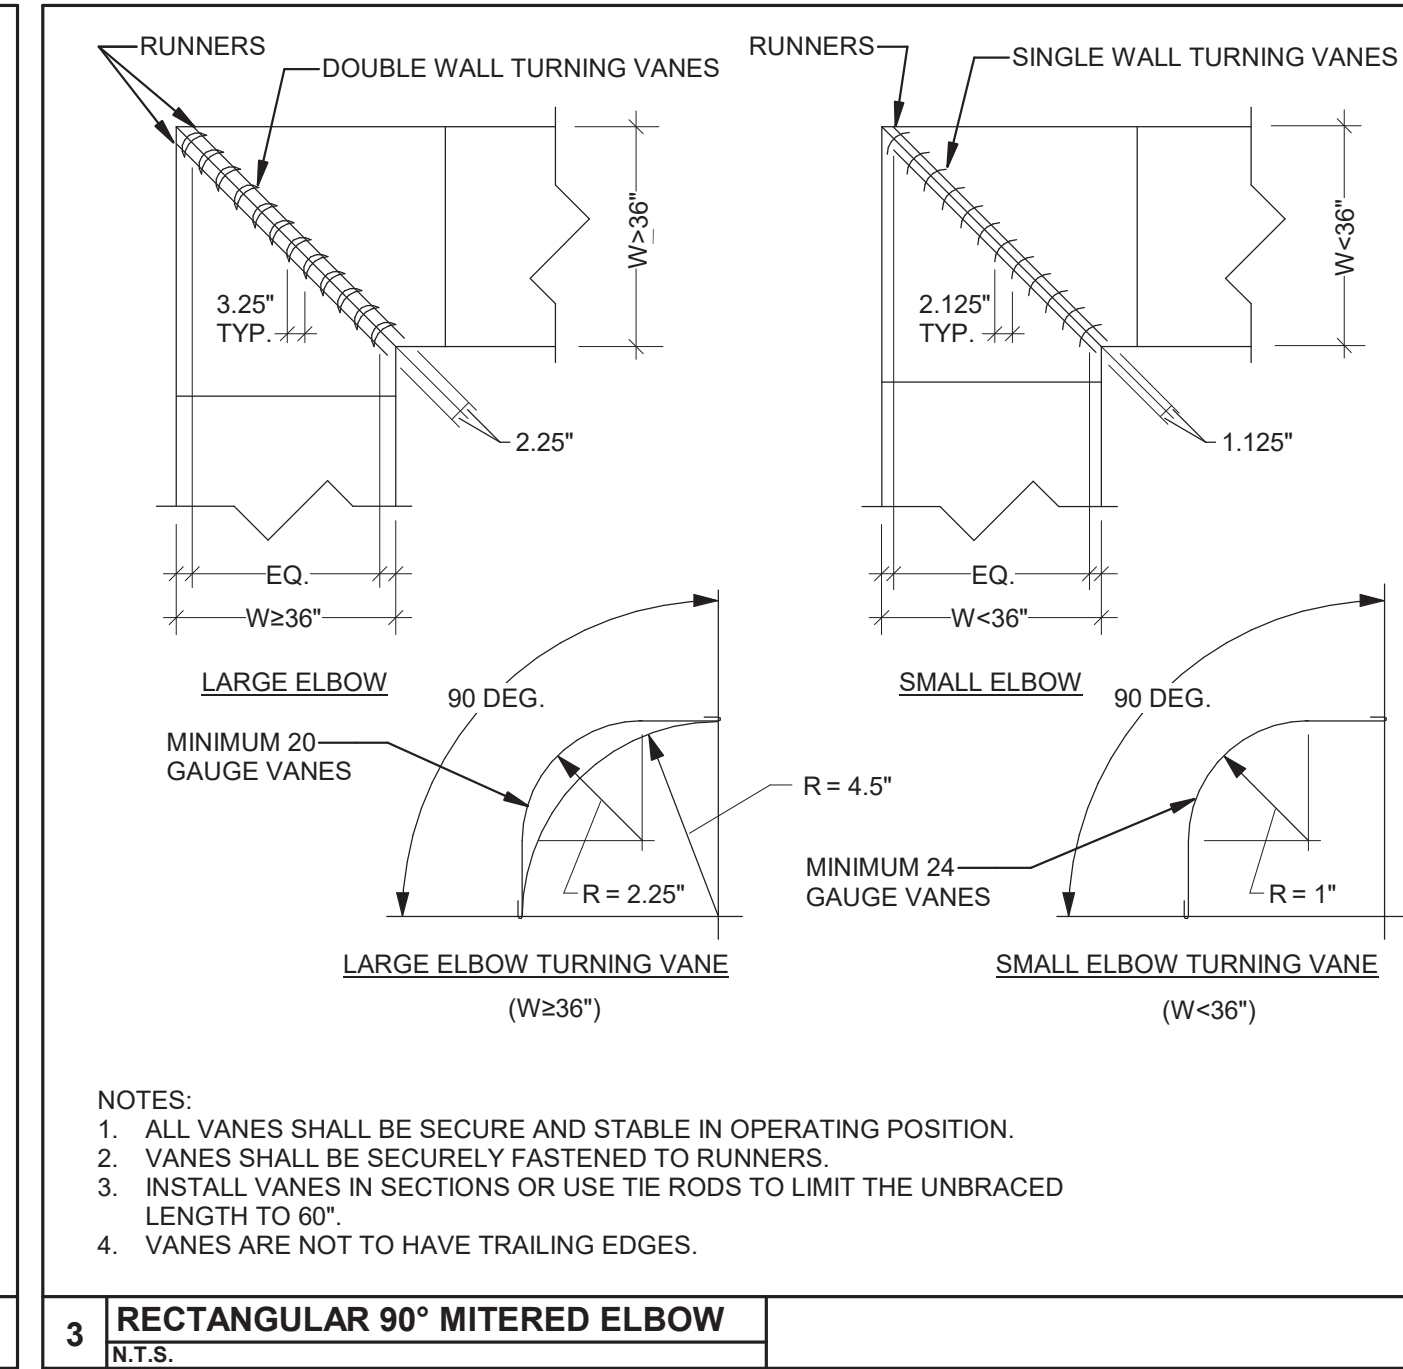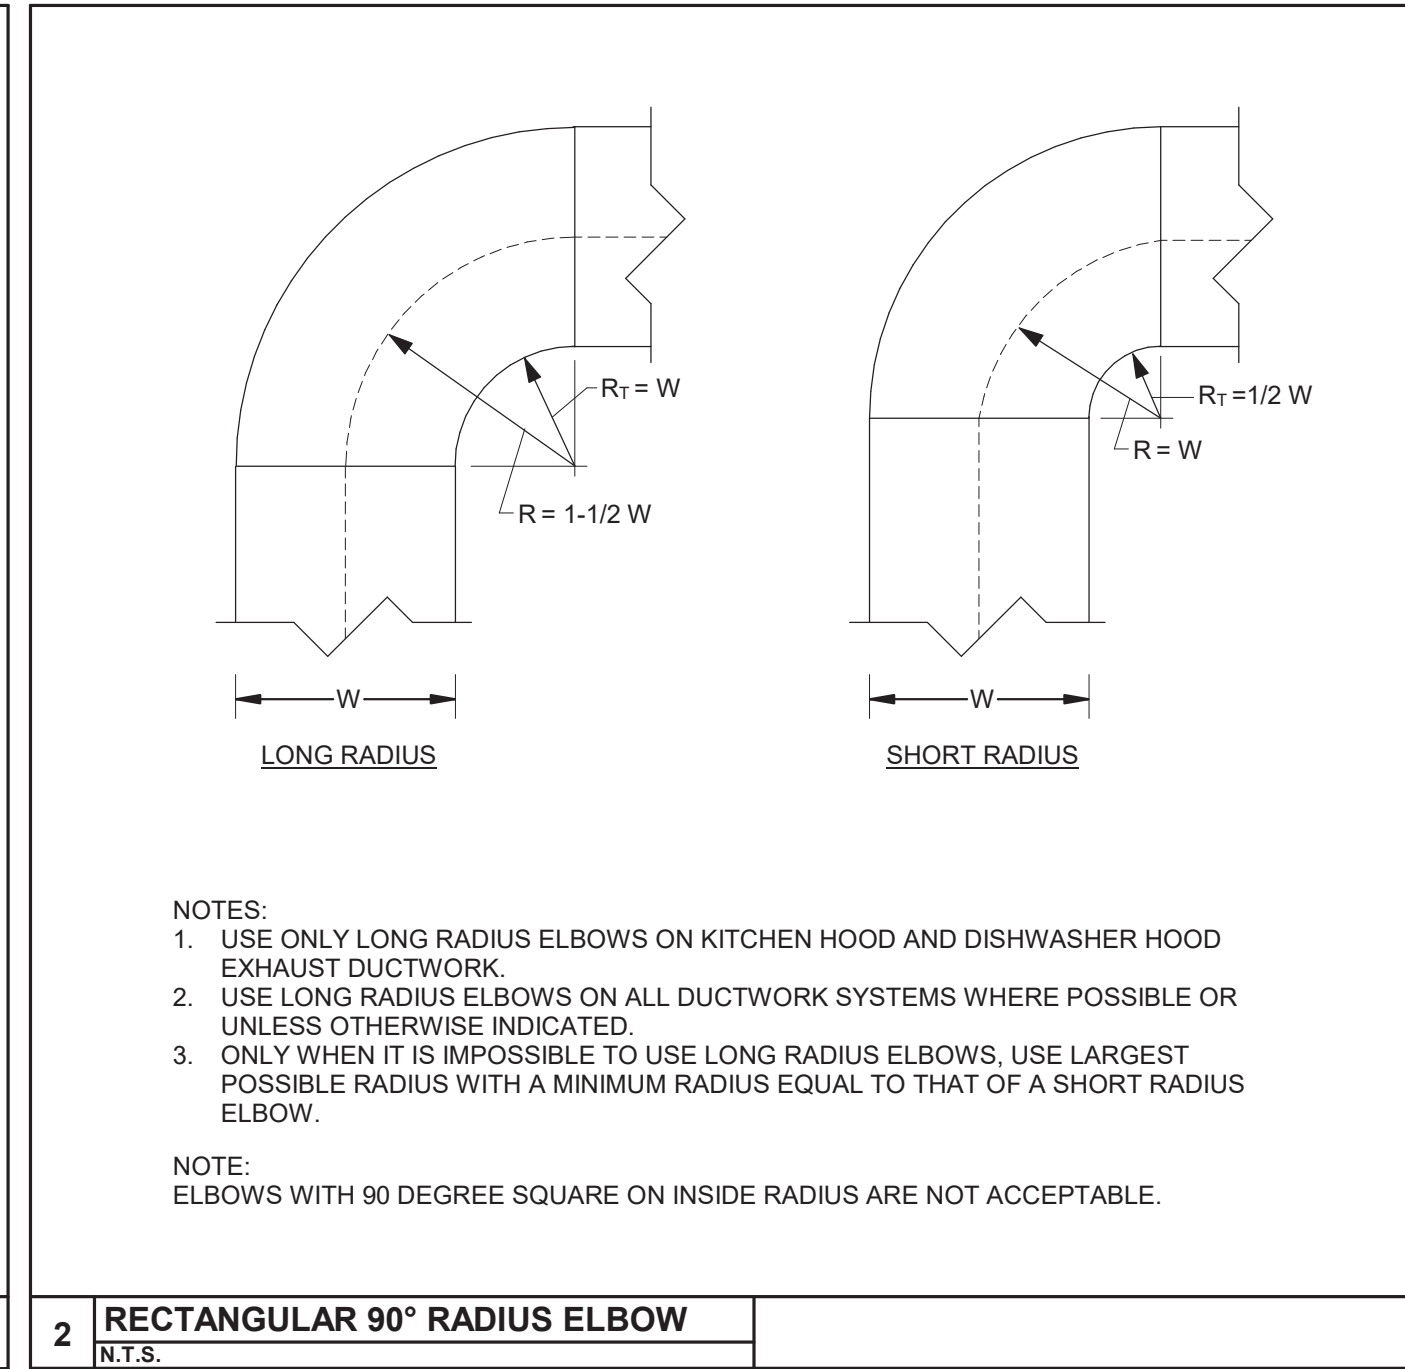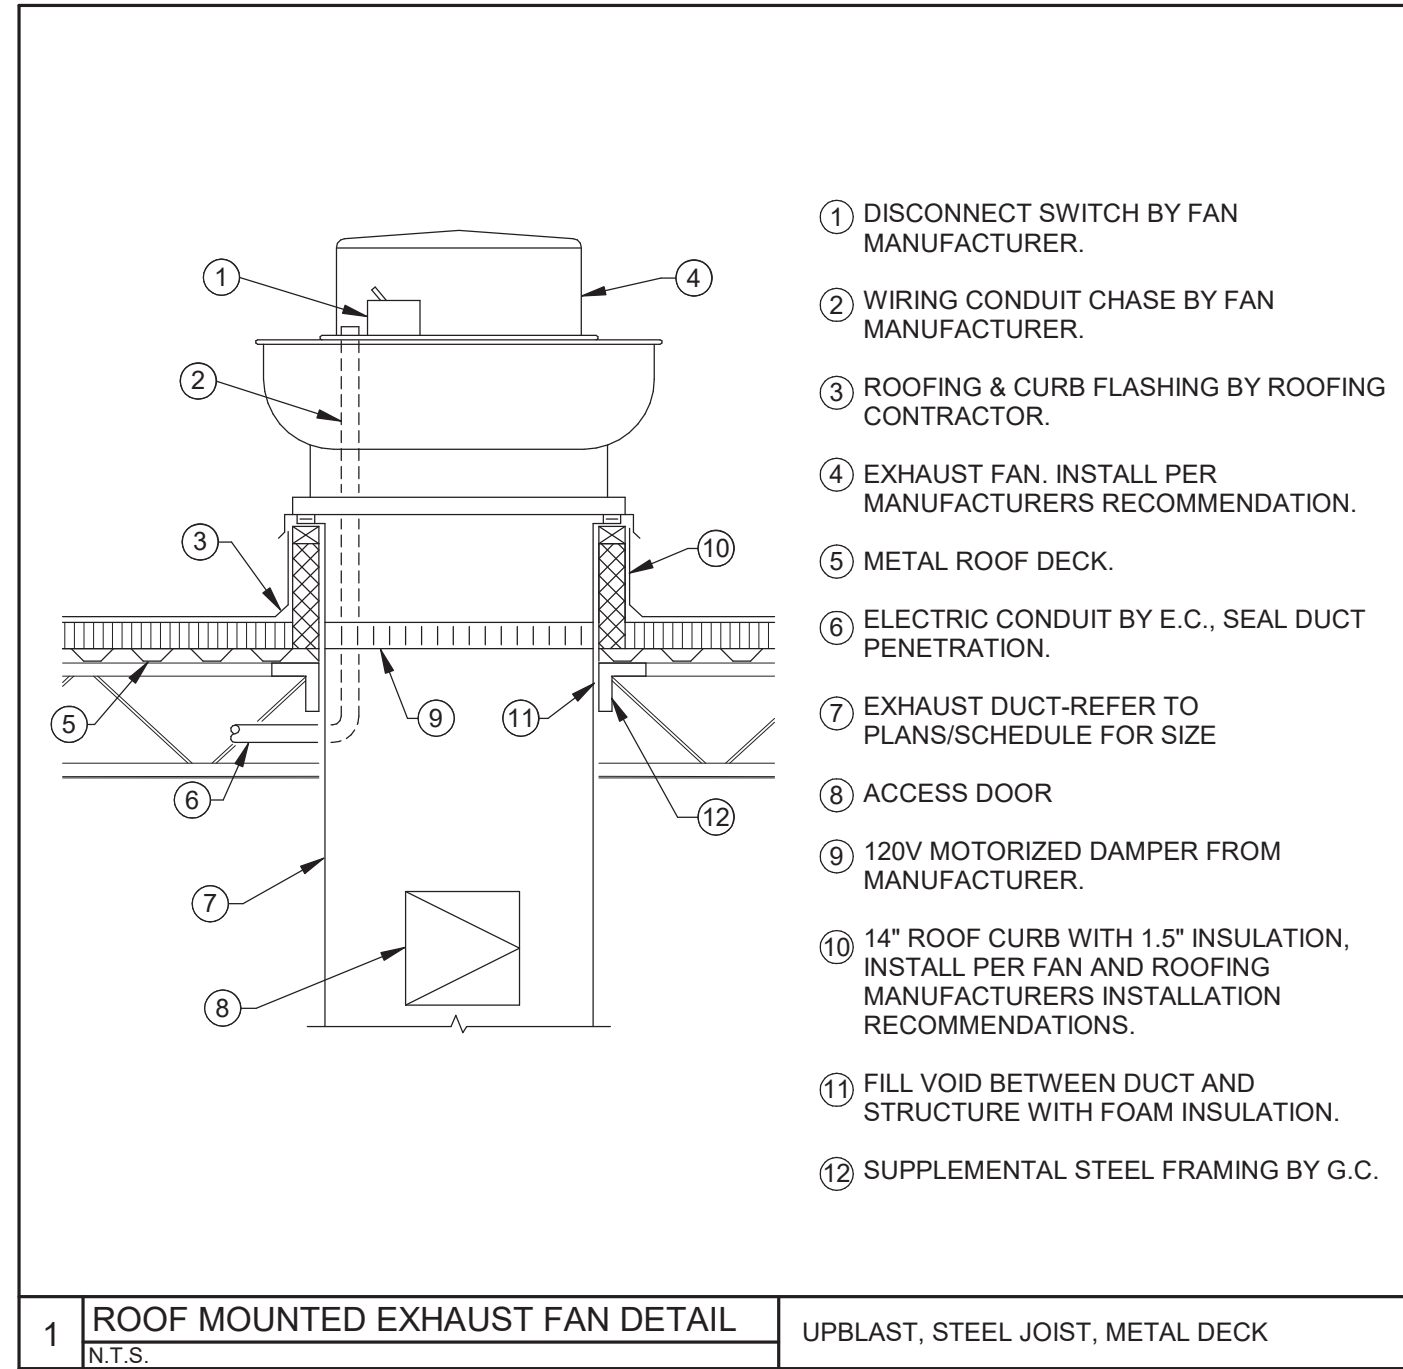

APP Architecture
creative focused design

JEFFREY D. ZELINSKI
63822

JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

615 Woodside Drive, Englewood, Ohio 45322
T 937.832.8898 F 937.832.3696
www.app-arch.com

DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, OH 45420

ISSUE

NO.	DATE	DESCRIPTION
-----	------	-------------

DATE 08/01/2025
JOB NO. 4284.00
DRAWN DJZ
CHECKED JDZ
COPYRIGHT © 2025 - App Architecture, Inc.
TITLE DETAILS
SHEET NO. H3.4

CONTROLLER NOTES

- 1 HAND/OFF/AUTO ECM FAN
CONTROLLER BY FAN MANUFACTURER.
MOUNTED IN FAN HOUSING OR IN
BUILDING ADJACENT TO FAN.
- 2 100 - 277V / 1 PHASE POWER TO
CONTROLLER.
- 3 MOTOR CONTROL: 0-10 VDC, 24V, &
COM.
- 4 DDC CONTROL SIGNAL: 0-10 VDC, 24V, &
COM.
- 5 AUX. CONTACT, LINE OR LOW VOLTAGE.
RATED FOR 10A @ 24-250V. N.O., N.C., &
COM.

— · · · — WIRING BY H.C.
 ————— WIRING BY E.C.
 - - - - - WIRING BY MANUFACTURER

DETAIL NOTES

- ① ECM FAN MOTOR
- ② TOGGLE DISCONNECT MOUNTED IN FAN HOUSING BY FAN MANUFACTURER.
- ③ THREE PHASE POWER SUPPLY WIRING BY MANUFACTURER.
- ④ DDC CONTROL WIRING TO FAN BY H.C.
- ⑤ DDC INPUT CONTROL WIRING BY H.C.
- ⑥ 120V POWER BY E.C.
- ⑦ TUGGLE MOUNTED MOTORIZED DAMPER BY FAN MANUFACTURER.
- ⑧ TOGGLE DISCONNECT SWITCH BY E.C.
- ⑨ 120V MOTORIZED DAMPER ACTUATOR PROVIDED BY H.C.
- ⑩ TAP 120V TO PROVIDE POWER TO BOTH HOA CONTROLLER AND DAMPER ACTUATOR.
- ⑪ WIRE 120V DAMPER POWER THROUGH AUXILIARY CONTACT.
- ⑫ FAN SUPPLY CIRCUIT BY E.C.

1	HOA CONTROLLER - THREE PHASE ECM FAN WIRING DIAGRAM
	N.T.S.

CONTROLLER NOTES

- 1 HAND/OFF/AUTO ECM FAN CONTROLLER BY FAN MANUFACTURER. MOUNTED IN FAN HOUSING OR IN BUILDING ADJACENT TO FAN.
- 2 100 - 277V / 1 PHASE POWER TO CONTROLLER.
- 3 MOTOR CONTROL: 0-10 VDC, 24V, & COM.
- 4 DDC CONTROL SIGNAL: 0-10 VDC, 24V, & COM.
- 5 AUX. CONTACT, LINE OR LOW VOLTAGE RATED FOR 10A @ 24-250V. N.O., N.C., & COM.

— · · · — WIRING BY H.C.
 ————— WIRING BY E.C.
 - - - - - WIRING BY MANUFACTURER

DETAIL NOTES

- ① ECM FAN MOTOR.
- ② TOGGLE DISCONNECT MOUNTED IN FAN HOUSING BY FAN MANUFACTURER.
- ③ SINGLE PHASE WIRING BY MANUFACTURER.
- ④ CONTROL WIRING BY MANUFACTURER.
- ⑤ DDC INPUT CONTROL WIRING BY H.C.
- ⑥ LINE VOLTAGE TO POWER MOTORIZED DAMPER BY E.C. TAP ON LOAD SIDE OF TOGGLE SWITCH. PROVIDES POWER TO HOA CONTROLLER AND DAMPER ACTUATOR.
- ⑦ DUCT MOUNTED MOTORIZED DAMPER BY FAN MANUFACTURER.
- ⑧ SUPPLY CIRCUIT POWER TO DISCONNECT BY E.C.
- ⑨ 120V MOTORIZED DAMPER ACTUATOR PROVIDED BY H.C.
- ⑩ WIRE 120V DAMPER POWER THROUGH AUXILIARY CONTACT.

2	HOA CONTROLLER - SINGLE PHASE ECM FAN WIRING DIAGRAM
	N.T.S.

- ① ELECTRICAL DISCONNECT W/ GFI RECEPTACLE SUPPLIED BY UNIT MANUFACTURER. POWER CONN. BY E.C. POWER ROUTED THROUGH ROOF CURB INTO UNIT.
- ② CONDENSATE DRAIN, REFER TO DETAIL
- ③ PROVIDE CONCRETE SPLASH BLOCK ON NEOPRENE PAD UNDER CONDENSATE DRAIN
- ④ FILL ALL VOIDS BETWEEN ROOF DECK & BOTTOM OF UNIT WITH UNFACED BATT INSULATION
- ⑤ EXTERNALLY INSULATED SUPPLY DUCT, REFER TO PLANS FOR SIZE
- ⑥ PROVIDE TWO LAYERS OF 5/8" WATER RESISTANT GYPSUM BOARD ON ROOF DECK
- ⑦ RETURN DUCT, REFER TO PLANS FOR SIZE
- ⑧ SEAL AROUND DUCT PENETRATIONS, TYP.
- ⑨ ROOF OPENINGS SHALL BE NO LARGER THAN REQUIRED FOR DUCT PENETRATIONS.
- ⑩ STRUCTURAL SUPPORT BY OTHERS, TYP.

- (11) FLASHING, CANT STRIPS (IF REQUIRED), ROOFING MATERIAL & ROOF CONSTRUCTION BY ROOFING CONTRACTOR
- (12) 14" HIGH INSULATED ROOF CURB PROVIDED BY THE H.C. SEE DETAIL.
- (13) COUNTER FLASHING BY H.C.
- (14) NAILING STRIP
- (15) ROOFTOP UNIT - REFER TO PLANS FOR CAPACITIES
- (16) DUCT TRANSITION AS REQUIRED, TYP.
- (17) FLEXIBLE DUCT CONNECTION, TYP.

3	ROOFTOP UNIT
	N.T.S.

- ① DRAIN PIPE. SAME SIZE AS UNIT OUTLET.
- ② CLEANOUT PLUG.
- ③ UNION.
- ④ SIDE OF ROOFTOP UNIT.
- ⑤ FROM DRAIN PAN.
- ⑥ 14" HIGH ROOF CURB. SEE DETAIL.
- ⑦ DRAINAGE WYE FITTING.
- ⑧ ROOF INSULATION.
- ⑨ ROOF DECK.
- ⑩ ROOFING MEMBRANE.
- ⑪ OPEN DRAIN - 1" AIR GAP.
- ⑫ ALTERNATE ROUTING OF DRAIN.
- ⑬ 12"x12"x1" THICK CONCRETE SPLASH BLOCK. PLACE ON TOP OF ADDITIONAL PIECE OF ROOFING MEMBRANE.
- ⑭ ROOF DRAIN.
- ⑮ ADJUSTABLE PIPE SUPPORT. ERICO CADDY PYRAMID EZ OR EQUAL. SET SUPPORT ON MEMBRANE.

CALCULATIONS:
a = SUPPLY FAN T.S.P. + 1"
b = a / 2

-VERIFY FAN T.S.P. WITH UNIT MANUFACTURER

4	ROOFTOP COOLING COIL CONDENSATE PIPING
	N.T.S.

- ① MOUNT TO EXTERIOR WALL ON UNISTRUT FRAMING. MOUNT 9'-0" ABOVE GRADE.
- ② INSULATED SUCTION, LIQUID REFRIGERANT PIPING LINE SETS WITH QUICK CONNECTIONS.
- ③ CONDENSATE PIPING, 1/2" SIZE.
- ④ WALL MOUNTED MICROPROCESSOR CONTROLLER WITH LCD DISPLAY, TEMPERATURE SETPOINT ADJUSTMENT, ALARM WITH SILENCE AND UNIT ON/OFF SELECTION. CONCEALED WIRING BY H.C.
- ⑤ DISCONNECT SWITCH, ELECTRICAL POWER FEED BY E.C.
- ⑥ WALL MOUNTED EVAPORATOR UNIT.
- ⑦ CONTROL WIRING BETWEEN EVAPORATOR AND CONDENSING UNIT BY H.C. ROUTE IN CONDUIT WITH REFRIGERANT PIPING.

NOTE: ALL EXPANDED PIPING AND CONTROL WIRING SHALL BE CONCEALED IN A PIPE SHROUD, COLOR TO MATCH WALL.


5	SPLIT SYSTEM - WALL MOUNTED UNIT
	NTS

- | | | | |
|---|---|----|--|
| 1 | 12" ROOF RAIL CURB. | | |
| 2 | CONDENSING UNIT. | 9 | DUCT FLOOR PENETRATION. SUPPLEMENTAL FRAMING BY G.C. |
| 3 | REFRIGERANT PIPING UP ON INTERIOR WALL. SECURE TO WALL WITH PIPE CLAMP. | 10 | POWER BY E.C. |
| 4 | MULTI-POSITION AHU. | 11 | REFRIGERANT PIPING TO CONDENSING UNIT. |
| 5 | FILTER KIT PROVIDED WITH UNIT. | 12 | CARBON FILTER. EQUAL TO CAMFIL #CC-PG-LGX048. PROVIDE 1" FILTER FRAME FROM CAMFIL. |
| 6 | MOUNT UNIT ON 18" TALL FRAME. | | |
| 7 | CONDENSATE DRAIN. ROUTE TO FLOOR DRAIN. PROVIDE TRAP PER MANUFACTURER INSTRUCTIONS. | | |
| 8 | REMOTE ROOM THERMOSTAT. | | |


NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 223-3821
PROJECT # 24065

6	SPLIT SYSTEM - MULTI-POSITION AHU
	NTS


7/31/2025 8:51:45 AM

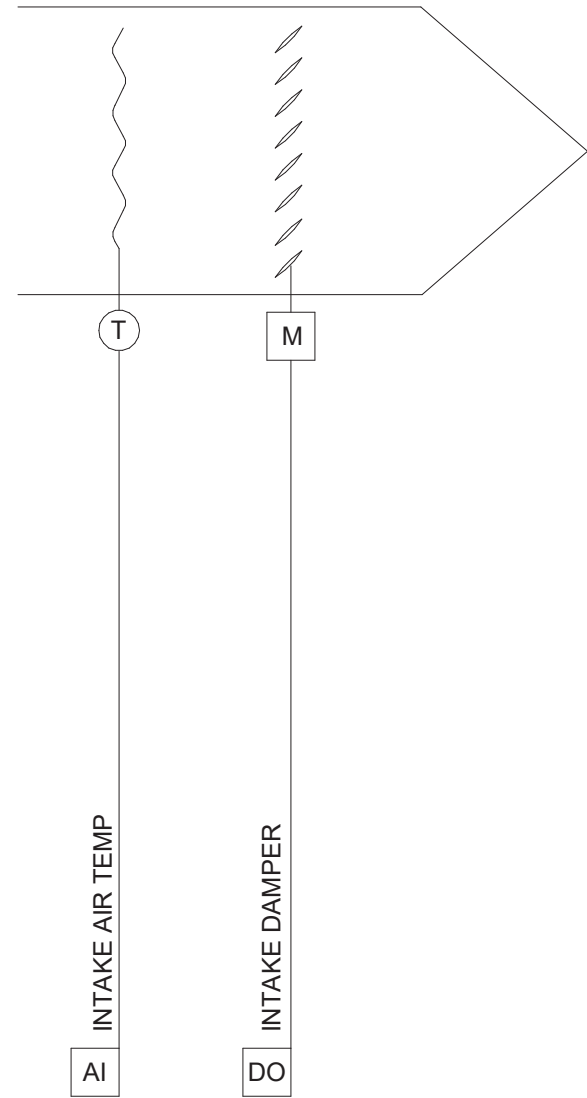


MAKEUP AIR DAMPER

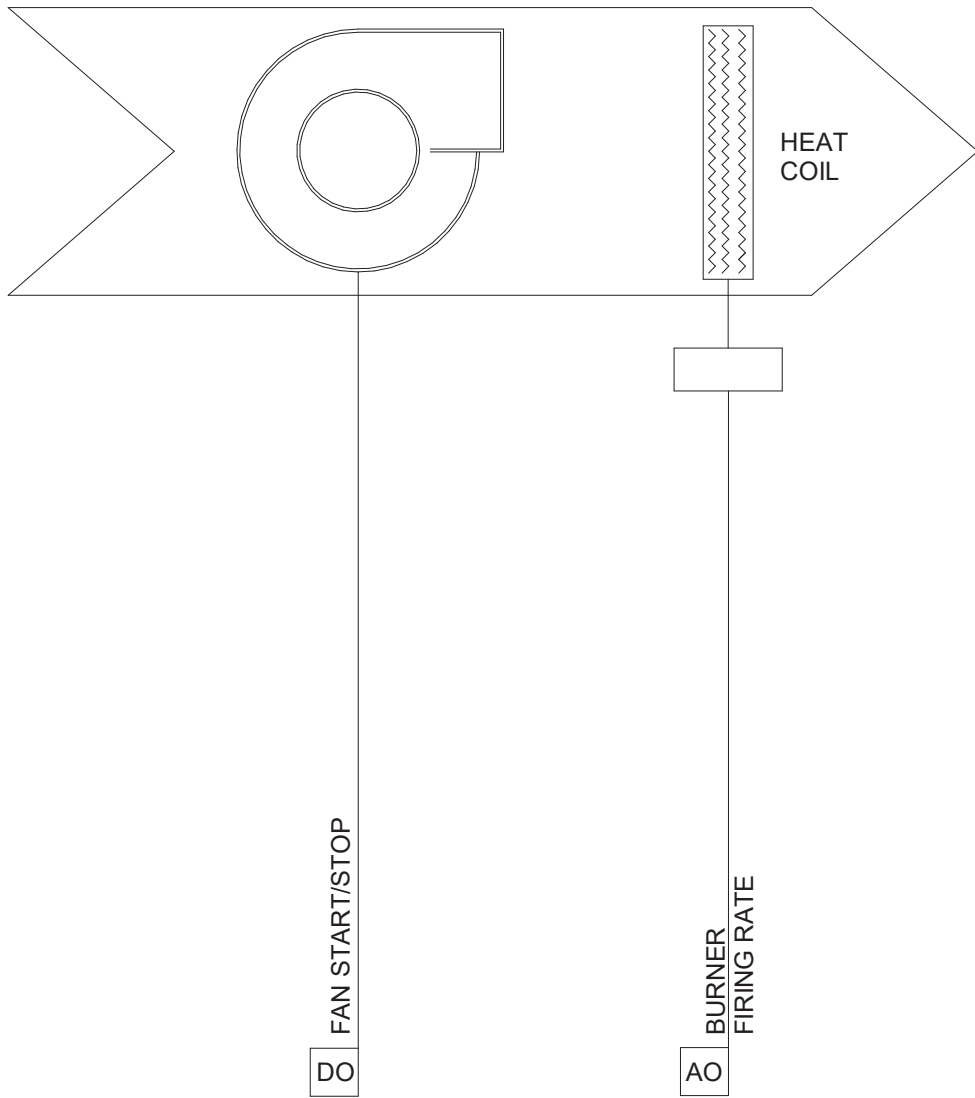


GAS FIRED UNIT HEATER

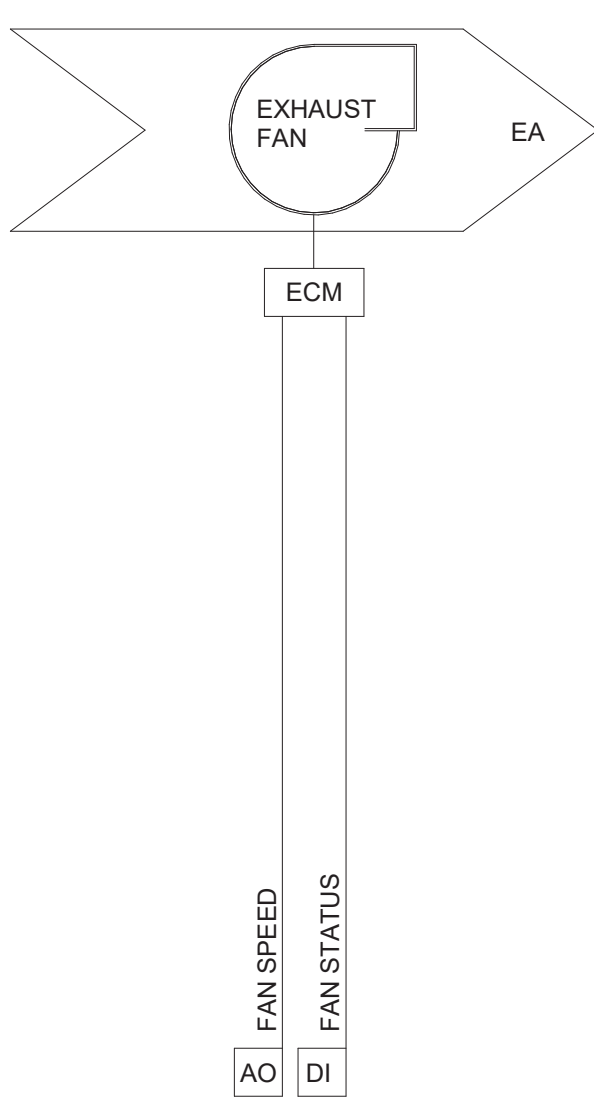

EF-5 CONTROLS -
MINIMUM VENTILATION

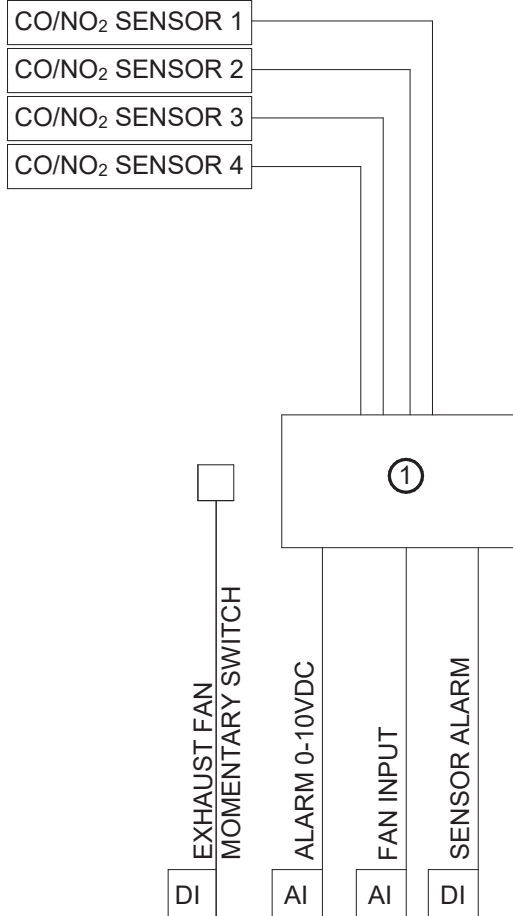

EF-4 CONTROLS - MAIN VENTILATION

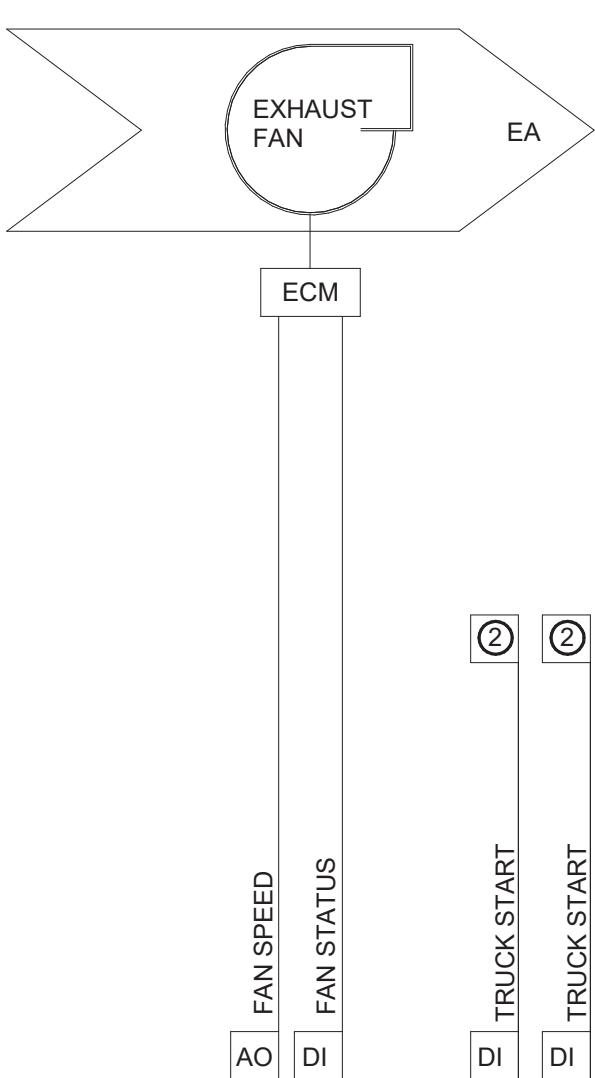

- ① CO/NO₂ CONTROL PANEL BY T.C. SEE H1.2 FOR MOUNTING LOCATION AND REFER TO SPECIFICATIONS FOR EQUIPMENT INFORMATION
- ② NEDERMAN AUTO START RECEIVER - PART # 89115581 PROVIDED BY T.C.

SEQUENCE OF OPERATION

OUTDOOR AIR DAMPER

THE OUTDOOR AIR DAMPER SHALL OPEN TO 100% WHEN EF-3 IS OPERATING.

DAMPER SHALL BE CLOSED WHEN EF-3 IS OFF.

THE INTAKE AIR TEMPERATURE SENSOR SHALL CONTROL THE GAS FIRED UNIT HEATER, GUH-1, BURNER FIRING RATE.

GAS FIRED UNIT HEATER

THE GAS-FIRED MODULATING HEATER SHALL OPERATE IN CONJUNCTION WITH THE INTAKE DAMPER TO PREHEAT INDUCED MAKE-UP AIR.

THE GAS-FIRED UNIT HEATER SHALL BE OFF WHEN THE INTAKE DAMPER IS CLOSED.

WHEN THE INTAKE DAMPER IS OPEN, THE UNIT FAN SHALL START AND THE BURNER SHALL FIRE WHEN THE INTAKE TEMPERATURE IS AT OR BELOW 40 DEG. F. (ADJ.) VIA THE INTEGRAL CONTROLLER.

MANUAL MOMENTARY WALL SWITCH

THE MANUAL MOMENTARY OVER-RIDE SWITCH SHALL COMMAND THE FAN TO 50% OF MAXIMUM AIRFLOW FOR 30 MINUTES (ADJ.).

EF-3 OPERATION

EF-3 SHALL OPERATE CONTINUOUSLY.

EF-4 OPERATION

EF-4 SHALL BE NORMALLY OFF.

THE FAN SHALL START UPON THE DDC SYSTEM RECEIVING AN ALARM FROM THE CO/NO₂ MONITORING SYSTEM, ACTIVATION FROM THE NEDERMAN TRUCK START RECEIVERS, OR A LOCAL MANUAL, MOMENTARY, OVER-RIDE WALL PUSH BUTTON.

CO/NO₂ SENSOR CONTROL

THE APPARATUS BAY'S CO/NO₂ SHALL BE PROGRAMMED TO THE FOLLOWING ALARM LEVELS.

ALARM LEVELS:

- NO ALARM: CO (<34 PPM) AND NO₂ (<2.5 PPM)
- ALARM LEVEL 1: CO (35 - 50 PPM) OR NO₂ (2.5 - 2.8 PPM)
- ALARM LEVEL 2: CO (>50 PPM) OR NO₂ (>2.8 PPM)

FAN AIRFLOW:

- NO ALARM: OFF
- ALARM LEVEL 1: 50% OF MAXIMUM AIRFLOW
- ALARM LEVEL 2: MAXIMUM AIRFLOW

WHEN THE FAN IS INDEXED TO EITHER THE 50% OR MAXIMUM AIRFLOW, THE FAN SHALL RUN FOR A MINIMUM OF 30 MINUTES (ADJ.) AT THE RESPECTIVE AIRFLOW.

TRUCK START SIGNAL

UPON A SIGNAL FROM ANY OF THE FIVE (5) TRUCK START RECEIVERS, THE FAN SHALL RUN AT MAXIMUM AIRFLOW FOR 5 MINUTES.

MANUAL MOMENTARY WALL SWITCH


THE MANUAL MOMENTARY OVER-RIDE SWITCH SHALL COMMAND THE FAN TO 50% OF MAXIMUM AIRFLOW FOR 30 MINUTES (ADJ.).

FAN SPEED CONTROL PRIORITY

THE CO/NO₂ SENSOR SHALL HAVE PRIORITY TO CHANGE THE FAN SPEED AT ANY TIME. IF THE MOMENTARY WALL SWITCH IS ACTIVATED TO RAISE THE FAN TO 50% AIRFLOW AND THE CO/NO₂ SENSOR ALARMS, THE FAN SHALL BE INDEXED TO RUN AT THE RESPECTIVE ALARM LEVEL AND RESET ITS RUN TIMER.

IF THE TRUCK START SIGNAL HAS ACTIVATED THE FAN AND A CO/NO₂ ALARM IS RECEIVED, THE FAN RUNTIME SHALL RESET TO 30 MINUTES. THE MOMENTARY FAN SWITCH SHALL ONLY START THE FAN SPEED IF THERE IS NO ALARM LEVEL FROM THE CO/NO₂ SENSOR OR TRUCK SIGNAL, AND THE FAN IS OFF. THE MOMENTARY WALL SWITCH SHALL NOT OVERRIDE THE CO/NO₂ CONTROLLER OR TRUCK START.

4 EF-4 - APPARATUS BAY CONTROL DIAGRAM

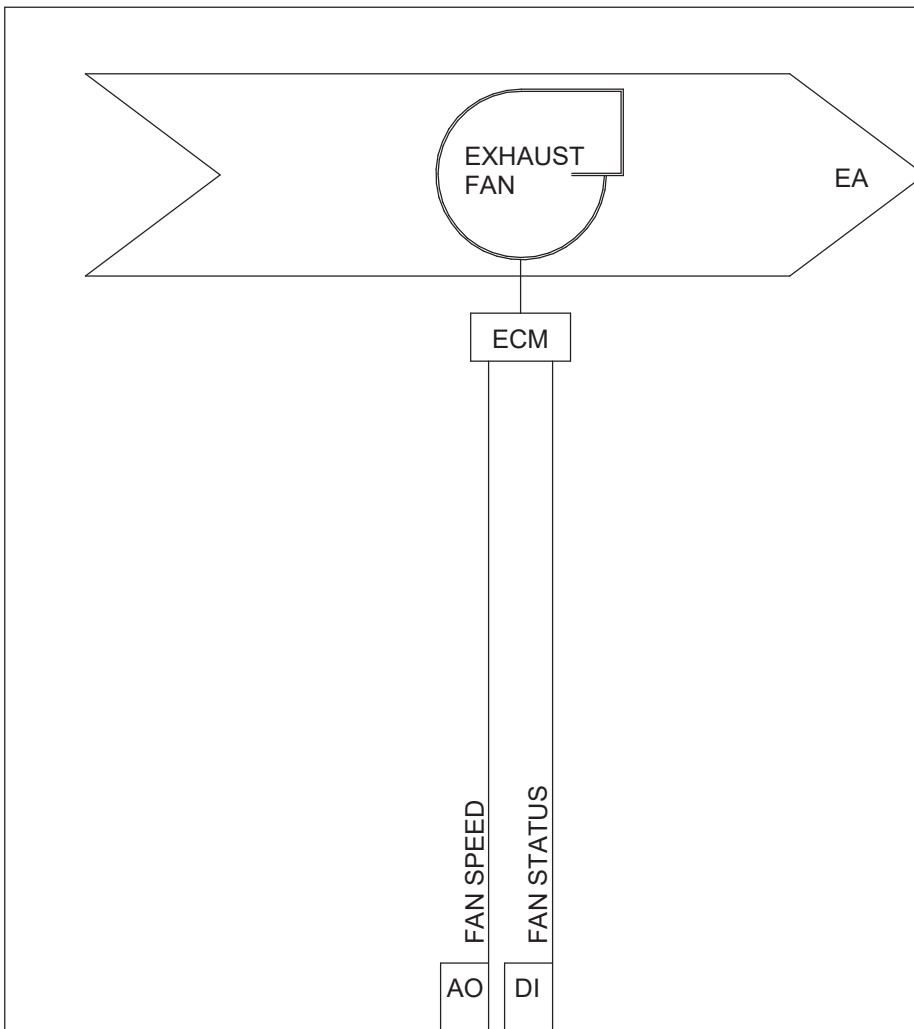


3 EF-3 CONTROL DIAGRAM

SEQUENCE OF OPERATION

A. FAN OPERATION

THE EXHAUST FAN SHALL RUN CONTINUOUSLY.

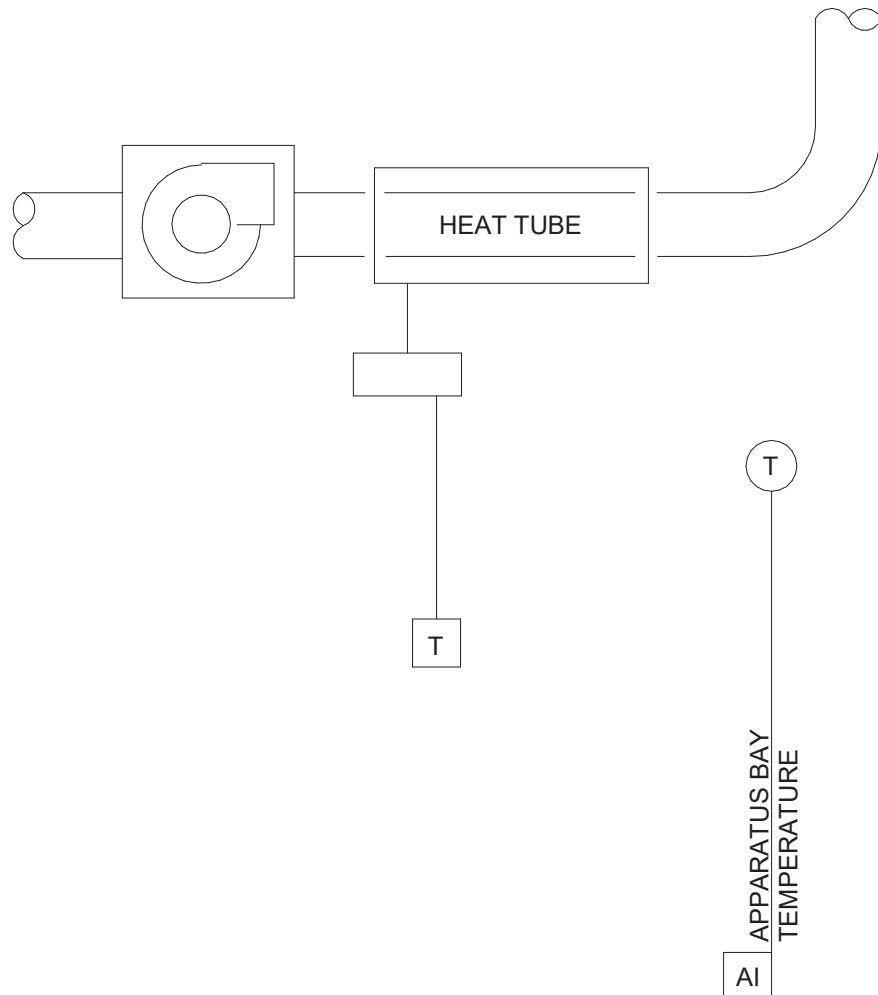

1 GAS-FIRED RADIANT HEATERS CONTROL DIAGRAM

SEQUENCE OF OPERATION

A. THE GAS-FIRED RADIANT HEATER SHALL OPERATE TO MAINTAIN THEIR RESPECTIVE THERMOSTAT (NON-DDC)

B. PROVIDE DDC TEMPERATURE SENSORS PER SHEET H1.1 TO MONITOR APPARATUS BAY TEMPERATURE. IF THE APPARATUS BAY TEMPERATURE DROPS BELOW 50°F (ADJ.) FOR 5 MIN (ADJ.) AN ALARM SHALL BE SENT TO THE CONSOLE.

MONITORING AND ALARMS

A. THE FOLLOWING POINTS SHALL BE MONITORED AND ALARMED AT THE MONITORING CONSOLE AND AS OTHERWISE SPECIFIED HEREINAFTER. THESE ARE IN ADDITION TO POINTS REQUIRED FOR OPERATIONAL CONTROL.

B. POINT DESCRIPTIONS

a. CURRENT SENSING RELAYS - PROVIDE FOR:

- 1) RTU-1 & 2 SUPPLY AIR FAN
- 4) RTU-1 & 2 COMPRESSORS
- 5) EXHAUST FANS

COORDINATE REQUIREMENTS FOR ECM EQUIPMENT.

b. HIGH/LOW TEMPERATURE ALARMS ON ALL DDC TEMPERATURE SENSORS WITH OFF-NORMAL MESSAGES.

c. GENERATOR TROUBLE.

d. FC-1/CD-1

e. FC-2/CD-2

f. FC-3/CD-3

C. WHEN INTERFACING WITH EQUIPMENT PROVIDING REMOTE ANALOG INPUT OR RECEIVING ANALOG OUTPUTS TO THE DDC SYSTEM OR WHEN MONITORING REQUIRES THE INSTALLATION OF EXTERNAL RELAYS AT THE EQUIPMENT BEING MONITORED, COORDINATE ALL REQUIREMENTS SUCH AS RANGE, SIGNAL CONDITION, GROUNDING, WIRING AND INPUT IMPEDANCE WITH THE SUPPLIER OF THE EQUIPMENT BEING MONITORED.

D. DIAL OUT ALARMS - DDC SYSTEM SHALL BE CAPABLE OF INITIATING DIAL OUT ALARM MESSAGE TO PAGERS, TELEPHONE OR INTERNET WHENEVER THE SYSTEM DETECTS AN ALARM. COORDINATE LIST OF DESIRED ALARMS AND INTERFACE WITH OWNERS' NOTIFICATION EQUIPMENT WITH THE OWNER.

A

B

C

D

E

F

7/31/2025 8:57:45 AM

T

SPACE TEMPERATURE

AI

BACNET MS/TP

SEQUENCE OF OPERATION

RTU-1 SHALL OPERATE BASED ON A 7-DAY PROGRAMMABLE THERMOSTAT PROVIDED BY THE UNIT MANUFACTURER. PROGRAM TO LIMIT TEMPERATURE RANGE TO 68°F - 74°F.

PROVIDE A DDC TEMPERATURE SENSOR AS INDICATED ON PLAN. IF TEMPERATURE RISES ABOVE 78°F (ADJ.) OR DROPS BELOW 64°F (ADJ.), SEND AN ALARM TO THE CONSOLE.

PROVIDE BACNET MS/TP CONNECTION FROM THE RTU TO THE BUILDING DDC SYSTEM. PULL IN ALL UNIT ALARMS. PROVIDE OWNER WITH DIAL-OUT ALERT FOR ALARMS.

1	RTU-1 CONTROLS	
---	----------------	--

T

SPACE TEMPERATURE

AI

BACNET MS/TP

SEQUENCE OF OPERATION

RTU-2 SHALL OPERATE BASED ON A 7-DAY PROGRAMMABLE THERMOSTAT PROVIDED BY THE UNIT MANUFACTURER. PROGRAM TO LIMIT TEMPERATURE RANGE TO 68°F - 74°F.

PROVIDE A DDC TEMPERATURE SENSOR AS INDICATED ON PLAN. IF TEMPERATURE RISES ABOVE 78°F (ADJ.) OR DROPS BELOW 64°F (ADJ.), SEND AN ALARM TO THE CONSOLE.

PROVIDE BACNET MS/TP CONNECTION FROM THE RTU TO THE BUILDING DDC SYSTEM. PULL IN ALL UNIT ALARMS. PROVIDE OWNER WITH DIAL-OUT ALERT FOR ALARMS.

SAFETIES:
RETURN AIR SMOKE DETECTOR SHALL BE TIED INTO RTU-1 FAN MOTOR STARTER. UPON RECEIVING A SIGNAL FROM THE RETURN AIR SMOKE DETECTOR, THE FAN SHALL SHUT-DOWN. THE H.C. / T.C. SHALL PROVIDE ALL REQUIRED RELAYS, WIRING, ETC. TO ACOMPLISH THIS SAFETY.

2	RTU-2 CONTROLS	
---	----------------	--

T

SPACE TEMPERATURE

AI

SEQUENCE OF OPERATION

FC-1/CD-1 SHALL OPERATE 24/7/365 TO MAINTAIN SPACE TEMPERATURE SETPOINT. PROGRAM THERMOSTAT TEMPERATURE RANGE TO 68-74 DEG. F.

PROVIDE A DDC TEMPERATURE SENSOR AS INDICATED ON PLAN. IF TEMPERATURE RISES ABOVE 78°F (ADJ.) OR DROPS BELOW 64°F (ADJ.), SEND AN ALARM TO THE CONSOLE.

3	FC-1 / CD-1 CONTROLS	
---	----------------------	--

T

SPACE TEMPERATURE

AI

SEQUENCE OF OPERATION

FC-2/CD-2 SHALL OPERATE 24/7/365 TO MAINTAIN SPACE TEMPERATURE SETPOINT. PROGRAM THERMOSTAT TEMPERATURE RANGE TO 68-74 DEG. F.

PROVIDE A DDC TEMPERATURE SENSOR AS INDICATED ON PLAN. IF TEMPERATURE RISES ABOVE 78°F (ADJ.) OR DROPS BELOW 64°F (ADJ.), SEND AN ALARM TO THE CONSOLE.

4	FC-2 / CD-2 CONTROLS	
---	----------------------	--

T

SPACE TEMPERATURE

AI

SEQUENCE OF OPERATION

FC-3/CD-3 SHALL OPERATE 24/7/365 TO MAINTAIN SPACE TEMPERATURE SETPOINT. PROGRAM THERMOSTAT TEMPERATURE RANGE TO 68-74 DEG. F.

5	FC-3 / CD-3 CONTROLS	
---	----------------------	--

T

RETURN WATER TEMP

AI

PUMP STARTER/STOP

STARTER BY E.C.

DI PUMP STATUS

SEQUENCE OF OPERATION

PUMP OPERATION
THE DOMESTIC HOT WATER RECIRCULATING PUMP SHALL BE STARTED AND STOPPED THROUGH THE DDC SYSTEM. PUMP SHALL OPERATE IN AN ENABLED OR DISABLED STATUS BASED ON BUILDING OCCUPANCY SCHEDULE.

THE BUILDING SHALL BE OCCUPIED 24/7/365

PUMP ENABLE
THE PUMP SHALL BE ENABLED DURING BUILDING OCCUPIED HOURS. WHEN ENABLED THE PUMP SHALL OPERATE BASED ON THE BUILDING RETURN WATER TEMPERATURE SETPOINT, 110 DEG. F. AS THE TEMPERATURE DROPS BELOW SETPOINT THE PUMP SHALL START AND SHALL OPERATE FOR A MINIMUM OF ONE HOUR. AFTER THE ONE HOUR MINIMUM RUN TIME IF THE RETURN WATER TEMPERATURE IS 110 DEG. F. OR GREATER THE PUMP SHALL STOP.

NOTE: REFER TO PLUMBING DRAWING FOR INSTALLATION LOCATION OF PIPE MOUNTED TEMPERATURE

6	DOMESTIC HOT WATER RECIRCULATING PUMP CONTROL DIAGRAM	N.T.S.
---	---	--------

DI

BACKFLOW ALARM

SEQUENCE OF OPERATION

THE DOMESTIC WATER BACKFLOW PREVENTER IS EQUIPPED WITH A DIGITAL CONTACT TO PROVIDE AN ALARM SIGNAL.

THE T.C. SHALL CONNECT THE DDC CONTROL SYSTEM TO THE BACKFLOW PREVENTER TO RECEIVE THIS ALARM SIGNAL AND PERFORM A DIAL OUT FEATURE TO ALERT DESIGNATED PERSONNEL.

7	DOMESTIC WATER BACKFLOW PREVENTER	
---	-----------------------------------	--

APP Architecture

creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.832.8898 F 937.832.3696
www.app-arch.com

STATE OF OHIO

JEFFREY D. ZELINSKI
63822

REGISTERED PROFESSIONAL ENGINEER

JEFFREY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

DAYTON FIRE DEPARTMENT

STATION 15

2801 Wayne Ave, Dayton, OH 45420

ISSUE		
NO.	DATE	DESCRIPTION

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DJZ
CHECKED	JDZ

COPYRIGHT © 2025 - App Architecture, Inc.	
TITLE	CONTROLS

SHEET NO.

H4.2

NAUMAN & ZELINSKI LLC.

204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 223-3851
PROJECT # 24065



JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

DAYTON FIRE DEPARTMENT
STATION 15

2801 Wayne Ave, Dayton, OH 45420

ISSUE		
NO.	DATE	DESCRIPTION

DATE	08/01/2025
JOB NO.	4284.00
DRAWN	DJZ
CHECKED	JDZ
COPYRIGHT © 2025 - App Architecture, Inc.	
TITLE	
VENTILATION	

SHEET NO.

H5.1

NAUMAN & ZELINSKI LLC.
204 S. Ludow Street Suite 400 Dayton, Ohio 45402
Phone (937) 223-3651
PROJECT # 24065

Building: UFD Station 15	
System Tag/Name: RTU-2	
Operating Condition Description: 24/7/365	
Units (select from pull-down list): IP	

Inputs for System	Name	Units	% diversity	
			System	Diversity
Floor area served by system	As	sf	1,210	25
Population of area served by system	Ps	P	100%	
Design primary supply fan airflow rate	Vpsd	cfm	2,410	2,410
OA req'd per unit area for system (Weighted average)	Ras	cfm/sf	2.00	
OA req'd per person for system area (Weighted average)	Rps	cfm/p	5.7	
Percent increase in Vbz over minimum required			0%	

Inputs for Potentially Critical Zones	
Zone Name	Zone Tag
Potentially Critical Zones	
HALL	113
LKR ROOM	115
LAUNDRY	116
TLT/SHR	117
TLT/SHR	118
TLT/SHR	119
ADA DORM	120
ADA DORM	121
ADA DORM	122
DORM	123
DORM	124
DORM	125
DORM	126
DECON	127
Fitness	

Occupancy Category	Select from pull-down list:
Floor Area of zone	Az
Design population of zone	Pz
Design total supply to zone (primary plus local recirculated)	Vzsd
Induction Terminal Unit, Dual Fan Dual Out or Transfer Fan?	Er

Inputs for Operating Condition Analysis	
Percent of total design airflow rate at conditioned analyzed	Ds
Air distribution type at conditioned analyzed	Ex
Zone air distribution effectiveness at conditioned analyzed	Ev
Primary air fraction of supply air at conditioned analyzed	Ez

Results	
System Ventilation Efficiency	Ev
Outdoor air intake required for system	Vor
Outdoor air per unit floor area	Vor/As
Outdoor air per person served by system (including diversity)	Vor/Ps
Outdoor air as a % of design primary supply air	Ypd

NOTES	
OMC CHAPTER 4 VENTILATION: 255 CFM	
EXHAUST AIRFLOW: 300 CFM	
POSITIVE PRESSURIZATION: 250 CFM	
OUTSIDE AIR FLOW RATE: 550 CFM	

Building: UFD Station 15	
System Tag/Name: RTU-2	
Operating Condition Description: 24/7/365	
Units (select from pull-down list): IP	

Inputs for System	Name	Units	% diversity	
			System	Diversity
Floor area served by system	As	sf	1,210	25
Population of area served by system	Ps	P	100%	
Design primary supply fan airflow rate	Vpsd	cfm	2,410	2,410
OA req'd per unit area for system (Weighted average)	Ras	cfm/sf	2.00	
OA req'd per person for system area (Weighted average)	Rps	cfm/p	5.7	
Percent increase in Vbz over minimum required			0%	

Inputs for Potentially Critical Zones	
Zone Name	Zone Tag
Potentially Critical Zones	
REPORT	113
LOBBY	115
LT DORM	116
TLT/SHR	117
LT OFFICE	118
DAYROOM	119
KITCHEN	120
Office space	121
Corridors	122
Dwelling unit	123
Restroom	124
Office space	125
Dayroom	126
Kitchen	127

Occupancy Category	Select from pull-down list:
Floor Area of zone	Az
Design population of zone	Pz
Design total supply to zone (primary plus local recirculated)	Vzsd
Induction Terminal Unit, Dual Fan Dual Out or Transfer Fan?	Er

Inputs for Operating Condition Analysis	
Percent of total design airflow rate at conditioned analyzed	Ds
Air distribution type at conditioned analyzed	Ex
Zone air distribution effectiveness at conditioned analyzed	Ev
Primary air fraction of supply air at conditioned analyzed	Ez

Results	
System Ventilation Efficiency	Ev
Outdoor air intake required for system	Vor
Outdoor air per unit floor area	Vor/As
Outdoor air per person served by system (including diversity)	Vor/Ps
Outdoor air as a % of design primary supply air	Ypd

NOTES	
OMC CHAPTER 4 VENTILATION: 283 CFM	
EXHAUST AIRFLOW: 870 CFM	
OUTSIDE AIR FLOW RATE: 870 CFM	

7/31/2025 11:06:52 AM

ELECTRICAL SPECIFICATIONS

- Z. LABEL ALL NORMAL POWER PANELBOARDS WITH PHENOLIC WHITE BACKGROUND AND BLACK LETTER PLATE WITH SOURCE OF FEEDER, SWITCH OR BREAKER NUMBER, VOLTAGE, PHASE, AND BRANCH. EMERGENCY POWERED ITEMS SHALL BE MARKED THE SAME WAY BUT SHALL BE WITH RED BACKGROUND AND WHITE LETTERS.
- AA. LABEL ALL NORMAL POWER DISCONNECT SWITCHES WITH PHENOLIC WHITE BACKGROUND AND BLACK LETTER PLATE WITH PANEL, CIRCUIT NUMBER, VOLTAGE, PHASE, FED FROM AND DESCRIPTION OF LOAD FED. EMERGENCY POWERED ITEMS SHALL BE MARKED THE SAME WAY BUT SHALL BE WITH RED BACKGROUND AND WHITE LETTERS.
- AB. ALL OPEN CABLING SHALL BE PLENUM RATED AND INSTALLED ON J-HOOK SYSTEM ABOVE ACCESSIBLE CEILINGS. COORDINATE LOCATIONS AND TYPE/SIZE WITH THE SYSTEMS VENDOR FOR OPTIMUM CABLE ROUTING.
- AC. DISCONNECT SWITCHES SHALL BE HEAVY DUTY; FUSIBLE TYPE TO UTILIZE 'RK1' FUSES.
- AD. LIGHTING CONTROL OCCUPANCY SENSORS SHALL BE BY HUBBELL, LEVITON, COOPER CONTROLS OR SENSOR SWITCH. CEILING MOUNTED SENSORS SHALL BE LOW PROFILE, "DOME" TYPE SENSORS.
- AE. EQUIPMENT, DUCTWORK AND PIPING SHALL NOT BE INSTALLED IN THE DEDICATED ELECTRICAL SPACE ABOVE OR IN THE WORKING SPACE REQUIRED AROUND ELECTRICAL SWITCHGEAR, MOTOR CONTROL CENTERS OR PANELBOARDS AS IDENTIFIED BY NEC 110.26 SPACES ABOUT ELECTRICAL EQUIPMENT – 600 VOLTS NOMINAL OR LESS; FOR EQUIPMENT RATED OVER 600 VOLTS NOMINAL – 110.32 WORK SPACE ABOUT EQUIPMENT – 110.33 ENTRANCE AND ACCESS TO WORK SPACE – 110.34 WORK SPACE AND GROUNDING. THE ELECTRICAL CONTRACTOR SHALL CAUTION OTHER TRADES TO COMPLY WITH THIS STIPULATION.
- AF. EXISTING CONDUITS AND WIRING NOT TO BE REUSED, SHALL BE REMOVED BACK TO SOURCE, REMOVE ALL UNUSED ELECTRICAL WORK, EQUIPMENT, WIRING AND CONDUITS, ETC. IN AREA OF WORK. DO NOT ABANDON IN PLACE UNLESS INACCESSIBLE. DISPOSE OF ALL REMOVED ITEMS EXCEPT WHERE OWNER WISHES TO KEEP THE ITEM.
- AG. PERFORM ALL CUTTING AND PATCHING REQUIRED FOR INSTALLATION OF ELECTRICAL SYSTEMS. PATCHING SHALL BE CONSISTENT WITH ADJACENT SURFACES.
- AH. PROVIDE ONE YEAR COMPLETE WARRANTY (PARTS, MATERIALS, LABOR). START OF WARRANTY FROM DATE OF BENEFICIAL OCCUPANCY AGREED TO IN WRITING.

ELECTRICAL INDEX OF DRAWINGS

SHEET	DRAWING TITLE
E0.1	LEGEND
E0.2	SCHEDULES
E0.3	PANEL SCHEDULES
E0.4	DETAILS
E1.1	DEMOLITION
E2.1	NEW LIGHTING PLAN
E3.1	NEW POWER AND SYSTEMS PLAN

ELECTRICAL SPECIFICATIONS

- A. ALL ELECTRICAL WIRING, EQUIPMENT AND INSTALLATION SHALL CONFORM TO THE 2023 OHIO BUILDING CODE, 2023 NATIONAL ELECTRIC CODE AND LOCAL CODES, LATEST ADOPTED EDITIONS.
- B. ALL ELECTRICAL EQUIPMENT SHALL BE U.L. APPROVED AND COMMERCIAL GRADE. PANELBOARDS, CIRCUIT BREAKERS AND DISCONNECTS BY SQUARE D, SIEMENS, CUTLER-HAMMER OR G.E
- C. SUBMIT ELECTRONIC SHOP DRAWINGS FOR REVIEW AND APPROVAL PRIOR TO ORDERING FOR THE FOLLOWING EQUIPMENT: LIGHT FIXTURES, PANELBOARD(S), CIRCUIT BREAKER(S) AND WIRING DEVICES.
- D. ALL POWER AND SYSTEMS WIRING SHALL BE INSTALLED IN CONDUIT RACEWAYS UNLESS OTHERWISE SPECIFICALLY NOTED.
- E. STAGGER LOCATIONS OF RECESSED OUTLETS WHERE SHOWN ON OPPOSITE SIDES OF STUD WALL PARTITIONS TO PREVENT SOUND TRANSMISSION BETWEEN ROOMS.
- F. DRAWINGS ARE SCHEMATIC IN NATURE TO REPRESENT REQUIRED EQUIPMENT/DEVICES AND ASSOCIATED POWER/CIRCUITRY. DRAWINGS SHALL NOT BE SCALED FOR DEVICE LOCATIONS. THE E.C. SHALL COORDINATE THE FINAL LOCATIONS OF ALL FLUSH MOUNTED DEVICES (INCLUDING FIRE ALARM AND TECHNOLOGY ROUGH-IN BOXES) WITH CASEWORK, FIXED FURNITURE, ETC. TO AVOID CONFLICTS AND VIEWING OBSTRUCTIONS. RECEPTACLES ASSOCIATED WITH/ADJACENT TO TECHNOLOGY OUTLET BOXES SHALL BE LOCATED AT THE SAME MOUNTING HEIGHT AND WITHIN 8" HORIZONTALLY UNLESS SPECIFICALLY NOTED OTHERWISE.
- G. THE ARCHITECT SHALL RESERVE THE RIGHT TO MAKE MINOR ADJUSTMENT IN LOCATIONS OF SYSTEM RUNS AND COMPONENTS WHERE THEY CONSIDER SUCH ADJUSTMENTS DESIRABLE IN THE INTEREST OF CONCEALING WORK OR PRESENTING A BETTER APPEARANCE WHERE EXPOSED. ANY SUCH CHANGES SHALL BE ANTICIPATED AND REQUESTED SUFFICIENTLY IN ADVANCE SO AS TO NOT CAUSE EXTRA WORK, OR UNDULY DELAY THE WORK. COORDINATE WORK IN ADVANCE WITH ALL OTHER TRADES AND REPORT IMMEDIATELY ANY DIFFICULTIES WHICH CAN BE ANTICIPATED. WHERE ANY SYSTEM RUNS AND COMPONENTS ARE SO PLACED AS TO CAUSE OR CONTRIBUTE TO A CONFLICT, IT SHALL BE READJUSTED AT THE EXPENSE OF THE CONTRACTOR CAUSING SUCH CONFLICT. THE ARCHITECT'S DECISION SHALL BE FINAL IN REGARD TO ARRANGEMENT OF EQUIPMENT, CONDUIT(S), DEVICES, WIREWAYS ETC., WHERE CONFLICT ARISES.
- H. ALL WIRING SHALL UTILIZE MIN. #12 AWG SIZE COPPER THINWALL STRANDED CONDUCTORS WITH INSULATION SUITABLE FOR THE APPLICATION. CONDUCTORS FOR ELECTRIC RADIANT HEATERS SHALL BE LISTED FOR THE APPLICATION.
- I. PROVIDE A SEPARATE NEUTRAL CONDUCTOR FOR EACH BRANCH CIRCUIT AND SEPARATE GREEN COLORED INSULATED COPPER GROUNDING CONDUCTOR FOR EACH BRANCH CIRCUIT CONDUIT. NEUTRAL WIRES FOR 120 VOLT CIRCUITS SHALL BE WHITE AND FOR 277 VOLT CIRCUITS SHALL BE GRAY COLOR.
- J. ALL CONDUCTORS SHALL BE INSTALLED IN MIN. 0.75" SIZE CONDUIT. EMT SHALL BE UTILIZED FOR INTERIOR FEEDERS AND BRANCH CIRCUITRY. MC CABLE SHALL ONLY BE ALLOWED FOR FINAL CONNECTION TO INDOOR LIGHT FIXTURES. LIQUID TIGHT FLEXIBLE METAL CONDUIT SHALL BE USED FOR ALL OTHER FINAL CONNECTIONS TO MOVEABLE/VIBRATING EQUIPMENT. ALL EXTERIOR CONDUIT SHALL BE RIGID METAL CONDUIT.
- K. EMT CONDUIT FITTINGS SHALL BE ALL STEEL COMPRESSION OR SETSCREW TYPE.
- L. ALL CONDUITS INSTALLED ON EXTERIOR OF BUILDING SHALL BE RIGID GALVANIZED TYPE WITH THREADED STEEL FITTINGS. UTILIZE COMPATIBLE NEMA 3R TYPE BOXES FOR ALL EXTERIOR FIXTURE AND OUTLET BOXES.
- M. BRANCH CIRCUITS WHERE FISHED IN EXISTING INACCESSIBLE WALLS ONLY MAY UTILIZE MC CABLE OR 0.5" SIZE FLEXIBLE METALLIC CONDUIT TO INDIVIDUAL DEVICES WHEN PROPERLY SUPPORTED.
- N. ALL EMPTY CONDUITS SHALL HAVE A NYLON PULLSTRING INSTALLED PER SPECIFICATIONS.
- O. WIRING DEVICES SHALL BE SPECIFICATION GRADE, WHITE COLOR, WITH BRUSHED STAINLESS STEEL COVERPLATES, HUBBELL, PAS, COOPER OR LEVITON. PROVIDE TAMPER-RESISTANT RECEPTACLES IN LOCATIONS AS REQUIRED BY NEC 406.12.
- P. ALL CONDUIT, FITTINGS, BENDS, ETC. SHALL BE PROPERLY SUPPORTED PER NEC AND NEATLY INSTALLED.
- Q. IDENTIFY PANEL AND CIRCUIT NUMBER ON ALL RECEPTACLE COVERPLATES WITH PRINTED LABELS WITH BLACK LETTERS ON CLEAR ADHESIVE BACKGROUND.
- R. PROVIDE TYPED PANEL DIRECTORIES INDICATING TYPE OF LOAD AND ROOM DESCRIPTION WITH ROOM NUMBER AND TYPE. UPDATE ALL EXISTING PANEL DIRECTORIES WITH NEW TYPED DIRECTORY CARDS WITH ALL CIRCUIT REVISIONS NOTED.
- S. ALL SPARE BREAKERS IN PANELBOARDS SHALL BE TURNED 'OFF'.
- T. THE TOTAL LOAD (AMPERES) OF ANY BRANCH CIRCUIT SHALL NOT EXCEED 80% OF THE RATED AMPACITY OF THE CIRCUIT BREAKER FOR THAT CIRCUIT.
- U. THE ELECTRICAL CONTRACTOR SHALL COORDINATE HIS WORK WITH OTHER CONTRACTORS TO AVOID INTERFERENCE WITH THE BUILDING COMPONENTS, EXISTING UTILITIES, EQUIPMENT, ETC.
- V. THE E.C. SHALL PROVIDE FIRESTOPPING FOR ALL PENETRATIONS THRU RATED WALLS. ALL FIRESTOPPING ASSEMBLIES SHALL BE LISTED AND APPROVED FOR THE ASSEMBLY AND PENETRATION UTILIZED.
- W. IDENTIFY ALL BRANCH CIRCUITS AT ALL JUNCTION BOXES BY NEATLY PRINTING PANEL AND CIRCUIT NUMBERS ON BOX COVERS WITH INDELIBILE MARKER.
- X. NEATLY LABEL BRANCH CIRCUIT NUMBERS ON EACH EXPOSED CONDUIT LEAVING PANELBOARDS WITH INDELIBILE MARKERS.
- Y. NEATLY LABEL PANEL AND BRANCH CIRCUIT NUMBERS ON EACH ACCESSIBLE OR EXPOSED CONDUIT ENTERING OR LEAVING ALL PULL BOXES AND JUNCTION BOXES WITH INDELIBILE MARKERS.

ELECTRICAL LEGEND

	OCCUPANCY SENSOR, CEILING MOUNTED.
	OCCUPANCY SENSOR CONTROL RELAY.
	DISCONNECT SWITCH (FUSIBLE)
	MOTOR STARTER OR VFD.
	COMBINATION MOTOR STARTER OR VFD AND DISCONNECT SWITCH.
	ELECTRIC MOTOR.
	UNIT HEATER.
	FAN COIL UNIT.
	CIRCUIT BREAKER PANEL, FLUSH MOUNTED.
	CIRCUIT BREAKER PANEL, SURFACE MOUNTED.
	POWER PANEL OR SWITCHBOARD, SURFACE MOUNTED.
	ELECTRIC BASEBOARD HEATER.
	NEW DATA OUTLET (18" M.H. UNLESS OTHERWISE INDICATED). TWO GANG OUTLET BOX WITH SINGLE GANG TRIM RING AND BLANK COVERPLATE. STUB AN EMPTY 1.0" BUSHED CONDUIT OUT ABOVE ACCESSIBLE CEILING.
	EXISTING DATA OUTLET (18" M.H. UNLESS OTHERWISE INDICATED M.H.). TWO GANG OUTLET BOX WITH SINGLE GANG TRIM RING AND BLANK COVERPLATE. STUB AN EMPTY 1.0" BUSHED CONDUIT OUT ABOVE ACCESSIBLE CEILING.
	WIRELESS WIFI ACCESS POINT; CEILING MOUNTED.
	FIRE ALARM HORN & SIGNAL LIGHT (80" A.F.F.), # WHEN SHOWN INDICATES CANDELA RATING OF STROBE. WHEN A # IS NOT SHOWN, THE STROBE SHALL BE RATED 110 CANDELA.
	FIRE ALARM SIGNALING LIGHT (80" A.F.F.), # WHEN SHOWN INDICATES CANDELA RATING OF STROBE. WHEN A # IS NOT SHOWN, THE STROBE SHALL BE RATED 110 CANDELA.
	FIRE ALARM SENDING STATION (46" M.H.).
	CEILING MOUNTED SMOKE DETECTOR.
	CEILING MOUNTED HEAT DETECTOR.
	DUCT MOUNTED SMOKE DETECTOR (S/SUPPLY, R/RETURN).
	ELECTRO-MAGNETIC DOOR HOLDER.
	WATER FLOW SWITCH.
	FIRE ALARM SUPERVISED VALVE.
	TELEVISION MONITOR RECEPTACLE AND CABLE OUTLET BOX ASSEMBLY REFER TO TV WALL BOX DETAIL - T1
	DOOR ACCESS CONTROL SYSTEM CARD READER - 46" M.H.
	CCTV CAMERA. ROUGH-IN BOX, 1" C. STUB
	ELECTRIC DOOR OPERATOR, INCLUDING RELAYS, OPERATING SWITCHES AND LIMIT SWITCHES SHALL BE FURNISHED BY THE DOOR EQUIPMENT SUPPLIER AND INSTALLED BY THE E.C. IN ACCORDANCE WITH APPROVED WIRING DIAGRAMS BY THE EQUIPMENT SUPPLIER (120 VOLT SINGLE PHASE OPERATION).
	PUSHPLATE DOOR CONTROLS FURNISHED BY THE DOOR EQUIPMENT SUPPLIER AND INSTALLED BY THE E.C. (42" M.H.).
	PUSHBUTTON (46" M.H. UNLESS OTHERWISE NOTED ON PLAN).
	4" DIAMETER BELL (90" M.H.).
	FLUSH MOUNTED CEILING SPEAKER.
	TRUMPET TYPE SPEAKER (96" M.H.); SINGLE GANG BOX WITH 0.75" BUSHED CONDUIT TO ABOVE ACCESSIBLE CORRIDOR CEILING OR NEAREST CABLE TRAY.
	CEILING FAN FURNISHED AND INSTALLED BY H.C.; WIRED BY E.C.

ELECTRICAL LEGEND

	ELECTRICAL CONNECTION REQUIRED.
	EXIT LIGHTING FIXTURE. ARROWS AS INDICATED.
	LIGHTING FIXTURE: CAPITAL LETTER DENOTES FIXTURES TYPE. LOWER CASE LETTER DENOTES SWITCHING ARRANGEMENT.
	LIGHTING FIXTURE ON NIGHT LIGHT OR EMERGENCY CIRCUIT.
	EACH ARROWHEAD REPRESENTS ONE COMPLETE CIRCUIT; CAPITAL LETTER DENOTES PANEL; NUMBER DENOTES CIRCUIT.
	WIRE & CONDUIT IN WALL OR ABOVE CEILING
	WIRE & CONDUIT UNDERGROUND
	JUNCTION BOX.
	DASHED SYMBOL INDICATES THAT PARTICULAR OUTLET OR DEVICE TO BE REMOVED AND CIRCUITRY MADE CONTINUOUS WHERE REQUIRED.
	EXISTING OUTLET OR DEVICE TO REMAIN, MAINTAIN EXISTING CIRCUITRY.
	20A-125V SINGLE RECEPTACLE, NEMA 5-20R (18" M.H.).
	20A-125V DUPLEX RECEPTACLE, NEMA 5-20R (18" M.H.).
	20A-125V DUPLEX RECEPTACLE WITH INTEGRAL USB CHARGING PORTS (1 USB 'A'; 1 USB 'C' PORT), NEMA 5-20R (18" M.H.), USB TYPE A-C CHARGING PORTS WITH MINIMUM 5 AMPS COMBINED CHARGING POWER.
	15A-125V DUPLEX RECEPTACLE WITH INTEGRAL NIGHT LIGHT ACCESSORY. DEVICE SHALL HAVE LED NIGHT LIGHT IN FACE OF DEVICE WITH PHOTO-SENSOR CONTROL, NEMA 5-20R (18" M.H.). SPECIAL PURPOSE RECEPTACLE. REFER TO NOTE ON PLAN
	20A-125V DOUBLE DUPLEX RECEPTACLE, NEMA 5-20R, (18" M.H.) TWO-GANG ASSEMBLY. D = DOUBLE DUPLEX.
	20A-125V DUPLEX RECEPTACLE, NEMA 5-20R, (46" M.H.) UNLESS OTHERWISE INDICATED D = DOUBLE DUPLEX.
	20A-125V DUPLEX RECEPTACLE, NEMA 5-20R, WITH GROUND FAULT CIRCUIT INTERRUPTER (18" M.H.).
	20A-125V WEATHERPROOF DUPLEX RECEPTACLE, NEMA 5-20R, WITH GROUND FAULT CIRCUIT INTERRUPTER (18" M.H.); WITH HUBBELL #W/P26M CAST ALUMINUM "WHILE-IN-USE" COVER.
	20A-125V/250V-1PH-4W SINGLE RECEPTACLE, NEMA 14-20R, (18" M.H.).
	30A-125V/250V-1PH-4W SINGLE RECEPTACLE, NEMA 14-30R, (18" M.H.).
	50A-125V/250V-1PH-4W SINGLE RECEPTACLE, NEMA 14-50R (18" M.H.)
	SINGLE POLE WALL SWITCH (46" M.H.)
	TWO POLE WALL SWITCH (46" M.H.).
	THREE-WAY WALL SWITCH (46" M.H.).
	FOUR-WAY WALL SWITCH (46" M.H.).
	LIGHTING OCCUPANCY SENSOR WALL SWITCH (46" M.H.)
	LIGHTING 0-10V LED DIMMER SWITCH WITH PRESET SLIDE CONTROL AND POWER ON-OFF 'DECORATOR' STYLE SWITCH (46" M.H.) UNLESS OTHERWISE INDICATED.
	LIGHTING 0-10V LED DIMMER SWITCH WITH PRESET SLIDE CONTROL AND 3-WAY POWER ON-OFF 'DECORATOR' STYLE SWITCH (46" M.H.) UNLESS OTHERWISE INDICATED.
	LIGHTING VACANCY SENSOR WALL SWITCH WITH MANUAL 'ON' PUSHBUTTON AND DUAL TECHNOLOGY MOTION SENSOR TO AUTOMATICALLY TURN 'OFF' WHEN ROOM UNOCCUPIED (46" M.H.).
	0-10V LED COMBINATION VACANCY SENSOR AND DIMMER SWITCH WITH PRESET SLIDE CONTROL AND SEPARATE ON-OFF 'DECORATOR' STYLE SWITCH (46" M.H.) UNLESS OTHERWISE INDICATED, RATED MIN. 800 WATTS.

GENERAL LEGEND

EC	ELECTRICAL CONTRACTOR.
FC	FIRE PROTECTION CONTRACTOR.
GC	GENERAL CONTRACTOR.
HC	HVAC CONTRACTOR.
PC	PLUMBING CONTRACTOR.
TC	TEMPERATURE CONTROLS CONTRACTOR.
NIC	NOT IN CONTRACT.
AFF	ABOVE FINISHED FLOOR - TO BOTTOM OF ITEM UNLESS INDICATED OTHERWISE IN DRAWING.
(E)	EXISTING.
ES	EQUIPMENT SUPPLIER.
EM	EMERGENCY.
MH	MOUNTING HEIGHT.
S	SURFACE MOUNTED.
WP	WEATHER PROOF.
	NOTE SYMBOL - APPLIES ONLY TO SHEET ON WHICH IS SHOWN.
	DETAIL NOTE SYMBOL - APPLIES ONLY TO DETAIL ON WHICH IS SHOWN.
	EQUIPMENT REFERENCE SYMBOL. ELECTRICAL CONNECTION REQUIRED.
	EQUIPMENT REFERENCE SYMBOL. NO ELECTRICAL CONNECTION REQUIRED.
	ROOM NUMBER.
	DETAIL SYMBOL DETAIL "B" SHOWN ON SHEET E2.
	SECTION SYMBOL SECTION "A" DESIGNATION, SHOWN ON SHEET E1.
	CONNECTION, NEW TO EXISTING.
	UP TO SYMBOL UP TO "FD1", SHOWN ON FLOOR ABOVE.
	1 HOUR FIRE PROTECTION SEE SPECIFICATION FOR PENETRATION DETAILS
	2 HOUR FIRE PROTECTION SEE SPECIFICATION FOR PENETRATION DETAILS
	3 HOUR FIRE PROTECTION SEE SPECIFICATION FOR PENETRATION DETAILS
	ITEM TO BE REMOVED.
	EXISTING TO REMAIN.
	NEW ITEM.

GENERAL NOTES

- A. ALL WORK SHALL BE IN ACCORDANCE WITH THE 2024 OHIO BUILDING CODE, INCLUDING REFERENCED CODES AND STANDARDS, ALL LOCAL AND STATE CODES AND MEET APPROVAL OF AUTHORITIES HAVING JURISDICTION.
- B. BIDDERS SHALL INSPECT PROJECT SITE EXISTING CONDITIONS DURING BIDDING.
- C. INCLUDE PAYMENT OF ALL PERMIT AND INSPECTION FEES AND OBTAIN AN ELECTRICAL PERMIT AND SECURE INSPECTION AND APPROVAL OF THE CODE OFFICIAL.
- D. SUBMIT AN ELECTRONIC COPY OF SUBMITTAL DATA AND DESCRIPTIVE LITERATURE IN .PDF FORMAT FOR ALL FIXTURES AND EQUIPMENT.
- E. WORKMANSHIP SHALL BE OF THE HIGHEST QUALITY AND REPRESENT THE BEST PRACTICES OF THE INDUSTRY.
- F. COORDINATE INSTALLATION WITH OTHER TRADES; PROVIDE OFFSETS AS REQUIRED.
- G. INSTALL ALL MATERIALS AND EQUIPMENT IN ACCORDANCE WITH MANUFACTURERS REQUIREMENTS.
- H. COORDINATE EACH ROUGH-IN INSTALLATION REQUIREMENTS AND LOCATIONS WITH OTHER TRADES, ACTUAL EQUIPMENT OR CABINetry PROVIDED AND FIELD CONDITIONS BEFORE PERFORMING WORK.
- I. REFER TO ARCHITECTURAL DRAWING ELEVATIONS FOR MOUNTING LOCATION INFORMATION, ARRANGEMENT AND HEIGHT FOR ALL DEVICES AT FURNISHINGS, CASEWORK, ETC.
- J. REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LOCATION OF ALL LIGHTING FIXTURES. WHERE DISCREPANCIES MAY OCCUR BETWEEN THE ELECTRICAL PLANS AND THE ARCHITECTURAL CEILING PLANS ON QUANTITY OF FIXTURES, THE ELECTRICAL PLANS SHALL TAKE PRECEDENCE. COORDINATE FIXTURE LOCATIONS WITH OTHER TRADES TO AVOID CONFLICTS WITH PIPING AND DUCTWORK.
- K. ALL EQUIPMENT AND MATERIAL REQUIRED FOR COMPLETE AND FUNCTIONAL ELECTRICAL SYSTEMS SHALL BE INCLUDED IN THE CONTRACT.

7/31/2025 11:06:53 AM

SUSPENDED OVERHEAD CIRCULATION FANS																								
FAN NUMBER	CIRCUIT NUMBER	NAMEPLATE	FAN					DISCONNECT MEANS				CONTROL			FEEDER									
			CHARACTERISTICS					TYPE	LOCATION															
			HP (KVA OR FLA)	120V-1PH	208V-3PH	208V-1PH	480V-1PH										480V-3PH	LOCATION						
CF1		CIRCULATION FAN 1	0.1 KVA	●					●	TOGGLE SWITCH	BREAKER	NEAR MOTOR	CONTROLLER	SEE NOTES	EC		FAN CONTROL PANEL	●		2	12	12	.5	1
CF2		CIRCULATION FAN 2	0.1 KVA	●					●						EC		●			2	12	12	.5	2

- Notes:
- 56" DIAMETER SUSPENDED INDUSTRIAL TYPE FAN WITH GROUP CONTROL.
 - 36" DIAMETER (CEILING HUGGER) CONTEMPORARY STYLE FAN WHITE FINISH.

LIGHTING FIXTURE SCHEDULE

FIXTURE SYMBOL	LUMINAIRE				FIXTURE VOLTAGE	MANUFACTURER & CATALOG NO.	OTHER ACCEPTABLE MANUFACTURES	DIFFUSING MEDIA	TRIM COLOR				S - SURFACE, R - RECESSED, SM - STEM MTD, WM - WALL MTD, C - CHAIN MTD, UC - UNDER CAB, CS - CLG. SURF.	MOUNTED			SIZE			SEE NOTES
	TYPE		WATTS/FIXTURE	LUMENS/ COLOR TEMP					WHITE	BLACK	ALUMINUM	BRONZE		STANDARD	SEE NOTES	WIDTH	LENGTH	DEPTH	DIAMETER	
	LED	LOW VOLTAGE																		
B1	●			30	3600 LUMENS/ 4000K	120	LITHONIA# CPX 2X2 AL07 SWWW M4	COLUMBIA, DAYBRITE	MATTE WHITE LENS	●				R	24	24	2			
B2	●			30	3600 LUMANS/ 4000K	120	LITHONIA# CPX 2X2 AL07 SWWW M4	COLUMBIA, DAYBRITE	MATTE WHITE LENS	●				S	24	24	2		3	
C1	●			40	5000 LUMENS/ 4000K	120	LITHONIA# CLX L48 5000LUM SEF FDL MVOLT G210 40K	COLUMBIA, DAYBRITE	FLAT DIFFUSE LENS	●				WM/S/SM	3	48	3			
C2	●			80	10000 LUMENS/ 4000K	120	LITHONIA# CLX L96 10000LUM SEF FDL MVOLT G210 40K	COLUMBIA, DAYBRITE	FLAT DIFFUSE LENS	●					3	96	3			
D1	●			30	2500 LUMENS/ 4000K	120	FINELITE# S17-LED-ACF-PF-4'-H-840-120V-SC	PRUDENTIAL, UTOPIA	ANGLED WHITE PERF DIFFUSER	●				WM (6'-0" A.F.F)	5	48	4			
D2	●			10	1300 LUMENS/ 3000K	120	LITHONIA# FMVTSL-241IN-MVOLT-30K-90CRI-BN-M4	COLUMBIA, DAYBRITE	SQUARE WHITE LENS	●				WM (7'-0" A.F.F)	6	24	4			
F1	●			13	1100 LUMENS/ 3000K	120	WF6 REG SWWW5 90CRI MW M6	GREEN CREATIVE, LITEOLIER	FLAT WHITE LENS	●				R			1.5	6	1	
F2	●			13	1100 LUMENS/ 4000K	120	WF6 REG SWWW5 90CRI MW M6	GREEN CREATIVE, LITEOLIER	REGRESSED BAFFLE LED	●				R			1.5	6		
F3	●			13	1100 LUMENS/ 4000K	120	WF6 REG SWWW5 90CRI MW M6	PRESCOLITE, LITEOLIER	FLAT WHITE LENS	●				R			1.5	6		
F4	●			16	1050 LUMENS/ 3000K	120	JSBT 6IN SWWW2 90CRI PIR MW M6	PRESCOLITE, LITEOLIER	FLAT WHITE LENS	●				R			1.5	8		
L1	●			20	4000K	120	ACOLYTE RB 90 AC12065 4.040	APPROVED EQUAL	TAPE LIGHT	●				COVE	.5	60	.5			
UC1	●			10	500 LUMENS/ 4000K	120	LITHONIA# UPLD-18IN-30K-90CRI-SWR-WH	CONTECH, LAMAR	MATTE WHITE LENS	●			2	UC (OF SHELF)	18				2	
X1	●			5		120	LITHONIA# LHQM-LED-R-HO-M6	COMPASS, CHLORIDE	LED EMERGENCY/EXIT RED LETTERS ON WHITE W/EM HEADS	●				WM						
X2	●			5		120	LITHONIA# LHQM-LED-R-HO-M6	COMPASS, CHLORIDE	LED EMERGENCY/EXIT RED LETTERS ON WHITE W/EM HEADS	●				CLG						
REM	●					120	LITHONIA# ERE-GY-T-RD-WP	COMPASS, CHLORIDE	LED REMOTE LAMP HEADS - 2 HEAD - ROUND			●		WM OR CLG SURFACE TO CANOPY				4		

- NOTES:
- SWITCHABLE COLOR TEMPERATURE.
 - INTEGRAL ROCKER SWITCH (HARD WIRED CONNECTION).
 - PROVIDE SURFACE MOUNTING KIT.

MOTORS, STARTERS, DISCONNECTS & CONTROLS

MOTOR NUMBER	CIRCUIT NUMBER	NAMEPLATE	MOTOR				LOCATION	NEMA SIZE	STARTERS							DISCONNECT MEANS							CONTROL			FEEDER											
			CHARACTERISTICS						TYPE				LOCATION			TYPE				LOCATION			INTERLOCK W/ DAMPER BY E.C.	MANUAL AT STARTER	INTEGRAL W/ EQUIP.	BY H.C.	SEE NOTE	NO. OF CONDUCTORS	WIRE SIZE	GRD. SIZE	CONDUIT SIZE	SEE NOTE					
			HP (KVA OR FLA)	120V-1PH	208V-3PH	208V-1PH			480V-1PH	480V-3PH	MANUAL	MAGNETIC	BUILT-IN MOTOR OIL	VFD	ECM*	NEAR MOTOR	MOTOR CONT. CNTR	EQUIP. CONT. PANEL	ROOM NUMBER	SEE NOTE	FURNISHED BY	DISC. SWITCH											MANUAL STARTER	RECEPTACLE	BREAKER	FUSIBLE	NEAR MOTOR
RTU-1		ROOFTOP UNIT 1	37 MCA / 50 MOCP		•			ROOF										•				•	•				HC				•		3	6	10	1	3
RTU-2		ROOFTOP UNIT 2	37 MCA / 50 MOCP		•			ROOF										•				•	•				HC				•		3	6	10	1	3
CD-1		CONDENSING UNIT 1	17 MCA / 27 MOCP			•		EXTERIOR WALL										•					•				EC						2	10	10	.5	
FC-1		FAN COIL 1				•		FITNESS										•					•				EC						2	12	12	.5	2
CD-2		CONDENSING UNIT 2	11 MCA / 28 MOCP			•		EXTERIOR WALL										•					•				EC						2	10	10	.5	
FC-2		FAN COIL 2				•		DECON										•					•				EC						2	12	12	.5	2
CD-3		CONDENSING UNIT 3	11 MCA / 28 MOCP			•		ROOF										•					•				EC						2	10	10	.5	
FC-3		FAN COIL 3				•		TOWER										•					•				EC						2	12	12	.5	2
EF-1		EXIST EF-1																																			1
EF-2		EXIST EF-2																																			1
EF-3		NEW EXH. FAN 3	1/10 HP	•				ROOF				•					HC	•									HC	•			•		2	12	12	.5	
EF-4		NEW EXH. FAN 4	2 HP		•			FITNESS				•					HC	•									HC	•			•		3	12	12	.5	
EF-5		NEW EXH. FAN 5	1/6 HP	•				DECON				•					HC	•									HC	•			•		2	12	12	.5	
RH-1		RAD HTR 1	5 AMPS	•				APP BAY										•					•				EC				•		2	12	12	.5	
RH-2		RAD HTR 2	5 AMPS	•				APP BAY										•					•				EC				•		2	12	12	.5	
RH-3		RAD HTR 3	5 AMPS	•				APP BAY										•					•				EC				•		2	12	12	.5	
RH-4		RAD HTR 4	5 AMPS	•				APP BAY										•					•				EC				•		2	12	12	.5	
GUH-1		GAS UNIT HTR	7 AMPS	•				APP BAY										•					•				HC			•			2	12	12	.5	
WH1		WATER HEATER	1 AMP	•							•						EC						•				EC			•			2	12	12	.5	
RCP1		REG RC PUMP	1 AMP	•							•						EC						•				EC			•			2	12	12	.5	

- * REFER TO ECM CONTROL DIAGRAM(S) ON HVAC DRAWINGS, WHEN NOTED, FOR INTERLOCK WIRING AND AUX POWER REQUIREMENTS.
- NOTES:
- RE-FEED EXISTING EQUIPMENT FROM NEW PANEL.
 - INDOOR FAN COIL UNIT POWERED FROM OUTDOOR CONDENSING UNIT. PROVIDE TOGGLE TYPE DISCONNECT AT UNIT.
 - PROVIDE 60A FEED TO FUSED DISCONNECT AT UNIT.

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 233-3821



615 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com



JEFFERY D. ZELINSKI, LICENSE #63822
EXPIRATION DATE 12/31/2025

CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15
2801 Wayne Ave, Dayton, Ohio, 45420

ISSUE		
NO.	DATE	DESCRIPTION

08/01/2025 FOR CONSTRUCTION

DATE	06/09/25
JOB NO.	4284.00
DRAWN	AP
CHECKED	TR

COPYRIGHT © 2025 - App Architecture, Inc.

TITLE
SCHEDULES

SHEET NO.

E0.2

A

B

C

D

E






F

Branch Panel: A					Construction: New					System: Normal Power						
LOCATION: MECH. 111					MOUNTING: Surface					A.I.C RATING						
SUPPLY FROM: MDP					ENCLOSURE: Type 1					MAINS TYPE: M.L.O						
VOLTAGE: 120/208 Wye-3-4					MCB RATING: 1 A					MAINS RATING: 200 A						
CKT	Description	Trip	Poles	Note	A		B		C		Note	Poles	Trip	Description	CKT	
1	DORM 124/125	20 A	1	1	1440 VA	0 VA						1	20 A	EX LIGHTS	2	
3	DORM 122/123	20 A	1	1			1440 VA	0 VA					1	20 A	EX TRFC SIGN	4
5	DORM 120/121	20 A	1	1					1440 VA	0 VA			1	20 A	EX LIGHTS	6
7	EX REC	20 A	1		0 VA	0 VA						1	20 A	EX LIGHTS	8	
9	EX REC TLT	20 A	1				0 VA	0 VA				1	20 A	EX LIGHTS	10	
11	EX LIGHTS	20 A	1						0 VA	0 VA			1	20 A	EX LIGHTS	12
13	EX WTR CLR	20 A	1		0 VA	0 VA							1	20 A	EX LIGHTS	14
15	EX KIT REC	20 A	1				0 VA	0 VA					1	20 A	EX REC	16
17	EX REFRIG	20 A	1	2					0 VA	0 VA			1	20 A	EX REC	18
19	EX DISPS REC	20 A	1		0 VA	0 VA							1	20 A	EX LIGHTS	20
21	EX KIT REC	20 A	1				0 VA	0 VA					1	20 A	EX LIGHTS	22
23	EX REC	20 A	1						0 VA	0 VA			1	20 A	EX LIGHTS	24
25	EX REC	20 A	1		0 VA	0 VA							1	20 A	EX REC	26
27	EX REC	20 A	1				0 VA	0 VA					1	20 A	EX REC	28
29	HALL113/TLTS	20 A	1						1080 VA	0 VA			1	20 A	EX LIGHTS	30
31	EX MED CGR	20 A	1		0 VA	0 VA							1	20 A	UNKNOWN	32
33	116 WASHER	20 A	1				180 VA	0 VA					1	20 A	SOUTH	34
35	116 DRYER	30 A	2						2496 VA	0 VA			1	20 A	EX TP LTNL	36
37	--	--	--		2496 VA	0 VA							1	20 A	EX CAD	38
39	Spare	20 A	1				0 VA	0 VA					1	20 A	UNKNOWN	40
41	Spare	20 A	1						0 VA	0 VA			1	20 A	UNKNOWN	42
43	DORM RM LTS	20 A	1		416 VA	429 VA							1	20 A	113/115/116 LIT	44
45	Spare	20 A	1	1			0 VA	180 VA					1	20 A	BASEMT REC	46
47	2ND FLR REC	20 A	1						540 VA	180 VA			1	20 A	3RD FLR REC	48
49	FC-3	15 A	2		500 VA	500 VA						2	15 A	CD-3	50	
51	--	--	--				500 VA	500 VA				--	--	--	--	52
53	HALL113 REC	20 A	1						900 VA							54
55																56
57																58
59																60
61																62
63																64
65																66
67																68
69																70
71																72
Total Load:					5743 VA		2800 VA		6636 VA							
NOTES:																
1: AFCI BREAKER																
2: GFCI BREAKER																
Load Classification		Connected Load		Demand Factor		Estimated...		Panel Totals								
Lighting		842 VA		125.00%		1053 VA		Total Conn. Load: 15175 VA								
Motor		2000 VA		112.50%		2250 VA		Total Est. Demand: 14441 VA								
Receptacles		12372 VA		90.41%		11186 VA		Total Conn. Current: 42 A								
								Total Est. Demand Current: 40 A								

Branch Panel: B					Construction: New					System: Normal Power					
LOCATION: MECH. 111					MOUNTING: Surface					A.I.C RATING					
SUPPLY FROM: MDP					ENCLOSURE: Type 1					MAINS TYPE: M.L.O					
VOLTAGE: 120/208 Wye-3-4					MCB RATING: 1 A					MAINS RATING: 200 A					
CKT	Description	Trip	Poles	Note	A		B		C		Note	Poles	Trip	Description	CKT
1	RTU-1	60 A	3		333 VA	0 VA						1	20 A	P20 PUMP	2
3	--	--	--				333 VA	0 VA				1	20 A	EX FAN	4
5	--	--	--						333 VA	0 VA		1	20 A	EX FAN	6
7	EX FAN	30 A	3		0 VA	0 VA						1	20 A	UNKNOWN	8
9	--	--	--				0 VA	0 VA				1	20 A	UNKNOWN	10
11	--	--	--						0 VA	0 VA		1	20 A	M9 EX FAN 1	12
13	M6 PUMP	20 A	3		0 VA	0 VA						1	20 A	M10 EX FAN 2	14
15	--	--	--				0 VA	0 VA				2	20 A	P23 AIR COMP	16
17	--	--	--						0 VA	0 VA		--	--	--	18
19	WASH/DRYER	30 A	2		0 VA	0 VA						1	20 A	BASE B HEAT	20
21	--	--	--				0 VA	0 VA				1	20 A	BASE B HEAT	22
23	FRIDGE	30 A	2	1					0 VA	0 VA	1	1	20 A	Z3 FRIDGE	24
25	--	--	--		0 VA	0 VA						1	20 A	UNKNOWN	26
27	FRONT DOOR	20 A	3				0 VA	0 VA				3	30 A	AIR COMP	28
29	--	--	--						0 VA	0 VA		--	--	--	30
31	--	--	--		0 VA	0 VA						--	--	--	32
33	REAR DOOR	20 A	3				0 VA	0 VA				2	20 A	FUEL PUMP	34
35	--	--	--						0 VA	0 VA		--	--	--	36
37	--	--	--		0 VA	0 VA						2	20 A	GAS PUMP	38
39	EX EXIT LTS	20 A	1				0 VA	0 VA				--	--	--	40
41	CAD	20 A	1						0 VA	0 VA		1	20 A	EX LIGHTS	42
43	EX LIGHTS	20 A	1		0 VA	0 VA						1	20 A	EX REC	44
45	EX EM LIGHTS	20 A	1				0 VA	0 VA				1	20 A	EX LIGHTS	46
47	FIRE ALARM	20 A	1						0 VA	0 VA		1	20 A	PHONE	48
49	FIRE ALARM	20 A	1		0 VA	333 VA						3	60 A	RTU-2	50
51	EX REC BOIL	20 A	1				0 VA	333 VA				--	--	--	52
53	EF-3	20 A	1						1000 VA	333 VA		--	--	--	54
Total Load:					667 VA		667 VA		1000 VA		333 VA				
NOTES:															
1: GFCI BREAKER															
Load Classification		Connected Load		Demand Factor		Estimated...		Panel Totals							
Power		3000 VA		100.00%		3000 VA									
								Total Conn. Load: 3000 VA							
								Total Est. Demand: 3000 VA							
								Total Conn. Current: 8 A							
								Total Est. Demand Current: 8 A							

Branch Panel: C					Construction: New					System: Normal Power					
LOCATION: DECON 126					MOUNTING: Surface					A.I.C RATING					
SUPPLY FROM: MDP					ENCLOSURE: Type 1					MAINS TYPE: M.L.O					
VOLTAGE: 120/208 Wye-3-4					MCB RATING: 1 A					MAINS RATING: 200 A					
CKT	Description	Trip	Poles	Note	A		B		C		Note	Poles	Trip	Description	CKT
1	DECON DRY	30 A	2		2496 VA	2200 VA						1	20 A	BAY RAD HTR	2
3	--	--	--				2496 VA	2200 VA				1	20 A	BAY RAD HTR	4
5	BAY FANS	20 A	1						1000 VA	410 VA		1	20 A	126/127 LTS	6
7	PORT CONN	30 A	1		0 VA	1000 VA						1	20 A	BAT CGR	8
9	BLOCK HTR	20 A	1				1000 VA	180 VA				1	20 A	FITNESS REC	10
11	FITNESS REC	20 A	1						180 VA	900 VA		1	20 A	FITNESS REC	12
13	TOG DC	60 A	3		0 VA	0 VA						3	60 A	TOG DC	14
15	--	--	--				0 VA	0 VA				--	--	--	16
17	--	--	--						0 VA	0 VA		--	--	--	18
19	GEAR DRYER	20 A	1		180 VA	540 VA						1	20 A	DECON REC	20
21	CO/NOX	20 A	1				180 VA	333 VA				3	20 A	EF-4	22
23	GUH-1	20 A	1						1000 VA	333 VA		--	--	--	24
25	EF-5	20 A	1		1000 VA	333 VA						--	--	--	26
27	FC-1	15 A	2				500 VA	500 VA				2	15 A	CD-1	28
29	--	--	--						500 VA	500 VA		--	--	--	30
31	FC-2	15 A	2		500 VA	500 VA						2	15 A	CD-2	32
33	--	--	--				500 VA	500 VA				--	--	--	34
35	WP/GF REC	20 A	1						360 VA			--	--	--	36
37															38
39															40
41															42
Total Load:					8749 VA		8389 VA		5183 VA						
NOTES:															
Load Classification		Connected Load		Demand Factor		Estimated...		Panel Totals							
Lighting		410 VA		125.00%		513 VA		Total Conn. Load: 22322 VA							
Motor		11000 VA		102.27%		11250 VA		Total Est. Demand: 22675 VA							
Other		0 VA		0.00%		0 VA		Total Conn. Current: 62 A							
Power		3400 VA		100.00%		3400 VA		Total Est. Demand Current: 63 A							
Receptacles		7512 VA		100.00%		7512 VA									

Switchboard: MDP									
Location: MECH. 111				Volts: 120/208 Wye			A.I.C. Rating:		
Supply From:				Phases: 3			Mains Type: M.L.O		
Mounting: Surface				Wires: 4			Mains Rating: 400 A		
Enclosure: Type 1							MCB Rating: 1 A		
Notes:									
CKT	Circuit Description	# of Poles	Frame Size	Trip Rating	Load	Wire Size	Feed	Cond. Size	
1	SPD	3	30 A	30 A	0 VA	--			
2	PANEL 'A'	3	200 A	200 A	15175 VA	4-#3/0, #6 GRD.			
3	PANEL 'B'	3	200 A	200 A	3000 VA	3-4-#3/0, #6 GRD.6			
4	PANEL 'C'	3	200 A	200 A	22322 VA	4-#3/0, #6 GRD.			
5	RTU-1	3	60 A	60 A	10000 VA	3-#6, #10 GRD.			
6	RTU-2	3	60 A	60 A	10000 VA	3-#6, #10 GRD.			
7	Spare	3	100 A	100 A	0 VA	--			
8									
9									
10									
			Total Conn. Load:		60496 VA				
			Total Amps:		168 A				
Legend:									
Load Classification		Connected Load	Demand Factor	Estimated...	Panel Totals				
Lighting		1239 VA	125.00%	1548 VA	Total Conn. Load: 60496 VA				
Motor		13000 VA	101.92%	13250 VA					
Other		0 VA	0.00%	0 VA	Total Est. Demand: 56107 VA				
Power		6400 VA	100.00%	6400 VA	Total Conn. Current: 168 A				
Receptacles		19884 VA	75.15%	14942 VA	Total Est. Demand... 156 A				
Spare		20000 VA	100.00%	20000 VA					
Notes:									

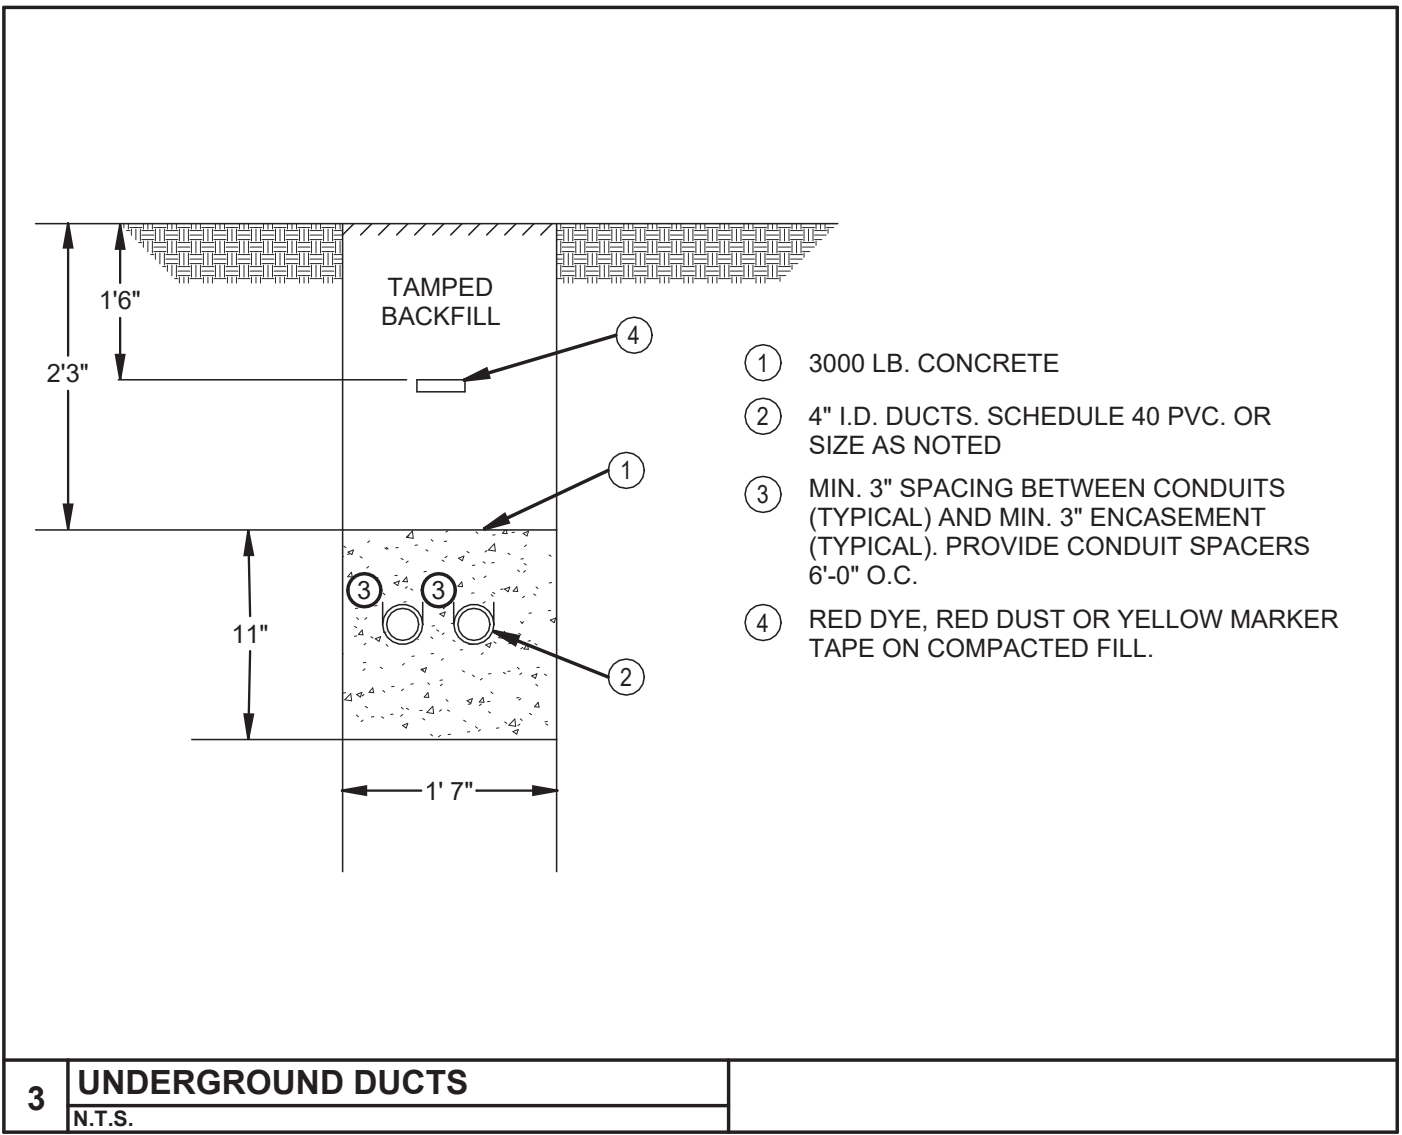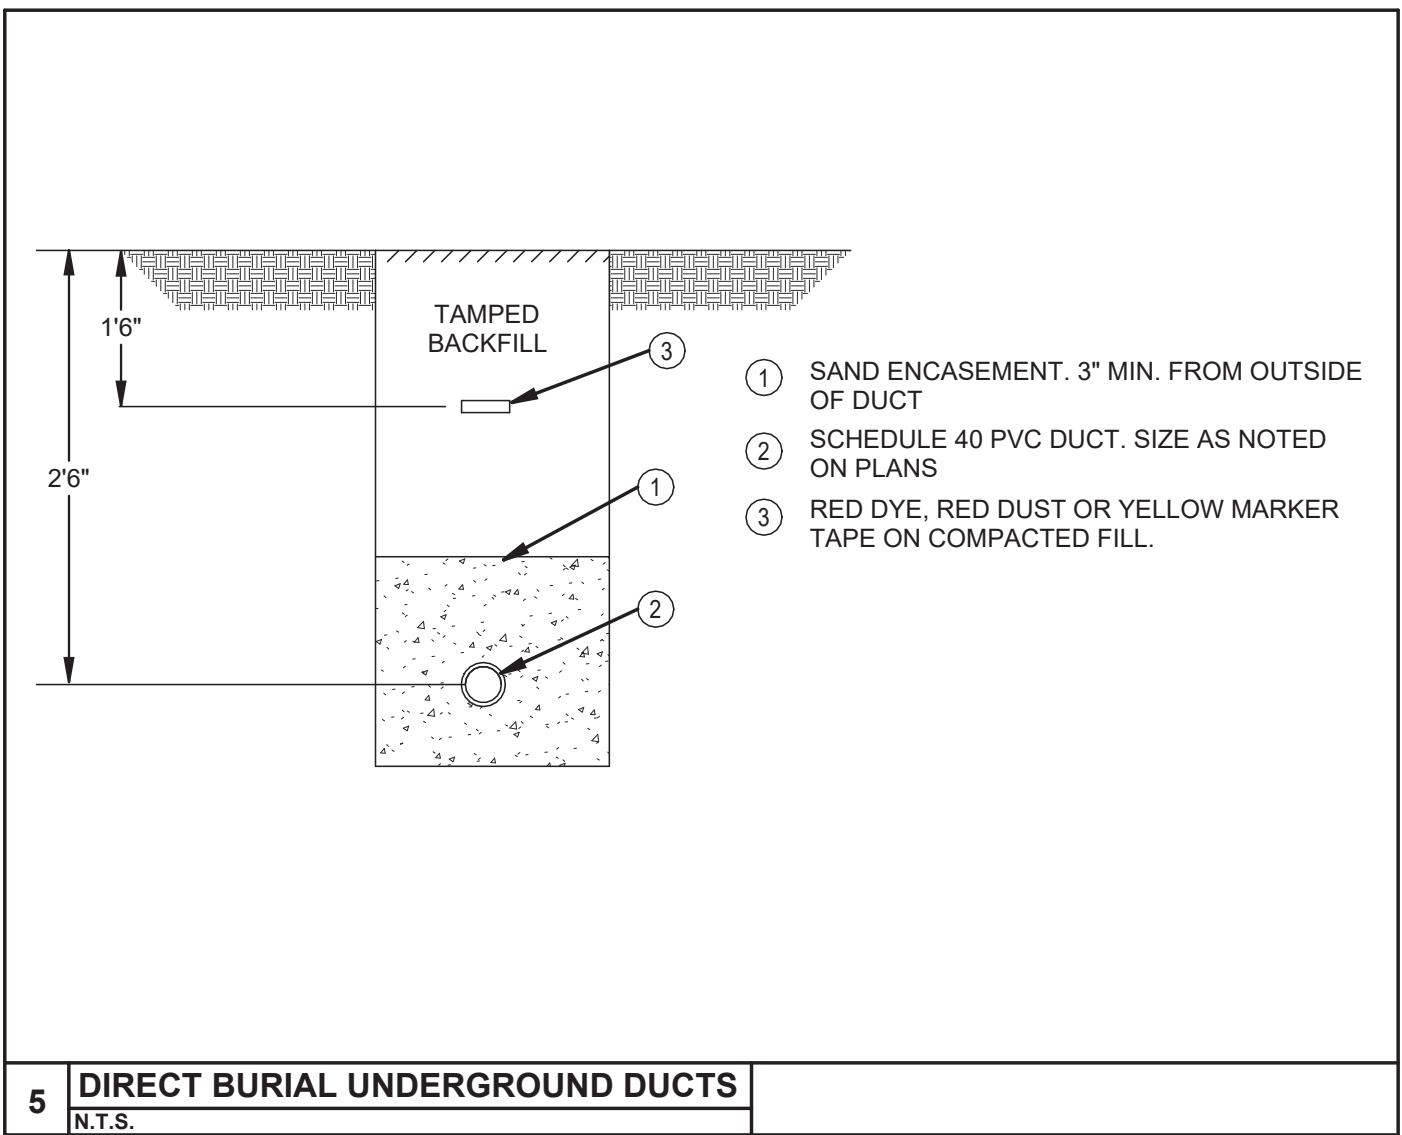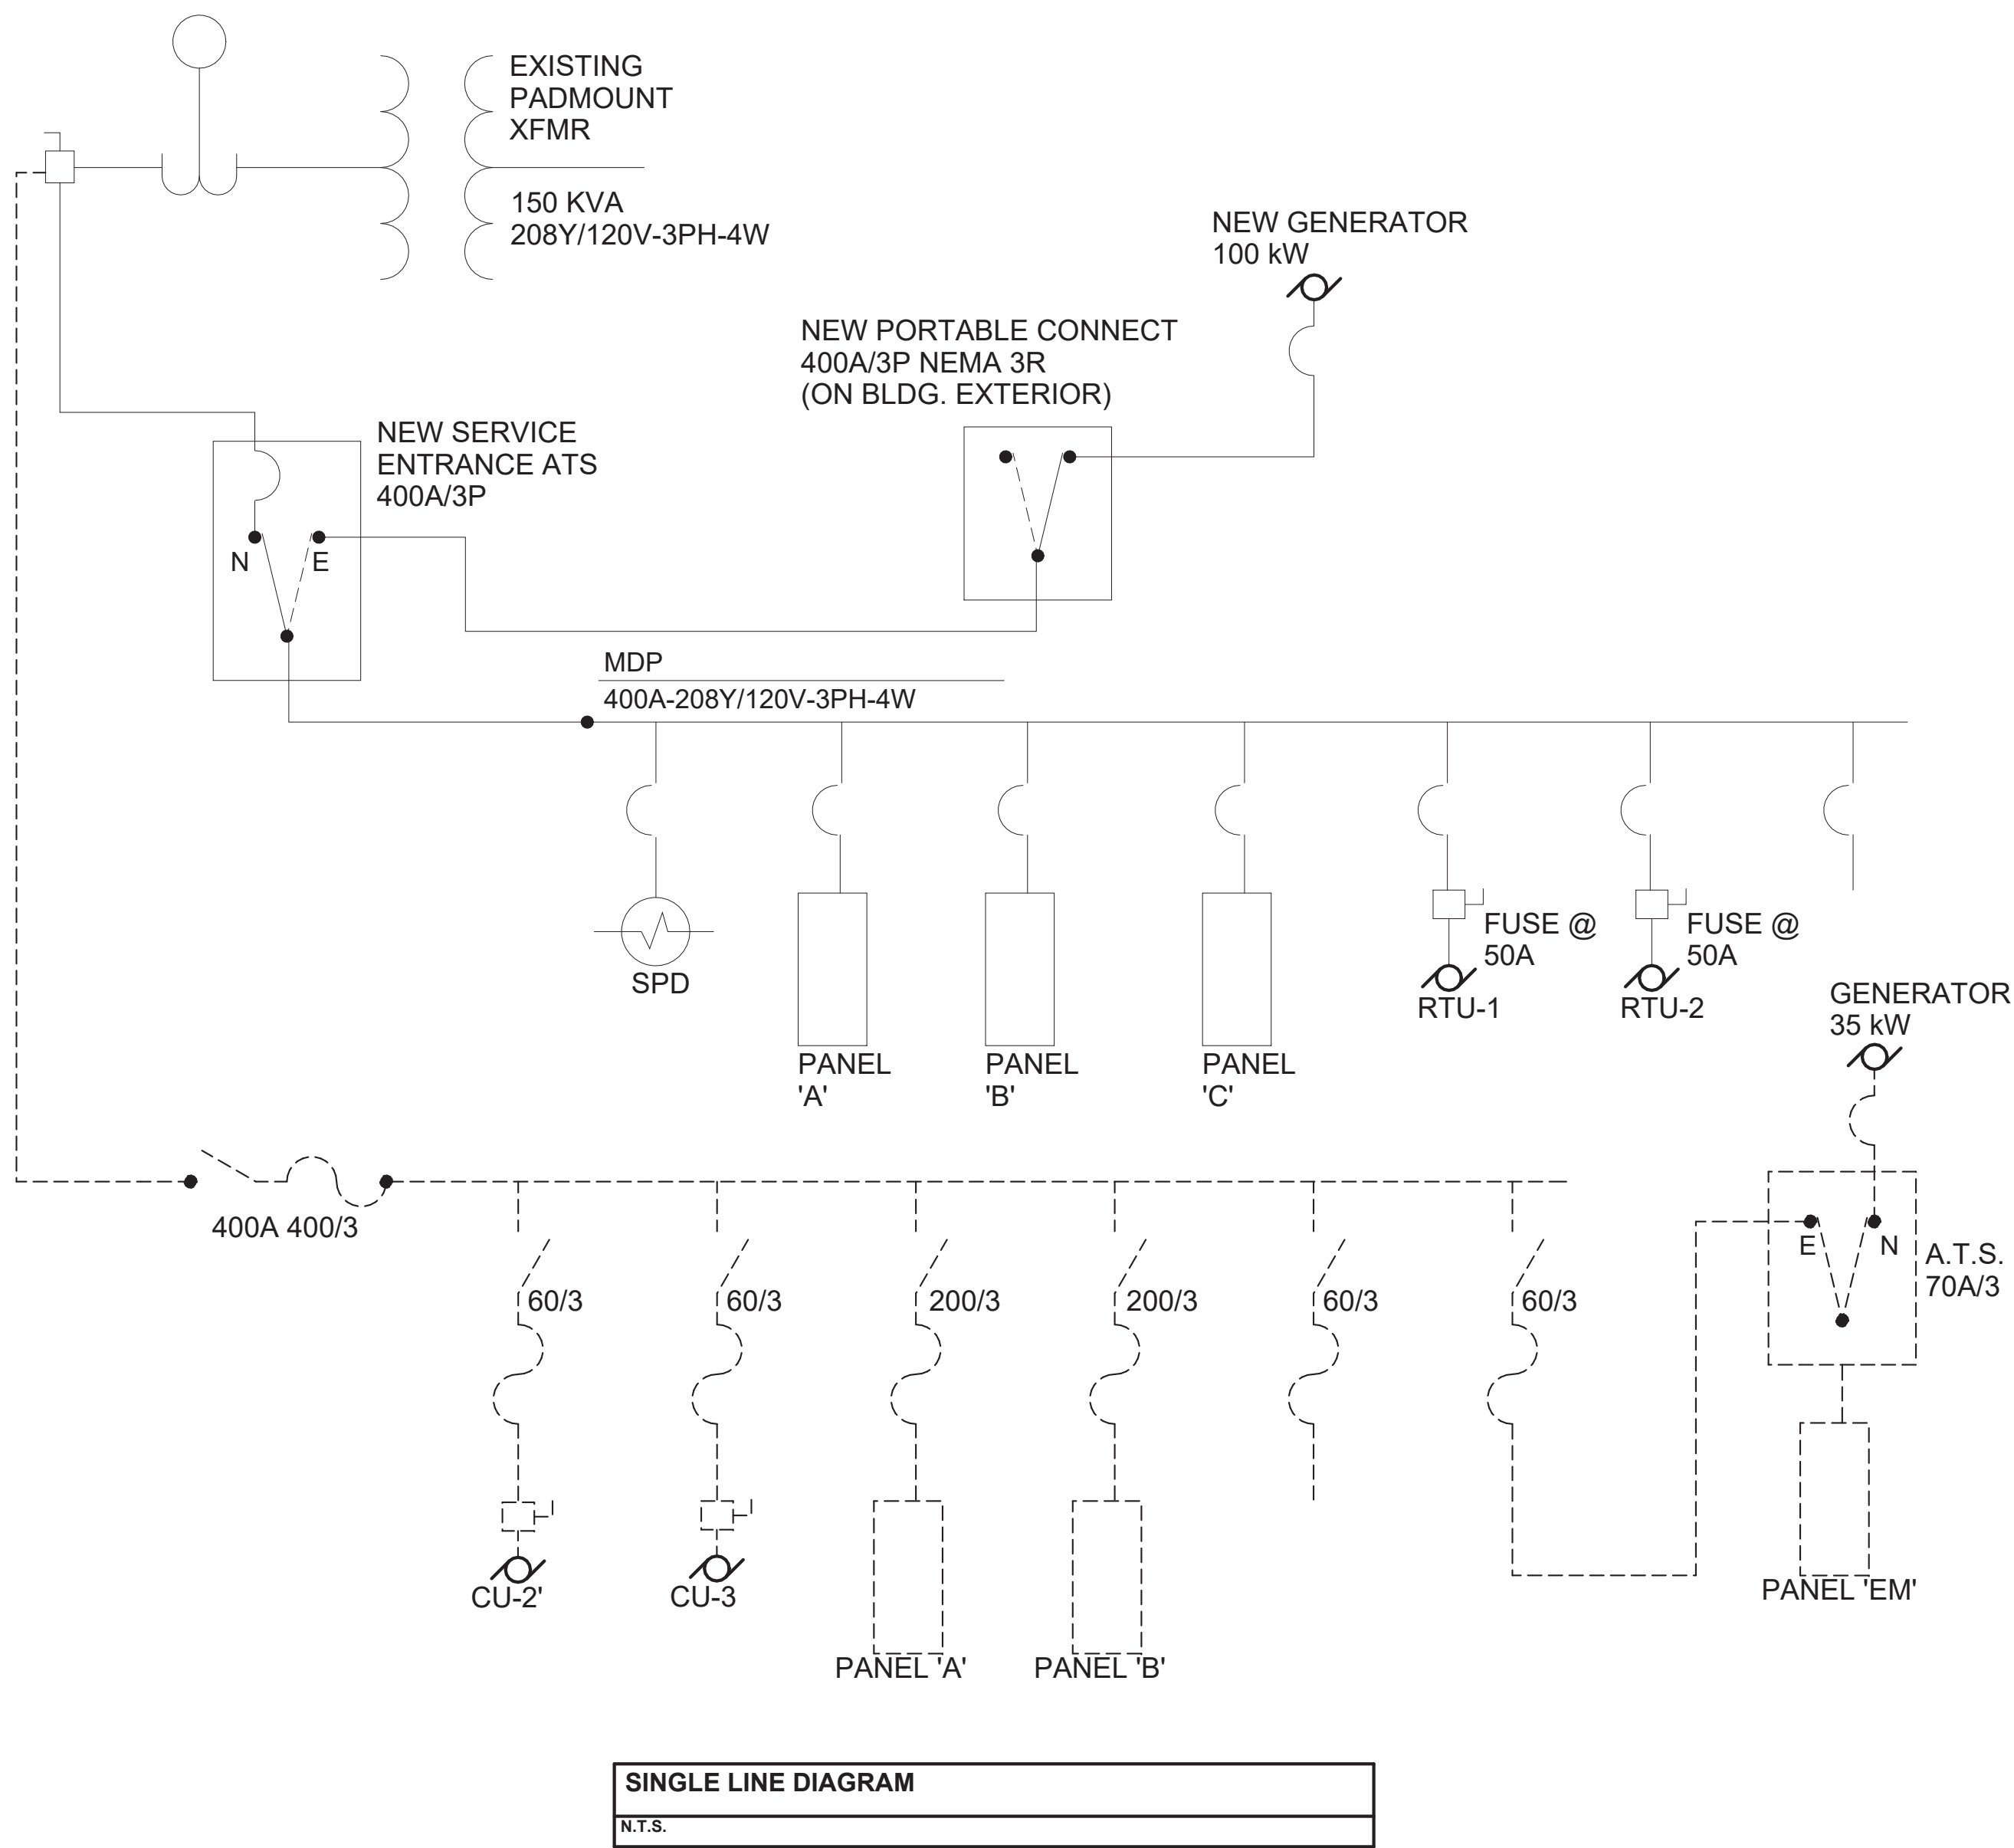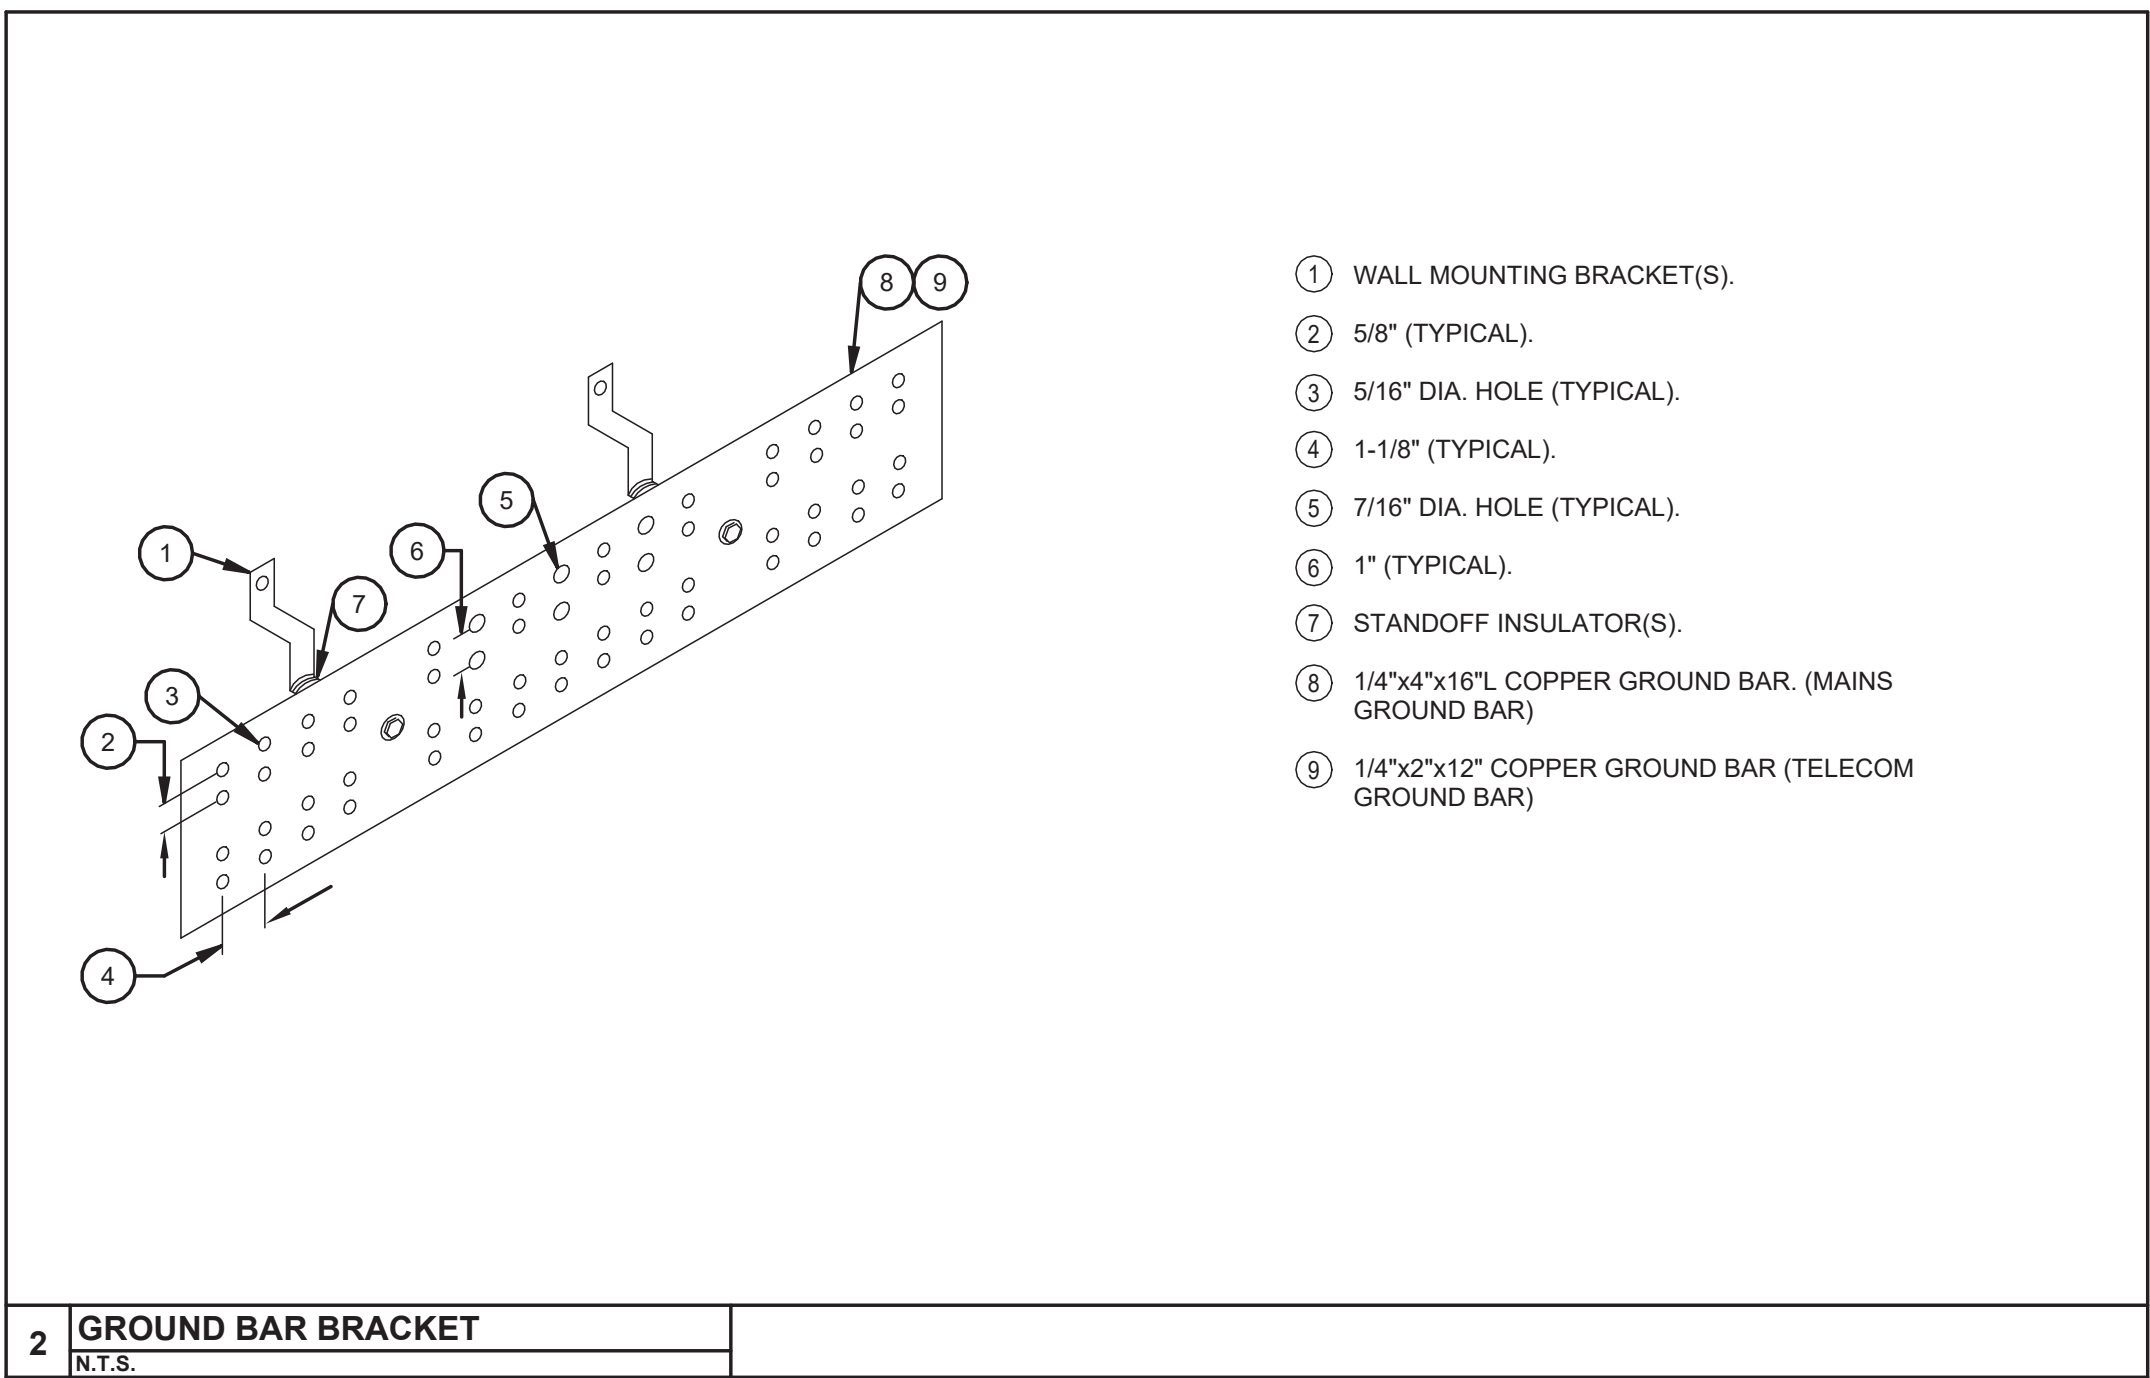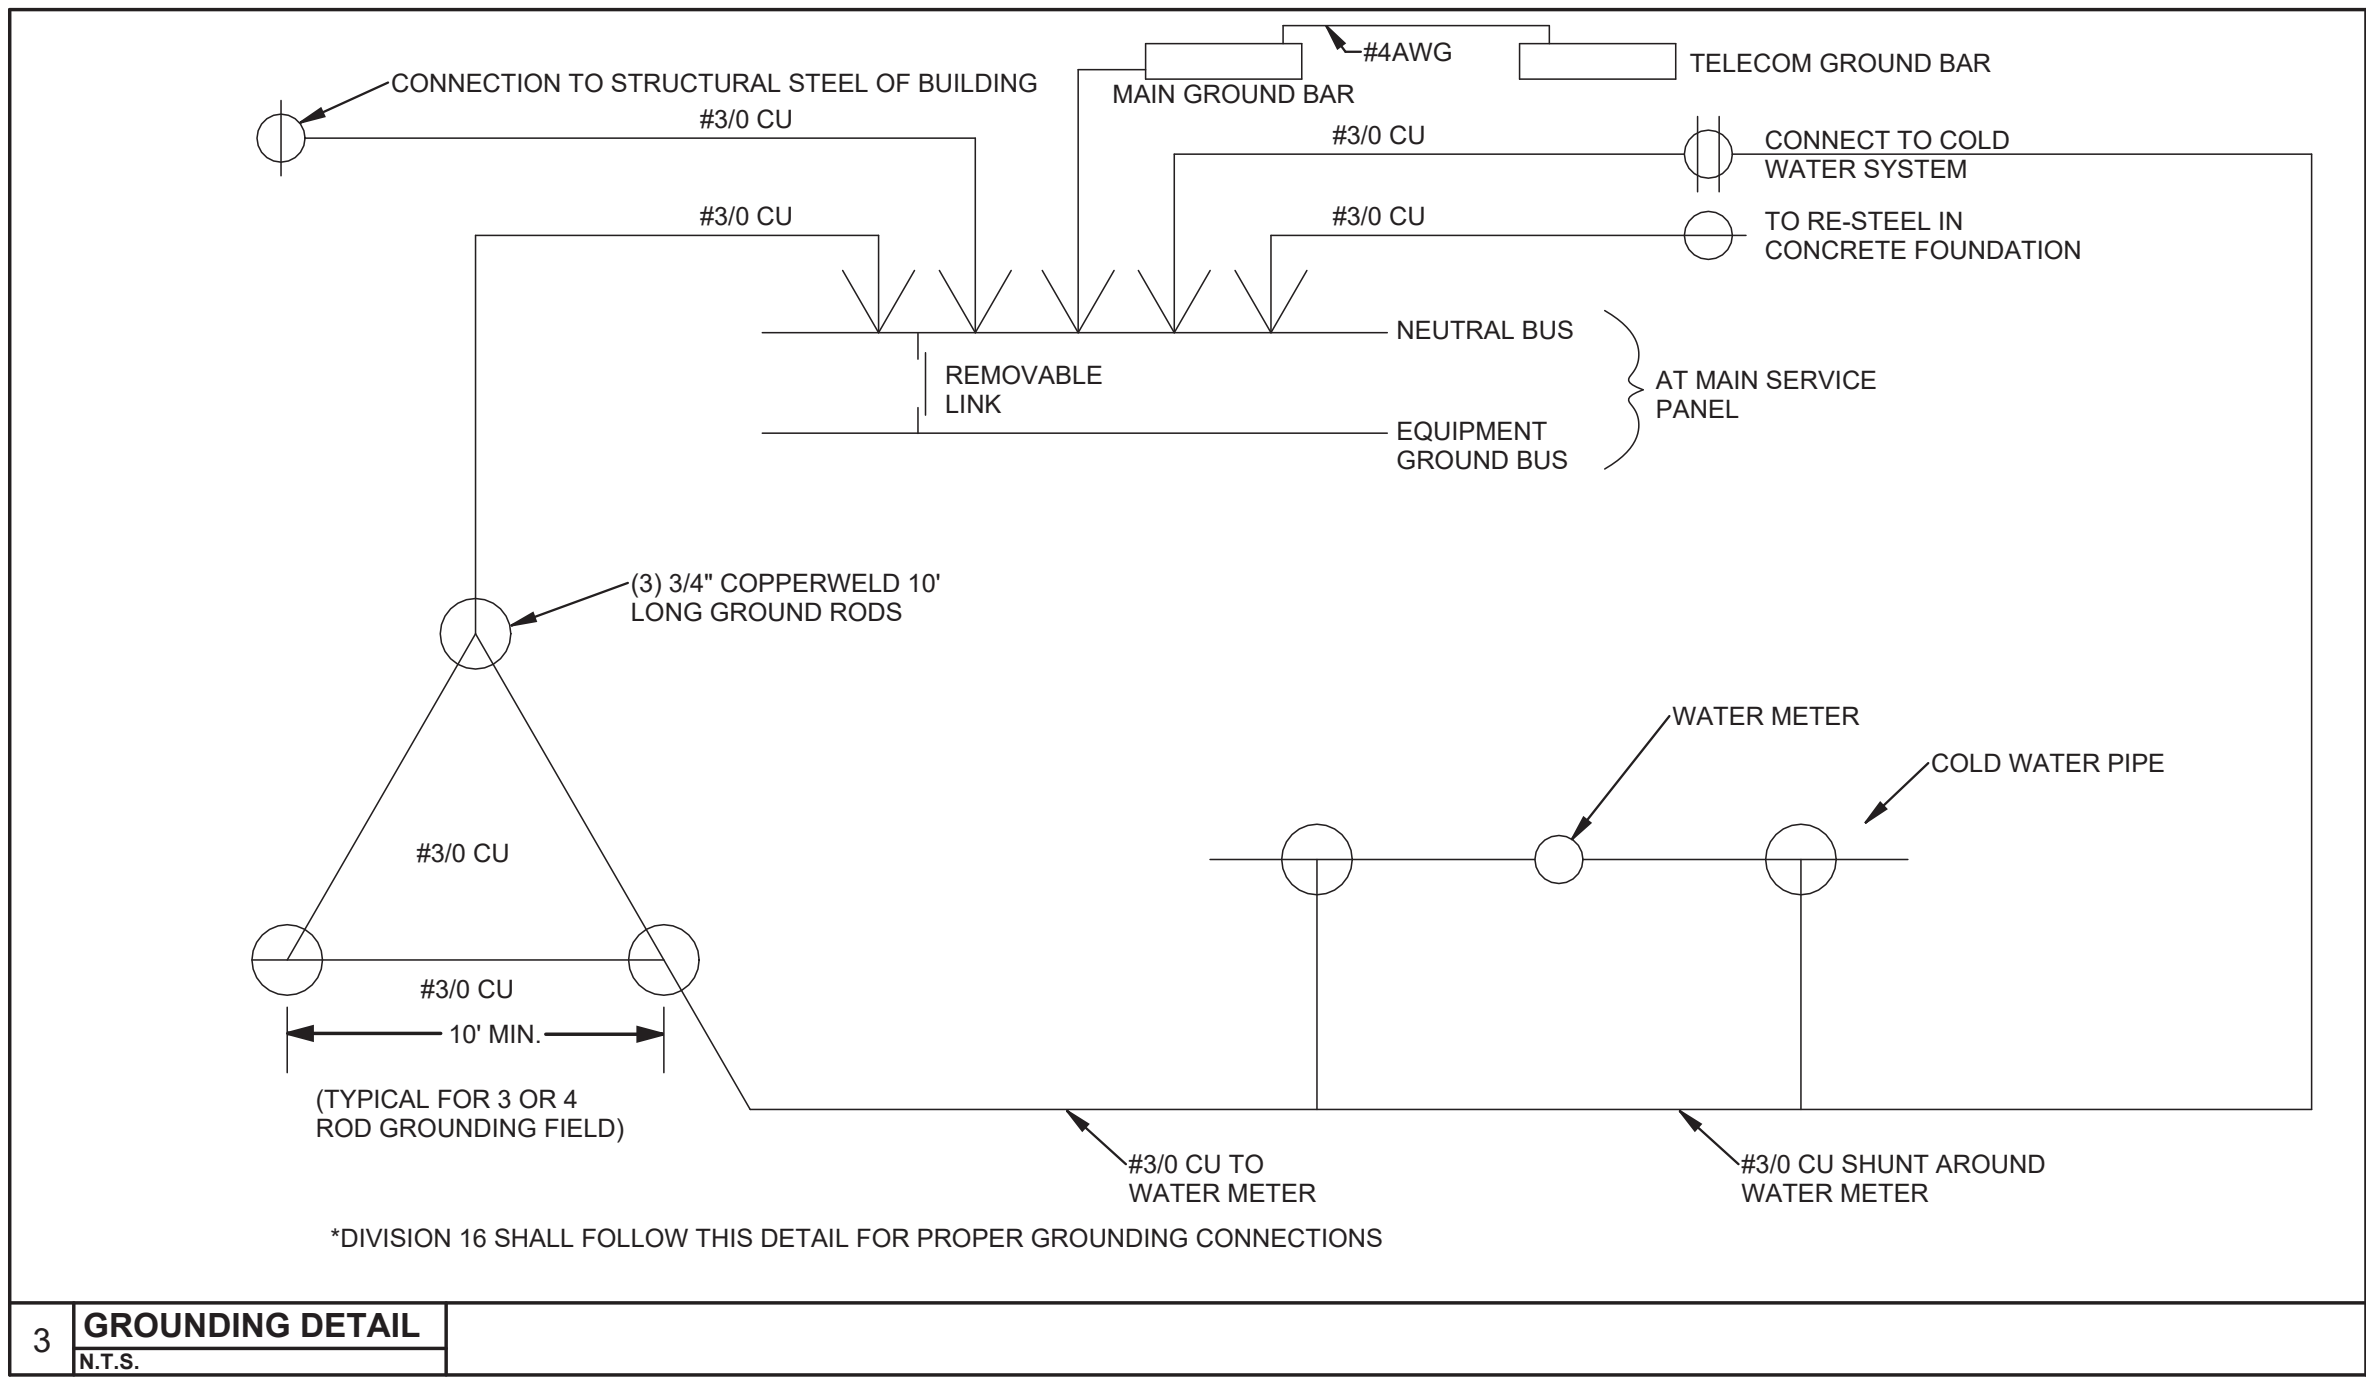

7/31/2025 11:06:59 AM

A

B

C

D

E

F

1

2


3

4

5


6

7

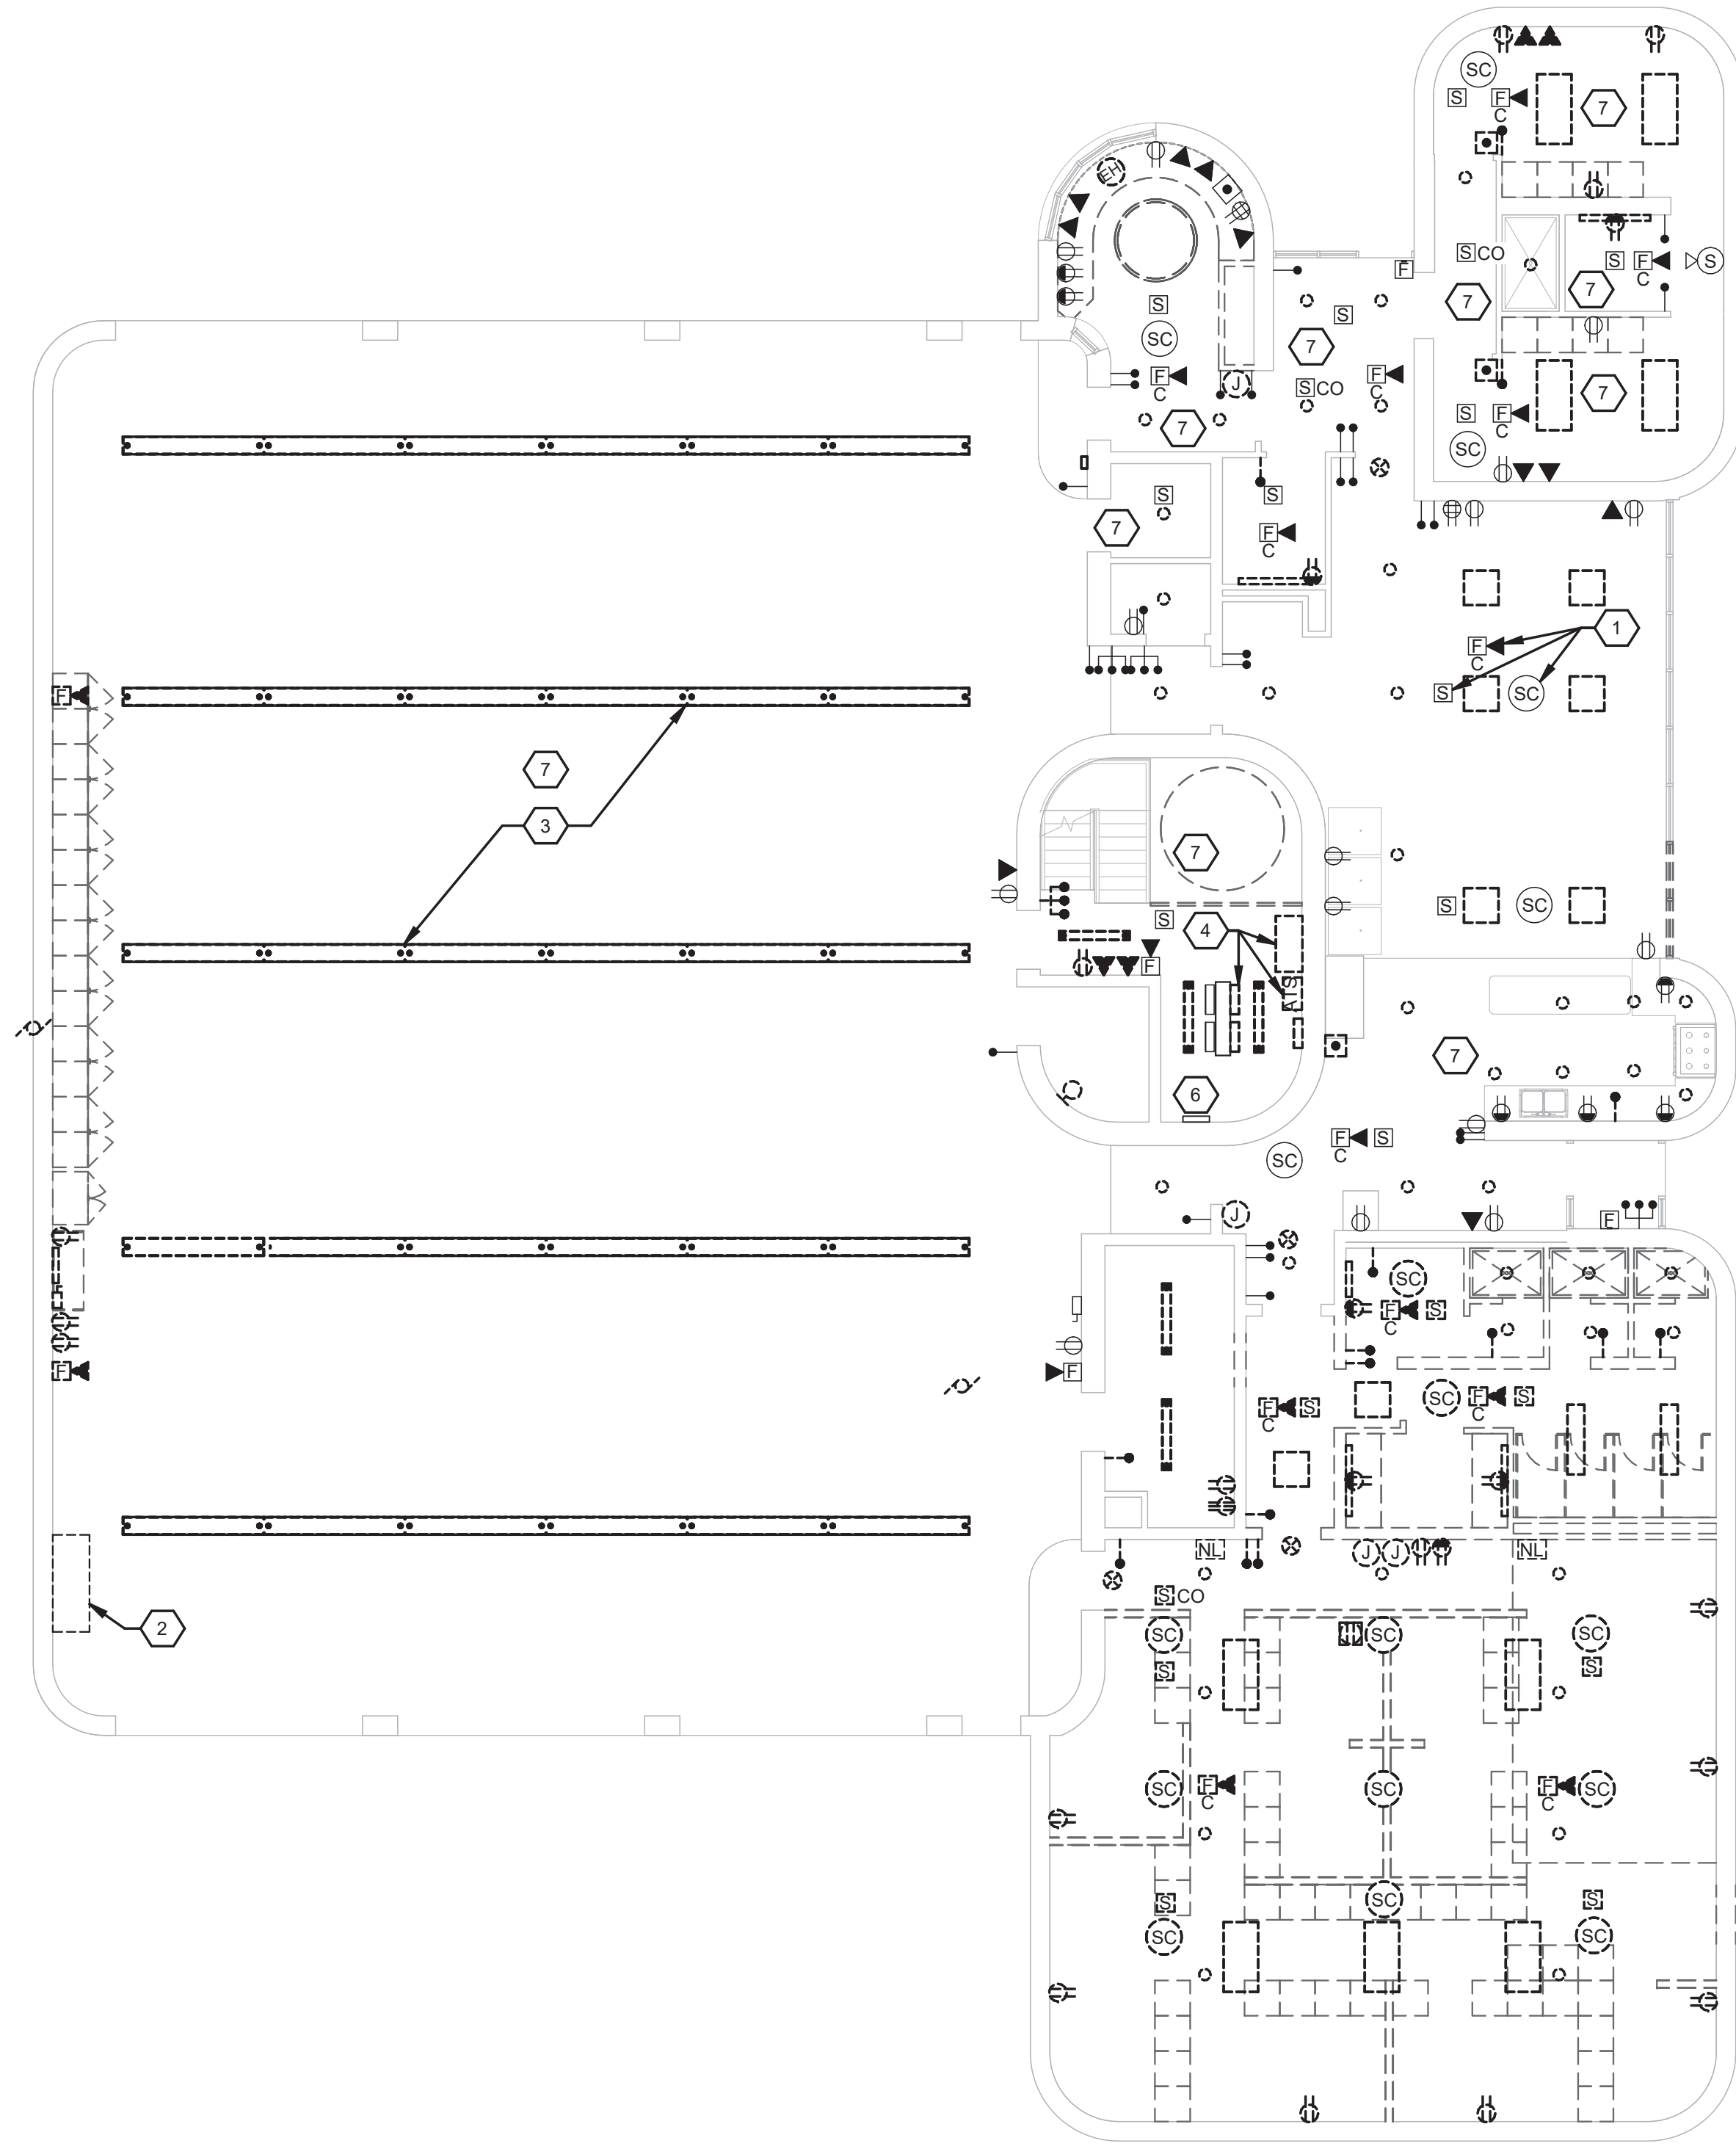


FIRST FLOOR DEMOLITION PLAN

SCALE: 1/8" = 1'-0"

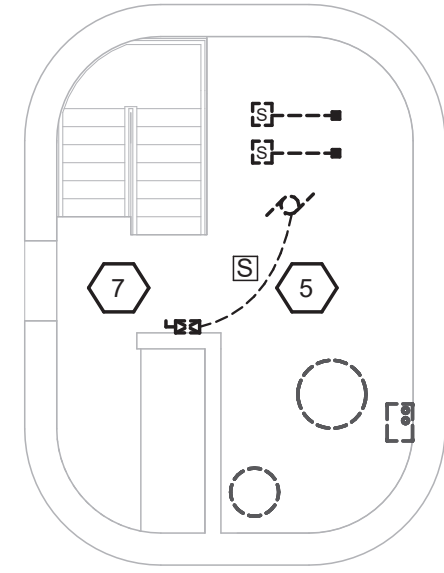


STAIR TOWER 3RD LEVEL

SCALE: 1/8" = 1'-0"

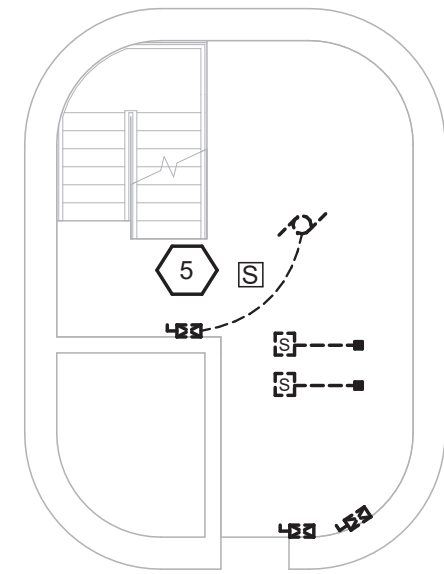

STAIR TOWER 2ND LEVEL

SCALE: 1/8" = 1'-0"

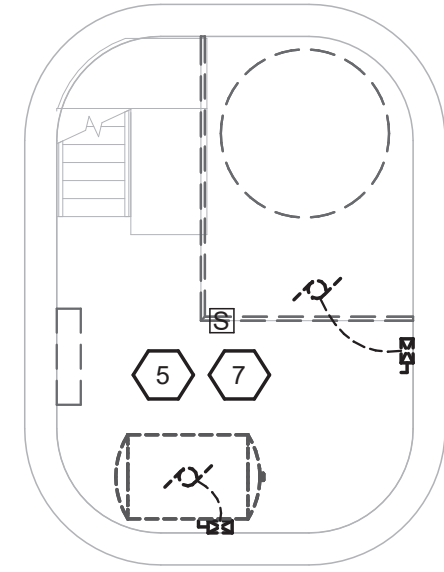

STAIR TOWER BASEMENT

SCALE: 1/8" = 1'-0"



DEMOLITION NOTES

1. EXISTING CEILING SYSTEMS DEVICES TEMPORARILY REMOVED, REPLACED IN NEW CEILING.
2. REMOVE EXISTING STANDBY GENERATOR AND ACCESSORY CIRCUITS, FEEDER, ETC.
3. REMOVE EXISTING BAY LIGHTS FOR REPLACEMENT WITH NEW. MAINTAIN CIRCUITRY, SWITCHING, ETC.
4. REMOVE EXISTING MAIN SERVICE PANEL, ATS AND PANELBOARDS FOR REPLACEMENT WITH NEW SERVICE ENTRANCE ATS AND DISTRIBUTION PANEL. MAINTAIN EXISTING BRANCH CIRCUITRY TO REMAIN.
5. DISCONNECT AND REMOVE ALL POWER TO HVAC AND PLUMBING SYSTEMS IN STAIR TOWER. REMOVE FIRE ALARM DUCT DETECTORS.
6. EXISTING FIRE ALARM PANEL/SYSTEM TO REMAIN.
7. EXISTING FIRE ALARM/FIRE CALL DEVICES TO REMAIN.



SCALE: 1/8"=1'-0"

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone (937) 233-3821

A

B

C

D

E


F



- # CONSTRUCTION NOTES
1. PROVIDE NEW LIGHTING IN APP BAY. CONNECT TO EXISTING CIRCUITRY/CONTROLS.
 2. OMIT LIGHTING IN THIS AREA OF APP BAY. COVER EXISTING JUNCTION BOXES.
 3. CONNECT UNDERCABINET LIGHTS AHEAD OF LOCAL ROOM LIGHTING CONTROL (UNDERCABINET LIGHTS CONTROLLED BY INTEGRAL SWITCH). COORDINATE ROUGH-IN LOCATION FOR UNDERCABINET LIGHTS WITH CASEWORK/HEADBOARD/ SHELVES.
 4. PROVIDE SEPARATE DIMMING CONTROL FOR DOWNLIGHT OVER WORK DESK.
 5. PROVIDE THREE-WAY SWITCHING FOR DORM CORRIDOR AND SEPARATE DIMMING CONTROL AS SHOWN.
 6. RETAIN EXISTING APP BAY LIGHTING CONTROLS.
 7. CONNECT NEW LIGHTS TO EXISTING CIRCUITRY, RETAIN EXISTING CONTROLS.
 8. CONNECT NEW LIGHTS TO EXISTING CIRCUITRY, PROVIDE NEW DIMMING CONTROL.
 9. PROVIDE LINEAR TAPE LIGHT AT TOP OF TV DISPLAY CASE WORK. PROVIDE DIMMER FLUSH MOUNTED IN SIDE OF CASE WORK. CONNECT TO ROOM LIGHTING CIRCUIT.

APP ARCHITECTURE
creative focused design

615 Woodside Drive, Englewood, Ohio 45322
T 937.836.8898 F 937.832.3696
www.app-arch.com

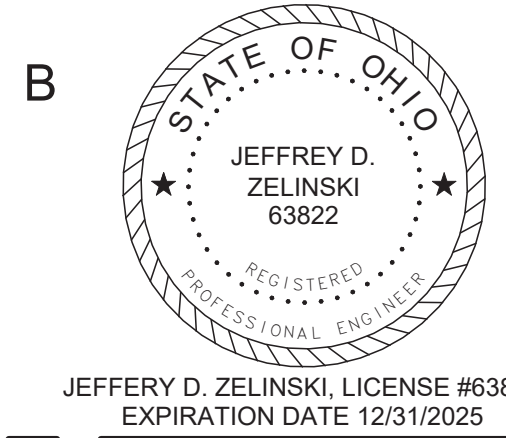

CITY OF DAYTON
DAYTON FIRE DEPARTMENT
STATION 15

ISSUE		
NO.	DATE	DESCRIPTION
	08/01/2025	FOR CONSTRUCTION


DATE	06/09/25
JOB NO.	4284.00
DRAWN	AP
CHECKED	TR

F COPYRIGHT © 2025 - App Architecture, Inc.

TITLE
NEW LIGHTING PLAN

SHEET NO.

E2.1

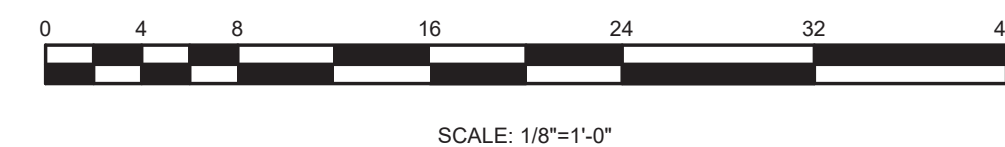

NAUMAN & ZELINSKI LLC.
204 S. Ludlow Street Suite 400 Dayton, Ohio 45402
Phone: (937) 223-3821

FIRST FLOOR NEW POWER AND SYSTEMS PLAN

SCALE: 1/8" = 1'-0"

STAIR TOWER 3RD LEVEL

SCALE: 1/8" = 1'-0"

STAIR TOWER/ROOF 2ND LEVEL

SCALE: 1/8" = 1'-0"

STAIR TOWER BASEMENT

SCALE: 1/8" = 1'-0"

CONSTRUCTION NOTES

1. PROVIDE 20A-120V CIRCUITS FOR GENERATOR BATTERY CHARGER AND BLOCK HEATER CIRCUITS.
2. PROVIDE 20A-120V CIRCUIT FOR PORTABLE CONNECT ACCESSORY CIRCUIT.
3. RECEPTACLE AT 72" M.H. FOR CONNECTION OF WALL MOUNTED OSCILLATING FAN. PROVIDE FAN EQUAL TO GLOBAL INDUSTRIAL #607050. 24" DIA, 7500 CFM, 120V CORD AND PLUG CONNECTED WITH 3 SPEED/OFF PULLCHAIN CONTROL.
4. PROVIDE 30A-3POLE FUSE DISCONNECT FOR TOG WASHER. PROVIDE FUSING PER MANUFACTURER RECOMMENDATION.
5. CONNECT NEW RECEPTACLE TO EXISTING DORM ROOM CIRCUIT.
6. PROVIDE 120V CONNECTIONS TO HOT WATER SYSTEMS. COORDINATE CONNECTION REQUIREMENTS AND CONTROL WITH P.C. PROVIDE STARTER FOR CONTROL BY H.C.
7. PROVIDE 120V CIRCUIT TO CO/NOX CONTROL PANEL.
8. DUCT DETECTOR LOCATED ABOVE CEILING OF DAYROOM. COORDINATE INSTALLATION WITH H.C.
9. EXISTING PAD MOUNTED TRANSFORMER.
10. PROVIDE GROUND FAULT BREAKER FOR KITCHEN REFRIGERATOR CIRCUITS.
11. MAINTAIN EXISTING KITCHEN RECEPTACLE/HOOD CIRCUITS, ETC.
12. SURFACE MOUNTED FAN CONTROLLER FOR CEILING FANS. ONE CONTROLLER FOR NORTH FANS, ONE FOR SOUTH.
13. CONNECT CEILING FAN TO ROOM LIGHTING CIRCUIT AHEAD OF CONTROLS.